

ANNUAL ENERGY AUDIT REPORT OF PASHCHIMANCHAL VIDYUT VITRAN NIGAM LIMITED

FOR F.Y. 2023-24



PREPARED BY

INGENIUS ENERGY CONSULTANCY PVT LTD

57/10, NEHRU NAGAR EAST, BHILAI -490020, C.G.

Phone: 9981900123, Email: ameetjain07@gmail.com

Table of Content

Acknowledgement	3
Audit Team	4
1. Executive Summary.....	5
1.1 Goals and Objective	5
1.2 About Energy Audit Firm.....	5
1.3 AT&C Losses for FY 2023-24.....	5
2. Background	8
2.1 Extant Regulation and Role of BEE.....	8
2.1.1 The Objectives of BEE.....	8
2.1.2. Role of BEE	8
2.1.2 Regulatory frame work for Energy Accounting & Audit	9
2.2 Purpose of Audit and Accounting Report	11
3. DISCOM Introduction and Over View	11
3.1 Name and Address of DISCOM	11
3.2 Name and Contact Details of Energy Manager (BEE Certified, IF any) and Authorized signatory of DISCOM (Nodal Officer).....	12
3.3 Summary Profile of DISCOM	12
3.3.1 Jurisdiction of DISCOM.....	12
3.3.2 Administrative Hierarchy	12
3.3.3 Consumer Details	45
3.4. Electrical Infrastructure and assets Voltage Wise	46
3.4.1. Metering Details.....	46
3.4.2. Distribution Transformer (DT) details	47
3.4.3. Feeder Details	47
3.4.4. Energy Flow Details	47
3.4.5. Pattern of Energy Distribution	48
3.4.7. Salient Features.....	55
3.5. Energy Conservation Measures	55
4. Energy Flow Analysis.....	56
4.1. Energy Flow Across 5 Service Levels	56
4.2. Validation of Metered Data	58
4.3. Validation of Energy Flow Data and Losses	58
5. Loss And Subsidy Computation.....	61
5.1. Energy Accounts Analysis for Previous Year	61
5.2. Energy Accounts Analysis and Performance in Current Year (Based on Quarterly Data)	63

5.2.1 Month Wise Input Energy and Billed Energy Details	63
5.2.2. Quarterly and Annual AT&C Loss	64
5.2.3. Circle Wise AT&C Losses Analysis	64
5.2.4. Feeder Wise T&D Losses Analysis	104
5.2.5. Feeder Wise AT&C Losses Analysis	104
5.3. Subsidy Computation and Analysis (Based on Quarterly Report)	134
6. Energy Audit Findings.....	140
6.1. Review of Capacity of DISCOM'S Energy Accounting and Audit Wing	140
6.2. Critical Analysis	140
6.2.1. Data Gaps	150
6.2.2. Summary of Key Responses of DISCOM Management on Comment by Energy Auditor	150
7. Conclusion and Action Plan.....	152
7.1 Summary of Key Findings & Critical Comments.....	152
7.2 Recommendations and Best Practices- Energy Accounting , Loss Reduction and Energy Conservation	153
7.3 Summary Energy Balance and Losses	155
7.4 Action Plan for Line Loss Reduction	155
7.5. Action plan for monitoring and reporting.....	156
7.6. Action plan for automated energy accounting.....	156
8. Annexures	160
8.1. Introduction of Verification Firm	160
8.2. Minutes of Meeting	161
8.3. Check List Prepared by Auditing Firm	163
8.4. Brief Approach, Scope & Methodology for Audit	164
8.5 Infrastructure Details	165
8.6. Electrical Distribution System	166
8.7. Voltage wise Input Energy	167
8.8. Voltage wise Sales Energy.....	169
8.9. Details of Consumer and Connection	170

Acknowledgement

The Energy Audit Team thankfully acknowledges the cooperation of the staffs of Pashchimanchal Vidyut Vitran Nigam Limited (PVVNL) in all the interaction during the audit, supplying the required inputs/data, involvement in the measurement and hospitality.

The Energy Audit Team likes to record appreciation for the following members with whom the team interacted during the audit and constantly was in touch during the preparation of the report.

1. Mr. Rahul Nanda (S.E. Commercial III)
2. Mr. Vivek Patel (Executive Engineer HV Cell)

And all the staff of the concerned offices for the proactive support and courtesy extended to the visiting energy audit team during the study.

The Audit Team

Audit Team

The following team was involved in the audit of PVVNL, from 24th June to 27th July 2024 for carrying out measurements, collection of data and field study.

Sl. No.	Name	Qualification	Experience	Contact Detail
1	Mr. Ameet Jain	Accredited Energy Auditor (AEA-0280) Director of M/s Ingenious Energy Consultancy (Team Leader)	17 yrs.	9981900123
2	Mr. Ashok Ghuha	Electrical Engineer Ex. Additional Chief Engineer (CSPDCL)	35 yrs.	
2	Mr. Sagar Verma	Mechanical Engineer	4 yrs.	
3	Mr. Kuldeep Dewangan	Electrical Engineer	2 yrs.	

About M/s Ingenious Energy Consultancy

Ingenius Energy Consultancy specializes in solving energy efficiency challenges in today's highly demanding environments. We help companies to improve their energy efficiency by reviewing and modernizing processes and introducing automation to systems and devices. We strive to satisfy customers in Energy Auditing and Consulting almost from all industry sectors across India. Based on our expertise and industry standards, we customize and scale our solutions for the needs of any company or community.

Ingenius Energy Consultancy was established in 2018 with a vision to serve the industry and deliver best solutions for Energy Conservation and Management of International Standards. We possess sufficient Infrastructure and a Team of Management and Technical professionals having vast diversified industrial experience of Consultancy & Training in Manufacturing and Service industry. Some of them are lead auditors from Bureau of Energy Efficiency (B.E.E.) Government of India.

1. Executive Summary

1.1 Goals and Objective

Pashchimanchal Vidyut Vitran Nigam Limited (PVVNL) is a designated consumer in Discom Sector. Being a designated Consumer PVVNL need to have Annual Energy Audit (Accounting) of their facilities as per BEE notification no. 18/1/BEE/Discom/2021 dated 6th October 2021.

The Annual Energy Audit (Accounting) at PVVNL is conducted with the following objectives:

- Verification of existing pattern of energy distribution across periphery of electricity distribution company.
- Verification of accounted energy flow submitted by electricity distribution company at all applicable voltage level of the distribution network.
- Verification of the accuracy of the data collected, analyses, and processes the data with respect to consistency, improvement in accounting and reducing loss of DISCOM.
- Verification of the information submitted by DC to the SDA/BEE about status of energy input, output and loss for the previous two year.
- Access the past performance of the establishment.
- Quantification of energy losses and energy saving potential.

1.2 About Energy Audit Firm

Ingenius Energy Consultancy specializes in solving energy efficiency challenges in today's highly demanding environments. We help companies to improve their energy efficiency by reviewing and modernizing processes and introducing automation to systems and devices. We strive to satisfy customers in Energy Auditing and Consulting almost from all industry sectors across India. Based on our expertise and industry standards, we customize and scale our solutions for the needs of any company or community.

Ingenius Energy Consultancy was established in 2018 with a vision to serve the industry and deliver best solutions for Energy Conservation and Management of International Standards. We possess sufficient Infrastructure and a Team of Management and Technical professionals having vast diversified industrial experience of Consultancy & Training in Manufacturing and Service industry. Some of them are lead auditors from Bureau of Energy Efficiency (B.E.E.) Government of India.

1.3 AT&C Losses for FY 2023-24

Distribution area of PVVNL is Divided into 29 Circle, 95 division and 255 Subdivision & the net input energy consumptions & AT&C Losses for the FY – 2023-24 is shown in table below the AT&C losses for FY 2023-24 is 12.08 % & the T&D losses of the sector is 12.72%.

Sl. No.	Energy Input Details	UoM	Value
1	Input Energy Purchase (From Generation Source)	MU	-----
2	Net Input Energy (at DISCOM Periphery after adjusting the transmission losses and energy traded)	MU	39107.84
3	Total Energy billed (is the Net Energy billed, adjusted for energy traded)	MU	34132.91
4	Transmission and distribution (T&D) loss details	MU	4974.93
		%	12.72 %
5	Collection Efficiency	%	100.73 %
6	Aggregate Technical & Commercial Loss	%	12.08 %

Table 1: Energy Balance & Losses for F.Y. 2022-23

Summary of Key Findings & Critical Comments

1. PVVNL informed that the procurement of power is done by UPPCL centrally. Information related to Input Energy Purchase (From Generation Source) is not available with PVVNL, and the same is left blank in the Form 1 data for all four quarters and the Annual Form. Only the Net Input Energy at DISCOM (Periphery after adjusting the transmission losses and energy traded), data is provided by PVVNL.
2. Due to non-availability of data of Energy Traded, it is not possible to verify the Net Input Energy data, as the verification cannot be done unless the traded energy data is provided. Also, during the audit, we discussed as to how the Net Input Energy is calculated without the data of Input Energy Purchase (From Generation Source), for which PVVNL has not provided any information.
3. During the Audit, it was observed and brought to the notice of PVVNL that there is discrepancy between the Collection Efficiency reported in the DISCOM's Balance Sheet and the Division-wise Collection Efficiency.
4. PVVNL informed that the discrepancies (as per the above point) arises due to the exclusion of certain subsidy amounts in the BEE Annual Energy Form. PVVNL explained that, accounting for these subsidies, the Collection Efficiency would be 100%. However, without considering these subsidies, the Collection Efficiency stands at 98.23%. Additionally, the Aggregate Technical and Commercial (AT&C) Loss, as per the Balance Sheet, is 14.27%, while as per the division wise losses the AT&C losses is 12.08%.
5. The reason for the discrepancies given by PVVNL was not justified in the opinion of the Ingenius Energy, as the exclusion of subsidies should have an opposite effect, i.e. the AT&C losses as per the Division wise losses should be greater than that as per the Balance Sheet but the same is just the opposite; PVVNL officials present concluded that the same shall be discussed with their commercial unit and resolved later.
6. During the audit it was reported by PVVNL that after quarter 2, there were significant changes and updates made to the software from where feeder data is collected. As a result, the data for Quarter 3 is more erroneous. However, the overall annual data is totality is correct, and for the same reason the T&D loss for Quarter 3 appeared as a negative value.
7. Most of the feeder with AT&C losses in the range of 60 to 80% and 80 to 100% are the rural area feeders.

8. The T&D loss for 1,819 feeders has shown a negative value. This was discussed with PVVNL during the audit and PVVNL informed that the discrepancy is due to the billing cycle, where some energy consumption for the current month is billed in the following month, leading to a negative T&D loss.
9. PVVNL did not provide any data or documentary evidence towards regarding their explanation for the negative AT&C losses, and the only reasoning provided was that collection efficiency is more than 100% for some of the divisions.
10. We have observed that the consumption for some 11 kV feeders is suddenly much higher than the feeder's input power. We discussed this issue with PVVNL, and they explained that the problem is due to incorrect tagging of some feeders. While they have cross-verified and corrected the values for some feeders, many others still show incorrect values and it can be concluded that PVVNL is not carrying out proper energy accounting and it should develop a proper protocol to verify and rectify the issues as soon as possible.
11. During Audit it was informed by PVVNL as -:
 - PVVNL has hired a third-party agency to analyse feeder data on a monthly basis.
 - The agency cross-checks the data discrepancies at the field level (Source of Data).
 - After cross-checking, any errors in reporting or data entry are corrected at PVVNL HQ, master sheet.
 - The agency provides a report of the erroneous data to PVVNL.
 - We have inquired with PVVNL about the steps taken in response to the report submitted by the third-party agency, however, no information has been provided regarding the corrective actions taken by PVVNL.

2. Background

2.1 Extant Regulation and Role of BEE

2.1.1 The Objectives of BEE

- To develop policies and Programmes on efficient use of energy and its conservation with the involvement of stakeholders.
- To plan, manage and implement energy conservation programmes as envisaged in the EC Act.
- To assume leadership and provide policy framework and direction to national energy efficiency and conservation efforts and programmes.
- To demonstrate energy efficiency delivery mechanisms, as envisaged in the EC Act, through Public-Private Partnership (PPP).
- To establish systems and procedures to measure, monitor and verify energy efficiency results in individual sectors as well as at the national level.
- To leverage multi-lateral, bi-lateral and private sector support in implementation of programmes and projects on efficient use of energy and its conservation.
- To promote awareness of energy savings and energy conservation.

2.1.2. Role of BEE

- BEE coordinates with designated agencies, designated consumers and other organization working in the field of energy conservation/efficiency to recognize and utilize the existing resources and infrastructure in performing the functions assigned to the Bureau under the Energy Conservation Act.
- The Act provides regulatory mandate for: standards & labelling of equipment and appliances; energy conservation building code for commercial buildings; and energy consumption norms for energy intensive industries.
- The EC Act was amended in 2010 to incorporate few additional provisions required to better equip BEE to manage ever-evolving sphere of energy efficiency in the country.
- Create awareness and disseminate information on energy efficiency and conservation.
- Arrange and organize training of personnel and specialists in the techniques for efficient use of energy and its conservation.
- Strengthen consultancy services in the field of Energy Efficiency.
- Promote research and development.
- Develop testing and certification procedures and promote testing facilities.
- Formulate and facilitate implementation of pilot projects and demonstration projects.
- Promote use of energy efficient processes, equipment, devices and systems.
- Take steps to encourage preferential treatment for use of energy efficient equipment or appliances.

- Promote innovative financing of energy efficiency projects.
- Give financial assistance to institutions for promoting efficient use of energy and its conservation.
- Prepare educational curriculum on efficient use of energy and its conservation.
- Implement international co-operation programmes relating to efficient use of energy and its conservation.

2.1.2 Regulatory frame work for Energy Accounting & Audit

The Energy Conservation Act 2001 (hereafter referred to as EC Act 2001) was enacted on 29th September 2001. The EC Act 2001 empowers BEE to notify regulations regarding energy conservation and efficiency improvement. In accordance with the EC Act 2001, BEE notified the Bureau of Energy Efficiency (Manner and Intervals for Conduct of Energy Audit) Regulations, 2021, on 6th October 2021. BEE subsequently amended these regulations with the Bureau of Energy Efficiency (Manner and Intervals for Conduct of Energy Audit) (Amendment) Regulations, 2022. The Ministry of Power (MoP) issued guidelines on 17th January 2023, for energy accounting and auditing of distribution companies, in line with the BEE regulations. Distribution companies and energy audit firms must comply with this regulatory framework when preparing energy accounts and audit reports. The regulatory framework for Energy accounting and Energy Auditing is shown in the below figure:

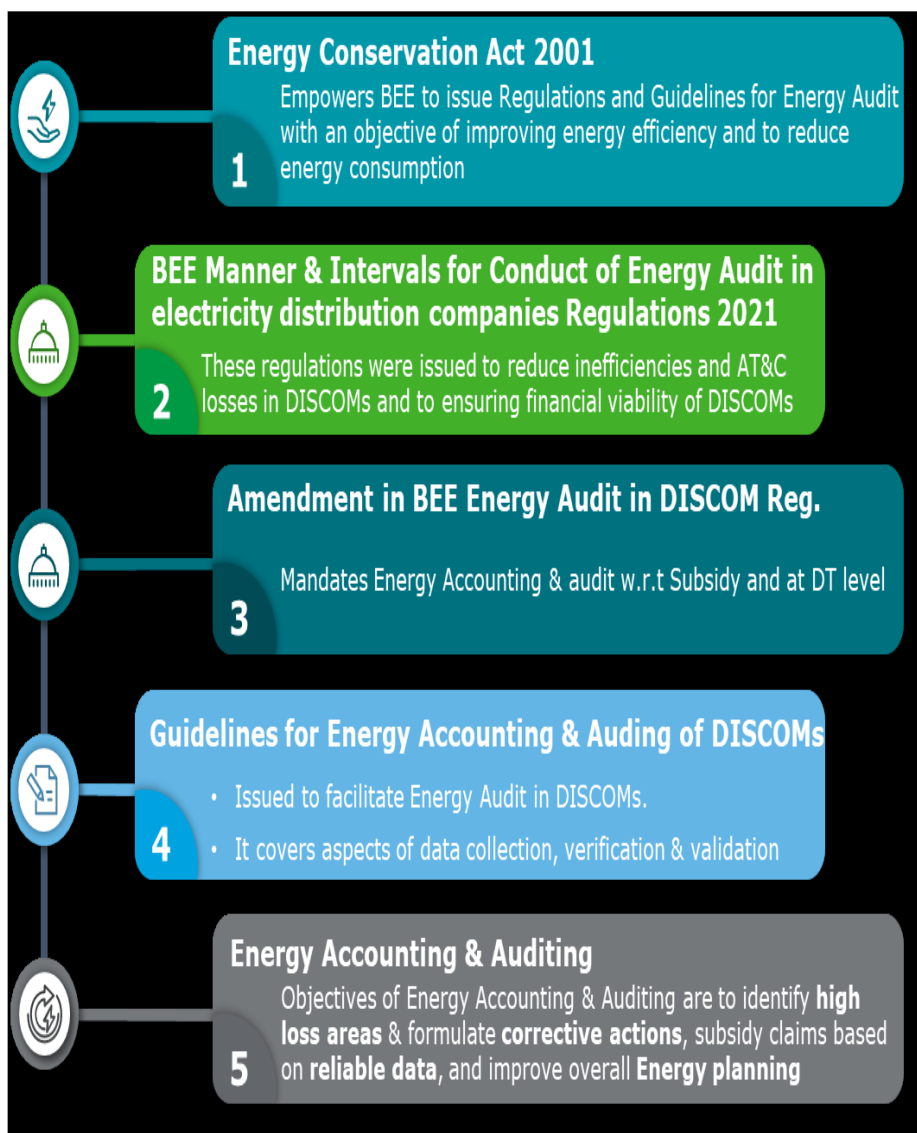


Figure 1: Regulatory framework for Energy Accounting & Audit

Key highlights of the Regulatory frame work are listed below:

- Bureau of Energy Efficiency (BEE) through Ministry of Power, Government of India issued regulations for Conduct of Mandatory Annual Energy Audit and Periodic Energy Accounting in DISCOMs. As per the regulation, all Electricity Distribution Companies are mandated to conduct annual energy audit and periodic energy accounting on quarterly basis.
- Owing to the impact of energy auditing on the entire distribution and retail supply business and absence of an existing framework with dedicated focus on the same, it was imperative to develop a set of comprehensive guidelines that all Distribution utilities across India can follow and adhere to.
- Accordingly, Regulations on Manner and Intervals for Conduct of Energy Audit and Accounting in Electricity Distribution Companies has been framed. Energy Accounting means accounting of all energy inflows at various voltage levels in the distribution periphery of the network, including renewable energy generation and open access consumers, and energy consumption by the end consumers. Energy accounting and a consequent annual energy audit would help to identify areas of high loss and pilferage, and thereafter focus efforts to take corrective action.
- These Regulations for Energy audit in Electricity Distribution Companies provides broad framework for conduct of Annual Energy Audit though and Quarterly Periodic Energy Accounting with necessary Pre-requisites and reporting requirements to be met.

2.2 Purpose of Audit and Accounting Report

Pashchimanchal Vidyut Vitran Nigam Limited (PVVNL) is a designated consumer in Discom Sector. Being a designated Consumer PVVNL need to have Annual Energy Audit (Accounting) of their facilities as per BEE notification no. 18/1/BEE/Discom/2021 dated 6th October 2021.

The energy intensity of India is higher with respect to GDP growth and there is an urgent need to address these issues on priority through integrated and comprehensive approach and by adopting latest techniques and technologies with active participation of all stakeholders.

Annual Energy audit (Accounting) will not only help in reducing losses in system, but it also helps DISCOM in sustainable growth. The objective of this energy audit is to reduce T&D loss and AT&C loss of the DISCOM through identification of commercially viable and implementable scheme for reduction of technical and commercial loss in the DISCOM thus leading to sustainable energy cost reductions.

The Annual Energy Audit (Accounting) at PVVNL is conducted with the following objectives:

- Verification of existing pattern of energy distribution across periphery of electricity distribution company.
- Verification of accounted energy flow submitted by electricity distribution company at all applicable voltage level of the distribution network.
- Verification of the accuracy of the data collected, analyses, and processes the data with respect to consistency, improvement in accounting and reducing loss of DISCOM.
- Verification of the information submitted by DC to the SDA/BEE about status of energy input, output and loss for the previous two year.
- Access the past performance of the establishment.
- Quantification of energy losses and energy saving potential.

3. DISCOM Introduction and Over View

3.1 Name and Address of DISCOM

Pashchimanchal Vidyut Vitran Nigam Limited is having its office at Urja Bhawan, Victoria Park, Meerut - 250001

Particular	Details
Name of DC	Pashchimanchal Vidyut Vitran Nigam Limited
Address	Urja Bhawan, Victoria Park, Meerut - 250001

Table 2: Name and Address of DISCOM

3.2 Name and Contact Details of Energy Manager (BEE Certified, IF any) and Authorized signatory of DISCOM (Nodal Officer)

Mr. Vivek Patel head the Energy Accounting/Audit wing and Mr. Anup Kumar Verma & Nodal is leading the energy accounting activated in PVVNL. The details of DISCOM's energy manager and authorized signatory for this report are shown below:

Particular	Details
Energy Manager	Mr. Rehan Shams
Authorized Signatory	Mr. Anup Kumar Verma Designation – Chief Executive (Commercial) Mob. No. - 9193330041

3.3 Summary Profile of DISCOM

3.3.1 Jurisdiction of DISCOM

About Electricity Department (PVVNL)

Pashchimanchal Vidyut Vitran Nigam Limited came into existence in July, 2003 as subsidiary company of UPPCL. The Discom covers in its jurisdiction the areas of District Meerut, Baghpat, Ghaziabad, Gautambudh Nagar, Bulandshahar, Hapur, Muzaffarnagar, Saharanpur, Shamli, Bijnor, Moradabad, Sambhal, J.P. Nagar and Rampur. The Discom comprises of 11 distribution zones based at Meerut, Ghaziabad, Bulandshahar, Noida, Saharanpur and Moradabad and each is headed by an officer of the rank of Chief Engineer. PVVNL is trying to implement the best practices in the distribution system. The tools used in achieving the commercial result include the massive disconnection drive against the defaulting consumers, the implementation of the OTS scheme, issuance of notices under section 3 and 5 to the defaulting consumers, bill distribution system through SMS & email, MRI based billing of the consumers with load above 10 KVA and replacement of electro mechanical meters through electronic & smart meters and adopting anti-theft measures i.e. vigorous combing in the high line losses areas, providing ABC conductors in Theft prone areas DT Metering, Double Metering of the consumers, Metering with AMR's.

3.3.2 Administrative Hierarchy

PVVNL is having its office at Urja Bhawan at Meerut and has 29 Circles. These Circles are further divided into 95 Divisions, 255 Sub-Divisions and Sections as shown in the below tables.

Parameters	Total
No. of Circles	29
No. of Division	95
No. of Sub- Division	255

ZONE	CIRCLE	DIVISION	SUB STATION
MEERUT-1	MEERUT	EUDD I MEERUT	LADIES PARK_10002
		EUDD I MEERUT	GHANTA GHAR TOWN HALL_10038
		EUDD I MEERUT	NEW MOHANPURI_10027
		EUDD I MEERUT	P.L SHARMA HOSPITAL_10030
		EUDD I MEERUT	RAILWAY ROAD_11484
		EUDD I MEERUT	T.P NAGAR_10037
		EUDD II MEERUT	BEGUM PUL_10008
		EUDD II MEERUT	CIVIL LINES_10009
		EUDD II MEERUT	JAGRITI VIHAR 1_10015
		EUDD II MEERUT	JAGRITI VIHAR 2_10490
		EUDD II MEERUT	JAGRITI VIHAR EXTENSION_10697
		EUDD II MEERUT	KHADOLI 2_10461
		EUDD II MEERUT	L BLOCK_10019
		EUDD II MEERUT	MANGAL PANDEY NAGAR_10024
		EUDD II MEERUT	MEDICAL 2_11353
		EUDD II MEERUT	MEDICAL COLLEGE_10402
		EUDD II MEERUT	RTO_10006
		EUDD II MEERUT	SADAR_10034
		EUDD II MEERUT	SAINT LUKES_10035
		EUDD II MEERUT	UNIVERSITY ROAD_10040
		EUDD III MEERUT	HAPUR ROAD_10014
		EUDD III MEERUT	LISARI GATE_10003
		EUDD III MEERUT	LISARI ROAD_10020
		EUDD III MEERUT	NAUCHANDI GROUND_10029
		EUDD III MEERUT	NEW SURAJ KUND_11354
		EUDD III MEERUT	RANGOLI SCHEME NO.7_10032
		EUDD III MEERUT	SHASTRI NAGAR_11399
		EUDD III MEERUT	SURAJ KUND HAPUR ROAD_10489
		EUDD III MEERUT	VIKASPURI_10042
		EUDD IV MEERUT	AMAN VIHAR_10043
		EUDD IV MEERUT	AMHERA_110714
		EUDD IV MEERUT	DEFENCE ENCLAVE_10010
		EUDD IV MEERUT	GANGA NAGAR 1_10012
		EUDD IV MEERUT	GANGA NAGAR 2_10013
		EUDD IV MEERUT	GANGA NAGAR 3_10472
		EUDD IV MEERUT	KANKER KHERA RURAL_10016
		EUDD IV MEERUT	KANKER KHERA TOWN_10017
		EUDD IV MEERUT	LALSANA_110714
		EUDD IV MEERUT	MES_10026
		EUDD IV MEERUT	NAGLA SHEKHU_110714
		EUDD IV MEERUT	POKET C SAINIK VIHAR_10265

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD IV MEERUT	SAINI_110714
		EUDD IV MEERUT	SOFIPUR_10033
		EUDD V MEERUT	HAPUR ROAD BYPASS_10432
		EUDD V MEERUT	MADHAVPURAM 2_11352
		EUDD V MEERUT	MADHAVPURAM_10022
		EUDD V MEERUT	MOHKAMPUR_10028
		EUDD V MEERUT	RAMLEELA GROUND 2_11398
		EUDD V MEERUT	RAMLEELA GROUND_10031
		EUDD V MEERUT	SHARDA ROAD_10266
MEERUT-2	EDC I MEERUT	EDD I MEERUT	DUNGRAWLI_110721
		EDD I MEERUT	GAGOL 2_10011
		EDD I MEERUT	GAGOL-1_15082
		EDD I MEERUT	JAHDIPUR_15036
		EDD I MEERUT	KAZIPUR_10018
		EDD I MEERUT	KHADOLI 2_11403
		EDD I MEERUT	LOHIYA NAGAR_10021
		EDD I MEERUT	MOHIUDDINPUR_10983
		EDD I MEERUT	NEW BAGHPAT ROAD (PANCHALI)_11185
		EDD I MEERUT	PANCHALI (BAGHPAT ROAD)_10400
		EDD I MEERUT	PANCHLI KHURD_11411
		EDD I MEERUT	PARTAPUR_15031
		EDD I MEERUT	POCKET C LOHIYA NAGAR_10401
		EDD I MEERUT	SHATABDI NAGAR SEC-II_15079
		EDD I MEERUT	SHATABDI NAGAR SECTOR-5_10385
		EDD I MEERUT	SHATABDI NAGAR_10036
		EDD I MEERUT	UDYOGPURAM 2_10986
		EDD I MEERUT	UDYOGPURAM_10039
		EDD III MEERUT	BHOLA_110724
		EDD III MEERUT	GEJHA_110724
		EDD III MEERUT	JANI KHURD_110724
		EDD III MEERUT	KAITHWARI_110724
		EDD III MEERUT	KARNAWAL_10995
		EDD III MEERUT	KHEWAI_110724
		EDD III MEERUT	LAKHWAYA_110724
		EDD III MEERUT	MALIYANA_10023
		EDD III MEERUT	PALLAV PURAM PHASE 1_10004
		EDD III MEERUT	PALLAV PURAM PHASE 2_10005
		EDD III MEERUT	PALLAV PURAM PHASE 3_11395
		EDD III MEERUT	PUTH_110724
		EDD III MEERUT	RAGHUNATHPUR_10992
		EDD III MEERUT	ROHTA_110724
		EDD III MEERUT	SIWAYA_110724

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD III MEERUT	UKLENA_110724
		EDD III MEERUT	VEDVYASPURI_10041
		EDD IV MEERUT	BHATIPURA_110725
		EDD IV MEERUT	BIJOLI_110725
		EDD IV MEERUT	GOKULPUR_110725
		EDD IV MEERUT	GOVINDPURE_110725
		EDD IV MEERUT	HASANPUR_110725
		EDD IV MEERUT	JITHOLI_110725
		EDD IV MEERUT	KHARKHODA_11001
		EDD IV MEERUT	KHARKHODA-II_110725
		EDD IV MEERUT	KITHOR TOWN_11004
		EDD IV MEERUT	LALIYANA_110725
		EDD IV MEERUT	MACHARA_110725
		EDD IV MEERUT	MEDICAL 3_11412
		EDD IV MEERUT	MEDICAL_110725
		EDD IV MEERUT	MUNDALI_110725
		EDD IV MEERUT	NAGLA PATU_110725
		EDD IV MEERUT	NAGLI KITHORE_110725
		EDD IV MEERUT	PIPLI KHERA_110725
		EDD IV MEERUT	RAISNA_110725
		EDD IV MEERUT	SAHKULIPUR_110725
		EDD IV MEERUT	SAYAL_110725
		EDD IV MEERUT	SHAHJAHANPUR_15084
		EDD IV MEERUT	SISOLI_110725
		EDD I MAWANA	BANA_110741
		EDD I MAWANA	BANA-II_110741
		EDD I MAWANA	DHIKOLI ROAD MAWANA_10145
		EDD I MAWANA	GADINA_110741
		EDD I MAWANA	GUDAM_110741
		EDD I MAWANA	HASTINAPUR ROAD MAWANA_10379
		EDD I MAWANA	INCHOLI_110741
		EDD I MAWANA	MAWANA TOWN_10146
		EDD I MAWANA	MAWANA_110741
		EDD I MAWANA	NAGLI AZMABAD_110741
		EDD I MAWANA	NILOHA_110741
		EDD I MAWANA	PHALAWDA_11028
		EDD I MAWANA	RAHWATI_110741
		EDD I MAWANA	SATHALA_110741
		EDD I MAWANA	TOFAPUR_110741
		EDD II MEERUT	BATZEVRA_110742
		EDD II MEERUT	BHAMORI_110742
		EDD II MEERUT	CHHUR_110742

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD II MEERUT	DAURALA_11016
		EDD II MEERUT	GOTKA_110742
		EDD II MEERUT	HARRA_110742
		EDD II MEERUT	JAMALPUR_110742
		EDD II MEERUT	KAPSAD_110742
		EDD II MEERUT	LAWAR_11013
		EDD II MEERUT	MAHADEV_110742
		EDD II MEERUT	MAHALKA_110742
		EDD II MEERUT	NAGLI AZAD_110742
		EDD II MEERUT	NANU_110742
		EDD II MEERUT	SAKOTI_110742
		EDD II MEERUT	SALAWA_110742
		EDD II MEERUT	SARDHANA TOWN_110742
		EDD II MEERUT	SARDHANA_10144
		EDD II MEERUT	SARDHANA_110742
		EDD II MEERUT	SAROORPUR_110742
		EDD II MEERUT	TEHSIL ROAD SARDHANA_10384
		EDD II MAWANA	AGWANPRUR_110743
		EDD II MAWANA	BEHSUMA_11041
		EDD II MAWANA	HASTINAPUR_11040
		EDD II MAWANA	KHAJOORI_110743
		EDD II MAWANA	KHURDAYALPUR_110743
		EDD II MAWANA	KUNHEDA_110743
		EDD II MAWANA	MAWANA THESHIL RURAL_110743
		EDD II MAWANA	MOREKHURD_110743
		EDD II MAWANA	NARANGPUR_110743
		EDD II MAWANA	PAKSHITGARH_110743
		EDD II MAWANA	PAKSHITGARH-2_11346
		EDD II MAWANA	SEENA_110743
		EDD I BARAUT	ADARSH NAGLA_110831
		EDD I BARAUT	ADLABAD_110831
		EDD I BARAUT	ASARA_110831
		EDD I BARAUT	BAOLI_110831
		EDD I BARAUT	BARAUT_10189
		EDD I BARAUT	BARWALA_110831
		EDD I BARAUT	BASOLI_110831
		EDD I BARAUT	CHAPRAULI TOWN_10747
		EDD I BARAUT	CHAPRAULI_110831
		EDD I BARAUT	IBRAHIMPUR MAZRA_110831
		EDD I BARAUT	JONMANA_110831
		EDD I BARAUT	KAKDIPUR_110831
		EDD I BARAUT	KAKOR_110831

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I BARAUT	KIRTHAL_110831
		EDD I BARAUT	KISHANPUR BARAL_110831
		EDD I BARAUT	KOTANA ROAD_10188
		EDD I BARAUT	KURDI_110831
		EDD I BARAUT	LOIN MALAKPUR_110831
		EDD I BARAUT	LOMB_110831
		EDD I BARAUT	LUHARI_110831
		EDD I BARAUT	MUKANDPUR_110831
		EDD I BARAUT	SABKA_110831
		EDD I BARAUT	SILANA_110831
		EDD I BARAUT	TEHSIL BARAUT_10381
		EDD I BARAUT	TUGANA_110831
		EDD II BARAUT	BAMNOLI_110832
		EDD II BARAUT	BARAUT_10187
		EDD II BARAUT	BARAWAD_110832
		EDD II BARAUT	BIJROL_110832
		EDD II BARAUT	BINOLI_110832
		EDD II BARAUT	CHAJHARPUR_110832
		EDD II BARAUT	DAHA_110832
		EDD II BARAUT	DAUGHAT_10778
		EDD II BARAUT	DHANORA SILVAR NAGAR_110832
		EDD II BARAUT	GAINDBARA-33_110832
		EDD II BARAUT	GANGNAULI_110832
		EDD II BARAUT	GURANA_110832
		EDD II BARAUT	HILWARI_110832
		EDD II BARAUT	JIWANA GULIYAAN_110832
		EDD II BARAUT	JOHDI_110832
		EDD II BARAUT	KAMALA_110832
		EDD II BARAUT	KANDERA_110832
		EDD II BARAUT	KANHAR_110832
		EDD II BARAUT	MAVIKALA_110832
		EDD II BARAUT	MOOLSAM_110832
		EDD II BARAUT	NIRPURA_110832
		EDD II BARAUT	RANCHAD_110832
		EDD II BARAUT	SANT NAGAR_110832
		EDD II BARAUT	TEEKRI_10777
		EDD II BARAUT	TITRODA_110832
		EDD I BAGHPAT	AMINAGAR SARAI_10733
		EDD I BAGHPAT	BAGHPAT R/L_110833
		EDD I BAGHPAT	BAGHPAT TOWN_10515
		EDD I BAGHPAT	BALI_110833
		EDD I BAGHPAT	BIHARIPUR_110833

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I BAGHPAT	BUDHERA_110833
		EDD I BAGHPAT	DOLA_110833
		EDD I BAGHPAT	DOLCHA_110833
		EDD I BAGHPAT	FATHEPUR_110833
		EDD I BAGHPAT	GATHINA_110833
		EDD I BAGHPAT	HISAWDA_110833
		EDD I BAGHPAT	MEETLI_110833
		EDD I BAGHPAT	MUKARI_110833
		EDD I BAGHPAT	PILANA_110833
		EDD I BAGHPAT	PURA MAHADEV_110833
		EDD I BAGHPAT	RIVER PARK_10375
		EDD I BAGHPAT	SIKOHUPUR_110833
		EDD I BAGHPAT	SINGHAULI_110833
		EDD I BAGHPAT	SOROORPUR_110833
		EDD I BAGHPAT	TATIRI_10739
		EDD I BAGHPAT	UPSIDC BAGHPAT_10715
		EDD II BAGHPAT	BADAGAWON_110834
		EDD II BAGHPAT	CHAMRAWAL_110834
		EDD II BAGHPAT	DHIKAULI_110834
		EDD II BAGHPAT	FIROZEPUR_110834
		EDD II BAGHPAT	KATHA_110834
		EDD II BAGHPAT	KHATTAPHLADPUR_110834
		EDD II BAGHPAT	KHEKADA TOWN_10206
		EDD II BAGHPAT	KHEKRA - R_110834
		EDD II BAGHPAT	ROTEL_110834
		EDD II BAGHPAT	SANKROD RD KHEKRA_110834
		EDD II BAGHPAT	SUNEHRA_110834
MORADABAD	EDC BIJNOR	EDD I BIJNOR	AVAS VIKAS_10227
		EDD I BIJNOR	BUKHARA NO 9 (BIJNOR 1)_10228
		EDD I BIJNOR	CHOUKPURI_120351
		EDD I BIJNOR	GANJ_120351
		EDD I BIJNOR	JHALU_10965
		EDD I BIJNOR	KHAMBHOR_120351
		EDD I BIJNOR	NAGAL JAT_120351
		EDD I BIJNOR	PILLI CHAWKI_120351
		EDD I BIJNOR	RAMPUR BAKLI_120351
		EDD I BIJNOR	SIKANDRI_120351
		EDD I CHANDPUR	BAGARPUR_120352
		EDD I CHANDPUR	BASTA_120352
		EDD I CHANDPUR	BHAGODA_120352
		EDD I CHANDPUR	CHANDPUR-1_10223
		EDD I CHANDPUR	CHANDPUR-2_10392

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I CHANDPUR	JALILPUR_120352
		EDD I CHANDPUR	KAKRALA_120352
		EDD I CHANDPUR	MASEET_120352
		EDD I CHANDPUR	MUSTAFABAD_120352
		EDD I CHANDPUR	PIPALSANA_120352
		EDD I CHANDPUR	SIAU_120352
		EDD II BIJNOR	BHOJPUR_120355
		EDD II BIJNOR	CHHITAWAR_120355
		EDD II BIJNOR	FAZALPUR_120355
		EDD II BIJNOR	GAJROLA SHIV_120355
		EDD II BIJNOR	KIRATPUR 2_10097
		EDD II BIJNOR	KIRTAPUR_120355
		EDD II BIJNOR	MANDAWAR_10972
		EDD II BIJNOR	PADLA_120355
		EDD II BIJNOR	SHADIPUR_120355
		EDD II BIJNOR	SWAHERI_120355
		EDD II BIJNOR	UMARPUR MEERA_120355
		EDD II CHANDPUR	ALLAUDINPUR_120356
		EDD II CHANDPUR	FAIZPUR_120356
		EDD II CHANDPUR	HALDAUR_11283
		EDD II CHANDPUR	KADAPUR_120356
		EDD II CHANDPUR	LADHUPURA_120356
		EDD II CHANDPUR	MADARIPUR KAKRALA_120356
		EDD II CHANDPUR	NOORPUR_10134
		EDD II CHANDPUR	PAJANIA_120356
		EDD II CHANDPUR	PHEENA_120356
		EDD II CHANDPUR	REHTA BILLOCH_120356
		EDD II CHANDPUR	SISONA_120356
		EDD II CHANDPUR	ULEDHA_120356
		EDD II CHANDPUR	UMRI_120356
	EDC DHAMPUR	EDD I DHAMPUR	BAGHAD ANSAAR_120361
		EDD I DHAMPUR	DHAMPUR_10243
		EDD I DHAMPUR	KADIPURA_120361
		EDD I DHAMPUR	NEHTAUR_10131
		EDD I DHAMPUR	S/S BASAWANPUR_120361
		EDD I DHAMPUR	S/S DHAKKA_120361
		EDD I DHAMPUR	S/S DHAMPUR TEHSIL_120361
		EDD I DHAMPUR	S/S KHANDSAL_120361
		EDD I DHAMPUR	S/S KLAYANPUR_120361
		EDD I DHAMPUR	S/S NINDRU_120361
		EDD I DHAMPUR	SHERKOT_10205
		EDD II DHAMPUR	AFZALGARH_11057

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD II DHAMPUR	BHIKKAWALA_120362
		EDD II DHAMPUR	DPH KALAGARH_120362
		EDD II DHAMPUR	HAFIZABAD_120362
		EDD II DHAMPUR	HERAVALI_120362
		EDD II DHAMPUR	MANIYAWALA_120362
		EDD II DHAMPUR	PAGEMBEARPUR_120362
		EDD II DHAMPUR	PALANPUR_120362
		EDD II DHAMPUR	SAHASPUR_11060
		EDD II DHAMPUR	SARKARA CHAKRAJMAL_120362
		EDD II DHAMPUR	SEOHARA_10276
		EDD II DHAMPUR	TAJPUR_120362
		EDD II DHAMPUR	THATJAT_120362
		EDD II DHAMPUR	UMARPUR KHADAR_120362
		EDD II DHAMPUR	VEERBHANWALA_120362
		EDD NAJIBABAD	AADARSHNAGAR NAJIBABAD_10225
		EDD NAJIBABAD	AKBARPUR CHAUGAWA_10465
		EDD NAJIBABAD	BARIA - 33_120363
		EDD NAJIBABAD	BHAGUWALA_120363
		EDD NAJIBABAD	CHANDAK_120363
		EDD NAJIBABAD	ISHLAMPUR SADAT_120363
		EDD NAJIBABAD	KHAIKHEDI_120363
		EDD NAJIBABAD	NAJIBABAD_120363
		EDD NAJIBABAD	RAJPUR NAWADA_120363
		EDD NAJIBABAD	SAHANPUR_10226
		EDD NAJIBABAD	SOFATPUR_120363
		EDD NAJIBABAD	TIMARPUR_120363
		EDD NAJIBABAD	TISOTRA_120363
		EDD NAGINA	AKBARABAD_120364
		EDD NAGINA	BADAPUR_11074
		EDD NAGINA	JOGIRAMPURA_120364
		EDD NAGINA	KOTWALI_120364
		EDD NAGINA	LALWALA_120364
		EDD NAGINA	NAGINA(R/L)_120364
		EDD NAGINA	PHULSANDA_120364
		EDD NAGINA	RAIPUR_120364
		EDD NAGINA	TAHSEEL NAGINA_10380
	EDC MORADABAD	EDD I MORADABAD	AHMAD NAGAR JAITWARA_120411
		EDD I MORADABAD	BERNI_120411
		EDD I MORADABAD	BHAISOR_120411
		EDD I MORADABAD	BILARI_10124
		EDD I MORADABAD	BILARI_120411
		EDD I MORADABAD	CHODHARPUR_120411

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I MORADABAD	CHOUDHERPUR INDUSTRIAL_120411
		EDD I MORADABAD	DARNI_120411
		EDD I MORADABAD	DEEN BANDHU PURAM_10173
		EDD I MORADABAD	GROWTH CENTER_120411
		EDD I MORADABAD	GUARAU_120411
		EDD I MORADABAD	HAJRAT NAGAR GARHI_120411
		EDD I MORADABAD	JALALPUR_120411
		EDD I MORADABAD	JARGOAN_120411
		EDD I MORADABAD	KUNDERKI_11141
		EDD I MORADABAD	LAKRI FAXALPUR_120411
		EDD I MORADABAD	MAINATHER_120411
		EDD I MORADABAD	MAJHOLA_120411
		EDD I MORADABAD	MDA 1_120411
		EDD I MORADABAD	MDA 2_120411
		EDD I MORADABAD	MUBARAKPUR_120411
		EDD I MORADABAD	NANPUR_120411
		EDD I MORADABAD	PAKBARA_120411
		EDD I MORADABAD	RATANPUR_120411
		EDD I MORADABAD	SAFEELPUR_120411
		EDD I MORADABAD	SAHASPUR_120411
		EDD I MORADABAD	SEONDARA_120411
		EDD I MORADABAD	SIYALI MALA_120411
		EDD I MORADABAD	TAHARPUR_120411
		EDD II MORADABAD	AGWANPUR II_120412
		EDD II MORADABAD	AGWANPUR_120412
		EDD II MORADABAD	BHAGATPUR_120412
		EDD II MORADABAD	BHEEKANPUR_120412
		EDD II MORADABAD	BHEETKHERA_120412
		EDD II MORADABAD	CHHAJJA NAGLA_120412
		EDD II MORADABAD	DALPATPUR_120412
		EDD II MORADABAD	FATHEPUR VISHNOI_120412
		EDD II MORADABAD	KANTH_11171
		EDD II MORADABAD	RASOOLPUR_11177
		EDD II MORADABAD	SALEMPUR GARI_120412
		EDD II MORADABAD	SARKHADA KHAS_120412
		EDD III MORADABAD	BUDHANPUR_120415
		EDD III MORADABAD	DILARI_120415
		EDD III MORADABAD	JAHANGIRPUR_120415
		EDD III MORADABAD	PAINDAPUR_120415
		EDD III MORADABAD	PIPALSANA_11176
		EDD III MORADABAD	SARKHADA PARAM_120415
		EDD III MORADABAD	SULTANPURDOST_120415

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD III MORADABAD	SURJAN NAGAR_120415
		EDD III MORADABAD	THAKURDWARA RURAL_120415
		EDD III MORADABAD	THAKURDWARA_10129
	EUDC MORADABAD	EUDD I MORADABAD	AVAS VIKAS - II_15066
		EUDD I MORADABAD	AVAS VIKAS_10389
		EUDD I MORADABAD	COMPANY BAGH_10171
		EUDD I MORADABAD	DELHI ROAD_10183
		EUDD I MORADABAD	DHAKKA_11422
		EUDD I MORADABAD	KASHIRAM_10172
		EUDD I MORADABAD	LOCO SHED_10185
		EUDD I MORADABAD	MAJHOLA_15014
		EUDD I MORADABAD	MANDI SAMITI_10176
		EUDD I MORADABAD	NAGAR 1_15013
		EUDD I MORADABAD	SHAHIDABAD_10487
		EUDD I MORADABAD	TAXI STAND_10175
		EUDD I MORADABAD	TRANSPORT NAGAR_10178
		EUDD II MORADABAD	DAULAT BAGH I_10169
		EUDD II MORADABAD	DAULAT BAGH II_15069
		EUDD II MORADABAD	JIGAR COLONY_10170
		EUDD II MORADABAD	PTC_10167
		EUDD II MORADABAD	RAMGANGA VIHAR 2_10486
		EUDD II MORADABAD	RAMGANGA VIHAR_10186
		EUDD II MORADABAD	TDI CITY_10174
		EUDD II MORADABAD	TOWN HALL_10168
		EUDD II MORADABAD	VIVEKANAND_10166
		EUDD II MORADABAD	WAVE GREEN_10470
		EUDD III MORADABAD	EKTA VIHAR_10390
		EUDD III MORADABAD	GAL SHAHEED_10179
		EUDD III MORADABAD	GIC_10182
		EUDD III MORADABAD	GULAB WARI_10488
		EUDD III MORADABAD	KATGHAR_10181
		EUDD III MORADABAD	PITAL BASTI_10180
		EUDD III MORADABAD	SHIVPURI_10437
		EUDD III MORADABAD	SITAPURI_10177
	EDC SAMBHAL	EDD CHANDAUSI	ADHOL_120473
		EDD CHANDAUSI	BAHJOI_10123
		EDD CHANDAUSI	BISARU_120473
		EDD CHANDAUSI	CHANDAUSI RURAL_10122
		EDD CHANDAUSI	CHANDAUSI_10122
		EDD CHANDAUSI	HANUMAN GARHI_10120
		EDD CHANDAUSI	JANETA_11208
		EDD CHANDAUSI	KAILA DEVI_120473

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD CHANDAUSI	KHEDAKHAS_120473
		EDD CHANDAUSI	KHRINI_120473
		EDD CHANDAUSI	KIRARI_120473
		EDD CHANDAUSI	MAULAGARH_15017
		EDD CHANDAUSI	PAWANSA_120473
		EDD CHANDAUSI	POWER HOUSE_10121
		EDD CHANDAUSI	PURA_120473
		EDD CHANDAUSI	TEHSIL CHANDAUSI_10391
		EDD SAMBHAL	ANCHODA KAMBAO_120474
		EDD SAMBHAL	ASGARIPUR_120474
		EDD SAMBHAL	ASMOLI_120474
		EDD SAMBHAL	BARAHI_120474
		EDD SAMBHAL	BHAWANIPUR_120474
		EDD SAMBHAL	CHIMYAWALI_120474
		EDD SAMBHAL	CHOUDHARY SARAI_10126
		EDD SAMBHAL	DHOBI GHAT_10463
		EDD SAMBHAL	FATHEPUR SARAI_120474
		EDD SAMBHAL	HATIMSARAI_120474
		EDD SAMBHAL	HAYAT NAGAR_10128
		EDD SAMBHAL	INDUSTRIAL_10469
		EDD SAMBHAL	LAKHORI JALALPUR_120474
		EDD SAMBHAL	MAHAMOODPUR MAFI_120474
		EDD SAMBHAL	NEKPUR_120474
		EDD SAMBHAL	R/L_120474
		EDD SAMBHAL	RAI SATTI_10125
		EDD SAMBHAL	RUKNUDEEN SARAI_11418
		EDD SAMBHAL	RUSTAMPUR NIYAWALI_120474
		EDD SAMBHAL	SAIDPUR GANGO_120474
		EDD SAMBHAL	SAIDPUR JASKOLI_120474
		EDD SAMBHAL	SAINDA URF SEHRA_120474
		EDD SAMBHAL	SALAKHANA_120474
		EDD SAMBHAL	SAMBHAL_10127
		EDD SAMBHAL	SINGHPUR SANI_120474
		EDD SAMBHAL	SIRSI_11209
		EDD SAMBHAL	TANDA KOTHI_120474
		EDD SAMBHAL	TEHSIL SAMBHAL_10468
		EDD BABRALA	BABRALA_11207
		EDD BABRALA	CHAPRA_120475
		EDD BABRALA	DHANARI_120475
		EDD BABRALA	GAWAN_11337
		EDD BABRALA	GUNNAUR_11200
		EDD BABRALA	HERONE_120475

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD BABRALA	JUNAWAI_120475
		EDD BABRALA	RAJPURA_120475
	EDC RAMPUR	EDD I RAMPUR	AJEETPUR_10111
		EDD I RAMPUR	AMBEDKAR PARK_10483
		EDD I RAMPUR	BILASPUR GATE_10387
		EDD I RAMPUR	CIVIL LINES_10110
		EDD I RAMPUR	DOONGARPUR_10112
		EDD I RAMPUR	NAWAB GATE_10113
		EDD I RAMPUR	PAHARI GATE_10114
		EDD I RAMPUR	PANWARIYA_10140
		EDD I RAMPUR	QUILA_10374
		EDD I RAMPUR	RAZA INTER COLLEGE_10115
		EDD I RAMPUR	SHAHABAD GATE_10116
		EDD I RAMPUR	THANA GANJ_11426
		EDD II RAMPUR	DARIYAL_120542
		EDD II RAMPUR	KHOD_120542
		EDD II RAMPUR	MASWASI_11300
		EDD II RAMPUR	MILAK KHANAM_120542
		EDD II RAMPUR	SAID NAGAR_120542
		EDD II RAMPUR	SWAR TEHSEEL_11307
		EDD II RAMPUR	SWAR_120542
		EDD II RAMPUR	TANDA TEHSEEL_120542
		EDD II RAMPUR	TANDA_10117
		EDD II RAMPUR	TANDA_120542
		EDD MILAK	AJEETPUR 2_15026
		EDD MILAK	BHITAR GAO SHAHBAD_10388
		EDD MILAK	DHAMORA_120543
		EDD MILAK	DURG NAGLA_120543
		EDD MILAK	KHARSOL_11513
		EDD MILAK	MADHUKAR_120543
		EDD MILAK	MILAK_11316
		EDD MILAK	PATWAI_120543
		EDD MILAK	PIPLA SHIV NAGAR_120543
		EDD MILAK	SAFINI_120543
		EDD MILAK	SHAHBAD_120543
		EDD MILAK	SIYARI_120543
		EDD BILASPUR	ANWARIA_11514
		EDD BILASPUR	ASHOK NAGAR_120544
		EDD BILASPUR	BEGAMABAD_120544
		EDD BILASPUR	BHOT_120544
		EDD BILASPUR	BILASPUR_10136
		EDD BILASPUR	DIBDIBA_120544

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD BILASPUR	GODHI_120544
		EDD BILASPUR	GOVINDPURA_120544
		EDD BILASPUR	KEMRI_120544
		EDD BILASPUR	KUA KHEDA_120544
		EDD BILASPUR	NEW BILASPUR_15083
		EDD BILASPUR	RUDRAPUR BORDER_120544
GAJRAULA	EDC AMROHA	EDD I AMROHA	BHAWALPUR_120631
		EDD I AMROHA	BUDHANPUR DIDDOLI_120631
		EDD I AMROHA	COLLECTRATE_10332
		EDD I AMROHA	DAULATPUR_120631
		EDD I AMROHA	DHANAURA MURADNAGAR_120631
		EDD I AMROHA	DISTRICT HOSPITAL_120631
		EDD I AMROHA	GULERIYA_10334
		EDD I AMROHA	JAUKHERA_120631
		EDD I AMROHA	JOYA_120631
		EDD I AMROHA	KAFOORPUR_120631
		EDD I AMROHA	KAILSA_120631
		EDD I AMROHA	KHARKHODA AZAM_120631
		EDD I AMROHA	NEW COLLECTRATE_10332
		EDD I AMROHA	PONDAPUR_120631
		EDD I AMROHA	RAJABPUR_120631
		EDD I AMROHA	RAJABPUR-2_120631
		EDD I AMROHA	SHAHBAZPUR_120631
		EDD I AMROHA	SUDANPUR_120631
		EDD I GAJRAULA	AAJAMPUR_120632
		EDD I GAJRAULA	ATTARI MURIDPUR_120632
		EDD I GAJRAULA	BACHRAUN_11256
		EDD I GAJRAULA	BHAGWANPUR_120632
		EDD I GAJRAULA	BHARAPUR_120632
		EDD I GAJRAULA	CHUCHAILA KHURD_120632
		EDD I GAJRAULA	DHANAURA THASEEL_11251
		EDD I GAJRAULA	DHANAURA_120632
		EDD I GAJRAULA	DHANAURI MAFI_120632
		EDD I GAJRAULA	DHAUTI_120632
		EDD I GAJRAULA	DINGRA_120632
		EDD I GAJRAULA	FAZALPUR_120632
		EDD I GAJRAULA	GAJRAULA_10138
		EDD I GAJRAULA	GANDASPUR_120632
		EDD I GAJRAULA	JALALPUR KALAN_11512
		EDD I GAJRAULA	KHADGUJAR_120632
		EDD I GAJRAULA	KUMRALA_120632
		EDD I GAJRAULA	MALISHYA_120632

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I GAJRAULA	MOHAMDABAD_120632
		EDD I GAJRAULA	MUNDA KHERA KHADAR_120632
		EDD I GAJRAULA	SHRI ACID NAIPURA_10424
		EDD I GAJRAULA	UPSIDC_10423
		EDD II AMROHA	AHROI_10331
		EDD II AMROHA	BAHADURPUR_120633
		EDD II AMROHA	DOUD SARAI_10333
		EDD II AMROHA	JALILPUR BAKKAL_120633
		EDD II AMROHA	JAMUNA KHAS_120633
		EDD II AMROHA	KORAL_120633
		EDD II AMROHA	KOTHI KHIDMATPUR_120633
		EDD II AMROHA	KUWAKHEDA_120633
		EDD II AMROHA	MAKHDUMPUR_120633
		EDD II AMROHA	MITTHEYPUR_120633
		EDD II AMROHA	MUNDHA KHERA_120633
		EDD II AMROHA	NAUGAWA SADAT_11239
		EDD II AMROHA	NAUGAWA SADAT-2_15008
		EDD II AMROHA	NAZARPUR KHURD_120633
		EDD II AMROHA	S-99_10335
		EDD II GAJRAULA	ADAMPUR_120634
		EDD II GAJRAULA	BURAWALI_120634
		EDD II GAJRAULA	DEHRA MILAK_120634
		EDD II GAJRAULA	DHAKKA_120634
		EDD II GAJRAULA	DHAWARSI_120634
		EDD II GAJRAULA	EKONDA_120634
		EDD II GAJRAULA	GARABPUR_120634
		EDD II GAJRAULA	HASANPUR_120634
		EDD II GAJRAULA	ISHAPUR_120634
		EDD II GAJRAULA	JAITOLI_120634
		EDD II GAJRAULA	NAGLA KHADER_120634
		EDD II GAJRAULA	REHERA_120634
		EDD II GAJRAULA	SAIDNAGLI_120634
		EDD II GAJRAULA	SIHALI JANGEER_120634
		EDD II GAJRAULA	TAHARPUR_120634
		EDD II GAJRAULA	TEHSIL HASANPUR_10393
		EDD II GAJRAULA	UJHARI_11262
SAHARANPUR	EUDC SAHARANPUR	EUDD I SAHARANPUR	AMBALA ROAD_10102
		EUDD I SAHARANPUR	AWAS VIKAS_10099
		EUDD I SAHARANPUR	GHANTA GHAR_10100
		EUDD I SAHARANPUR	HAKIKAT NAGAR_10098
		EUDD I SAHARANPUR	MANAK MAU_10101
		EUDD I SAHARANPUR	MANDI SAMITI_10103

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD I SAHARANPUR	PAPER MILL_10150
		EUDD II SAHARANPUR	HUSSAIN BASTI_10422
		EUDD II SAHARANPUR	JAIN BAGH_10105
		EUDD II SAHARANPUR	JANAK NAGAR_10155
		EUDD II SAHARANPUR	KISHANPURA_10160
		EUDD II SAHARANPUR	PUL KHUMARAN_10106
		EUDD II SAHARANPUR	TP NAGAR_10421
	EDC I SAHARANPUR	EDD BEHAT	BEHAT TEHSIL_10820
		EDD BEHAT	BEHAT_130141
		EDD BEHAT	FATEHPUR_130141
		EDD BEHAT	JEEWALA_130141
		EDD BEHAT	KHURRAMPUR_130141
		EDD BEHAT	KUSHALIPUR_130141
		EDD BEHAT	MATHANA_130141
		EDD BEHAT	MIRZAPUR_130141
		EDD BEHAT	MUZAFFARABAD_130141
		EDD BEHAT	QASIMPUR TANDA_130141
		EDD BEHAT	RAIPUR_130141
		EDD BEHAT	RAIPUR-II_130141
		EDD BEHAT	SANSARPUR_130141
		EDD BEHAT	SHAHKUMBRI_130141
		EDD BEHAT	TOTATANDA_130141
		EDD I SAHARANPUR	CHAURIMANDI_130142
		EDD I SAHARANPUR	CHILKANA_10787
		EDD I SAHARANPUR	DHABKI GUJJAR_130142
		EDD I SAHARANPUR	DUMJHERA_130142
		EDD I SAHARANPUR	GADREDHI_130142
		EDD I SAHARANPUR	GATHEDA_130142
		EDD I SAHARANPUR	GHUNNA_130142
		EDD I SAHARANPUR	GHUUNA INDUSTRIAL_130142
		EDD I SAHARANPUR	HAKIMPURA_130142
		EDD I SAHARANPUR	NAWADA_130142
		EDD I SAHARANPUR	PATHED_130142
		EDD I SAHARANPUR	PILAKHANI INDUSTRIAL_130142
		EDD I SAHARANPUR	PUNWARKA_130142
		EDD I SAHARANPUR	SALEMPUR GADA_130142
		EDD I SAHARANPUR	SARKARI SEHILAH_130142
		EDD I SAHARANPUR	SARSAWA_10788
		EDD DEOBAND	AAMKI DEEPCHANDPUR_130143
		EDD DEOBAND	AMBETA SHEKH_130143
		EDD DEOBAND	BABUPUR NANGLI_130143
		EDD DEOBAND	BALSAWA ISSAPUR_130143

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD DEOBAND	BANEYDA_130143
		EDD DEOBAND	BEERPUR_130143
		EDD DEOBAND	BHATOL_130143
		EDD DEOBAND	BHAYLA_130143
		EDD DEOBAND	CHACHERIKI_130143
		EDD DEOBAND	CHANDENA KOLI_130143
		EDD DEOBAND	DANGHERA_130143
		EDD DEOBANDH	DEOBAND_10297
		EDD DEOBANDH	DEOBAND_10298
		EDD DEOBAND	GANGDASPUR_130143
		EDD DEOBAND	KHERA MUGAL_130143
		EDD DEOBAND	KURDHEE_130143
		EDD DEOBAND	LAKHNOR_130143
		EDD DEOBAND	MERAGPUR_130143
		EDD DEOBAND	NAGAL_130143
		EDD DEOBAND	PANIYALI_130143
		EDD DEOBAND	PHAUPUR_130143
		EDD DEOBAND	RAJPUR_130143
		EDD DEOBAND	RANKHANDI_130143
		EDD DEOBAND	TALHEDI_130143
		EDD DEOBAND	TANSHIPUR_130143
		EDD DEOBANDH	TEHSIL DEOBAND_10382
	EDC II SAHARANPUR	EDD NAKUR	BEERAKHEDI-I_130161
		EDD NAKUR	BERKHERI_130161
		EDD NAKUR	BHARMAU_130161
		EDD NAKUR	CHAUPURA_11515
		EDD NAKUR	DHYAKI_130161
		EDD NAKUR	GANGO-H-I/II_10287
		EDD NAKUR	GANGO-H-III_10286
		EDD NAKUR	JEHRA_130161
		EDD NAKUR	KALSI_130161
		EDD NAKUR	KHADLANA_130161
		EDD NAKUR	KISHANPURA_11477
		EDD NAKUR	KULHEDI_130161
		EDD NAKUR	MANAKMAU_130161
		EDD NAKUR	MANOHRA_130161
		EDD NAKUR	NAKUR TEHSIL_15002
		EDD NAKUR	NATHODI_130161
		EDD NAKUR	RANDHEDI_130161
		EDD NAKUR	S/S ISSOPUR_130161
		EDD NAKUR	S/S MAHENGHI_130161
		EDD NAKUR	S/S SALARPURA_130161

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD NAKUR	SIKANDERPUR_130161
		EDD NAKUR	SUB STATION AMBEHTA_10886
		EDD NAKUR	SUB STATION DUDHALA_130161
		EDD NAKUR	SUB STATION GANGOH I_130161
		EDD NAKUR	SUB STATION HARPALI_130161
		EDD NAKUR	SUB STATION HAZIPURA_130161
		EDD NAKUR	SUB STATION JHABIRAN_130161
		EDD NAKUR	SUB STATION JHARWAN_130161
		EDD NAKUR	SUB STATION KHANDWA_130161
		EDD NAKUR	SUB STATION KHEDA_130161
		EDD NAKUR	SUB STATION KHOSPURA_130161
		EDD NAKUR	SUB STATION LAKHNAUTI_130161
		EDD NAKUR	SUB STATION NAKUR_130161
		EDD NAKUR	SUB STATION PHANDPURI_130161
		EDD NAKUR	SUB STATION RAMGARH_130161
		EDD NAKUR	SUB STATION TABAR_130161
		EDD NAKUR	TITRON_10873
		EDD II SAHARANPUR	BAHEDA SANDAL SINGH_130162
		EDD II SAHARANPUR	CHAURADEV_130162
		EDD II SAHARANPUR	HARORA_130162
		EDD II SAHARANPUR	ITI 2_130162
		EDD II SAHARANPUR	ITI_130162
		EDD II SAHARANPUR	KAILASHPUR 2_130162
		EDD II SAHARANPUR	KAILASHPUR_130162
		EDD II SAHARANPUR	KHAJURI AKBARPUR_130162
		EDD II SAHARANPUR	KHATOLI_130162
		EDD II SAHARANPUR	PAHASU_130162
		EDD II SAHARANPUR	PILKHANI RAMPUR_130162
		EDD II SAHARANPUR	SHEKHPURA_130162
		EDD RAMPUR MANIHARN	BARGAON_130163
		EDD RAMPUR MANIHARN	CHAKWALI_130163
		EDD RAMPUR MANIHARN	CHORA BAGDOLI_130163
		EDD RAMPUR MANIHARN	DEDPURA_130163
		EDD RAMPUR MANIHARN	ISLAMNAGAR_130163
		EDD RAMPUR MANIHARN	JANKHEDA ISLAMNAGAR NEW_130163
		EDD RAMPUR MANIHARN	JARODA PANDA_130163
		EDD RAMPUR MANIHARN	KHUA KHEDA_130163
		EDD RAMPUR MANIHARN	KISHANPURA_10932
		EDD RAMPUR MANIHARN	MIRZAPUR AMBHETA CHAND_130163
		EDD RAMPUR MANIHARN	NANAUTA 2_15004
		EDD RAMPUR MANIHARN	NANAUTA_130163
		EDD RAMPUR MANIHARN	RAMPUR DEHAT_130163

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD RAMPUR MANIHARN	RAMPUR TEHSIL_10917
		EDD RAMPUR MANIHARN	SAMBHAL HERI_130163
		EDD RAMPUR MANIHARN	SHARPUR JARODA_130163
		EDD RAMPUR MANIHARN	SIMLANA_130163
		EDD RAMPUR MANIHARN	TASKA_130163
		EDD RAMPUR MANIHARN	TIKROL_130163
MUZAFFARNAGAR	EUDC MUZAFFARNAGAR	EUDD I MUZAFFARNAGAR	DISTRICT HOSPITAL_10247
		EUDD I MUZAFFARNAGAR	DWARKA CITY_130211
		EUDD I MUZAFFARNAGAR	GANDHI COLONY_10255
		EUDD I MUZAFFARNAGAR	JANSATH ROAD_10259
		EUDD I MUZAFFARNAGAR	MANDI SAMITI_10257
		EUDD I MUZAFFARNAGAR	NEW RORKEE ROAD_15016
		EUDD I MUZAFFARNAGAR	PACHANDA ROAD_10256
		EUDD I MUZAFFARNAGAR	RAMPUR TIRAHA_15019
		EUDD I MUZAFFARNAGAR	RORKEE ROAD_10246
		EUDD I MUZAFFARNAGAR	TOWN HALL_10251
		EUDD I MUZAFFARNAGAR	TRANSPORT NAGAR_10258
		EUDD II MUZAFFARNAGAR	BARLA_130212
		EUDD II MUZAFFARNAGAR	BASEDA_130212
		EUDD II MUZAFFARNAGAR	GHATAYAN_130212
		EUDD II MUZAFFARNAGAR	HASMPUR_130212
		EUDD II MUZAFFARNAGAR	JANSATH RURAL_130212
		EUDD II MUZAFFARNAGAR	JANSATH TEHSIL_10612
		EUDD II MUZAFFARNAGAR	KAKROLI_130212
		EUDD II MUZAFFARNAGAR	KAMHEDA DHANSRI_130212
		EUDD II MUZAFFARNAGAR	KASAMPUR KHOLA_130212
		EUDD II MUZAFFARNAGAR	KHERI NIJAMPUR_130212
		EUDD II MUZAFFARNAGAR	KHUDDA_130212
		EUDD II MUZAFFARNAGAR	KITHODA_11465
		EUDD II MUZAFFARNAGAR	KUTUBPUR_130212
		EUDD II MUZAFFARNAGAR	MEERAPUR_130212
		EUDD II MUZAFFARNAGAR	PURKAZI_10622
		EUDD II MUZAFFARNAGAR	RAMRAJ_130212
		EUDD II MUZAFFARNAGAR	RASOOLPUR_130212
		EUDD II MUZAFFARNAGAR	SAKARPUR_130212
		EUDD II MUZAFFARNAGAR	SHERPUR KHADER_130212
		EUDD II MUZAFFARNAGAR	SIKHEDA_130212
		EUDD II MUZAFFARNAGAR	TUGLAKPUR KAMHEDA_130212
		EUDD III MUZAFFARNAGAR	BEGRAJPUR_15024
		EUDD III MUZAFFARNAGAR	MAHAVEER CHOWK_10250
		EUDD III MUZAFFARNAGAR	MIMLANA ROAD_10249
		EUDD III MUZAFFARNAGAR	NUMAISH GROUND_10252

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD III MUZAFFARNAGAR	SHAMLI ROAD_10248
		EUDD III MUZAFFARNAGAR	SHERNAGAR_130213
		EUDD III MUZAFFARNAGAR	SUJDU_10253
	EDC I MUZAFFARNAGAR	EDD I MUZAFFARNAGAR	ALAWALPUR MAZRA_130261
		EDD I MUZAFFARNAGAR	BAGHRA_130261
		EDD I MUZAFFARNAGAR	BHOKARHEDI_10573
		EDD I MUZAFFARNAGAR	BHOPA_130261
		EDD I MUZAFFARNAGAR	BHUDINA KALAN_130261
		EDD I MUZAFFARNAGAR	HADOLI_130261
		EDD I MUZAFFARNAGAR	JASOI_130261
		EDD I MUZAFFARNAGAR	JOLLY_130261
		EDD I MUZAFFARNAGAR	KINONI_130261
		EDD I MUZAFFARNAGAR	KUTBA_130261
		EDD I MUZAFFARNAGAR	LALUKHEDI_130261
		EDD I MUZAFFARNAGAR	MAKHYALI_130261
		EDD I MUZAFFARNAGAR	MUKUNDPUR_130261
		EDD I MUZAFFARNAGAR	MUNDBHAR_130261
		EDD I MUZAFFARNAGAR	NIRANA_130261
		EDD I MUZAFFARNAGAR	PIPALHEDA_130261
		EDD I MUZAFFARNAGAR	SAVTOO_130261
		EDD I MUZAFFARNAGAR	SHUKERTAAL_130261
		EDD I MUZAFFARNAGAR	SIKRI_130261
		EDD I MUZAFFARNAGAR	SISOLI_10578
		EDD II MUZAFFARNAGAR	BADAHIKLA_130262
		EDD II MUZAFFARNAGAR	BAGRAJPUR_130262
		EDD II MUZAFFARNAGAR	BEGRAJPUR INDUS_130262
		EDD II MUZAFFARNAGAR	BIJOPURA_130262
		EDD II MUZAFFARNAGAR	BIRALSI_130262
		EDD II MUZAFFARNAGAR	CHARTHAWAL IPDS_15005
		EDD II MUZAFFARNAGAR	CHARTHAWAL_130262
		EDD II MUZAFFARNAGAR	CHOWKDA_130262
		EDD II MUZAFFARNAGAR	DATYANA_130262
		EDD II MUZAFFARNAGAR	DINKARPUR_130262
		EDD II MUZAFFARNAGAR	DUDHALI_130262
		EDD II MUZAFFARNAGAR	KARWADA_130262
		EDD II MUZAFFARNAGAR	KHEDI DUDHADHARI_130262
		EDD II MUZAFFARNAGAR	KULHEDI_130262
		EDD II MUZAFFARNAGAR	KUTESRA_130262
		EDD II MUZAFFARNAGAR	LACHERA_130262
		EDD II MUZAFFARNAGAR	LADWA NASIRPUR_130262
		EDD II MUZAFFARNAGAR	NIRMANA_130262
		EDD II MUZAFFARNAGAR	PURA_130262

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD II MUZAFFARNAGAR	ROHANA_130262
		EDD II MUZAFFARNAGAR	RONI HAZIPUR_130262
		EDD II MUZAFFARNAGAR	ROORKEE ROAD_130262
		EDD II MUZAFFARNAGAR	SANDHAWALI_130262
		EDD II MUZAFFARNAGAR	SANJHEK_130262
		EDD II MUZAFFARNAGAR	SHAMLI ROAD 30 NO_130262
		EDD II MUZAFFARNAGAR	SOHAJANI TAGAN_130262
		EDD II MUZAFFARNAGAR	SONTA_130262
	EDC II MUZAFFARNAGAR	EDD BUDHANA	AADAMPUR_130271
		EDD BUDHANA	ALIPUR ATERNA_130271
		EDD BUDHANA	ATALI_130271
		EDD BUDHANA	BHORAKALA_130271
		EDD BUDHANA	BIRAL_130271
		EDD BUDHANA	BUDHANA DEHAT_130271
		EDD BUDHANA	BUDHANA_10141
		EDD BUDHANA	CHANDHEDHI_130271
		EDD BUDHANA	DOONGAR_130271
		EDD BUDHANA	FUGANA_130271
		EDD BUDHANA	GARHI NOABAD_130271
		EDD BUDHANA	HABIBPUR_130271
		EDD BUDHANA	JAULA_130271
		EDD BUDHANA	KAKDA_130271
		EDD BUDHANA	KARODA MAHAJAN_130271
		EDD BUDHANA	KHANPUR_130271
		EDD BUDHANA	KHARAD_130271
		EDD BUDHANA	KURALS_130271
		EDD BUDHANA	KURAVA_130271
		EDD BUDHANA	KURTHAL_130271
		EDD BUDHANA	LUHSANA_130271
		EDD BUDHANA	MINDKALI_130271
		EDD BUDHANA	MOHAMMADPUR RAISINGH_130271
		EDD BUDHANA	PARASAULI_130271
		EDD BUDHANA	SARANAWALI_130271
		EDD BUDHANA	SHAHDABBAR_130271
		EDD BUDHANA	SHAHPUR_10555
		EDD BUDHANA	SORAM_130271
		EDD BUDHANA	VALLEY_130271
		EDD KHATAULI	BUDHANA MOD_10147
		EDD KHATAULI	GOELA_130272
		EDD KHATAULI	KHATAULI RURAL_130272
		EDD KHATAULI	KHATAULI_10148
		EDD KHATAULI	PAMNAWALI_130272

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD KHATAULI	RATANPURI_130272
		EDD KHATAULI	SARAI RASOOLPUR (ANTWADA)_130272
		EDD KHATAULI	SIKANDERPUR_130272
		EDD KHATAULI	TISANG_130272
		EDD KHATAULI	TODA_130272
	EDC SHAMLI	EDD II SHAMLI	AADARSH MANDI_10203
		EDD II SHAMLI	AALDI_137451
		EDD II SHAMLI	AILUM_10655
		EDD II SHAMLI	BHABHISA_137451
		EDD II SHAMLI	COLLECTORATE_15022
		EDD II SHAMLI	DANGROL_137451
		EDD II SHAMLI	DUDHAR_137451
		EDD II SHAMLI	GANGEROO_137451
		EDD II SHAMLI	ISLAMPUR GHASOLLI_137451
		EDD II SHAMLI	ISSOPURTEEL_137451
		EDD II SHAMLI	JASALA_137451
		EDD II SHAMLI	JHINJHANA ROAD_15021
		EDD II SHAMLI	KANDHLA RURAL_137451
		EDD II SHAMLI	KANDHLA TOWN_10328
		EDD II SHAMLI	KANIYAN_137451
		EDD II SHAMLI	KHANDRAWALI_137451
		EDD II SHAMLI	KIWANA_137451
		EDD II SHAMLI	LANK_137451
		EDD II SHAMLI	LISAD_137451
		EDD II SHAMLI	NALA_137451
		EDD II SHAMLI	RAMPUR KHEDI_137451
		EDD II SHAMLI	SHAMLI TOWN (KHERI KARMU)_15023
		EDD II SHAMLI	UNCHA GAON_137451
		EDD III SHAMLI	BABRI_137452
		EDD III SHAMLI	BAHAWADI_137452
		EDD III SHAMLI	BANAT I_10701
		EDD III SHAMLI	BHAJJU_137452
		EDD III SHAMLI	BHESANI ISHLAMPUR_137452
		EDD III SHAMLI	BHIKKA MAZRA_137452
		EDD III SHAMLI	BUTRADA_137452
		EDD III SHAMLI	BUTRADI_137452
		EDD III SHAMLI	CHUNSA_137452
		EDD III SHAMLI	HARAD_137452
		EDD III SHAMLI	HASANPUR LUHARI_137452
		EDD III SHAMLI	HIRANWADA_137452
		EDD III SHAMLI	INDUSTRIAL_137452
		EDD III SHAMLI	JALALABAD_10706

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD III SHAMLI	JHAL_137452
		EDD III SHAMLI	KAIDI_137452
		EDD III SHAMLI	KARODA HATHI_137452
		EDD III SHAMLI	KUDANA_137452
		EDD III SHAMLI	KURMALI_137452
		EDD III SHAMLI	NOZAL_137452
		EDD III SHAMLI	SIKKA_137452
		EDD III SHAMLI	SILAWAR_137452
		EDD III SHAMLI	THANA BHAWAN_10491
		EDD III SHAMLI	THANABHAWAN RURAL_137452
		EDD IV SHAMLI	ABDAN NAGAR_137453
		EDD IV SHAMLI	BALWA_137453
		EDD IV SHAMLI	BHOORA_137453
		EDD IV SHAMLI	DEVI MANDIR KAIRANA_10383
		EDD IV SHAMLI	DUNDUKHERA_137453
		EDD IV SHAMLI	JANDHERI_137453
		EDD IV SHAMLI	JHARKHERI_137453
		EDD IV SHAMLI	JHINJHANA RURAL_137453
		EDD IV SHAMLI	JHINJHANA TOWN_10685
		EDD IV SHAMLI	KAIRANA RURAL_137453
		EDD IV SHAMLI	KAMALPUR_137453
		EDD IV SHAMLI	KANDELA_137453
		EDD IV SHAMLI	KASERVA KALAN_137453
		EDD IV SHAMLI	KERTU_137453
		EDD IV SHAMLI	KHERI KARMU_137453
		EDD IV SHAMLI	KHURGAN_137453
		EDD IV SHAMLI	MANSURA_137453
		EDD IV SHAMLI	MOHAMMADPUR RAI_137453
		EDD IV SHAMLI	PANJEETH_137453
		EDD IV SHAMLI	PAWTI KALAN_137453
		EDD IV SHAMLI	SIMBHALKA_137453
		EDD I SHAMLI	AMBEHTA YAKUBPUR_137454
		EDD I SHAMLI	BHAINSWAL_137454
		EDD I SHAMLI	BHOGI MAZRA_137454
		EDD I SHAMLI	CHAUSANA_137454
		EDD I SHAMLI	DATHEDA_137454
		EDD I SHAMLI	DULLA KHERI_137454
		EDD I SHAMLI	GAGOR_137454
		EDD I SHAMLI	GARHI ABDULLA_137454
		EDD I SHAMLI	GARHI PUKHTA_10639
		EDD I SHAMLI	HATHCHHOYA_137454
		EDD I SHAMLI	INDUSTRIAL ESTATE_137454

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I SHAMLI	KHEDI KHUSHNAM_137454
		EDD I SHAMLI	KHODSAMA_137454
		EDD I SHAMLI	MALANDI_137454
		EDD I SHAMLI	MUNDET KHADAR_137454
		EDD I SHAMLI	NONANGLI_137454
		EDD I SHAMLI	OON TOWN_15001
		EDD I SHAMLI	OON_137454
		EDD I SHAMLI	PINDORA_137454
		EDD I SHAMLI	SHAMLI SHAMLA_137454
		EDD I SHAMLI	SIKANDERPUR_137454
		EDD I SHAMLI	TITOLI_137454
		EDD I SHAMLI	TODA_137454
		EDD I SHAMLI	YARPUR_137454
NOIDA	EUDC I NOIDA	EUDD I NOIDA	SECTOR 117_10412
		EUDD I NOIDA	SECTOR 122 JJ_11410
		EUDD I NOIDA	SECTOR 122_10413
		EUDD I NOIDA	SECTOR 63 A_11518
		EUDD I NOIDA	SECTOR 63 B_10406
		EUDD I NOIDA	SECTOR 63 C_11519
		EUDD I NOIDA	SECTOR 63 D BLOCK_10049
		EUDD I NOIDA	SECTOR 63 G BLOCK_10050
		EUDD I NOIDA	SECTOR 63 H_10408
		EUDD I NOIDA	SECTOR 63 J_10407
		EUDD I NOIDA	SECTOR 64_10048
		EUDD I NOIDA	SECTOR 65_10051
		EUDD I NOIDA	SECTOR 67_10060
		EUDD I NOIDA	SECTOR 72_10061
		EUDD I NOIDA	SECTOR 79_10411
		EUDD VII NOIDA	SECTOR 23_10053
		EUDD VII NOIDA	SECTOR 32_10052
		EUDD VII NOIDA	SECTOR 52_10059
		EUDD VII NOIDA	SECTOR 53_10409
		EUDD VII NOIDA	SECTOR 59_10264
		EUDD VII NOIDA	SECTOR 60_10054
		EUDD VII NOIDA	SECTOR 61_10410
		EUDD VII NOIDA	SECTOR 62 (GREEN BELT)_10055
		EUDD VII NOIDA	SECTOR 62 B1_10056
		EUDD VII NOIDA	SECTOR 62 B2_10057
		EUDD VII NOIDA	SECTOR 62 B3_10405
		EUDD VII NOIDA	SECTOR 62 C_10058
		EUDD V NOIDA	SECTOR 10_10513
		EUDD V NOIDA	SECTOR 108 NEW_10403

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD V NOIDA	SECTOR 108 OLD_10084
		EUDD V NOIDA	SECTOR 11_10262
		EUDD V NOIDA	SECTOR 132_10092
		EUDD V NOIDA	SECTOR 135_10093
		EUDD V NOIDA	SECTOR 20_10087
		EUDD V NOIDA	SECTOR 25_10263
		EUDD V NOIDA	SECTOR 3_11372
		EUDD V NOIDA	SECTOR 46_10404
		EUDD V NOIDA	SECTOR 47_10089
		EUDD V NOIDA	SECTOR 56_10216
		EUDD V NOIDA	SECTOR 58_10090
		EUDD V NOIDA	SECTOR 8_10261
		EUDD V NOIDA	SECTOR 9_10091
		EUDD II NOIDA	CGEWHO (KENDRIYA VIHAR 2)_10419
		EUDD II NOIDA	HOSIERY COMPLEX D-BLOCK_10418
		EUDD II NOIDA	HOSIERY COMPLEX_10077
		EUDD II NOIDA	NSEZ (NEW)_10066
		EUDD II NOIDA	NSEZ OLD_10067
		EUDD II NOIDA	SECTOR 100_10072
		EUDD II NOIDA	SECTOR 150_11385
		EUDD II NOIDA	SECTOR 29_10075
		EUDD II NOIDA	SECTOR 31_10068
		EUDD II NOIDA	SECTOR 38_10069
		EUDD II NOIDA	SECTOR 39_10070
		EUDD II NOIDA	SECTOR 42_10416
		EUDD II NOIDA	SECTOR 50 NEW_10415
		EUDD II NOIDA	SECTOR 50 OLD_10073
		EUDD II NOIDA	SECTOR 80 NEW_10414
		EUDD II NOIDA	SECTOR 80 OLD_10064
		EUDD II NOIDA	SECTOR 82_10076
		EUDD II NOIDA	SECTOR 83_10071
		EUDD II NOIDA	SECTOR 84_10417
		EUDD II NOIDA	SECTOR 88_10065
		EUDD II NOIDA	SECTOR 93 B_10420
		EUDD II NOIDA	SECTOR PHASE 2_10062
		EUDD III NOIDA	SEC 18 (OLD)_10095
		EUDD III NOIDA	SEC 6 (OLD)_10081
		EUDD III NOIDA	SEC 6A (NEW)_10082
		EUDD III NOIDA	SECTOR 1_10083
		EUDD III NOIDA	SECTOR 124_10078
		EUDD III NOIDA	SECTOR 126_10079
		EUDD III NOIDA	SECTOR 137_10458

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD III NOIDA	SECTOR 142_10080
		EUDD III NOIDA	SECTOR 153_10459
		EUDD III NOIDA	SECTOR 16_10094
		EUDD III NOIDA	SECTOR 168_10457
		EUDD III NOIDA	SECTOR 16A (NEW)_10455
		EUDD III NOIDA	SECTOR 16A (OLD)_10085
		EUDD III NOIDA	SECTOR 18 (ANSAL)_11425
		EUDD III NOIDA	SECTOR 18 (NEW)_10096
		EUDD III NOIDA	SECTOR 19_10086
		EUDD III NOIDA	SECTOR 43_11433
		EUDD III NOIDA	SECTOR 44_10088
		EUDD III NOIDA	SECTOR 45_10456
		EDD IV NOIDA	BISNAULI_141024
		EDD IV NOIDA	CHITTHERA_10221
		EDD IV NOIDA	DHOOM MANIKPUR_10222
		EDD IV NOIDA	KOT_141024
		EDD IV NOIDA	KUDI KHERA_141024
		EDD IV NOIDA	LUHARLI_141024
		EDD IV NOIDA	NTPC ROAD DADRI_141024
		EDD IV NOIDA	PIYAWALI_141024
		EUDD VIII NOIDA	BANKAPUR_141025
		EUDD VIII NOIDA	JAHANGIRPUR_11188
		EUDD VIII NOIDA	JEWER RURAL_141025
		EUDD VIII NOIDA	JEWER TOWN_11193
		EUDD GREATER NOIDA	BHATTA PARSOL_141026
		EUDD GREATER NOIDA	DANKOR_11292
		EUDD GREATER NOIDA	ETHEHRA_141026
		EUDD GREATER NOIDA	MANDI SHYAM NAGAR_141026
		EUDD GREATER NOIDA	RABUPURA_11195
		EUDD GREATER NOIDA	SALARPUR_141026
		EUDD GREATER NOIDA	SEC-122_141026
		EUDD GREATER NOIDA	SEC-17A_11510
		EUDD GREATER NOIDA	SUDAMA PURI_141026
GHAZIABAD-1	EUDD I GHAZIABAD	EUDD I GHAZIABAD	BAPU DHAM 3_11374
		EUDD I GHAZIABAD	BAPU DHAM 7_10473
		EUDD I GHAZIABAD	BAPU DHAM 8_10474
		EUDD I GHAZIABAD	BSR 1_10281
		EUDD I GHAZIABAD	BSR 2_10337
		EUDD I GHAZIABAD	BSR 3_10476
		EUDD I GHAZIABAD	GOVINDPURAM_10329
		EUDD I GHAZIABAD	KAMLA NEHRU NAGAR_10330
		EUDD I GHAZIABAD	KAVI NAGAR_10282

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD I GHAZIABAD	KAVINAGAR I BLOCK_11350
		EUDD I GHAZIABAD	NEW KAVI NAGAR_10475
		EUDD I GHAZIABAD	PAC TASK FORCE_10280
		EUDD I GHAZIABAD	RAJ NAGAR 2_11349
		EUDD I GHAZIABAD	RAJNAGAR 1_10278
		EUDD I GHAZIABAD	RDC RAJ NAGAR_10443
		EUDD I GHAZIABAD	SANJAY NAGAR_10499
		EUDD I GHAZIABAD	SWARN JAYANTI PURAM_11460
		EUDD IX GHAZIABAD	AKBARPUR BEHRAMPUR_10502
		EUDD IX GHAZIABAD	BHAMETA_10493
		EUDD IX GHAZIABAD	CHIRANJIV VIHAR_10275
		EUDD IX GHAZIABAD	LAL KUAN 2_10435
		EUDD IX GHAZIABAD	SHASTRI NAGAR 1_10279
		EUDD IX GHAZIABAD	SHASTRI NAGAR 2_10492
		EUDD IX GHAZIABAD	SUDAMAPURI_10436
		EUDD IX GHAZIABAD	UDYOG KUNJ_10338
		EUDD V GHAZIABAD	CHARAN SINGH COLONY_10434
		EUDD V GHAZIABAD	ELECTROSTEEL_10323
		EUDD V GHAZIABAD	LAL KUAN 1_10482
		EUDD V GHAZIABAD	PRATAP VIHAR 2_10433
		EUDD V GHAZIABAD	PRATAP VIHAR_10326
		EUDD V GHAZIABAD	RATHI ISPAT_10290
		EUDD V GHAZIABAD	SIDDHART VIHAR YOJNA SEC-9_10395
		EUDD V GHAZIABAD	SOUTH SIDE_10325
GHAZIABAD-3	EUDD II GHAZIABAD	EUDD II GHAZIABAD	KAUSHAMBI_10348
		EUDD II GHAZIABAD	MAHARAJPUR 1 SAHIBABAD_10478
		EUDD II GHAZIABAD	MAHARAJPUR 2 SAHIBABAD_10477
		EUDD II GHAZIABAD	SECTOR 16A (NEW) VASUNDHARA_10351
		EUDD II GHAZIABAD	SECTOR 16A (OLD) VASUNDHARA_11330
		EUDD II GHAZIABAD	SECTOR 19 VASUNDHARA_10349
		EUDD II GHAZIABAD	SECTOR 4 VAISHALI(ANIMAL PARK)_10345
		EUDD II GHAZIABAD	SEMANT VIHAR_10352
		EUDD II GHAZIABAD	VAISHALI SEC 6 NEW_11331
		EUDD II GHAZIABAD	VAISHALI SEC 6 OLD_10480
		EUDD II GHAZIABAD	VAISHALI SECTOR 1_10479
		EUDD II GHAZIABAD	VAISHALI SECTOR 2_11329
		EUDD II GHAZIABAD	VAISHALI SECTOR 3_10344
		EUDD II GHAZIABAD	VAISHALI SECTOR 5_10346
		EUDD VI GHAZIABAD	AMBIKA STEEL_10361
		EUDD VI GHAZIABAD	MAHARAJPUR 3_10446
		EUDD VI GHAZIABAD	SECTOR 10 VASUNDHARA_10363
		EUDD VI GHAZIABAD	SHALIMAR GARDEN 1_10365

ZONE	CIRCLE	DIVISION	SUB STATION
		EUDD VI GHAZIABAD	SHALIMAR GARDEN 2_11365
		EUDD VI GHAZIABAD	SURYA NAGAR 1 2_10364
		EUDD VI GHAZIABAD	VASUNDHARA SEC-8_15072
		EUDD VI GHAZIABAD	VIKRAM ENCLAVE 1_10366
		EUDD VI GHAZIABAD	VIKRAM ENCLAVE 2_11367
		EUDD VIII GHAZIABAD	ABHAY KHAND 1_10354
		EUDD VIII GHAZIABAD	AHINSHA KHAND 2_10353
		EUDD VIII GHAZIABAD	GREEN BELT 1_10355
		EUDD VIII GHAZIABAD	KALA PATTHAR_10356
		EUDD VIII GHAZIABAD	NITI KHAND 1_10357
		EUDD VIII GHAZIABAD	NITI KHAND 2_10358
		EUDD VIII GHAZIABAD	SHAKTI KHAND 2_10360
		EUDD VIII GHAZIABAD	SHIPRA SUN CITY_10359
		EUDD XI GHAZIABAD	SECTOR 55_10310
		EUDD XI GHAZIABAD	SECTOR 62 A2_11194
		EUDD XI GHAZIABAD	SECTOR 62 B3_10057
		EUDD XI GHAZIABAD	SECTOR 62A_10046
GHAZIABAD-2	EDC GHAZIABAD	EDD MODINAGAR	EDST FARIDNAGAR_150932
		EDD MODINAGAR	EDST GADANA_150932
		EDD MODINAGAR	EDST ISHAKNAGAR_10528
		EDD MODINAGAR	EDST KHINDORA_150932
		EDD MODINAGAR	EDST NIWARI ROAD OLD_150932
		EDD MODINAGAR	EDST PATLA NIWARI_10522
		EDD MODINAGAR	EDST TALHETA_150932
		EDD MODINAGAR	GADANA_10526
		EDD MODINAGAR	GOVIND PURI_10241
		EDD MODINAGAR	MAHESH MARG OLD_10238
		EDD MODINAGAR	MODI STEEL_10239
		EDD MODINAGAR	NIWARI ROAD_10240
		EDD MODINAGAR	S/S COLONY_15073
		EDD MURADNAGAR	ASALAT NAGAR_10464
		EDD MURADNAGAR	DASNA DEHAT_10536
		EDD MURADNAGAR	EDST HRM DCM DASNA_10537
		EDD MURADNAGAR	EDST KAKRA_150934
		EDD MURADNAGAR	EDST KAUSHALIYA_150934
		EDD MURADNAGAR	EDST NOORPUR_150934
		EDD MURADNAGAR	EDST RAGHUNATHPUR_150934
		EDD MURADNAGAR	EDST RAWLI_150934
		EDD MURADNAGAR	EDST SURANA_150934
		EDD MURADNAGAR	GANGNEHAR MURADNAGAR_15025
		EDD MURADNAGAR	GOYAL ISPAT (BHARAT UDHOYG)_10201
		EDD MURADNAGAR	HUSAINPUR_150934

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD MURADNAGAR	MURADNAGAR NEW _10199
		EDD MURADNAGAR	OLD MURADNAGAR _10200
GHAZIABAD-3	EUDC III GHAZIABAD	EUDD X GHAZIABAD	ARTHLA _10322
		EUDD X GHAZIABAD	DURGA INDUSTRIAL PARK MILAK NAGAR _11502
		EUDD X GHAZIABAD	MOHAN NAGAR 1 _15010
		EUDD X GHAZIABAD	MOHAN NAGAR 2 _10444
		EUDD X GHAZIABAD	NAND GRAM 1 _10341
		EUDD X GHAZIABAD	NAND GRAM 2 _10696
		EUDD X GHAZIABAD	NEAR HINDON VIHAR _11500
		EUDD X GHAZIABAD	NEAR HINDON VIHAR _11500
	EUDC I GHAZIABAD	EUDD III GHAZIABAD	AMBEDKAR DISTRICT CENTER _10431
		EUDD III GHAZIABAD	CITY _10317
		EUDD III GHAZIABAD	DIESEL POWER HOUSE _10316
		EUDD III GHAZIABAD	GULMOHER (RAKESH MARG) _10430
		EUDD III GHAZIABAD	NAVYUG MARKET _10428
		EUDD III GHAZIABAD	NEHRU NAGAR _10315
		EUDD III GHAZIABAD	NEW GANDHI NAGAR _10429
	EUDC III GHAZIABAD	EUDD IV GHAZIABAD	KARHERA _10501
		EUDD IV GHAZIABAD	KOYAL ENCLAVE _10538
		EUDD IV GHAZIABAD	LAJPAT NAGAR _10319
		EUDD IV GHAZIABAD	RAJENDRA NAGAR 1 _10321
		EUDD IV GHAZIABAD	RAJENDRA NAGAR 2 _10445
		EUDD VII GHAZIABAD	ATTOR _15071
		EUDD VII GHAZIABAD	LOHIYA NAGAR _10503
		EUDD VII GHAZIABAD	MATHURAPUR _15070
		EUDD VII GHAZIABAD	MEERUT ROAD 1 _10318
		EUDD VII GHAZIABAD	MEERUT ROAD 2 _11368
		EUDD VII GHAZIABAD	MORTA _10438
		EUDD VII GHAZIABAD	NEW BUS STAND _10439
		EUDD VII GHAZIABAD	NOOR NAGAR 1 _10521
		EUDD VII GHAZIABAD	NOOR NAGAR 2 _11369
		EUDD VII GHAZIABAD	PATEL NAGAR 1 _10342
		EUDD VII GHAZIABAD	PATEL NAGAR 2 _10343
GHAZIABAD-2	EDC LONI	EDD I LONI	ASHOK VIHAR _15020
		EDD I LONI	AVAS VIKAS SEC-6 _10484
		EDD I LONI	AWAS VIKAS SEC-17 _150971
		EDD I LONI	BALRAM NAGAR 1 _10229
		EDD I LONI	BALRAM NAGAR II _10508
		EDD I LONI	MANDOLA _150971
		EDD I LONI	PAVI _10230
		EDD I LONI	RAM PARK _10449
		EDD I LONI	RAMESHWAR PARK _10509

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD I LONI	TRONICA CITY A2_10450
		EDD I LONI	TRONICA CITY A5 A6_10448
		EDD I LONI	TRONICA CITY B2_10231
		EDD II LONI	CHAMAN VIHAR_15018
		EDD II LONI	DLF_10235
		EDD II LONI	LAL BAGH_10452
		EDD II LONI	NAI PURA_10233
		EDD II LONI	ROOP NAGAR-1_10234
		EDD II LONI	ROOP NAGAR-2_10451
		EDD III LONI	BHETA HAZIPUR_15015
		EDD III LONI	CHIRORI_150973
		EDD III LONI	DHARIPUR_150973
		EDD III LONI	FULERA_150973
		EDD III LONI	INDRAPRASTHA TILLA_10453
		EDD III LONI	KOYAL ENCLAVE_11517
		EDD III LONI	KRISHNA VIHAR KUTI_10454
		EDD III LONI	NAISATOLI_10236
		EDD III LONI	SIKHRANI_150973
BULANDSHAHAH	EDC I BULANDSHAHAH	EDD KHURJA	ARNIA_161111
		EDD KHURJA	CENTRAL PORTARY_10267
		EDD KHURJA	HAJARATPUR_15077
		EDD KHURJA	JARARA_161111
		EDD KHURJA	JHAMKA_161111
		EDD KHURJA	KALINDI KUNJ_10269
		EDD KHURJA	KANANI_161111
		EDD KHURJA	KHURJA JUNCTION_161111
		EDD KHURJA	PAHASU_10939
		EDD KHURJA	PALRA_161111
		EDD KHURJA	SANETA_161111
		EDD KHURJA	SEEKRI_11516
		EDD KHURJA	SUBSTATION 4_10268
		EDD KHURJA	SUBSTATION 5_10394
		EDD KHURJA	TELIYA GHAT_10270
		EDD VI BULANDSHAHAH	AULINA_161132
		EDD VI BULANDSHAHAH	AURANGABAD_11124
		EDD VI BULANDSHAHAH	BALKA_161132
		EDD VI BULANDSHAHAH	KHANPUR_11085
		EDD VI BULANDSHAHAH	LAKHAVATI_161132
		EDD VI BULANDSHAHAH	MAITHNA_161132
		EDD VI BULANDSHAHAH	MAMAN_161132
		EDD VI BULANDSHAHAH	PAVASARA_161132
		EDD VI BULANDSHAHAH	PIPALA_161132

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD VI BULANDSHAHAHAR	RAMPURA_161132
		EDD VI BULANDSHAHAHAR	SUJAPUR_161132
		EUDD BULANDSHAHAHAR	ANOOH SAHAR ROAD_10211
		EUDD BULANDSHAHAHAR	HYDEL COLONY_10210
		EUDD BULANDSHAHAHAR	NEEMKHERA_15030
		EUDD BULANDSHAHAHAR	NO 4 DM ROAD_10212
		EUDD BULANDSHAHAHAR	OLD JAIL ANSARI ROAD_10213
		EUDD BULANDSHAHAHAR	SABJI MANDI_10209
		EUDD BULANDSHAHAHAR	SABZI MANDI 2_15029
		EUDD BULANDSHAHAHAR	TANDA_15035
		EUDD BULANDSHAHAHAR	TRANSPORT NAGAR_15028
		EUDD BULANDSHAHAHAR	WALIPURA_10376
		EUDD BULANDSHAHAHAR	YAMUNA PURAM 2_10498
		EUDD BULANDSHAHAHAR	YAMUNA PURAM_10215
	EDC II BULANDSHAHAHAR	EDD I BULANDSHAHAHAR	2 JHOKABAD_10219
		EDD I BULANDSHAHAHAR	7 JHOKABAD_10397
		EDD I BULANDSHAHAHAR	DANKAUR ROAD_10367
		EDD I BULANDSHAHAHAR	FIBER GLASS_10399
		EDD I BULANDSHAHAHAR	GOPAL PUR (JOKHABAD)_10398
		EDD I BULANDSHAHAHAR	GULAOTHI 1_10119
		EDD I BULANDSHAHAHAR	GULAOTHI II_161121
		EDD I BULANDSHAHAHAR	IPL INDUSTRIAL AREA SIKANDRABAD_10496
		EDD I BULANDSHAHAHAR	S/S MURADABAD_161121
		EDD I BULANDSHAHAHAR	SANOTA_161121
		EDD I BULANDSHAHAHAR	SIKANDRABAD_10481
		EDD I BULANDSHAHAHAR	TEHSIL SIKANDRABAD_10396
		EDD SIANA	AHMEDANAGAR_161122
		EDD SIANA	BB NAGAR_11100
		EDD SIANA	BUGRASI_11088
		EDD SIANA	BUKLANA_161122
		EDD SIANA	KAANCH ROAD_161122
		EDD SIANA	KUCHESAR_161122
		EDD SIANA	LADPURA_161122
		EDD SIANA	LKT KHAD_161122
		EDD SIANA	MADONA_161122
		EDD SIANA	NAYABAANSH_161122
		EDD SIANA	RAINA_161122
		EDD SIANA	S/S DAULATPUR_161122
		EDD SIANA	S/S KAROTHI_161122
		EDD SIANA	S/S SAIDPUR_161122
		EDD SIANA	SATHLA_161122

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD SIANA	SHERPUR_161122
		EDD SIANA	SIANA_10156
		EDD V BULANDSHAHAHAR	BARAL_161123
		EDD V BULANDSHAHAHAR	BHOOR_161123
		EDD V BULANDSHAHAHAR	CHANDERU_161123
		EDD V BULANDSHAHAHAR	CHOLA_161123
		EDD V BULANDSHAHAHAR	FAKANA_161123
		EDD V BULANDSHAHAHAR	GANGROL_161123
		EDD V BULANDSHAHAHAR	KHURJA ROAD SKD_161123
		EDD V BULANDSHAHAHAR	MADHOPURA_161123
		EDD V BULANDSHAHAHAR	NEW KAKOD 2_11138
		EDD V BULANDSHAHAHAR	OLD KAKOD I_161123
		EDD V BULANDSHAHAHAR	WAIR_161123
	EDC III BULANDSHAHAHAR	EDD III BULANDSHAHAHAR	AHAMADGARH_161131
		EDD III BULANDSHAHAHAR	BANSURI_161131
		EDD III BULANDSHAHAHAR	CHITSON_161131
		EDD III BULANDSHAHAHAR	KELAWAN_161131
		EDD III BULANDSHAHAHAR	KUTUBPUR_161131
		EDD III BULANDSHAHAHAR	LALNER_161131
		EDD III BULANDSHAHAHAR	MAHARAJPUR_161131
		EDD III BULANDSHAHAHAR	MANGLAUR_161131
		EDD III BULANDSHAHAHAR	RONDA_161131
		EDD III BULANDSHAHAHAR	SAMANPUR_161131
		EDD III BULANDSHAHAHAR	SARABA_161131
		EDD III BULANDSHAHAHAR	SHIKARPUR RURAL_161131
		EDD III BULANDSHAHAHAR	SHIKARPUR_10107
		EDD III BULANDSHAHAHAR	SHIWALI_161131
		EDD III BULANDSHAHAHAR	UTRAWALI_161131
		EDD JAHANGIRABAD	ANUOOPSHAHR RURAL_161133
		EDD JAHANGIRABAD	ANUOOPSHAHR TEHSIL_11114
		EDD JAHANGIRABAD	CHANDOK_161133
		EDD JAHANGIRABAD	CHARORA_161133
		EDD JAHANGIRABAD	JADOL_161133
		EDD JAHANGIRABAD	JAHANGIRABAD RURAL_161133
		EDD JAHANGIRABAD	JINAI_161133
		EDD JAHANGIRABAD	KARANPUR_161133
		EDD JAHANGIRABAD	KARETHA_161133
		EDD JAHANGIRABAD	MANDI SAMITI_161133
		EDD JAHANGIRABAD	MOHARSA_161133
		EDD JAHANGIRABAD	PAYANAKALA_161133
		EDD JAHANGIRABAD	RAGHANATHPUR_161133
		EDD JAHANGIRABAD	SIRORA_161133

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD JAHANGIRABAD	SUBSTATION JHANGIRABAD TOWN_10485
		EDD JAHANGIRABAD	TAL BIBYANA_161133
		EDD JAHANGIRABAD	UNCHA GAON_161133
		EDD DEBAI	BAILON_161134
		EDD DEBAI	CHHATTARI_10946
		EDD DEBAI	CHIRORI_161134
		EDD DEBAI	DEBAI RURAL DHARAMPUR_161134
		EDD DEBAI	DEBAI TEHSIL_161134
		EDD DEBAI	DEBAI_10260
		EDD DEBAI	DHARAMPUR_161134
		EDD DEBAI	GALIBPUR_161134
		EDD DEBAI	JIROLI_161134
		EDD DEBAI	KALINADI CHHATTARI_161134
		EDD DEBAI	KARNAWAS_161134
		EDD DEBAI	KHUSALABAD_161134
		EDD DEBAI	KHUSHRUPUR_161134
		EDD DEBAI	NARAYANPUR_161134
		EDD DEBAI	NARORA_10947
		EDD DEBAI	SULTANPUR BILONI_161134
	EDC HAPUR	EDD I HAPUR	ANAND VIHAR_10378
		EDD I HAPUR	ATRADA_167341
		EDD I HAPUR	BABUGARH_10194
		EDD I HAPUR	DELHI ROAD_10196
		EDD I HAPUR	DHERKHERA R/L_167341
		EDD I HAPUR	DHIR KHERA INDUSTRIAL_10192
		EDD I HAPUR	JASROOP NAGAR_167341
		EDD I HAPUR	MODINAGAR ROAD_10191
		EDD I HAPUR	PATNA MURADPUR_10198
		EDD I HAPUR	PREET VIHAR_10193
		EDD I HAPUR	RAMPUR ROAD_10427
		EDD I HAPUR	S/S KAILLY_167341
		EDD I HAPUR	S/S LALPUR_167341
		EDD I HAPUR	SWARG ASHRAM ROAD_10426
		EDD I HAPUR	TOWN HALL_10197
		EDD I HAPUR	VAJHEELPUR_167341
		EDD II HAPUR	FAGAUTA_167342
		EDD II HAPUR	JINDAL NAGAR_167342
		EDD II HAPUR	KHERA_10162
		EDD II HAPUR	KHERA-II_167342
		EDD II HAPUR	KILHORA_167342
		EDD II HAPUR	MASSORIE_167342

ZONE	CIRCLE	DIVISION	SUB STATION
		EDD II HAPUR	MUKIMPUR_167342
		EDD II HAPUR	NIZAMPUR_167342
		EDD II HAPUR	PARTAPUR_10163
		EDD II HAPUR	PILKHUWA 1_10161
		EDD II HAPUR	PILKHUWA 2_15012
		EDD II HAPUR	PIPLA BANDPUR PABLA_15011
		EDD II HAPUR	S/S DHULANA_167342
		EDD II HAPUR	SAMANA_167342
		EDD II HAPUR	SAPNAWAT_167342
		EDD II HAPUR	TEXTILE CENTER_15078
		EDD II HAPUR	UBARPUR_167342
		EDD II HAPUR	UPSIDC COCA COLA_167342
		EDD II HAPUR	UPSIDC II_167342
		EDD GARH MUKHTESHWAR	ALAMNAGAR_167343
		EDD GARH MUKHTESHWAR	BAHADURGARH_167343
		EDD GARH MUKHTESHWAR	BRIJGHAT_167343
		EDD GARH MUKHTESHWAR	DATTIYANA_167343
		EDD GARH MUKHTESHWAR	DEHRA RAMPUR_167343
		EDD GARH MUKHTESHWAR	DHANPURA_167343
		EDD GARH MUKHTESHWAR	GARH 1ST_167343
		EDD GARH MUKHTESHWAR	GARMUKHTESHWAR-II_10208
		EDD GARH MUKHTESHWAR	GOHARA_167343
		EDD GARH MUKHTESHWAR	HARORA_167343
		EDD GARH MUKHTESHWAR	JHADHINA_167343
		EDD GARH MUKHTESHWAR	KAKODI_167343
		EDD GARH MUKHTESHWAR	KOTA HARNATHPUR_167343
		EDD GARH MUKHTESHWAR	LODHIPUR_167343
		EDD GARH MUKHTESHWAR	RAMPURA_167343
		EDD GARH MUKHTESHWAR	SIMBHOALI_167343
		EDD GARH MUKHTESHWAR	UPEDA_167343

3.3.3 Consumer Details

Energy Consumption with type of customer is given in the table.

Consumer category	Total Number of connections (Nos)	% of number of connections	Total Connected Load (MW)	% of connected load	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore
Residential	6290631.00	83.35	13697287.54	57.04	8148.04	8532.92
Agricultural	505168.00	6.69	3213055.68	13.38	764.37	509.08

Commercial/Industrial-LT	654195.00	8.67	2741365.77	11.42	3631.51	3694.48
Commercial/Industrial-HT	9736.00	0.13	3682998.93	15.34	7706.04	7669.57
Others	87322.00	1.16	678664.84	2.83	1650.53	1654.10
TOTAL	7547052.00	100.00	24013372.76	100.00	21900.48	22060.14

3.4. Electrical Infrastructure and assets Voltage Wise

The input energy, consumption, transmission losses and key infrastructure details of the PVVNL are summarized in table below:

EHT sale	526
Net input energy (received at DISCOM periphery or at distribution point)-(MU)	39107.55
Is 100% metering available at 66/33 kV (Select yes or no from list)	Yes
Is 100% metering available at 11 kV (Select yes or no from list)	Yes
% of metering available at DT	9%
% of metering available at consumer end	96%
No of feeders at 66kV voltage level	0
No of feeders at 33kV voltage level	1
No of feeders at 11kV voltage level	1
No of LT feeders' level	0
Line length (ckt. km) at 66kV voltage level	0
Line length (ckt. km) at 33kV voltage level	14412
Line length (ckt. km) at 11kV voltage level	110572
Line length (km) at LT level	199036
Length of Aerial Bunched Cables	82753.722
Length of Underground Cables	3398.946
HT/LT ratio	0.6279

3.4.1. Metering Details

The status of meter installs in PVVNL as on 31-03-24 are given in the below tables:

Sl. No.	Parameters	66kV and above	33kV	11/22kV	LT
i.	Number of conventional metered consumers	18.00	358.00	2808.00	7017713.00
ii	Number of consumers with 'smart' meters	0.00	0.00	0.00	188867.00

iii	Number of consumers with 'smart prepaid' meters	0.00	0.00	0.00	0.00
iv	Number of consumers with 'AMR' meters	0.00	0.00	6775.00	7828.00
v	Number of consumers with 'non-smart prepaid' meters	0.00	0.00	0.00	0.00
vi	Number of unmetered consumers	0.00	0.00	0.00	332644.00
vii	Number of total consumers	18.00	358.00	9583.00	7547052.00

3.4.2. Distribution Transformer (DT) details

The details of distribution transformer in PVVNL as on 31-03-2023 are given in the below tables:

Sl. No.	Parameters	66kV and above	33kV	11/22kV	LT
i.	Number of conventionally metered Distribution Transformers	0.00	0.00	0.00	56294.00
ii	Number of DTs with communicable meters	0.00	0.00	0.00	0.00
iii	Number of unmetered DTs	0.00	0.00	0.00	593418.00
iv	Number of total Transformers	0.00	0.00	0.00	649712.00

3.4.3. Feeder Details

The details of distribution line in PVVNL as on 31-03-2023 are given in the below table:

Parameters	66kV and above	33kV	11/22kV	LT
Number of metered feeders	1.00	1.00	2148.00	0.00
Number of feeders with communicable meters	0.00	0.00	4913.00	0.00
Number of unmetered feeders	0.00	0.00	0.00	0.00
Number of total feeders	1.00	1.00	7061.00	0.00

3.4.4. Energy Flow Details

Energy flow details for FY 2022-23 are given in the below table:

Energy Input Details	Formula	UoM	Value
Input Energy Purchase (From Generation Sourced)	A	MU	-----

Net Input Energy (at DISCOM Periphery after adjusting the transmission losses and energy traded)	B	MU	39107.84
Total Energy billed (is the Net energy billed, adjusted for energy traded)	C	MU	34132.91
Transmission and Distribution (T&D) loss details	D	MU	4974.93
	$E=D/B \times 100$	%	12.72 %

3.4.5. Pattern of Energy Distribution

Power Purchase:

1. PVVNL informed that the procurement of power is done by UPPCL centrally. Information Related to Input Energy Purchase (From Generation Source) is not available with PVVNL, and the same is left blank in the Form 1 data for all four quarters and the Annual Form. Only the Net Input Energy at DISCOM (Periphery after adjusting the transmission losses and energy traded), data is provided by PVVNL.
2. Due to non-availability of data of Energy Traded, it is not possible to verify the Net Input Energy data, as the verification cannot be done unless the traded energy data is provided. Also, during the audit, we discussed as to how the Net Input Energy is calculated without the data of Input Energy Purchase (From Generation Source), for which PVVNL has not provided any information



Net Input Energy:

During the analyzed period, PVVNL Purchased a maximum energy of 4297.81 million units. (MUs) in June 2023, while the least energy of 2408.90 MUs was purchased in FEB 2024. This show that the company's energy purchased varies considerably from month to month irrespective of the seasonal impact.

Energy Billed:

The energy billed by PVVNL showed a minor increasing trend from April 2023 to March 2024, with a slight bump in month of July & August. This indicated that the company's energy consumption has gradually over the analyzed period.

The Chart below shows PVVNL energy Input & Billed Pattern from April 2023 to March 2024:

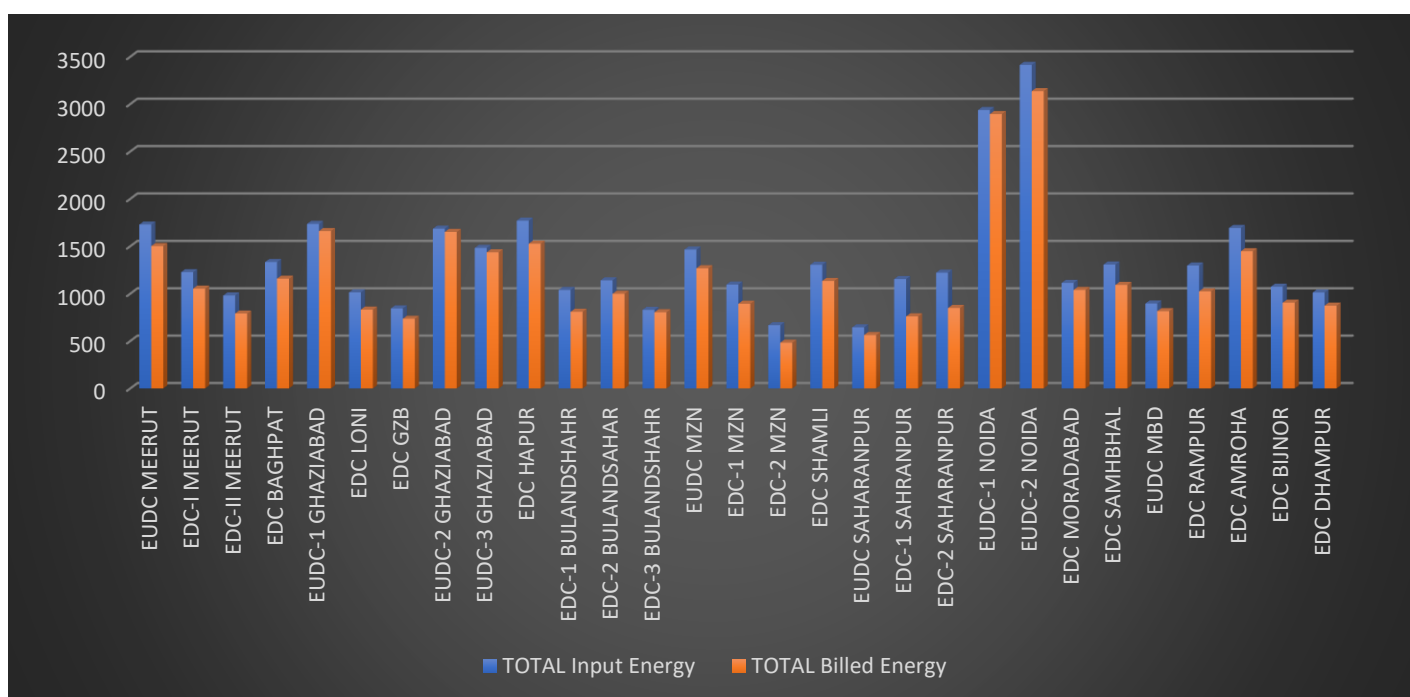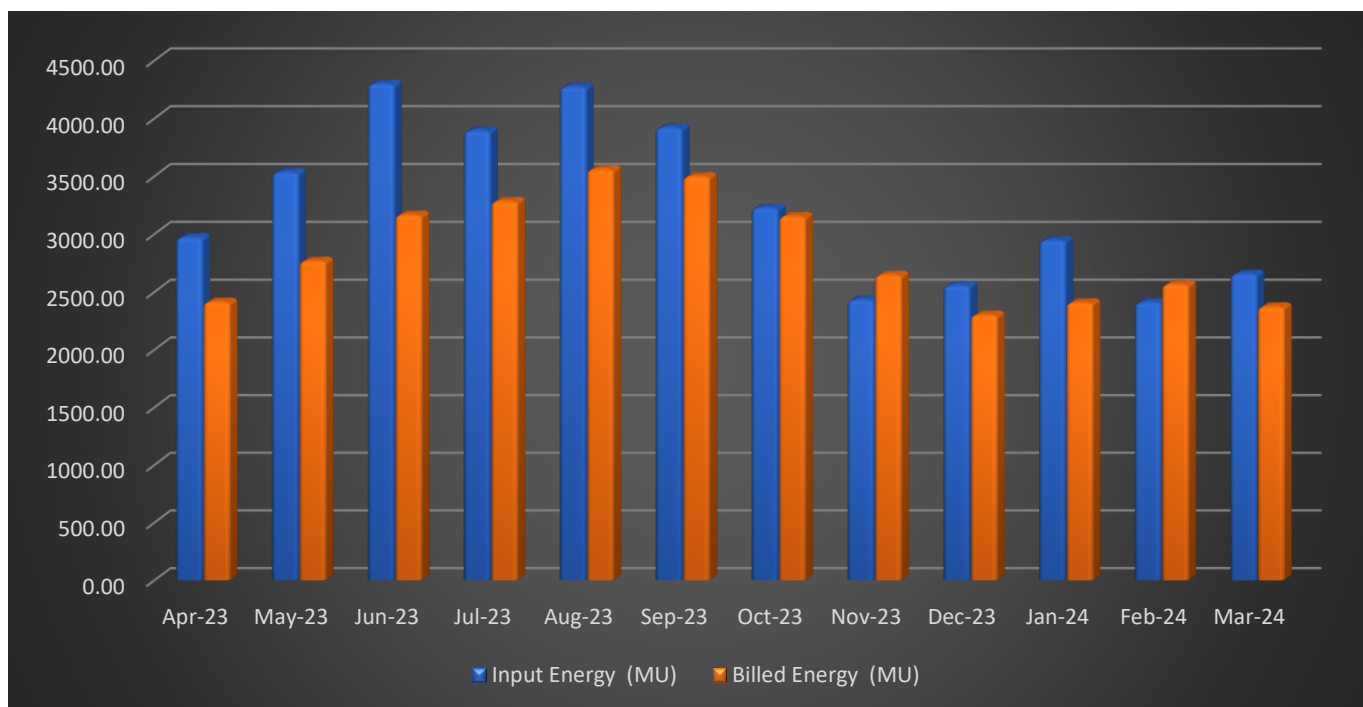

In conclusion, PVVNL net energy input pattern show considerable variation from month to month. While the maximum energy was input in month of June 2023, the least energy was input in Feb 2024, indicating a gradual increase in energy consumption. The chart shown that the energy input fluctuates considerably, which pose challenges for the company in managing its energy may supply and demand.

The month wise break up of input energy (MU) parameter for all the circle/Zone is given below:

Month Wise Input Energy For FY 2023-24												
CIRCLE /ZONE	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
EUDC MEERUT	125.91	158.37	191.77	190.02	207.00	186.16	135.80	101.69	107.15	118.23	97.20	109.71
MEERUT ZONE-1	125.91	158.37	191.77	190.02	207.00	186.16	135.80	101.69	107.15	118.23	97.20	109.71
EDC-I MEERUT	91.75	112.37	133.59	119.89	139.25	124.76	105.06	73.67	78.16	92.26	72.84	83.28
EDC-II MEERUT	70.50	93.59	115.44	86.95	105.79	101.47	89.78	62.67	63.94	68.76	55.99	65.65
EDC BAGHPAT	91.36	116.59	155.54	118.42	160.13	148.01	128.89	81.70	81.66	91.24	72.77	86.97
MEERUT ZONE-2	253.61	322.55	404.58	325.26	405.17	374.23	323.72	218.04	223.76	252.26	201.59	235.89
EUDC-1 GHAZIABAD	128.91	154.79	179.95	184.26	197.47	184.37	141.21	104.43	109.60	132.34	107.25	111.01
GHAZIABAD ZONE-1	128.91	154.79	179.95	184.26	197.47	184.37	141.21	104.43	109.60	132.34	107.25	111.01
EDC LONI	77.18	89.24	103.75	102.90	117.30	106.47	83.70	61.50	64.86	75.52	63.57	67.85
EDC GZB	62.75	77.16	90.33	85.62	98.21	86.56	68.74	51.07	53.83	63.89	50.62	55.88
GHAZIABAD ZONE-2	139.93	166.39	194.09	188.53	215.52	193.04	152.43	112.57	118.69	139.41	114.18	123.72
EUDC-2 GHAZIABAD	126.41	151.72	177.18	182.96	191.24	173.18	137.18	104.07	105.63	126.91	103.22	105.20
EUDC-3 GHAZIABAD	118.02	138.05	151.26	156.33	161.37	157.56	122.72	89.95	91.49	101.47	88.57	106.37
GHAZIABAD ZONE-3	244.44	289.77	328.44	339.29	352.62	330.73	259.89	194.02	197.12	228.38	191.78	211.57
EDC HAPUR	135.06	162.64	190.50	178.64	200.45	175.14	141.75	107.11	112.58	131.63	104.67	130.35
EDC-1 BULANDSHAHR	75.39	93.01	113.76	115.63	126.15	103.82	82.11	58.17	64.76	78.24	61.36	66.71
EDC-2 BULANDSAHAR	87.61	98.15	118.38	113.79	125.40	119.29	100.49	70.78	76.72	77.14	73.58	79.03

Month Wise Input Energy For FY 2023-24

CIRCLE /ZONE	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
EDC-3 BULANDSHAHR	62.16	79.03	104.52	99.75	107.63	75.81	60.63	42.11	47.98	53.39	44.12	52.21
BULANDSAHAR ZONE	360.21	432.82	527.16	507.80	559.63	474.05	384.98	278.17	302.04	340.39	283.72	328.30
EUDC MZN	115.38	130.05	153.39	133.25	154.86	150.67	127.73	100.36	91.76	114.10	96.78	96.70
EDC-1 MZN	85.50	96.98	119.52	88.99	104.57	99.18	93.24	75.86	81.34	92.72	75.47	83.06
EDC-2 MZN	52.07	64.27	78.01	53.45	67.58	65.69	59.80	41.53	45.44	52.25	40.62	46.15
EDC SHAMLI	100.08	128.50	157.48	110.26	145.30	141.46	113.27	76.81	80.60	91.98	75.49	83.87
MUZAFFARNAGAR ZONE	353.03	419.80	508.40	385.94	472.30	457.00	394.04	294.55	299.14	351.05	288.36	309.78
EUDC SAHARANPUR	47.62	58.05	68.87	68.29	73.82	68.87	47.80	38.78	40.67	53.09	39.00	39.81
EDC-1 SAHRANPUR	88.98	99.40	126.09	99.67	108.87	108.75	85.72	78.05	89.71	106.00	79.18	83.59
EDC-2 SAHARANPUR	91.87	108.16	147.24	102.30	111.08	121.63	93.25	78.55	89.48	106.89	82.68	87.99
SAHARANPUR ZONE	228.47	265.61	342.21	270.26	293.77	299.25	226.77	195.37	219.86	265.98	200.86	211.39
EUDC-1 NOIDA	227.53	261.99	300.91	305.54	319.02	302.04	247.90	185.63	190.88	213.73	179.25	202.93
EUDC-2 NOIDA	258.15	301.71	343.81	372.65	380.31	351.00	283.45	210.74	220.84	255.90	211.38	223.58
NOIDA ZONE	485.69	563.70	644.72	678.19	699.33	653.04	531.36	396.37	411.72	469.63	390.63	426.51
EDC MORADABAD	83.98	99.02	127.69	115.66	120.85	101.52	85.82	68.85	73.62	83.25	73.68	79.27
EDC SAMHBHAL	103.49	116.37	145.26	136.82	143.30	109.90	95.78	81.09	88.98	101.70	83.59	100.41
EUDC MBD	66.38	82.73	99.94	98.37	102.61	93.64	70.59	51.52	53.74	69.64	51.31	55.49
EDC RAMPUR	95.51	115.21	142.29	134.96	137.95	120.43	99.80	78.92	91.67	109.03	85.84	85.26

Month Wise Input Energy For FY 2023-24

CIRCLE /ZONE	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
MORADABADZONE	349.35	413.33	515.18	485.81	504.70	425.49	351.99	280.38	308.00	363.62	294.42	320.42
EDC AMROHA	132.62	155.57	205.75	149.74	169.16	141.77	144.76	109.49	115.92	129.77	110.05	128.94
EDC BIJNOR	85.44	96.81	130.06	89.37	96.52	103.56	99.17	79.42	74.65	79.85	67.48	71.30
EDC DHAMPUR	83.90	93.06	125.52	98.16	98.91	96.78	79.83	66.13	68.07	75.27	61.37	65.96
GAJRAULA ZONE	301.96	345.44	461.33	337.26	364.58	342.10	323.75	255.03	258.64	284.90	238.91	266.20

The month wise break up of billed energy (MUs) parameter for all the circle/zone is given below:

Month Wise Billed Energy For FY 2023-24

Zone/Circle	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
EUDC MEERUT	96.63	115.60	143.89	164.39	160.87	168.45	148.55	112.23	92.71	93.98	110.42	94.56
MEERUT ZONE-1	96.63	115.60	143.89	164.39	160.87	168.45	148.55	112.23	92.71	93.98	110.42	94.56
EDC-I MEERUT	75.50	80.32	100.13	96.90	114.89	109.30	96.81	81.58	67.65	74.01	80.72	75.36
EDC-II MEERUT	57.30	61.97	75.72	67.71	81.07	79.71	70.36	63.39	56.52	57.13	61.54	57.92
EDC BAGHPAT	82.97	87.62	137.32	93.70	120.23	116.79	97.88	85.16	81.14	81.49	85.49	87.99
MEERUT ZONE-2	215.77	229.90	313.18	258.31	316.19	305.79	265.05	230.13	205.30	212.63	227.74	221.27
EUDC-1 GHAZIABAD	106.10	132.78	152.68	171.52	176.73	178.48	167.80	131.31	101.40	110.97	125.67	105.01
GHAZIABAD ZONE-1	106.10	132.78	152.68	171.52	176.73	178.48	167.80	131.31	101.40	110.97	125.67	105.01
EDC LONI	54.35	68.96	71.01	78.94	81.68	91.59	82.83	68.50	58.33	56.41	58.60	60.47
EDC GZB	47.25	58.40	58.99	72.43	76.64	69.72	64.01	54.71	45.22	49.19	51.51	86.61

Month Wise Billed Energy For FY 2023-24

Zone/Circle	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
GHAZIABAD ZONE-2	101.61	127.36	130.00	151.37	158.33	161.31	146.84	123.21	103.55	105.61	110.12	147.07
EUDC-2 GHAZIABAD	110.92	138.39	150.76	176.49	179.15	174.32	163.24	130.30	99.97	107.26	119.02	101.06
EUDC-3 GHAZIABAD	98.52	132.38	136.77	153.83	146.56	156.60	138.93	100.03	86.47	88.46	109.71	87.81
GHAZIABAD ZONE-3	209.44	270.78	287.53	330.33	325.72	330.93	302.17	230.34	186.44	195.72	228.73	188.87
EDC HAPUR	116.28	122.25	159.48	135.31	150.86	163.64	134.90	115.25	97.57	108.23	113.58	109.43
EDC-1 BULANDSHAHR	53.16	66.85	86.91	77.91	91.39	79.04	70.31	58.06	52.60	57.94	61.94	52.25
EDC-2 BULANDSAHAR	79.78	82.83	103.26	88.37	102.31	109.89	86.28	74.82	67.09	69.58	70.55	64.12
EDC-3 BULANDSHAHR	63.11	72.27	94.00	83.09	94.99	71.07	68.29	53.04	52.11	49.73	49.54	52.05
BULANDSAHAR ZONE	312.33	344.19	443.63	384.69	439.54	423.64	359.79	301.17	269.37	285.48	295.61	277.85
EUDC MZN	102.73	109.47	116.13	118.14	118.71	126.38	120.03	105.70	78.90	81.36	101.19	89.08
EDC-1 MZN	67.85	70.76	74.73	75.11	87.27	85.34	75.57	74.64	65.65	73.06	76.40	67.02
EDC-2 MZN	35.27	42.55	48.45	42.94	49.57	44.55	41.86	34.79	35.11	36.35	35.01	36.01
EDC SHAMLI	83.16	91.00	92.09	98.20	151.49	107.83	100.70	85.08	77.24	85.87	81.05	80.66
MUZAFFARNAGAR ZONE	289.01	313.77	331.40	334.40	407.04	364.11	338.15	300.21	256.90	276.63	293.65	272.77
EUDC SAHARANPUR	38.79	50.00	52.89	57.92	57.26	58.29	53.35	39.44	35.05	39.88	44.10	36.88
EDC-1 SAHRANPUR	50.28	58.45	59.90	60.82	80.72	79.36	62.82	55.12	53.63	68.56	66.18	64.49
EDC-2 SAHARANPUR	68.95	68.06	68.51	67.61	80.28	85.69	71.58	64.03	66.80	71.13	71.91	64.32
SAHARANPUR ZONE	158.01	176.51	181.31	186.34	218.25	223.33	187.75	158.60	155.47	179.57	182.19	165.70
EUDC-1 NOIDA	192.33	228.62	264.28	295.52	303.27	312.69	286.87	243.47	189.55	194.23	203.73	180.49
EUDC-2 NOIDA	211.69	244.56	269.56	303.40	331.57	331.34	309.39	257.01	202.93	215.22	247.71	212.16
NOIDA ZONE	404.01	473.18	533.84	598.92	634.85	644.03	596.26	500.48	392.48	409.45	451.44	392.65

Month Wise Billed Energy For FY 2023-24

Zone/Circle	Apr-23	May-23	Jun-23	Jul-23	Aug-23	Sep-23	Oct-23	Nov-23	Dec-23	Jan-24	Feb-24	Mar-24
EDC MORADABAD	74.75	89.23	97.35	105.00	105.46	98.01	93.64	79.85	79.17	71.80	71.56	73.06
EDC SAMHBHAL	73.23	82.94	96.07	121.90	114.58	100.65	91.26	82.42	88.93	84.84	79.09	76.11
EUDC MBD	53.42	64.75	81.93	89.01	90.77	89.07	80.29	59.91	46.75	51.72	60.48	47.27
EDC RAMPUR	69.27	85.13	87.53	98.94	98.88	99.90	97.29	80.06	80.83	78.38	76.77	71.17
MORADABADZONE	270.66	322.06	362.87	414.85	409.68	387.62	362.48	302.23	295.68	286.73	287.90	267.61
EDC AMROHA	118.29	114.24	127.66	127.59	140.49	124.40	123.15	114.75	113.98	112.63	115.86	114.68
EDC BIJNOR	68.80	74.49	83.76	79.99	83.58	88.03	78.79	77.96	63.45	70.65	70.93	64.24
EDC DHAMPUR	62.14	71.90	74.12	80.53	88.24	97.55	76.80	63.77	64.75	67.78	65.12	60.10
GAJRAULA ZONE	249.23	260.63	285.54	288.11	312.30	309.98	278.74	256.48	242.19	251.06	251.91	239.01

3.4.7. Salient Features

a) Vision

To Be India's Best DISCOM by providing reliable and quality power at affordable rates.

b) Mission

- Provide Power to all by implementing state-of-art enabled distribution network.
- Be a part of socio-economics development of state by enlightening lives and empowering progress.
- Earn Consumer's delight through excellence in delivering services at par with consumer expectations.
- Maximize sustainable value to all stakeholders through IT enable solutions and smart technology.
- Help creating conducive environment for attracting investment.
- Enable and take care of employees for unleashing their full potential, team work, collaboration, collective wisdom and productivity.

c) Core Values

- Safety
- Consumer's delight & Care
- Ethics
- Integrity
- Responsibility
- Accountability
- Agility

3.5. Energy Conservation Measures

Energy conservation is a critical issue in today's world, as the demand for energy continues to increase while the resources available to produce it are finite. The energy conservation measures that have already been taken and propose some measures for the future are explained below.

Energy Conservation Measures taken by the DISCOM:

Several energy conservation measures have already been implemented to reduce energy consumption and promote sustainable energy use. Some of these measures are:

1. **Energy Management Systems:** The Company has implemented energy management systems to monitor and control energy consumption, identify areas of energy waste, and optimize energy usage.
2. **Renewable Energy:** The Company has increased the use of renewable energy sources, such as solar power, to reduce reliance on fossil fuels and reduce carbon emissions.
3. **Energy Audits:** Regular energy audits are conducted to identify energy waste and implement measures to reduce it.

Propose Energy Conservation Measure for the Future:

1. Installation of Smart Meters.
2. Installation of Automatic Power factor controller (Capacitor Bank) at newly constructed PSS.
3. System improvement & automation.
4. Replacing worm out /under sized conductors.
5. Increase in HT/LT Ratio.
6. Preventive & Periodic maintenance of line & transformer.
7. Load balancing of distribution transformers.
8. Renewable Energy: The Company has increased the use of renewable energy sources, such as solar power, to reduce reliance on fossil fuels and reduce carbon emissions.

4. Energy Flow Analysis


4.1. Energy Flow Across 5 Service Levels

The Energy at different voltage levels and the losses at different levels are shown in below table long-term energy, short-term energy and renewable energy wise details are given below:

Sl. No.	DISCOM	Input (MU)	Sale (MU)	Loss (MU)	Loss %
1	LT				
2	11kV	34,990.000	30046.834	4943.512	14.128%
3	33kV	3,590.000	3560.037	30.338	0.844%
4	>33kV	527.000	526.041	0.787	0.149%

Note: - DT Metering at LT level as required in the above format is not available due to the fact that the complete DT metering is not done yet. Complete DT metering will be taken care under RDSS.

Energy Flow Diagram

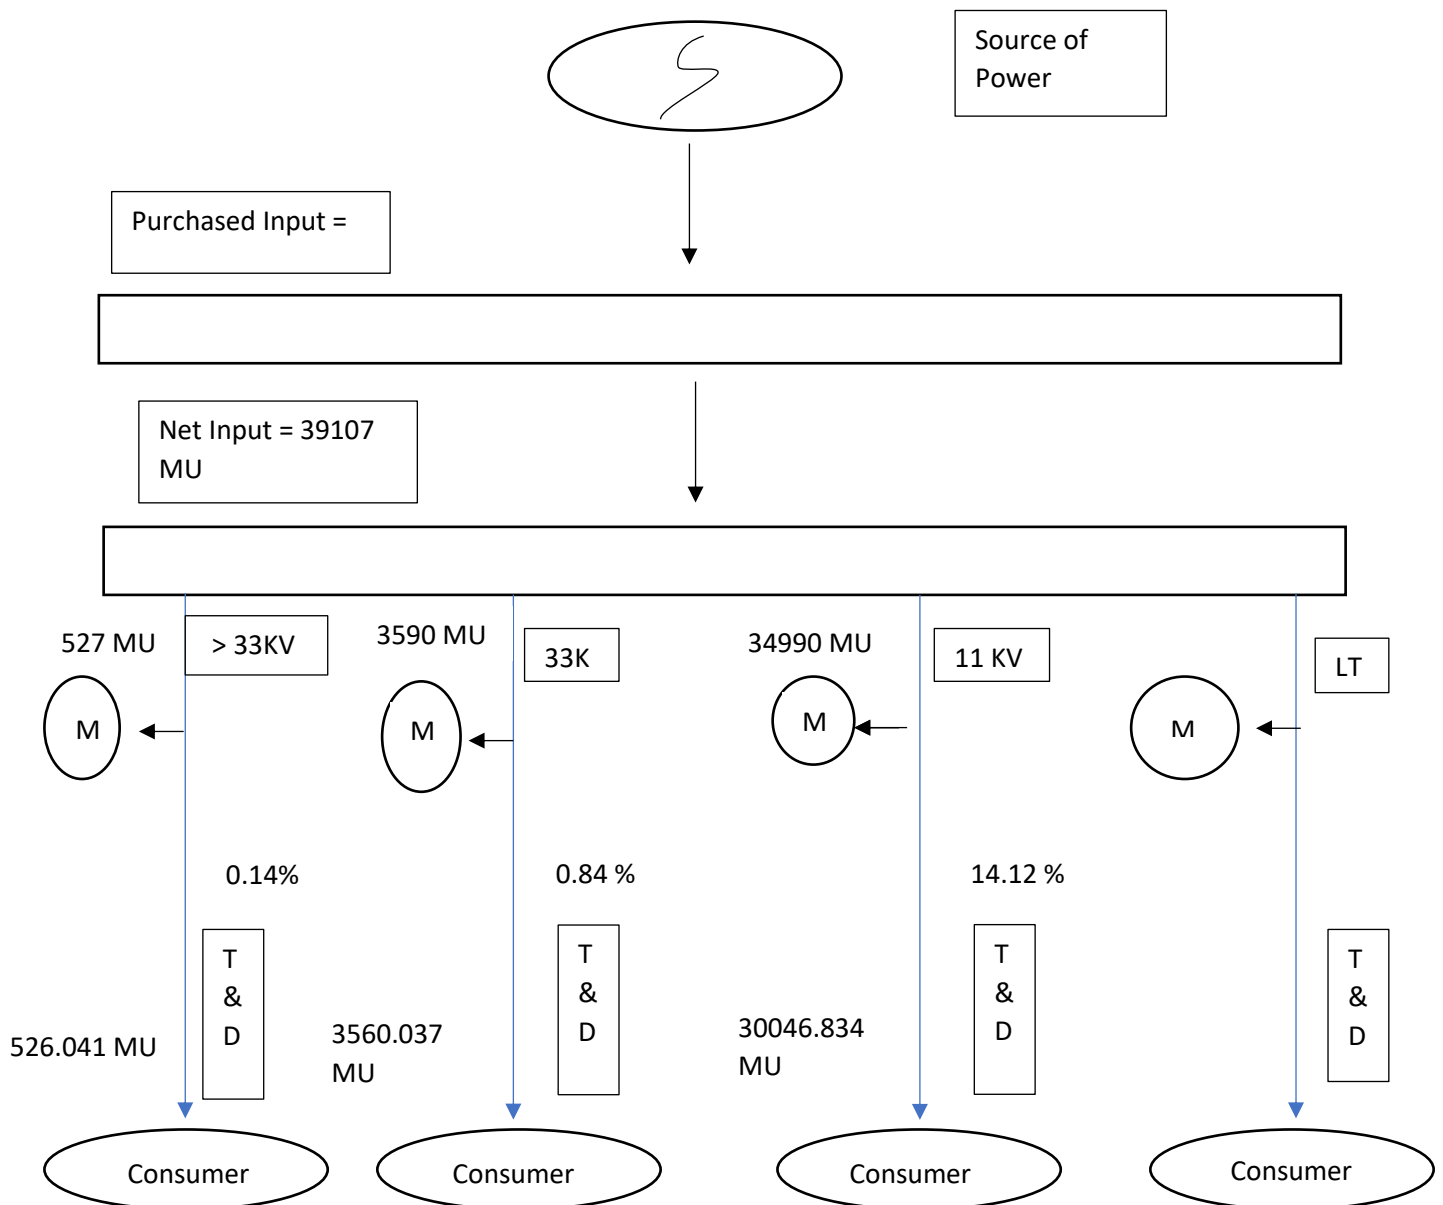

The distribution transformers in PNVNL are not equipped with meters, which prevents the measurement of input power on the LT line. As a result, the Transmission and Distribution (T&D) losses on the LT line cannot be calculated.

4.2. Validation of Metered Data

a) Validation of feeder data: Based on data available in 11 kV Feeder meter at substation for a sample size of 10% for which documentary evidence to be captured in the audit report.

b) Validation of energy flow data and losses: Based on field survey as per the following sample size:

- Min. 10 or 1% (whichever is higher) of DISCOM's input energy metering points between Transmission and 66kV/33kV/11kV distribution feeders by checking functional and communication status of meters etc.
- For all Divisions with AT&C losses greater than 25% or at-least 1/3 of the total Divisions of DISCOM, verify:
- Total of min. 10 or 1% of metering points (whichever is higher) between 220-132- 110- 66 /33 kV outgoing and 22kV-11kV-6.6kV-3kV incoming feeders/ direct end consumer by checking functional and communication status of meters.
- In an Urban High Loss Division, check 5 or 1% of Metering points (whichever is higher) at DTs where communicable meters were already install PVVNL under other schemes such as R-APDRP and IPDS.
- Total of min. of 10 or 1% of metering points (whichever is higher) between 11kV/6.6kV feeders and DTs by checking functional and communication status of meters, foot survey of feeder to check for thefts/ hooking etc.
- Verify metering and connection status of min. of 10 or 2% consumers of the Division (whichever is higher) of the following category of consumers – Agriculture (Metered and Un-metered), Govt. category connection (ULB, RLB etc.), and LT Industrial

4.3. Validation of Energy Flow Data and Losses

The Energy at different voltage levels and the losses at different levels are shown in below table Procurement of Power is done by UPPCL centrally. Information related to quantum purchase for PVVNL is not available at Discom HQ.

3	Voltage level	Particulars	MU
i	66kV and above	Long-Term Conventional	39,108
		Medium Conventional	0
		Short Term Conventional	
		Banking	0
		Long-Term Renewable energy	
		Medium and Short-Term RE	0
		Captive, open access input	
		Sale of surplus power	
		Quantum of inter-state transmission loss	
		Power procured from inter-state sources	39,108
		Power at state transmission boundary	39,108

ii	33kV	Long-Term Conventional	
		Medium Conventional	0
		Short Term Conventional	0
		Banking	0
		Long-Term Renewable energy	0
		Medium and Short-Term RE	0
		Captive, open access input	0
		Sale of surplus power	0.000
		Quantum of intra-state transmission loss	0
		Power procured from intra-state sources	0
iii		Input in DISCOM wires network	39,108
iv	33 kV	Renewable Energy Procurement	
		Small capacity conventional/ biomass/ hydro plants Procurement	
		Captive, open access input	
v	11 kV	Renewable Energy Procurement	
		Small capacity conventional/ biomass/ hydro plants Procurement	
		Sales Migration Input	
vi	LT	Renewable Energy Procurement	
		Sales Migration Input	
vii		Energy Embedded within DISCOM wires network	0
viii		Total Energy Available/ Input	39,108
4	Voltage level	Energy Sales Particulars	MU
i	LT Level	DISCOM' consumers	
		Demand from open access, captive	
		Embedded generation used at LT level	
		Sale at LT level	0
		Quantum of LT level losses	0
		Energy Input at LT level	
ii	11 kV Level	DISCOM' consumers	30,047
		Demand from open access, captive	
		Embedded generation at 11 kV level used	
		Sales at 11 kV level	30,047
		Quantum of Losses at 11 kV	4,944
		Energy input at 11 kV level	34,990
iii	33 kV Level	DISCOM' consumers	3,560
		Demand from open access, captive	

		Embedded generation at 33 kV or below level	
		Sales at 33 kV level	3,560
		Quantum of Losses at 33 kV	30
		Energy input at 33kV Level	3,590
iv	> 33 kV	DISCOM' consumers	526.0408454
		Demand from open access, captive	
		Cross border sale of energy	
		Sale to other DISCOMs	
		Banking	
		Energy input at > 33kV Level	527
		Sales at 66kV and above (EHV)	526
Total Energy Requirement			39,108
Total Energy Sales			34,133

5. Loss And Subsidy Computation

5.1. Energy Accounts Analysis for Previous Year

Previous cycle of audit is energy accounting base on the notification No. 18/1/BEE/DISCOM/2021 from Bureau of Energy Efficiency dated 6th October 2021.

a) Summary of AT&C Losses

The AT&C losses for the FY 2021-22 & for the FY 2022-23 are as Show Below

Sl. No.	Energy Input Details	UoM	F.Y. 2022-23	F.Y. 2023-24
1	Input Energy Purchase (From Generation Source)	MU	-----	-----
2	Net Input Energy (at DISCOM Periphery after adjusting the transmission losses and energy traded)	MU	39043.25	39107.84
3	Total Energy bill PVVNL (is the Net Energy bill PVVNL, adjusted for energy traded)	MU	33437.01	34132.91
4	Transmission and distribution (T&D) loss details	MU	5606.24	4974.93
		%	14.36 %	12.72%
5	Collection Efficiency	%	97.33 %	100.73%
6	Aggregate Technical & Commercial Loss	%	16.65 %	12.08%

b) Circle Wise T&D and AT&C Losses

The Circle wise connected load & input energy, transmission & distribution losses and AT&C loss is given in following table:


Sl. No.	Name of Circle	Total Number of Connection (Nos)	Total Connected Load(MW)	Input Energy (MU)	Total Billed Energy (MU)	T & D loss (MU)	T & D loss (%)	AT & C loss (%)
1	EUDC MEERUT	347855	1152496.31	1728.996	1502.28	226.716	13.11%	12.48%
2	EDC I MEERUT	259190	801195.15	1226.863	1053.179	173.684	14.16%	4.81%
3	EDC II MEERUT	234520	613048.86	980.529	790.328	190.201	19.40%	13.97%
4	EDC BAGHPAT	272814	764720.39	1333.262	1157.771	175.491	13.16%	18.80%
5	EUDC I GHAZIABAD	205683	983861.04	1509.809	1449.174	60.635	4.02%	3.44%
6	EUDC II GHAZIABAD	240524	1292104.69	1868.106	1820.947	47.159	2.52%	2.12%
7	EUDC III GHAZIABAD	218439	1013558.96	1525.693	1477.31	48.383	3.17%	1.74%
8	EDC LONI	249985	714589.71	1013.824	831.68	182.144	17.97%	16.11%
9	EDC GHAZIABAD	174693	539548.99	844.665	734.696	109.969	13.02%	11.19%

Sl. No.	Name of Circle	Total Number of Connection (Nos)	Total Connected Load(MW)	Input Energy (MU)	Total Billed Energy (MU)	T & D loss (MU)	T & D loss (%)	AT & C loss (%)
10	EDC HAPUR	307129	1018683.66	1770.492	1526.782	243.71	13.77%	15.15%
11	EDC I BULANDSHAHAHAR	234948	596874.68	1039.094	808.349	230.745	22.21%	23.67%
12	EDC II BULANDSHAHAHAR	186231	632190.54	1140.354	998.898	141.456	12.40%	9.60%
13	EDC III BULANDSHAHAHAR	244547	538608.95	829.329	803.275	26.054	3.14%	3.24%
14	EUDC MUZAFFARNAGAR	254707	794165.04	1465.009	1267.809	197.2	13.46%	13.94%
15	EDC I MUZAFFARNAGAR	178169	570758.04	1096.433	893.396	203.037	18.52%	15.40%
16	EDC II MUZAFFARNAGAR	139225	367403.42	666.857	482.467	184.39	27.65%	21.41%
17	EDC SHAMLI	276325	792139.68	1305.083	1134.375	170.708	13.08%	11.72%
18	EUDC SAHARANUR	150722	424690.08	644.668	563.848	80.82	12.54%	8.73%
19	EDC I SAHARANPUR	294359	678838.56	1153.998	760.325	393.673	34.11%	36.01%
20	EDC II SAHARANPUR	251526	650016.02	1221.114	848.866	372.248	30.48%	29.81%
21	EUDC-1 NOIDA	132026	1622260.22	2937.354	2895.051	42.303	1.44%	0.27%
22	EUDC-2 NOIDA	270314	1970375.27	3413.526	3136.538	276.988	8.11%	9.54%
23	EDC MORADABAD	418347	843692.23	1113.212	1038.863	74.349	6.68%	10.59%
24	EDC SAMBHAL	338207	784426.92	1306.673	1092.02	214.653	16.43%	19.75%
25	EDC AMROHA	363112	859475.8	1693.529	1447.729	245.8	14.51%	14.02%
26	EUDC MORADABAD	207867	690965.52	895.948	815.36	80.588	8.99%	9.43%
27	EDC RAMPUR	386773	800977.88	1296.858	1024.143	272.715	21.03%	19.09%
28	EDC BIJNOR	289857	135359.68	1073.618	904.657	168.961	15.74%	13.33%
29	EDC DHAMPUR	418958	843220.26	1012.944	872.795	140.149	13.84%	10.76%

5.2. Energy Accounts Analysis and Performance in Current Year (Based on Quarterly Data)

5.2.1 Month Wise Input Energy and Billed Energy Details

Sl. No.	Months	Input Energy (MU)	Billed Energy (MU)
1	Apr-23	2971.48	2412.82
2	May-23	3532.57	2766.76
3	Jun-23	4297.81	3165.86
4	Jul-23	3892.62	3283.22
5	Aug-23	4272.09	3559.50
6	Sep-23	3919.44	3497.67
7	Oct-23	3225.94	3153.59
8	Nov-23	2430.60	2646.38
9	Dec-23	2555.72	2301.50
10	Jan-24	2946.18	2407.83
11	Feb-24	2408.90	2565.38
12	Mar-24	2654.49	2372.39

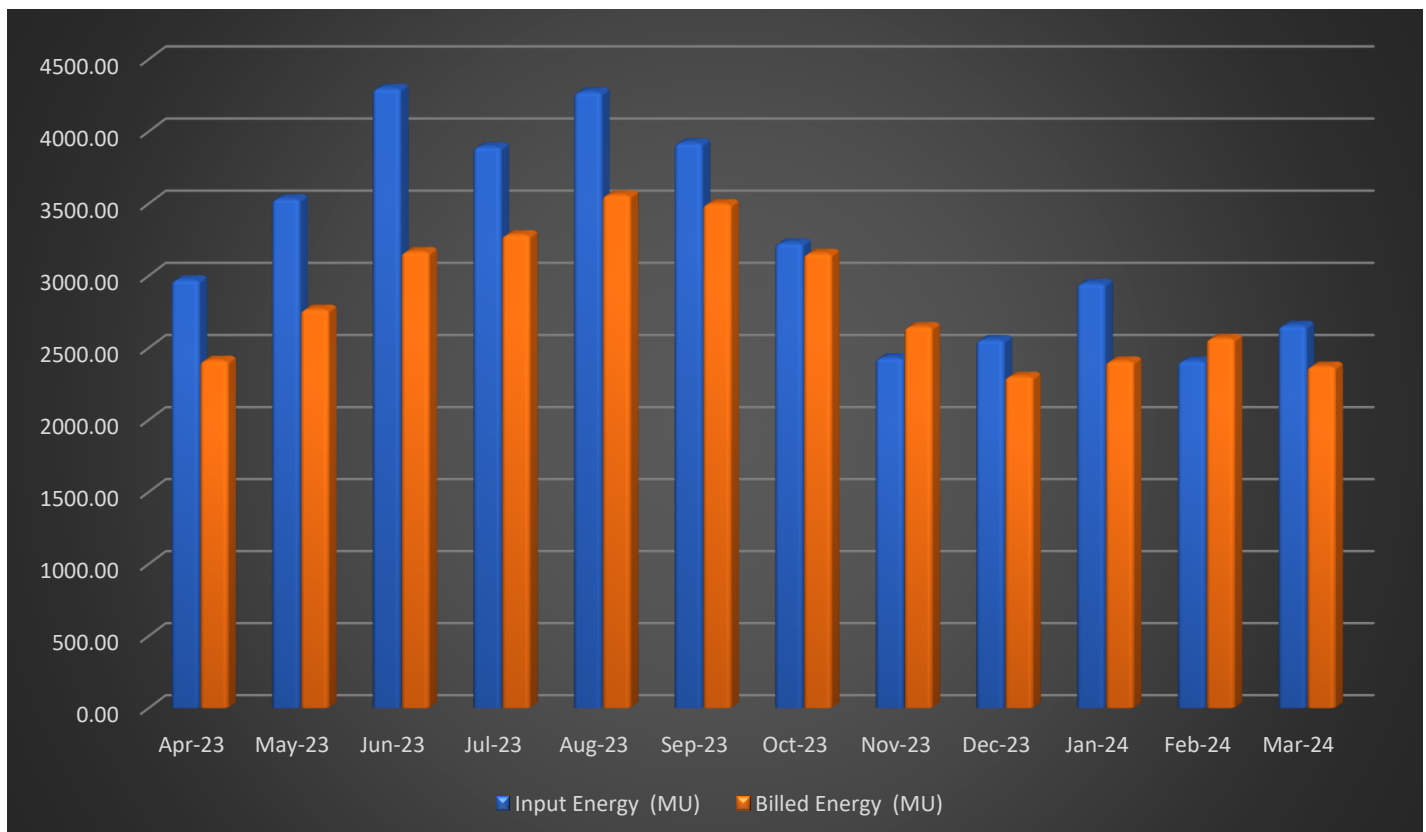

5.2.2. Quarterly and Annual AT&C Loss

The Quarter wise and Annual AT&C losses for FY 2023-24 are shown in below table

Sl. No.	Energy Input Details	UoM	Quarterly				Annual
			Q1	Q2	Q3	Q4	F.Y. 2023-24
1	Input Energy Purchase (From Generation Source)	MU	-----	-----	-----	-----	-----
2	Net Input Energy (at DISCOM Periphery after adjusting the transmission losses and energy traded)	MU	10801.87	12084.14	8087.15	8009.57	39107.84
3	Total Energy bill PVVNL (is the Net Energy bill PVVNL, adjusted for energy traded)	MU	8347.65	10326.41	8100.08	7345.61	34132.91
4	Transmission and distribution (T&D) loss details	MU	2454.22	1757.73	-12.93%	663.96	4974.93
		%	22.72%	14.55%	-0.16%	8.29%	12.72%
5	Collection Efficiency	%	94.82%	84.50%	92.34%	104.49%	100.73%
6	Aggregate Technical & Commercial Loss	%	26.72%	27.79%	7.51%	4.17%	12.08%

NOTE: During the audit it was reported by PVVNL that after quarter 2, there were significant changes and updates made to the software from where feeder data is collected. As a result, the data for Quarter 3 is more erroneous. However, the overall annual data is totality is correct, and for the same reason the T&D loss for Quarter 3 appeared as a negative value.

5.2.3. Circle Wise AT&C Losses Analysis

1. Circle Wise Connections & Energy Consumption for F.Y. 2023-24

The Circle wise connections, load, input energy & Billed Energy with Percentage share in different circle is given below the “EDC DHAMPUR” circle having maximum numbers of consumers and “EUDC-1 NOIDA” circle having minimum number of consumers. “EUDC-2 NOIDA” has maximum input energy as well as billed unit and “EUDC SAHARANUR” Have minimum input energy as well as billed unit shown in table.

Sl. No.	Name of Circle	Total Number of Connection (Nos)	% of Number of Connection	Total Connected Load(MW)	% of Connected Load	Input Energy (MU)	% Share of Input	Total Billed Energy (MU)	% of Energy Consumption
1	EUDC MEERUT	347855	4.61%	1152496.31	4.91%	1728.996	4.42%	1502.28	4.40%
2	EDC I MEERUT	259190	3.43%	801195.15	3.41%	1226.863	3.14%	1053.179	3.09%
3	EDC II MEERUT	234520	3.11%	613048.86	2.61%	980.529	2.51%	790.328	2.32%
4	EDC BAGHPAT	272814	3.61%	764720.39	3.26%	1333.262	3.41%	1157.771	3.39%
5	EUDC I GHAZIABAD	205683	2.73%	983861.04	4.19%	1509.809	3.86%	1449.174	4.25%

Sl. No.	Name of Circle	Total Number of Connection (Nos)	% of Number of Connection	Total Connected Load(MW)	% of Connected Load	Input Energy (MU)	% Share of Input	Total Billed Energy (MU)	% of Energy Consumption
6	EUDC II GHAZIABAD	240524	3.19%	1292104.69	5.50%	1868.106	4.78%	1820.947	5.33%
7	EUDC III GHAZIABAD	218439	2.89%	1013558.96	4.31%	1525.693	3.90%	1477.31	4.33%
8	EDC LONI	249985	3.31%	714589.71	3.04%	1013.824	2.59%	831.68	2.44%
9	EDC GHAZIABAD	174693	2.31%	539548.99	2.30%	844.665	2.16%	734.696	2.15%
10	EDC HAPUR	307129	4.07%	1018683.66	4.34%	1770.492	4.53%	1526.782	4.47%
11	EDC I BULANDSHAHAHAR	234948	3.11%	596874.68	2.54%	1039.094	2.66%	808.349	2.37%
12	EDC II BULANDSHAHAHAR	186231	2.47%	632190.54	2.69%	1140.354	2.92%	998.898	2.93%
13	EDC III BULANDSHAHAHAR	244547	3.24%	538608.95	2.29%	829.329	2.12%	803.275	2.35%
14	EUDC MUZAFFARNAGAR	254707	3.37%	794165.04	3.38%	1465.009	3.75%	1267.809	3.71%
15	EDC I MUZAFFARNAGAR	178169	2.36%	570758.04	2.43%	1096.433	2.80%	893.396	2.62%
16	EDC II MUZAFFARNAGAR	139225	1.84%	367403.42	1.56%	666.857	1.71%	482.467	1.41%
17	EDC SHAMLI	276325	3.66%	792139.68	3.37%	1305.083	3.34%	1134.375	3.32%
18	EUDC SAHARANUR	150722	2.00%	424690.08	1.81%	644.668	1.65%	563.848	1.65%
19	EDC I SAHARANPUR	294359	3.90%	678838.56	2.89%	1153.998	2.95%	760.325	2.23%
20	EDC II SAHARANPUR	251526	3.33%	650016.02	2.77%	1221.114	3.12%	848.866	2.49%
21	EUDC-1 NOIDA	132026	1.75%	1622260.22	6.91%	2937.354	7.51%	2895.051	8.48%
22	EUDC-2 NOIDA	270314	3.58%	1970375.27	8.39%	3413.526	8.73%	3136.538	9.19%
23	EDC MORADABAD	418347	5.54%	843692.23	3.59%	1113.212	2.85%	1038.863	3.04%
24	EDC SAMBHAL	338207	4.48%	784426.92	3.34%	1306.673	3.34%	1092.02	3.20%
25	EDC AMROHA	363112	4.81%	859475.8	3.66%	1693.529	4.33%	1447.729	4.24%
26	EUDC MORADABAD	207867	2.75%	690965.52	2.94%	895.948	2.29%	815.36	2.39%
27	EDC RAMPUR	386773	5.12%	800977.88	3.41%	1296.858	3.32%	1024.143	3.00%
28	EDC BIJNOR	289857	3.84%	135359.68	0.58%	1073.618	2.75%	904.657	2.65%
29	EDC DHAMPUR	418958	5.55%	843220.26	3.59%	1012.944	2.59%	872.795	2.56%

2. Circle Wise AT&C Losses


The Circle wise AT&C Losses are shown in the table below:

Sl. No.	Name of Circle	Input Energy (MU)	Total Billed Energy (MU)	T & D loss (MU)	T & D loss (%)	AT & C loss (%)
1	EUDC MEERUT	1728.996	1502.28	226.716	13.11%	12.48%
2	EDC I MEERUT	1226.863	1053.179	173.684	14.16%	4.81%
3	EDC II MEERUT	980.529	790.328	190.201	19.40%	13.97%
4	EDC BAGHPAT	1333.262	1157.771	175.491	13.16%	18.80%
5	EUDC I GHAZIABAD	1509.809	1449.174	60.635	4.02%	3.44%
6	EUDC II GHAZIABAD	1868.106	1820.947	47.159	2.52%	2.12%
7	EUDC III GHAZIABAD	1525.693	1477.31	48.383	3.17%	1.74%
8	EDC LONI	1013.824	831.68	182.144	17.97%	16.11%
9	EDC GHAZIABAD	844.665	734.696	109.969	13.02%	11.19%
10	EDC HAPUR	1770.492	1526.782	243.71	13.77%	15.15%
11	EDC I BULANDSHAHAHAR	1039.094	808.349	230.745	22.21%	23.67%
12	EDC II BULANDSHAHAHAR	1140.354	998.898	141.456	12.40%	9.60%
13	EDC III BULANDSHAHAHAR	829.329	803.275	26.054	3.14%	3.24%
14	EUDC MUZAFFARNAGAR	1465.009	1267.809	197.2	13.46%	13.94%
15	EDC I MUZAFFARNAGAR	1096.433	893.396	203.037	18.52%	15.40%
16	EDC II MUZAFFARNAGAR	666.857	482.467	184.39	27.65%	21.41%
17	EDC SHAMLI	1305.083	1134.375	170.708	13.08%	11.72%
18	EUDC SAHARANUR	644.668	563.848	80.82	12.54%	8.73%
19	EDC I SAHARANPUR	1153.998	760.325	393.673	34.11%	36.01%
20	EDC II SAHARANPUR	1221.114	848.866	372.248	30.48%	29.81%
21	EUDC-1 NOIDA	2937.354	2895.051	42.303	1.44%	0.27%
22	EUDC-2 NOIDA	3413.526	3136.538	276.988	8.11%	9.54%
23	EDC MORADABAD	1113.212	1038.863	74.349	6.68%	10.59%
24	EDC SAMBHAL	1306.673	1092.02	214.653	16.43%	19.75%
25	EDC AMROHA	1693.529	1447.729	245.8	14.51%	14.02%
26	EUDC MORADABAD	895.948	815.36	80.588	8.99%	9.43%
27	EDC RAMPUR	1296.858	1024.143	272.715	21.03%	19.09%
28	EDC BIJNOR	1073.618	904.657	168.961	15.74%	13.33%
29	EDC DHAMPUR	1012.944	872.795	140.149	13.84%	10.76%

3. High Loss Circle

“EDC I SAHARANPUR” circle has the highest T&D Loss & AT&C loss

Sl. No.	Name of Circle	Total Number of Connection (Nos)	Total Connected Load(MW)	Input Energy (MU)	Total Billed Energy (MU)	T & D loss (MU)	T & D loss (%)	AT & C loss (%)
1	EDC LONI	249985	714589.71	1013.824	831.68	182.144	17.97%	16.11%
2	EDC I BULANDSHAHAR	234948	596874.68	1039.094	808.349	230.745	22.21%	23.67%
3	EDC II MUZAFFARNAGAR	139225	367403.42	666.857	482.467	184.39	27.65%	21.41%
4	EDC I SAHARANPUR	294359	678838.56	1153.998	760.325	393.673	34.11%	36.01%
5	EDC II SAHARANPUR	251526	650016.02	1221.114	848.866	372.248	30.48%	29.81%
6	EDC SAMBHAL	338207	784426.92	1306.673	1092.02	214.653	16.43%	19.75%
7	EDC RAMPUR	386773	800977.88	1296.858	1024.143	272.715	21.03%	19.09%

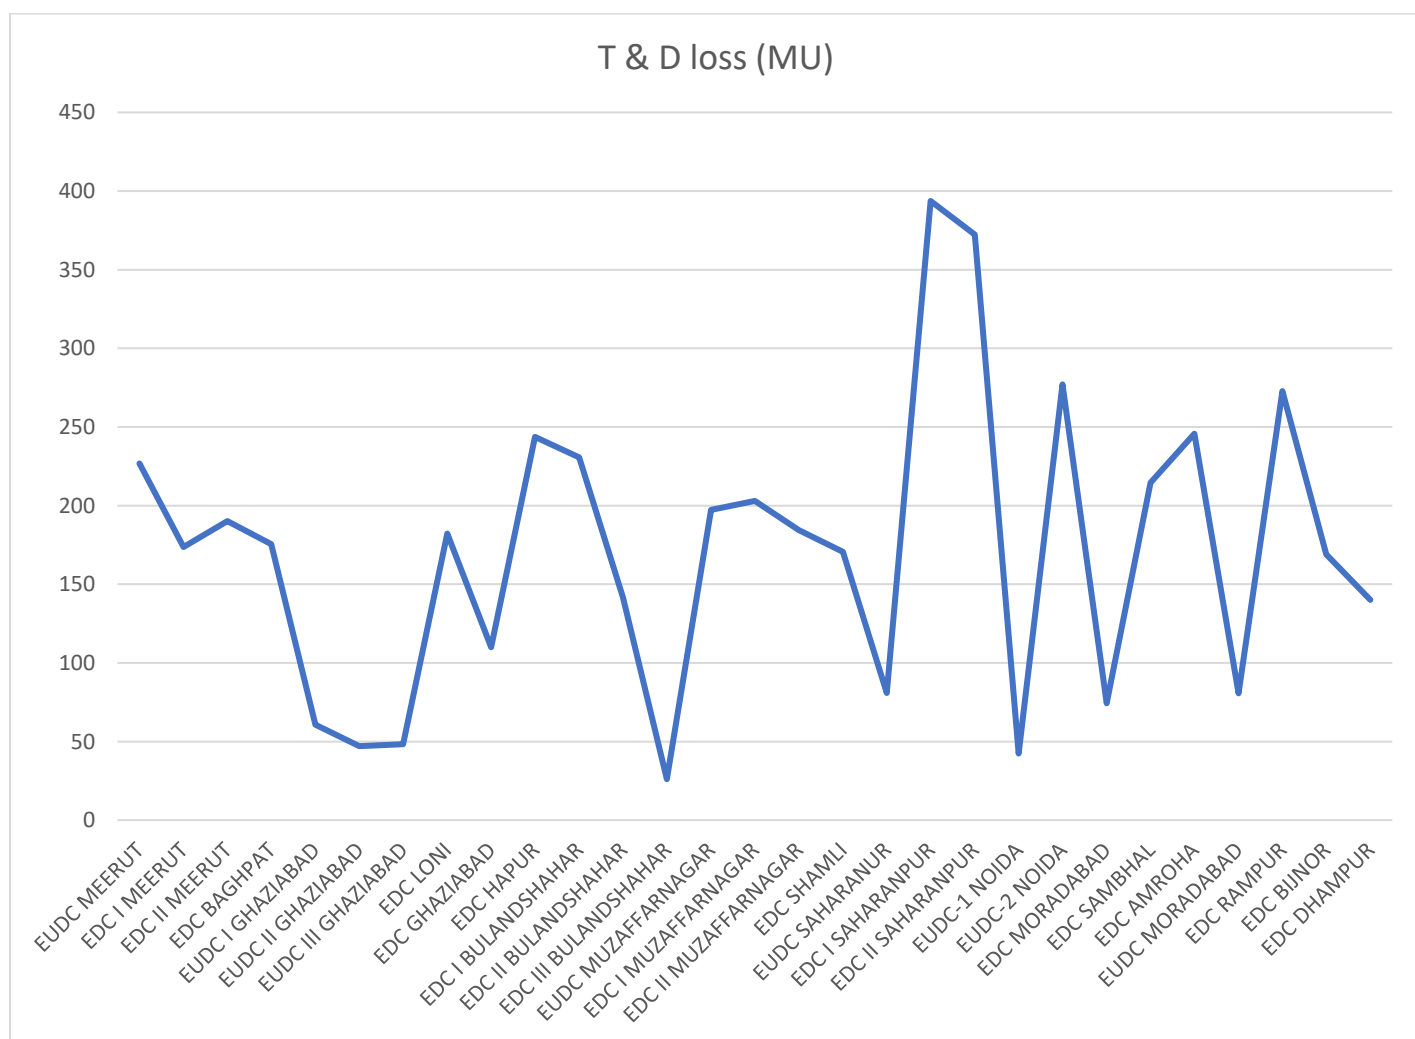

Division wise AT&C Losses Analysis

4. Division Wise AT&C Losses

The Division Wise AT&C Losses Shown in the table below:

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
1	EUDC MEERUT	EUDD I MEERUT	Residential	30726	95853.54	216.179	106.294	60.73%	41.142	19.03%	76.0243	76.8434	101.08%	20%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	14946	44307.14		46.469	26.55%			54.3629	54.7352	100.68%	
			Commercial/Industrial-HT	22	2738.9		5.521	3.15%			5.9416	7.4368	125.16%	
			Others	660	6028.95		16.753	9.57%			15.9806	10.5921	66.28%	
Sub-total				46354	148928.53	216.179	175.037	100.00%	41.142	19.03%	152.3094	149.6075	98.23%	20%
2	EUDC MEERUT	EUDD II MEERUT	Residential	59551	189323.32	392.002	197.054	56.96%	46.075	11.75%	140.7663	139.8673	99.36%	11%
			Agricultural	12	69.83		0.103	0.03%			0.0482	0.0546	113.28%	
			Commercial/Industrial-LT	13538	52574.38		63.906	18.47%			73.0257	73.2521	100.31%	
			Commercial/Industrial-HT	79	22525.1		44.537	12.87%			47.8076	57.9765	121.27%	
			Others	1502	13097.25		40.327	11.66%			33.6022	27.301	81.25%	
Sub-total				74682	277589.88	392.002	345.927	100.00%	46.075	11.75%	295.25	298.4515	101.08%	11%
3	EUDC MEERUT	EUDD III MEERUT	Residential	47085	129065.78	365.756	157.911	51.16%	57.087	15.61%	109.5202	114.0217	104.11%	12%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	15804	60638.87		121.895	39.49%			86.3654	83.2253	96.36%	
			Commercial/Industrial-HT	13	2656.3		4.822	1.56%			5.2172	5.4451	104.37%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Others	708	6176.2			24.041			7.79%	17.398	24.0253	
Sub-total				63610	198537.15	365.756	308.669	100.00%	57.087	15.61%	218.5008	226.7174	103.76%	12%
4	EUDC MEERUT	EUDD IV MEERUT	Residential	88916	257861.49	489.201	274.786	61.08%	39.307	8.03%	187.891	188.6923	100.43%	6%
			Agricultural	2062	13728.07		22.492	5.00%			5.1434	2.1689	42.17%	
			Commercial/Industrial-LT	11182	34994		40.812	9.07%			46.204	46.3231	100.26%	
			Commercial/Industrial-HT	59	25246.9		83.387	18.53%			69.6718	70.3806	101.02%	
			Others	1066	9447.97		28.417	6.32%			24.8891	31.8613	128.01%	
Sub-total				103285	341278.43	489.201	449.894	100.00%	39.307	8.03%	333.7993	339.4262	101.69%	6%
5	EUDC MEERUT	EUDD V MEERUT	Residential	49832	120259.8	265.858	119.646	53.71%	43.105	16.21%	82.0604	84.0179	102.39%	19%
			Agricultural	39	304.57		0.359	0.16%			0.1567	0.0877	55.97%	
			Commercial/Industrial-LT	9570	51120.96		68.164	30.60%			70.2281	65.3326	93.03%	
			Commercial/Industrial-HT	60	11548.9		25.714	11.54%			23.848	23.7787	99.71%	
			Others	423	2928.09		8.87	3.98%			8.1148	5.4534	67.20%	
Sub-total				59924	186162.32	265.858	222.753	100.00%	43.105	16.21%	184.408	178.6703	96.89%	19%
6	EDC I MEERUT	EDD I MEERUT	Residential	65223	141518.09	488.128	127.692	30.19%	65.133	13.34%	80.8974	91.8551	113.55%	2%
			Agricultural	2183	15232.56		30.002	7.09%			5.8877	2.2879	38.86%	
			Commercial/Industrial-LT	7407	53385.49		78.845	18.64%			74.6813	105.5769	141.37%	
			Commercial/Industrial-HT	221	72223.6		175.938	41.59%			152.1892	156.083	102.56%	
			Others	563	5916.09		10.518	2.49%			11.4509	11.7597	102.70%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				75597	288275.83	488.128	422.995	100.00%	65.133	13.34%	325.1065	367.5626	113.06%	2%
7	EDC I MEERUT	EDD III MEERUT	Residential	83132	172020.53	388.418	164.802	48.18%	46.344	11.93%	97.4914	99.8812	102.45%	11%
			Agricultural	5936	33526.85		71.897	21.02%			9.7592	4.1951	42.99%	
			Commercial/Industrial-LT	7008	25924.89		29.828	8.72%			31.7811	41.0098	129.04%	
			Commercial/Industrial-HT	52	27916.9		55.047	16.09%			52.1443	53.8248	103.22%	
			Others	1074	9868.77		20.5	5.99%			27.4194	22.3482	81.51%	
Sub-total				97202	269257.94	388.418	342.074	100.00%	46.344	11.93%	218.5954	221.2591	101.22%	11%
8	EDC I MEERUT	EDD IV MEERUT	Residential	72601	147829.65	350.317	125.187	43.45%	62.207	17.76%	64.426	74.2998	115.33%	-2%
			Agricultural	8740	67157.26		123.308	42.80%			7.7879	9.6973	124.52%	
			Commercial/Industrial-LT	4009	16215.26		19.699	6.84%			19.0183	22.689	119.30%	
			Commercial/Industrial-HT	24	4729.5		7.806	2.71%			7.6252	7.9401	104.13%	
			Others	1017	7729.71		12.11	4.20%			11.8023	22.1428	187.61%	
Sub-total				86391	243661.38	350.317	288.11	100.00%	62.207	17.76%	110.6597	136.769	123.59%	-2%
9	EDC II MEERUT	EDD II MEERUT	Residential	87736	169370.55	510.018	141.886	36.14%	117.375	23.01%	73.4612	76.5201	104.16%	21%
			Agricultural	12572	75733.99		165.525	42.16%			12.9654	11.0453	85.19%	
			Commercial/Industrial-LT	8375	29610.39		39.027	9.94%			35.4282	40.3757	113.96%	
			Commercial/Industrial-HT	33	17003.7		36.148	9.21%			31.1276	30.9846	99.54%	
			Others	1077	6435.05		10.057	2.56%			9.6659	8.9894	93.00%	
Sub-total				109793	298153.68	510.018	392.643	100.00%	117.375	23.01%	162.6483	167.9151	103.24%	21%
10	EDC II MEERUT	EDD I MAWANA	Residential	51292	97170.28	249.805	85.706	39.32%	31.841	12.75%	48.0215	52.4683	109.26%	5%
			Agricultural	7028	41770.23		86.013	39.46%			6.807	6.3786	93.71%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	5128	12961.43		13.901	6.38%			14.7898	19.088	129.06%	
			Commercial/Industrial-HT	34	10459.9		23.234	10.66%			20.8125	20.5599	98.79%	
			Others	709	4007.97		9.11	4.18%			8.7001	9.0018	103.47%	
Sub-total				64191	166369.81	249.805	217.964	100.00%	31.841	12.75%	99.1309	107.4966	108.44%	5%
11	EDC II MEERUT	EDD II MAWANA	Residential	49094	87946.9	220.706	70.634	39.30%	40.985	18.57%	37.1252	42.1515	113.54%	8%
			Agricultural	8299	48879.69		93.523	52.04%			6.7065	9.4093	140.30%	
			Commercial/Industrial-LT	2441	7483.11		8.548	4.76%			9.3184	9.3142	99.95%	
			Commercial/Industrial-HT	7	1004.4		1.246	0.69%			1.2215	1.2424	101.71%	
			Others	695	3211.27		5.77	3.21%			7.018	7.3982	105.42%	
Sub-total				60536	148525.37	220.706	179.721	100.00%	40.985	18.57%	61.3896	69.5156	113.24%	8%
12	EDC BAGHPAT	EDD I BARAUT	Residential	56896	102388.42	313.224	96.824	34.74%	34.501	11.01%	49.0695	59.4068	121.07%	13%
			Agricultural	8125	65381.71		149.433	53.61%			21.917	11.8978	54.29%	
			Commercial/Industrial-LT	3546	15597.06		17.013	6.10%			17.0357	17.5528	103.04%	
			Commercial/Industrial-HT	21	4366.02		9.957	3.57%			9.2062	8.957	97.29%	
			Others	695	4460.45		5.496	1.97%			7.3885	4.7204	63.89%	
Sub-total				69283	192193.66	313.224	278.723	100.00%	34.501	11.01%	104.6169	102.5348	98.01%	13%
13	EDC BAGHPAT	EDD II BARAUT	Residential	68151	128724.02	436.44	121.269	34.07%	80.494	18.44%	72.5419	74.1218	102.18%	30%
			Agricultural	9095	84033.28		203.321	57.12%			29.0311	12.9674	44.67%	
			Commercial/Industrial-LT	5760	14479.62		16.592	4.66%			15.996	17.2759	108.00%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	4	562.5		0.406	0.11%			0.5102	0.4638	90.91%	
			Others	928	7687.34		14.358	4.03%			17.3701	11.6203	66.90%	
			Sub-total	83938	235486.76	436.44	355.946	100.00%	80.494	18.44%	135.4493	116.4492	85.97%	30%
14	EDC BAGHPAT	EDD I BAGHPAT	Residential	63308	117685	355.212	115.429	37.32%	45.953	12.94%	61.2901	69.0847	112.72%	17%
			Agricultural	7947	60825.67		144.828	46.83%			19.3989	9.325	48.07%	
			Commercial/Industrial-LT	5011	17769.5		23.584	7.63%			22.0017	22.4879	102.21%	
			Commercial/Industrial-HT	44	8112.4		14.439	4.67%			13.8624	13.9293	100.48%	
			Others	829	5379.35		10.979	3.55%			11.6737	8.0444	68.91%	
			Sub-total	77139	209771.92	355.212	309.259	100.00%	45.953	12.94%	128.2268	122.8713	95.82%	17%
15	EDC BAGHPAT	EDD II BAGHPAT	Residential	35258	67868.04	228.386	85.484	39.98%	14.543	6.37%	39.426	37.3471	94.73%	10%
			Agricultural	4262	32317.65		71.994	33.67%			10.6153	5.6177	52.92%	
			Commercial/Industrial-LT	2421	9804.3		16.775	7.84%			11.5678	12.0096	103.82%	
			Commercial/Industrial-HT	41	13966.2		35.377	16.54%			31.9591	33.0559	103.43%	
			Others	472	3311.86		4.213	1.97%			5.9725	7.5685	126.72%	
			Sub-total	42454	127268.05	228.386	213.843	100.00%	14.543	6.37%	99.5407	95.5988	96.04%	10%
16	EUDC I GHAZIABAD	EUDD I GHAZIABAD	Residential	52072	185750.79	558.296	196.411	36.22%	16.054	2.88%	141.1592	141.6366	100.34%	3%
			Agricultural	31	294.41		0.22	0.04%			0.1135	0.0927	81.67%	
			Commercial/Industrial-LT	9252	60518.54		79.648	14.69%			85.516	85.6149	100.12%	
			Commercial/Industrial-HT	322	101838.2		236.534	43.62%			216.0922	214.3201	99.18%	
			Others	1237	12561.51		29.429	5.43%			32.2015	31.2749	97.12%	
			Sub-total											

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				62914	360963.45	558.296	542.242	100.00%	16.054	2.88%	475.0824	472.9392	99.55%	3%
17	EUDC I GHAZIABAD	EUDD V GHAZIABAD	Residential	61590	173235.36	461.894	183.104	40.41%	8.777	1.90%	127.7749	123.2028	96.42%	1%
			Agricultural	5	22.39		0.003	0.00%			0.003	0.0048	160.00%	
			Commercial/Industrial-LT	5811	33000.05		44.948	9.92%			44.028	44.8494	101.87%	
			Commercial/Industrial-HT	131	70207.7		194.349	42.89%			162.6232	153.5007	94.39%	
			Others	597	11878.87		30.713	6.78%			28.0376	44.1435	157.44%	
Sub-total				68134	288344.37	461.894	453.117	100.00%	8.777	1.90%	362.4667	365.7012	100.89%	1%
18	EUDC I GHAZIABAD	EUDD IX GHAZIABAD	Residential	66714	264834.74	489.619	327.565	72.18%	35.804	7.31%	226.5317	229.8363	101.46%	6%
			Agricultural	44	244.77		0.242	0.05%			0.0973	0.066	67.83%	
			Commercial/Industrial-LT	7102	29976.17		39.575	8.72%			41.7561	41.8395	100.20%	
			Commercial/Industrial-HT	85	31292.4		61.78	13.61%			58.3801	62.7813	107.54%	
			Others	690	8205.14		24.653	5.43%			22.1604	20.4561	92.31%	
Sub-total				74635	334553.22	489.619	453.815	100.00%	35.804	7.31%	348.9256	354.9792	101.73%	6%
19	EUDC II GHAZIABAD	EUDD II GHAZIABAD	Residential	52686	263360.18	695.176	258.064	37.47%	6.514	0.94%	187.2594	185.4838	99.05%	1%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	7385	48792.08		58.318	8.47%			64.5974	64.524	99.89%	
			Commercial/Industrial-HT	322	129946.3		360.721	52.38%			313.8807	318.4618	101.46%	
			Others	759	6469.2		11.559	1.68%			12.6804	12.1916	96.15%	
Sub-total				61152	448567.76	695.176	688.662	100.00%	6.514	0.94%	578.4179	580.6612	100.39%	1%
20	EUDC II GHAZIABAD	EUDD VI GHAZIABAD	Residential	64283	239278.6	564.945	234.779	43.26%	22.239	3.94%	169.0475	171.713	101.58%	4%
			Agricultural	0	0		0	0.00%			0	0	0.00%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	9552	44502.24		52.87	9.74%			58.1804	59.2224	101.79%	
			Commercial/Industrial-HT	239	87143.2		242.062	44.60%			212.9878	216.8365	101.81%	
			Others	791	6111.25		12.995	2.39%			15.4664	7.8338	50.65%	
Sub-total				74865	377035.29	564.945	542.706	100.00%	22.239	3.94%	455.6821	455.6057	99.98%	4%
21	EUDC II GHAZIABAD	EUDD VIII GHAZIABAD	Residential	49881	268169.8	424.776	330.532	78.79%	5.241	1.23%	235.874	241.824	102.52%	0%
			Agricultural	5	24.46		0.006	0.00%			0.0046	0.0036	78.26%	
			Commercial/Industrial-LT	4649	21973.48		28.073	6.69%			33.1236	33.2983	100.53%	
			Commercial/Industrial-HT	46	21700.6		34.092	8.13%			39.537	40.5772	102.63%	
			Others	591	11316.3		26.832	6.40%			27.2767	22.9486	84.13%	
Sub-total				55172	323184.64	424.776	419.535	100.00%	5.241	1.23%	335.8159	338.6517	100.84%	0%
22	EUDC II GHAZIABAD	EUDD XI GZB (KHODA)	Residential	42167	123419.3	183.209	142.591	83.86%	13.165	7.19%	101.5248	102.0524	100.52%	6%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	7022	17546		21.718	12.77%			24.5353	24.4805	99.78%	
			Commercial/Industrial-HT	8	1291.7		2.719	1.60%			3.0223	3.0261	100.13%	
			Others	138	1060		3.016	1.77%			2.765	3.4967	126.46%	
Sub-total				49335	143317	183.209	170.044	100.00%	13.165	7.19%	131.8474	133.0557	100.92%	6%
23	EUDC III GHAZIABAD	EUDD III GHAZIABAD	Residential	28184	109665.45	225.764	121.615	57.56%	14.491	6.42%	87.3964	87.6251	100.26%	4%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	11009	45437.45		50.199	23.76%			59.6886	59.9964	100.52%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	33	7720.2		21.993	10.41%			22.8028	22.6791	99.46%	
			Others	631	6957.29		17.466	8.27%			17.442	21.4199	122.81%	
			Sub-total	39857	169780.39	225.764	211.273	100.00%	14.491	6.42%	187.3298	191.7205	102.34%	4%
24	EUDC III GHAZIABAD	EUDD IV GHAZIABAD	Residential	60486	182281.14	371.203	188.196	53.61%	20.15	5.43%	135.6252	135.7733	100.11%	4%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	10612	51604.52		70.397	20.05%			74.6001	73.7904	98.91%	
			Commercial/Industrial-HT	76	15749.92		25.938	7.39%			25.2263	25.4857	101.03%	
			Others	522	23288.56		66.522	18.95%			54.4209	59.5758	109.47%	
			Sub-total	71696	272924.14	371.203	351.053	100.00%	20.15	5.43%	289.8725	294.6252	101.64%	4%
25	EUDC III GHAZIABAD	EUDD VII GHAZIABAD	Residential	44356	192605.65	564.587	251.25	45.42%	11.409	2.02%	177.3323	169.2021	95.42%	0%
			Agricultural	500	2941.09		3.328	0.60%			0.6724	0.4342	64.57%	
			Commercial/Industrial-LT	10083	64386.91		80.405	14.54%			83.0907	82.7812	99.63%	
			Commercial/Industrial-HT	163	66102.3		192.513	34.80%			162.7936	175.41	107.75%	
			Others	857	9843.96		25.682	4.64%			22.3708	28.2945	126.48%	
			Sub-total	55959	335879.91	564.587	553.178	100.00%	11.409	2.02%	446.2598	456.122	102.21%	0%
26	EUDC III GHAZIABAD	EUDD X GHAZIABAD	Residential	41978	122670.14	364.139	124.281	34.35%	2.333	0.64%	85.1832	83.6953	98.25%	1%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	8491	53906.7		71.291	19.70%			71.9449	72.2526	100.43%	
			Commercial/Industrial-HT	90	54878.6		160.053	44.24%			136.4197	135.4597	99.30%	
			Others	368	3519.08		6.181	1.71%			7.6122	8.8203	115.87%	
			Sub-total											

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				50927	234974.52	364.139	361.806	100.00%	2.333	0.64%	301.16	300.2279	99.69%	1%
27	EDC LONI	EDD I LONI	Residential	89570	181956	462.121	164.961	42.43%	73.381	15.88%	103.4442	104.7459	101.26%	17%
			Agricultural	625	4942.24		9.721	2.50%			0.6202	0.6115	98.60%	
			Commercial/Industrial-LT	11381	80154.47		109.641	28.20%			106.6632	108.2081	101.45%	
			Commercial/Industrial-HT	246	43213.75		91.708	23.59%			79.149	79.9679	101.03%	
			Others	370	3851.47		12.709	3.27%			17.3574	10.5694	60.89%	
Sub-total				102192	314117.93	462.121	388.74	100.00%	73.381	15.88%	307.234	304.1028	98.98%	17%
28	EDC LONI	EDD II LONI	Residential	75367	161974.47	268.221	147.801	62.62%	32.2	12.01%	101.0616	106.9492	105.83%	7%
			Agricultural	3	15.19		0.011	0.00%			0.008	0.0038	47.50%	
			Commercial/Industrial-LT	8937	45768.49		66.116	28.01%			66.8198	66.4207	99.40%	
			Commercial/Industrial-HT	48	7526.85		18.033	7.64%			16.2477	17.3772	106.95%	
			Others	173	2734.14		4.06	1.72%			4.4146	7.4601	168.99%	
Sub-total				84528	218019.14	268.221	236.021	100.00%	32.2	12.01%	188.5517	198.211	105.12%	7%
29	EDC LONI	EDD III LONI	Residential	56444	138554.48	283.482	128.819	62.26%	76.563	27.01%	84.4655	86.6223	102.55%	23%
			Agricultural	1361	10011.95		20.274	9.80%			1.6502	2.0282	122.91%	
			Commercial/Industrial-LT	5110	24172.52		34.833	16.83%			36.1382	36.5286	101.08%	
			Commercial/Industrial-HT	27	6917.4		17.628	8.52%			15.7438	15.7143	99.81%	
			Others	323	2796.29		5.365	2.59%			6.9925	12.1033	173.09%	
Sub-total				63265	182452.64	283.482	206.919	100.00%	76.563	27.01%	144.9902	152.9967	105.52%	23%
30	EDC GHAZIABAD	EDD MODINAGAR	Residential	78885	183708.76	365.483	173.391	49.26%	13.484	3.69%	101.6292	111.2901	109.51%	-3%
			Agricultural	4036	20981.15		42.234	12.00%			2.9721	4.0593	136.58%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	8695	35132.42		44.226	12.56%			45.9649	45.2158	98.37%	
			Commercial/Industrial-HT	70	18768.4		37.697	10.71%			34.517	35.6372	103.25%	
			Others	764	6792.95		54.451	15.47%			16.3546	20.1521	123.22%	
Sub-total				92450	265383.68	365.483	351.999	100.00%	13.484	3.69%	201.4378	216.3545	107.41%	-3%
31	EDC GHAZIABAD	EDD MURADNAGAR	Residential	71108	155938.81	479.182	153.475	40.10%	96.485	20.14%	87.2303	96.6626	110.81%	22%
			Agricultural	3018	17051.41		29.233	7.64%			2.375	2.4657	103.82%	
			Commercial/Industrial-LT	7371	41500.57		57.955	15.14%			55.243	45.9908	83.25%	
			Commercial/Industrial-HT	114	50701.75		127.316	33.27%			106.4212	106.9843	100.53%	
			Others	632	8972.77		14.718	3.85%			18.3866	12.5465	68.24%	
Sub-total				82243	274165.31	479.182	382.697	100.00%	96.485	20.14%	269.6561	264.6499	98.14%	22%
32	EDC HAPUR	EDD-1 HAPUR	Residential	84032	190717.3	576.006	196.123	40.74%	94.64	16.43%	117.7461	125.0748	106.22%	16%
			Agricultural	6314	35720.13		79.1	16.43%			11.1424	3.1539	28.31%	
			Commercial/Industrial-LT	12183	49187.02		61.316	12.74%			64.3859	68.2928	106.07%	
			Commercial/Industrial-HT	175	47896.9		130.01	27.01%			110.2631	107.7807	97.75%	
			Others	909	6446.18		14.817	3.08%			12.2577	12.8918	105.17%	
Sub-total				103613	329967.53	576.006	481.366	100.00%	94.64	16.43%	315.7952	317.194	100.44%	16%
33	EDC HAPUR	EDD-2 HAPUR	Residential	83323	176426.7	794.759	155.267	22.79%	113.425	14.27%	81.106	89.4079	110.24%	15%
			Agricultural	5658	32765.25		67.456	9.90%			10.8662	3.9319	36.18%	
			Commercial/Industrial-LT	8520	56161.39		67.653	9.93%			62.1819	65.9847	106.12%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	365	148795.9		380.955	55.91%			315.228	305.2311	96.83%	
			Others	940	6490.53		10.003	1.47%			9.9428	12.3969	124.68%	
Sub-total				98806	420639.77	794.759	681.334	100.00%	113.425	14.27%	479.3249	476.9525	99.51%	15%
34	EDC HAPUR	EDD GARH	Residential	84709	154493.96	399.727	129.902	35.68%	35.645	8.92%	61.5706	68.4916	111.24%	17%
			Agricultural	14233	81593.67		178.765	49.10%			25.762	8.4648	32.86%	
			Commercial/Industrial-LT	4633	18141.7		25.04	6.88%			21.5468	32.881	152.60%	
			Commercial/Industrial-HT	25	8064.8		19.72	5.42%			16.3585	16.7789	102.57%	
			Others	1110	5782.23		10.655	2.93%			28.3268	12.7234	44.92%	
Sub-total				104710	268076.36	399.727	364.082	100.00%	35.645	8.92%	153.5647	139.3397	90.74%	17%
35	EDC I BULANDSHAHAH	EUDD BULANDSHAHAH	Residential	56639	134374.73	311.21	147	62.86%	77.353	24.86%	102.9949	102.8433	99.85%	25%
			Agricultural	115	606.32		0.52	0.22%			0.226	0.1501	66.42%	
			Commercial/Industrial-LT	10149	29609.38		37.133	15.88%			42.3251	42.963	101.51%	
			Commercial/Industrial-HT	55	10920.3		21.889	9.36%			21.1849	23.2963	109.97%	
			Others	1504	9984.57		27.315	11.68%			18.5095	15.9201	86.01%	
Sub-total				68462	185495.3	311.21	233.857	100.00%	77.353	24.86%	185.2404	185.1728	99.96%	25%
36	EDC I BULANDSHAHAH	EDD VI BULANDSHAHAH	Residential	51799	87537.3	257.904	62.006	28.30%	38.764	15.03%	30.7863	35.6804	115.90%	23%
			Agricultural	8197	46208.3		102.906	46.96%			16.1533	6.9235	42.86%	
			Commercial/Industrial-LT	2198	7520.24		11.207	5.11%			8.1096	8.0496	99.26%	
			Commercial/Industrial-HT	18	10107		30.419	13.88%			27.4755	23.2952	84.79%	
			Others	786	3416.5		12.602	5.75%			11.2477	11.1856	99.45%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				62998	154789.34	257.904	219.14	100.00%	38.764	15.03%	93.7724	85.1343	90.79%	23%
37	EDC I BULANDSHAHAH	EDD KHURJA	Residential	87102	155168.49	469.98	140.69	39.59%	114.628	24.39%	70.9203	74.0939	104.47%	24%
			Agricultural	7582	41713.91		99.425	27.98%			15.0682	8.0137	53.18%	
			Commercial/Industrial-LT	7865	33782.91		56.522	15.91%			48.5743	51.4389	105.90%	
			Commercial/Industrial-HT	80	20911.5		46.758	13.16%			43.6374	42.2522	96.83%	
			Others	859	5013.23		11.957	3.36%			7.1793	9.5295	132.74%	
Sub-total				103488	256590.04	469.98	355.352	100.00%	114.628	24.39%	185.3795	185.3282	99.97%	24%
38	EDC II BULANDSHAHAH	EDD I BULANDSHAHAH	Residential	45199	100673	652.123	83.687	13.82%	46.512	7.13%	55.5554	61.6123	110.90%	3%
			Agricultural	2414	10992.43		18.117	2.99%			3.5324	1.8166	51.43%	
			Commercial/Industrial-LT	6435	26616.72		30.832	5.09%			32.374	33.1681	102.45%	
			Commercial/Industrial-HT	223	187340.4		461.071	76.13%			361.2953	370.9857	102.68%	
			Others	495	4170.12		11.904	1.97%			10.548	14.3846	136.37%	
Sub-total				54766	329792.67	652.123	605.611	100.00%	46.512	7.13%	463.3051	481.9673	104.03%	3%
39	EDC II BULANDSHAHAH	EDD V BULANDSHAHAH	Residential	45995	86970.68	203.171	70.829	49.13%	58.99	29.03%	28.3415	34.9557	123.34%	26%
			Agricultural	5914	28970.7		55.413	38.43%			8.7866	3.4579	39.35%	
			Commercial/Industrial-LT	1703	6459.8		8.056	5.59%			6.911	7.7786	112.55%	
			Commercial/Industrial-HT	17	5087.7		5.912	4.10%			5.8725	6.0735	103.42%	
			Others	587	2525.13		3.971	2.75%			3.4872	3.3626	96.43%	
Sub-total				54216	130014.01	203.171	144.181	100.00%	58.99	29.03%	53.3988	55.6283	104.18%	26%
40	EDC II BULANDSHAHAH	EDD SAYANA	Residential	61918	95164.8	285.06	87.029	401.24%	35.954	12.61%	39.5079	41.3471	104.66%	15%
			Agricultural	11000	61618.58		137.067	631.94%			13.5525	8.6185	63.59%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	3563	10412.13		12.868	59.33%			12.784	12.6957	99.31%	
			Commercial/Industrial-HT	10	2389		7.338	33.83%			6.2786	6.2132	98.96%	
			Others	758	2799.35		4.804	22.15%			5.7005	7.1017	124.58%	
Sub-total				77249	172383.86	285.06	249.106	1148.48%	35.954	12.61%	77.8235	75.9762	97.63%	15%
41	EDC III BULANDSHAHAH	EDD III BULANDSHAHAH	Residential	52771	85642.8	275.592	75.515	27.84%	4.322	1.57%	29.3039	35.977	122.77%	0%
			Agricultural	10398	60237.31		170.479	62.84%			25.4649	9.1018	35.74%	
			Commercial/Industrial-LT	2379	7480.62		8.91	3.28%			7.2937	8.1563	111.83%	
			Commercial/Industrial-HT	9	3899.7		11.29	4.16%			7.0634	8.7807	124.31%	
			Others	649	2698.5		5.076	1.87%			2.58	10.8187	419.33%	
Sub-total				66206	159958.93	275.592	271.27	100.00%	4.322	1.57%	71.7059	72.8345	101.57%	0%
42	EDC III BULANDSHAHAH	EDD DIBAYEE	Residential	79151	114059.2	261.11	79.345	32.35%	15.844	6.07%	36.0907	47.257	130.94%	10%
			Agricultural	7436	47308.62		130.919	53.38%			22.0071	6.0959	27.70%	
			Commercial/Industrial-LT	4126	12403.5		15.73	6.41%			14.5397	14.8791	102.33%	
			Commercial/Industrial-HT	16	4026.2		10.776	4.39%			9.3583	8.5914	91.81%	
			Others	1402	4806.5		8.496	3.46%			6.1203	7.7888	127.26%	
Sub-total				92131	182604.02	261.11	245.266	100.00%	15.844	6.07%	88.1161	84.6122	96.02%	10%
43	EDC III BULANDSHAHAH	EDD JAHANGIRABAD	Residential	70909	108702.93	292.627	81.337	97.54%	5.888	2.01%	43.5994	46.7666	107.26%	0%
			Agricultural	10162	67081.63		169.083	202.77%			24.7441	8.5505	34.56%	
			Commercial/Industrial-LT	4024	11961.88		16.784	20.13%			15.1412	14.2164	93.89%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	22	3662.4		7.469	8.96%			6.7302	6.2723	93.20%	
			Others	1093	4637.16		12.066	14.47%			11.3063	27.8121	245.99%	
Sub-total				86210	196046	292.627	286.739	343.87%	5.888	2.01%	101.5212	103.6179	102.07%	0%
44	EUDC MUZAFFARNAGAR	EUDD I MUZAFFARNAGAR	Residential	70173	174731.2	347.417	183.014	64.17%	62.199	17.90%	123.4739	125.2494	101.44%	16%
			Agricultural	312	1976.74		2.51	0.88%			0.2077	0.253	121.81%	
			Commercial/Industrial-LT	15959	42543.08		48.944	17.16%			56.4193	56.4497	100.05%	
			Commercial/Industrial-HT	46	9114.2		18.165	6.37%			18.3294	23.3953	127.64%	
			Others	1212	8994.81		32.585	11.42%			20.9835	20.1513	96.03%	
Sub-total				87702	237360.03	347.417	285.218	100.00%	62.199	17.90%	219.4138	225.4987	102.77%	16%
45	EUDC MUZAFFARNAGAR	EUDD II MUZAFFARNAGAR	Residential	91355	167766.15	473.282	139.431	34.00%	63.228	13.36%	69.5821	78.7922	113.24%	9%
			Agricultural	11571	72517.18		168.179	41.01%			8.1759	8.3827	102.53%	
			Commercial/Industrial-LT	5318	18399.16		23.625	5.76%			23.2846	23.6084	101.39%	
			Commercial/Industrial-HT	20	14412		64.814	15.81%			48.291	45.9504	95.15%	
			Others	1195	6919.66		14.005	3.42%			14.2923	14.2983	100.04%	
Sub-total				109459	280014.15	473.282	410.054	100.00%	63.228	13.36%	163.6259	171.032	104.53%	9%
46	EUDC MUZAFFARNAGAR	EUDD III MUZAFFARNAGAR	Residential	48436	110839.75	644.31	105.355	18.40%	71.773	11.14%	72.3231	74.6832	103.26%	15%
			Agricultural	478	2975.46		5.798	1.01%			0.7741	0.6394	82.60%	
			Commercial/Industrial-LT	7867	26259.56		30.95	5.41%			33.1542	34.4071	103.78%	
			Commercial/Industrial-HT	98	128504.78		409.42	71.51%			329.7103	305.646	92.70%	
			Others	667	8211.31		21.014	3.67%			15.286	17.7345	116.02%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				57546	276790.86	644.31	572.537	100.00%	71.773	11.14%	451.2477	433.1102	95.98%	15%
47	EDC I MUZAFFARNAGAR	EDD I MUZAFFARNAGAR	Residential	69817	135536.5	626.301	104.591	20.39%	113.256	18.08%	49.2338	62.8454	127.65%	15%
			Agricultural	10079	65774.25		140.847	27.45%			7.0575	9.046	128.18%	
			Commercial/Industrial-LT	3303	14362.5		19.401	3.78%			17.4062	15.9236	91.48%	
			Commercial/Industrial-HT	93	87819.89		243.603	47.48%			199.0308	196.732	98.85%	
			Others	919	4385.3		4.603	0.90%			6.9446	6.7254	96.84%	
Sub-total				84211	307878.44	626.301	513.045	100.00%	113.256	18.08%	279.6729	291.2724	104.15%	15%
48	EDC I MUZAFFARNAGAR	EDD II MUZAFFARNAGAR	Residential	79322	152314.5	470.132	116.375	30.60%	89.781	19.10%	57.3704	65.275	113.78%	17%
			Agricultural	10798	75607.12		194.04	51.02%			9.2611	8.8207	95.24%	
			Commercial/Industrial-LT	2951	13901.98		19.442	5.11%			16.0788	17.6501	109.77%	
			Commercial/Industrial-HT	38	16620.3		45.885	12.06%			39.6357	37.8333	95.45%	
			Others	849	4435.7		4.609	1.21%			5.3057	2.0362	38.38%	
Sub-total				93958	262879.6	470.132	380.351	100.00%	89.781	19.10%	127.6517	131.6153	103.11%	17%
49	EDC II MUZAFFARNAGAR	EDD KHATAULI	Residential	56862	115141.16	263.875	85.371	40.15%	51.233	19.42%	56.2449	58.7052	104.37%	13%
			Agricultural	5604	34609.56		97.367	45.79%			9.5067	5.1232	53.89%	
			Commercial/Industrial-LT	4340	12228.23		14.877	7.00%			16.4195	16.5138	100.57%	
			Commercial/Industrial-HT	25	3732		6.432	3.02%			6.6932	6.8469	102.30%	
			Others	796	4653.77		8.595	4.04%			9.373	19.2163	205.02%	
Sub-total				67627	170364.72	263.875	212.642	100.00%	51.233	19.42%	98.2373	106.4054	108.31%	13%
50	EDC II MUZAFFARNAGAR	EDD BUDHANA	Residential	58332	110610.6	402.982	73.356	27.19%	133.157	33.04%	41.5061	51.234	123.44%	27%
			Agricultural	8714	68929.56		172.611	63.97%			9.0032	9.6774	107.49%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	3901	9999.23		12.516	4.64%			12.5262	12.9071	103.04%	
			Commercial/Industrial-HT	12	1991.5		2.113	0.78%			1.9211	2.2665	117.98%	
			Others	639	5507.81		9.229	3.42%			11.0037	6.7281	61.14%	
Sub-total				71598	197038.7	402.982	269.825	100.00%	133.157	33.04%	75.9603	82.8131	109.02%	27%
51	EDC SHAMLI	EDD I SHAMLI	Residential	45459	85236.24	294.098	66.837	23.15%	5.446	1.85%	44.6171	42.4312	95.10%	13%
			Agricultural	9751	72939.17		161.353	55.90%			18.8954	11.7944	62.42%	
			Commercial/Industrial-LT	1950	7085.74		9.263	3.21%			8.1632	8.1308	99.60%	
			Commercial/Industrial-HT	31	15843.6		47.081	16.31%			38.7447	35.1348	90.68%	
			Others	577	2408.61		4.118	1.43%			3.6409	3.6365	99.88%	
Sub-total				57768	183513.36	294.098	288.652	100.00%	5.446	1.85%	114.0613	101.1277	88.66%	13%
52	EDC SHAMLI	EDD II SHAMLI	Residential	59911	122441.15	309.79	108.264	40.42%	41.927	13.53%	67.9508	77.0965	113.46%	8%
			Agricultural	5746	52757.75		111.858	41.76%			7.4576	7.728	103.63%	
			Commercial/Industrial-LT	7780	19762.82		23.442	8.75%			25.7355	26.4992	102.97%	
			Commercial/Industrial-HT	35	6012.3		9.3	3.47%			9.1167	9.6874	106.26%	
			Others	857	5486.06		14.999	5.60%			14.4109	10.9542	76.01%	
Sub-total				74329	206460.08	309.79	267.863	100.00%	41.927	13.53%	124.6715	131.9653	105.85%	8%
53	EDC SHAMLI	EDD III SHAMLI	Residential	53643	98262.7	301.823	77.915	28.27%	26.21	8.68%	44.0317	50.4373	114.55%	2%
			Agricultural	7470	56564.87		126.27	45.81%			8.3203	9.793	117.70%	
			Commercial/Industrial-LT	3132	11426.71		14.467	5.25%			14.3114	14.4166	100.74%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	42	17221.5		51.816	18.80%			38.2134	37.0008	96.83%	
			Others	624	3726.17		5.145	1.87%			6.3614	7.9938	125.66%	
Sub-total				64911	187201.95	301.823	275.613	100.00%	26.21	8.68%	111.2382	119.6415	107.55%	2%
54	EDC SHAMLI	EDD IV SHAMLI	Residential	62482	110410.14	399.372	97.229	32.17%	97.125	24.32%	55.492	63.0922	113.70%	21%
			Agricultural	11533	86125		177.537	58.74%			12.6326	21.0007	166.24%	
			Commercial/Industrial-LT	4481	12522.78		15.746	5.21%			15.3773	14.5505	94.62%	
			Commercial/Industrial-HT	8	2153.7		4.854	1.61%			14.6105	4.1563	28.45%	
			Others	813	3752.67		6.881	2.28%			5.2774	4.9319	93.45%	
Sub-total				79317	214964.29	399.372	302.247	100.00%	97.125	24.32%	103.3898	107.7316	104.20%	21%
55	EUDC SAHARANUR	EUDD I SAHARANUR	Residential	60187	153231.63	317.859	168.628	60.52%	39.222	12.34%	121.3627	114.8125	94.60%	9%
			Agricultural	5	27.24		0.009	0.00%			0.0087	0.0097	111.49%	
			Commercial/Industrial-LT	14823	43717.95		53.267	19.12%			56.9801	57.9148	101.64%	
			Commercial/Industrial-HT	39	12662.2		23.659	8.49%			22.5732	22.1257	98.02%	
			Others	1048	11344.32		33.074	11.87%			27.3252	42.1098	154.11%	
Sub-total				76102	220983.34	317.859	278.637	100.00%	39.222	12.34%	228.2499	236.9725	103.82%	9%
56	EUDC SAHARANUR	EUDD II SAHARANPUR	Residential	53721	128696.26	326.809	140.789	49.36%	41.598	12.73%	98.3281	107.7047	109.54%	8%
			Agricultural	5	32.23		0.016	0.01%			0.0122	0.01	81.97%	
			Commercial/Industrial-LT	19988	53736.82		59.044	20.70%			69.2329	71.6588	103.50%	
			Commercial/Industrial-HT	29	12387.9		54.593	19.14%			46.2033	52.682	114.02%	
			Others	877	8853.53		30.769	10.79%			26.5248	19.9292	75.13%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				74620	203706.74	326.809	285.211	100.00%	41.598	12.73%	240.3013	251.9847	104.86%	8%
57	EDC I SAHARANPUR	EDD I SAHARANPUR	Residential	86616	154104.1	321.841	121.417	54.35%	98.437	30.59%	62.7809	70.2132	111.84%	29%
			Agricultural	5069	26978.95		49.448	22.13%			4.4472	4.8076	108.10%	
			Commercial/Industrial-LT	5270	17610.71		21.782	9.75%			20.9634	21.5883	102.98%	
			Commercial/Industrial-HT	38	13383		21.69	9.71%			20.6632	20.3626	98.55%	
			Others	831	4538		9.067	4.06%			11.3359	6.3388	55.92%	
Sub-total				97824	216614.76	321.841	223.404	100.00%	98.437	30.59%	120.1906	123.3105	102.60%	29%
58	EDC I SAHARANPUR	EDD DEOBAND	Residential	90850	139686.35	552.491	117.164	36.76%	233.782	42.31%	60.9441	60.9108	99.95%	46%
			Agricultural	12857	73233.22		148.807	46.69%			9.169	12.8655	140.32%	
			Commercial/Industrial-LT	6763	18914.53		22.606	7.09%			22.072	21.7169	98.39%	
			Commercial/Industrial-HT	13	4482.04		10.698	3.36%			9.2648	9.2213	99.53%	
			Others	1122	8098.55		19.434	6.10%			24.6132	13.9688	56.75%	
Sub-total				111605	244414.69	552.491	318.709	100.00%	233.782	42.31%	126.0631	118.6833	94.15%	46%
59	EDC I SAHARANPUR	EDD BEHAT	Residential	75215	132040.09	279.666	97.275	44.58%	61.454	21.97%	46.9598	49.6286	105.68%	26%
			Agricultural	4341	29140.52		54.52	24.98%			5.1884	4.5708	88.10%	
			Commercial/Industrial-LT	4120	11616.01		15.416	7.06%			14.9243	14.7528	98.85%	
			Commercial/Industrial-HT	110	38418.3		39.048	17.89%			43.1149	38.8032	90.00%	
			Others	1144	6594.19		11.953	5.48%			13.4731	9.5322	70.75%	
Sub-total				84930	217809.11	279.666	218.212	100.00%	61.454	21.97%	123.6605	117.2876	94.85%	26%
60	EDC II SAHARANPUR	EDD II SAHARANPUR	Residential	56188	106575.5	301.044	87.848	36.55%	60.722	20.17%	45.9808	52.1546	113.43%	13%
			Agricultural	5222	31523.37		65.963	27.45%			4.2452	5.9591	140.37%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	3860	20782.75		26.409	10.99%			24.7347	24.9977	101.06%	
			Commercial/Industrial-HT	72	19638.9		52.105	21.68%			38.8011	42.9348	110.65%	
			Others	859	4052.55		7.997	3.33%			6.6129	4.9431	74.75%	
Sub-total				66201	182573.07	301.044	240.322	100.00%	60.722	20.17%	120.3747	130.9893	108.82%	13%
61	EDC II SAHARANPUR	EDD NAKUR	Residential	89179	150339.64	611.751	108.974	27.31%	212.66	34.76%	54.8338	62.7807	114.49%	42%
			Agricultural	21153	131014.55		255.728	64.08%			55.1025	26.3543	47.83%	
			Commercial/Industrial-LT	5571	14158.11		16.382	4.10%			16.0194	15.9493	99.56%	
			Commercial/Industrial-HT	13	4893.8		7.836	1.96%			7.9007	8.5925	108.76%	
			Others	1399	7817.61		10.171	2.55%			11.0296	15.2267	138.05%	
Sub-total				117315	308223.71	611.751	399.091	100.00%	212.66	34.76%	144.886	128.9035	88.97%	42%
62	EDC II SAHARANPUR	EDD RAMPUR MANIHARAN	Residential	54885	84709.05	308.319	68.887	32.89%	98.866	32.07%	32.492	40.6234	125.03%	23%
			Agricultural	8798	58258.33		113.49	54.18%			6.7103	11.9641	178.29%	
			Commercial/Industrial-LT	3436	8985.79		10.63	5.08%			10.6787	10.8675	101.77%	
			Commercial/Industrial-HT	8	3526.2		9.111	4.35%			10.083	7.5253	74.63%	
			Others	883	3739.87		7.335	3.50%			7.6562	5.2179	68.15%	
Sub-total				68010	159219.24	308.319	209.453	100.00%	98.866	32.07%	67.6202	76.1982	112.69%	23%
63	EUDC-1 NOIDA	EUDD I NOIDA	Residential	44345	282079.69	1385.77 1	444.154	32.67%	26.172	1.89%	300.9128	313.6899	104.25%	1%
			Agricultural	1	4.48		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	6970	88712.3		133.577	9.82%			134.5712	130.4634	96.95%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	1060	284407.3		732.016	53.84%			652.4658	644.2781	98.75%	
			Others	1004	17059		49.852	3.67%			61.0036	73.5449	120.56%	
Sub-total				53380	672262.77	1385.771	1359.599	100.00%	26.172	1.89%	1148.9534	1161.9763	101.13%	1%
64	EUDC-1 NOIDA	EUDD V NOIDA	Residential	41141	212456.09	908.11	268.381	30.07%	15.508	1.71%	186.3145	186.1209	99.90%	0%
			Agricultural	1	7		0.001	0.00%			0.0023	0.0013	56.52%	
			Commercial/Industrial-LT	8407	90315.81		121.733	13.64%			128.2064	137.2524	107.06%	
			Commercial/Industrial-HT	751	215928.85		474.114	53.12%			477.925	480.08	100.45%	
			Others	852	10750.38		28.373	3.18%			34.0735	33.7245	98.98%	
Sub-total				51152	529458.13	908.11	892.602	100.00%	15.508	1.71%	826.5217	837.1791	101.29%	0%
65	EUDC-1 NOIDA	EUDD VII NOIDA	Residential	23407	139095.8	643.473	145.951	22.70%	0.623	0.10%	106.7604	115.2312	107.93%	-1%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	3182	28382.62		41.351	6.43%			45.9183	43.7033	95.18%	
			Commercial/Industrial-HT	448	232171		413.686	64.35%			431.6415	423.293	98.07%	
			Others	457	20889.9		41.862	6.51%			45.6507	55.1075	120.72%	
Sub-total				27494	420539.32	643.473	642.85	100.00%	0.623	0.10%	629.9709	637.335	101.17%	-1%
66	EUDC-2 NOIDA	EUDD II NOIDA	Residential	47633	328195.36	1300.872	353.781	27.41%	10.209	0.78%	242.3979	254.5856	105.03%	0%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	6556	59747.74		76.623	5.94%			80.063	80.053	99.99%	
			Commercial/Industrial-HT	999	340198.95		767.086	59.43%			643.1447	666.8565	103.69%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Others	1180	39123.93		93.173	7.22%			156.2738	125.9737	80.61%	
Sub-total				56368	767265.98	1300.872	1290.663	100.00%	10.209	0.78%	1121.8794	1127.4688	100.50%	0%
67	EUDC-2 NOIDA	EUDD III NOIDA	Residential	32344	220640.62	1013.839	275.331	27.17%	0.341	0.03%	197.2551	197.4125	100.08%	-3%
			Agricultural	11	61.88		0.209	0.02%			0.0465	0.0442	95.05%	
			Commercial/Industrial-LT	8863	89488.9		120.446	11.88%			129.6015	128.2319	98.94%	
			Commercial/Industrial-HT	556	316690.9		540.841	53.36%			588.6393	588.4734	99.97%	
			Others	1027	23629.78		76.671	7.56%			90.3511	123.7921	137.01%	
Sub-total				42801	650512.08	1013.839	1013.498	100.00%	0.341	0.03%	1005.8935	1037.9541	103.19%	-3%
68	EUDC-2 NOIDA	EDD IV NOIDA	Residential	59055	129961.05	501.115	140.354	33.91%	87.251	17.41%	75.3441	75.4772	100.18%	31%
			Agricultural	823	4581.02		5.334	1.29%			2.7906	0.7209	25.83%	
			Commercial/Industrial-LT	4839	20713.42		29.793	7.20%			31.3224	28.3655	90.56%	
			Commercial/Industrial-HT	88	69823.16		221.082	53.42%			183.7903	145.4068	79.12%	
			Others	467	5728.69		17.301	4.18%			21.097	14.5123	68.79%	
Sub-total				65272	230807.34	501.115	413.864	100.00%	87.251	17.41%	314.3444	264.4827	84.14%	31%
69	EUDC-2 NOIDA	EUDD VIII NOIDA	Residential	30613	58873	206.195	77.948	55.60%	66.004	32.01%	32.9734	21.5114	65.24%	45%
			Agricultural	4326	24566.48		39.539	28.20%			1.967	5.8471	297.26%	
			Commercial/Industrial-LT	2029	5896.34		11.666	8.32%			9.0596	7.8407	86.55%	
			Commercial/Industrial-HT	9	1741.5		4.542	3.24%			4.604	4.4536	96.73%	
			Others	272	2560.2		6.496	4.63%			7.6297	6.1781	80.97%	
Sub-total				37249	93637.52	206.195	140.191	100.00%	66.004	32.01%	56.2337	45.8309	81.50%	45%

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
70	EUDC-2 NOIDA	EUDD GREATER NOIDA	Residential	61630	146311.25	391.505	169.683	60.97%	113.183	28.91%	89.8456	79.486	88.47%	36%
			Agricultural	2656	15290.17		23.186	8.33%			8.784	2.1663	24.66%	
			Commercial/Industrial-LT	3852	14121.95		25.27	9.08%			25.7861	22.5485	87.44%	
			Commercial/Industrial-HT	15	46912.1		40.933	14.71%			44.6484	40.0387	89.68%	
			Others	471	5516.88		19.25	6.92%			24.393	30.116	123.46%	
Sub-total				68624	228152.35	391.505	278.322	100.00%	113.183	28.91%	193.4571	174.3555	90.13%	36%
71	EDC MORADABAD	EDD I MORADABAD	Residential	163507	234889.52	608.207	201.334	35.34%	38.468	6.32%	111.654	113.7559	101.88%	11%
			Agricultural	16027	95844.69		210.786	37.00%			25.1463	12.5876	50.06%	
			Commercial/Industrial-LT	8047	30709.43		39.157	6.87%			40.195	40.0402	99.61%	
			Commercial/Industrial-HT	144	39294.93		85.228	14.96%			80.0383	79.8142	99.72%	
			Others	2111	12761.67		33.234	5.83%			28.7577	25.7222	89.44%	
Sub-total				189836	413500.24	608.207	569.739	100.00%	38.468	6.32%	285.7913	271.9201	95.15%	11%
72	EDC MORADABAD	EDD II MORADABAD	Residential	106518	160446.54	283.704	124.471	49.64%	32.959	11.62%	68.3405	75.6495	110.69%	9%
			Agricultural	5077	29234.39		57.787	23.05%			5.7791	3.6081	62.43%	
			Commercial/Industrial-LT	5058	19344.05		23.191	9.25%			24.0257	24.2269	100.84%	
			Commercial/Industrial-HT	58	13096.4		27.475	10.96%			25.315	25.1573	99.38%	
			Others	1360	5758.53		17.821	7.11%			11.2952	10.0818	89.26%	
Sub-total				118071	227879.91	283.704	250.745	100.00%	32.959	11.62%	134.7555	138.7236	102.94%	9%
73	EDC MORADABAD	EDD III MORADABAD	Residential	101494	155474.7	221.301	131.142	60.05%	2.922	1.32%	73.0521	68.4605	93.71%	12%
			Agricultural	3879	24552.36		57.214	26.20%			9.4707	3.5101	37.06%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	3685	11417.79		16.698	7.65%			15.5503	14.5035	93.27%	
			Commercial/Industrial-HT	19	5711.4		5.292	2.42%			5.7728	7.0854	122.74%	
			Others	1363	5155.83		8.033	3.68%			7.5834	5.4951	72.46%	
Sub-total				110440	202312.08	221.301	218.379	100.00%	2.922	1.32%	111.4293	99.0546	88.89%	12%
74	EDC SAMBHAL	EDD CHANDASI	Residential	102175	155622.4	464.247	121.665	30.11%	60.196	12.97%	66.8037	71.1825	106.55%	19%
			Agricultural	12309	87272.14		197.809	48.96%			25.4738	12.078	47.41%	
			Commercial/Industrial-LT	7125	25376.72		34.13	8.45%			34.6879	35.2369	101.58%	
			Commercial/Industrial-HT	74	16927.7		38.418	9.51%			34.5715	34.6595	100.25%	
			Others	1947	7559.52		12.029	2.98%			10.1591	7.0805	69.70%	
Sub-total				123630	292758.48	464.247	404.051	100.00%	60.196	12.97%	171.696	160.2374	93.33%	19%
75	EDC SAMBHAL	EDD SHAMBHAL	Residential	121128	184622.8	620.616	178.138	35.68%	121.289	19.54%	80.8389	91.5256	113.22%	20%
			Agricultural	15174	107381.06		210.593	42.18%			25.4208	18.4176	72.45%	
			Commercial/Industrial-LT	10218	30626.94		57.858	11.59%			44.725	41.6245	93.07%	
			Commercial/Industrial-HT	73	15966.5		40.997	8.21%			35.7005	35.7839	100.23%	
			Others	1615	8443.81		11.741	2.35%			11.7671	10.2324	86.96%	
Sub-total				148208	347041.11	620.616	499.327	100.00%	121.289	19.54%	198.4523	197.584	99.56%	20%
76	EDC SAMBHAL	EDD BABRALA	Residential	54231	63991.65	221.81	38.661	20.49%	33.168	14.95%	18.965	20.5491	108.35%	22%
			Agricultural	8991	66391.29		135.645	71.91%			16.7782	10.6605	63.54%	
			Commercial/Industrial-LT	1950	7465.41		8.884	4.71%			9.1089	9.2541	101.59%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	10	1267.2		1.63	0.86%			1.6361	1.7183	105.02%	
			Others	1187	5511.78		3.822	2.03%			4.6442	4.5304	97.55%	
Sub-total				66369	144627.33	221.81	188.642	100.00%	33.168	14.95%	51.1324	46.7124	91.36%	22%
77	EDC AMROHA	EDD I AMROHA	Residential	58168	87385.75	393.46	82.383	23.23%	38.811	9.86%	43.4838	46.2271	106.31%	20%
			Agricultural	11671	65696.27		191.238	38.30%			13.2507	12.8366	96.87%	
			Commercial/Industrial-LT	3965	16269.97		47.355	9.48%			36.4873	35.9145	98.43%	
			Commercial/Industrial-HT	22	3844.8		7.3	1.46%			9.0617	10.0724	111.15%	
			Others	918	4105.45		26.373	5.28%			22.2772	5.5811	25.05%	
Sub-total				74744	177302.24	393.46	354.649	77.76%	38.811	9.86%	124.5607	110.6317	88.82%	20%
78	EDC AMROHA	EDD II AMROHA	Residential	74919	124975.79	377.124	110.22	37.31%	81.669	21.66%	53.2189	65.4562	122.99%	15%
			Agricultural	7994	47800.92		138.525	46.89%			12.9535	8.2345	63.57%	
			Commercial/Industrial-LT	7293	23998.53		35.035	11.86%			32.4378	32.9835	101.68%	
			Commercial/Industrial-HT	17	2343.28		4.16	1.41%			3.9773	4.126	103.74%	
			Others	933	3865.83		7.515	2.54%			7.5511	9.0572	119.95%	
Sub-total				91156	202984.35	377.124	295.455	100.00%	81.669	21.66%	110.1386	119.8574	108.82%	15%
79	EDC AMROHA	EDD I GAJRAULA	Residential	74092	107122.52	492.188	94.931	21.59%	52.463	10.66%	53.2049	63.0305	118.47%	8%
			Agricultural	11560	65625.87		165.944	37.74%			17.0011	12.264	72.14%	
			Commercial/Industrial-LT	4862	16472.49		20.536	4.67%			20.3334	21.3333	104.92%	
			Commercial/Industrial-HT	93	51294.1		151.137	34.37%			126.3049	125.87	99.66%	
			Others	907	4307.09		7.177	1.63%			8.3864	10.1767	121.35%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				91514	244822.07	492.188	439.725	100.00%	52.463	10.66%	225.2307	232.6745	103.30%	8%
80	EDC AMROHA	EDD HASANPUR	Residential	80025	99447.1	430.757	87.498	24.45%	72.857	16.91%	38.5217	40.6561	105.54%	17%
			Agricultural	20569	117688.21		248.637	69.47%			29.9664	23.7513	79.26%	
			Commercial/Industrial-LT	3901	11712.68		14.35	4.01%			11.6851	12.7687	109.27%	
			Commercial/Industrial-HT	9	1270.8		1.803	0.50%			1.8118	1.8166	100.26%	
			Others	1194	4248.35		5.612	1.57%			7.1677	10.1024	140.94%	
Sub-total				105698	234367.14	430.757	357.9	100.00%	72.857	16.91%	89.1527	89.0951	99.94%	17%
81	EUDC MORADABAD	EUDD I MORADABAD	Residential	55617	149412.6	323.723	143.354	47.35%	20.953	6.47%	103.7635	104.7023	100.90%	10%
			Agricultural	2	15		0.006	0.00%			0.0037	0.0036	97.30%	
			Commercial/Industrial-LT	11100	52470.97		58.164	19.21%			65.703	66.0679	100.56%	
			Commercial/Industrial-HT	178	38808.6		74.818	24.71%			74.3993	72.6112	97.60%	
			Others	1308	10067.64		26.428	8.73%			25.8903	16.9709	65.55%	
Sub-total				68205	250774.81	323.723	302.77	100.00%	20.953	6.47%	269.7598	260.3559	96.51%	10%
82	EUDC MORADABAD	EUDD II MORADABAD	Residential	49050	156160.38	292.682	166.631	63.25%	29.225	9.99%	117.9227	119.2399	101.12%	7%
			Agricultural	0	0		0	0.00%			0	0	0.00%	
			Commercial/Industrial-LT	12515	42493.57		45.276	17.19%			53.1466	54.1106	101.81%	
			Commercial/Industrial-HT	73	14921.76		27.006	10.25%			29.5679	37.012	125.18%	
			Others	1253	10428.41		24.544	9.32%			22.7969	20.3223	89.15%	
Sub-total				62891	224004.12	292.682	263.457	100.00%	29.225	9.99%	223.4341	230.6848	103.25%	7%
83	EUDC MORADABAD	EUDD III MORADABAD	Residential	61322	138668.91	279.543	148.242	59.50%	30.41	10.88%	103.9775	107.02	102.93%	11%
			Agricultural	0	0		0	0.00%			0	0	0.00%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	14843	59555.14		61.808	24.81%			68.539	69.5634	101.49%	
			Commercial/Industrial-HT	62	10080.7		16.136	6.48%			15.6983	15.6556	99.73%	
			Others	544	7881.84		22.947	9.21%			21.6646	16.4217	75.80%	
Sub-total				76771	216186.59	279.543	249.133	100.00%	30.41	10.88%	209.8794	208.6607	99.42%	11%
84	EDC RAMPUR	EDD I RAMPUR	Residential	68937	151187.95	395.597	149.534	52.12%	108.697	27.48%	101.7989	110.9091	108.95%	18%
			Agricultural	121	616.07		0.525	0.18%			0.296	0.2152	72.70%	
			Commercial/Industrial-LT	11069	31507.5		37.343	13.02%			42.445	42.6502	100.48%	
			Commercial/Industrial-HT	67	18550.3		56.407	19.66%			49.268	49.3251	100.12%	
			Others	1072	12132.42		43.091	15.02%			16.0999	34.4888	214.22%	
Sub-total				81266	213994.24	395.597	286.9	100.00%	108.697	27.48%	209.9078	237.5884	113.19%	18%
85	EDC RAMPUR	EDD II RAMPUR	Residential	97544	128419.4	328.769	140.541	55.06%	73.501	22.36%	56.2735	52.4368	93.18%	32%
			Agricultural	4018	23164.11		45.719	17.91%			4.7801	3.5957	75.22%	
			Commercial/Industrial-LT	4577	15209.38		20.731	8.12%			17.8173	16.955	95.16%	
			Commercial/Industrial-HT	56	21789.9		33.93	13.29%			32.7904	29.5168	90.02%	
			Others	2010	6759.16		14.347	5.62%			14.1059	7.3764	52.29%	
Sub-total				108205	195341.95	328.769	255.268	100.00%	73.501	22.36%	125.7672	109.8807	87.37%	32%
86	EDC RAMPUR	EDD MILAK	Residential	106768	127601.1	240.635	113.16	55.28%	35.947	14.94%	60.0576	62.4115	103.92%	19%
			Agricultural	4772	33455.13		49.951	24.40%			7.2279	5.0033	69.22%	
			Commercial/Industrial-LT	4290	12811.26		17.014	8.31%			16.4185	15.4297	93.98%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	18	5507.4		13.603	6.65%			12.3449	11.5386	93.47%	
			Others	2613	8690.01		10.96	5.35%			18.9573	15.445	81.47%	
Sub-total				118461	188064.9	240.635	204.688	100.00%	35.947	14.94%	115.0062	109.8281	95.50%	19%
87	EDC RAMPUR	EDD BILASPUR	Residential	66809	100027.59	331.857	93.292	33.64%	54.57	16.44%	48.072	54.4313	113.23%	12%
			Agricultural	6832	41971.17		75.652	27.28%			9.2527	6.5527	70.82%	
			Commercial/Industrial-LT	3851	11085.96		16.33	5.89%			15.3401	14.4391	94.13%	
			Commercial/Industrial-HT	134	46708.3		86.86	31.32%			70.9686	73.8894	104.12%	
			Others	1215	3783.77		5.153	1.86%			5.8967	8.3629	141.82%	
Sub-total				78841	203576.79	331.857	277.287	100.00%	54.57	16.44%	149.5301	157.6754	105.45%	12%
88	EDC BIJNOR	EDD I BIJNOR	Residential	54459	109881.38	287.881	96.519	42.33%	59.849	20.79%	58.2804	65.3353	112.11%	15%
			Agricultural	5667	34775.78		67.528	29.61%			5.0517	4.3661	86.43%	
			Commercial/Industrial-LT	6374	18106.89		22.288	9.77%			24.5108	24.3337	99.28%	
			Commercial/Industrial-HT	35	11079.3		21.108	9.26%			20.3618	21.4424	105.31%	
			Others	1156	7175.64		20.589	9.03%			17.4625	19.8568	113.71%	
Sub-total				67691	181018.99	287.881	228.032	100.00%	59.849	20.79%	125.6672	135.3343	107.69%	15%
89	EDC BIJNOR	EDD II BIJNOR	Residential	60693	91359.21	185.616	76.204	46.70%	22.453	12.10%	38.9341	47.8071	122.79%	6%
			Agricultural	5399	33007.62		57.556	35.28%			5.0784	4.147	81.66%	
			Commercial/Industrial-LT	4248	10919.47		12.858	7.88%			12.6555	13.0356	103.00%	
			Commercial/Industrial-HT	35	5797.8		9.689	5.94%			8.7259	8.4566	96.91%	
			Others	578	3355.56		6.856	4.20%			11.0058	7.982	72.53%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
Sub-total				70953	144439.66	185.616	163.163	100.00%	22.453	12.10%	76.3997	81.4283	106.58%	6%
90	EDC BIJNOR	EDD I CHANDPUR	Residential	54499	78157.38	321.464	72.433	26.42%	47.349	14.73%	42.4647	45.6816	107.58%	17%
			Agricultural	8479	48694.98		90.574	33.04%			6.3663	8.1871	128.60%	
			Commercial/Industrial-LT	4574	12719.99		16.91	6.17%			17.0857	16.4559	96.31%	
			Commercial/Industrial-HT	17	20809.5		83.783	30.56%			57.7924	53.1103	91.90%	
			Others	892	5108.63		10.415	3.80%			8.5016	4.9677	58.43%	
Sub-total				68461	165490.48	321.464	274.115	100.00%	47.349	14.73%	132.2107	128.4026	97.12%	17%
91	EDC BIJNOR	EDD II CHANDPUR	Residential	67522	92773.5	278.657	96.007	40.11%	39.31	14.11%	46.197	47.9711	103.84%	13%
			Agricultural	10581	58416.19		113.316	47.34%			9.9335	10.4546	105.25%	
			Commercial/Industrial-LT	3714	11509.88		23.108	9.65%			14.2256	14.0306	98.63%	
			Commercial/Industrial-HT	7	1283.4		1.296	0.54%			0.9623	1.2621	131.15%	
			Others	928	3553.79		5.62	2.35%			6.2471	4.746	75.97%	
Sub-total				82752	167536.76	278.657	239.347	100.00%	39.31	14.11%	77.5655	78.4644	101.16%	13%
92	EDC DHAMPUR	EDD NAJIBABAD	Residential	86651	164237.84	289.912	125.769	49.15%	34.025	11.74%	68.7342	78.7556	114.58%	9%
			Agricultural	6771	41690.11		75.623	29.55%			7.6226	5.126	67.25%	
			Commercial/Industrial-LT	8226	19837.33		25.33	9.90%			23.8032	24.0001	100.83%	
			Commercial/Industrial-HT	57	15614.1		20.984	8.20%			19.8986	18.5788	93.37%	
			Others	1060	4541.03		8.181	3.20%			7.5546	4.4891	59.42%	
Sub-total				102765	245920.41	289.912	255.887	100.00%	34.025	11.74%	127.6132	130.9496	102.61%	9%
93	EDC DHAMPUR	EDD I DHAMPUR	Residential	80232	134813.99	236.383	118.22	59.20%	36.672	15.51%	68.3851	76.0094	111.15%	11%
			Agricultural	5757	32432.47		48.223	24.15%			5.2575	3.8453	73.14%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-LT	8928	22985.83		24.141	12.09%			25.2065	23.8982	94.81%	
			Commercial/Industrial-HT	8	1665.9		1.791	0.90%			1.9985	1.8086	90.50%	
			Others	989	4987.13		7.336	3.67%			6.2307	6.6628	106.94%	
Sub-total				95914	196885.32	236.383	199.711	100.00%	36.672	15.51%	107.0783	112.2243	104.81%	11%
94	EDC DHAMPUR	EDD II DHAMPUR	Residential	106653	139000.16	282.904	143.277	59.24%	41.064	14.52%	60.6275	66.4837	109.66%	12%
			Agricultural	6310	35384.4		55.119	22.79%			6.0381	4.6183	76.49%	
			Commercial/Industrial-LT	7911	20955.01		34.645	14.33%			18.8164	19.2409	102.26%	
			Commercial/Industrial-HT	10	1468.8		1.455	0.60%			1.0752	1.352	125.74%	
			Others	1348	5425.3		7.344	3.04%			8.525	6.042	70.87%	
Sub-total				122232	202233.67	282.904	241.84	100.00%	41.064	14.52%	95.0822	97.7369	102.79%	12%
95	EDC DHAMPUR	EDD NAGINA	Residential	86698	149100.84	203.745	105.895	60.39%	28.388	13.93%	57.0812	62.6413	109.74%	10%
			Agricultural	4533	26142.08		37.401	21.33%			4.4057	4.2531	96.54%	
			Commercial/Industrial-LT	5974	15433.74		18.215	10.39%			17.684	17.6585	99.86%	
			Commercial/Industrial-HT	15	4041.9		7.34	4.19%			6.5041	6.297	96.82%	
			Others	827	3462.3		6.506	3.71%			6.4826	5.2491	80.97%	
Sub-total				98047	198180.86	203.745	175.357	100.00%	28.388	13.93%	92.1576	96.099	104.28%	10%
96	TOTAL		Residential	6290631	13697287.5	39107.84	13329.993	39.05%	4974.929	12.72%	8148.0401	8532.9152	104.72%	12.08%
			Agricultural	505168	3213055.68		6923.311	20.28%			764.3671	509.0772	66.60%	
			Commercial/Industrial-LT	654195	2741365.77		3617.345	10.60%			3631.5056	3694.4831	101.73%	

Sl. No.	Name of circle	Name of Division	Consumer profile			Energy parameters			Losses		Commercial Parameter			AT & C loss (%)
			Consumer category	Total Number of connections (Nos)	Total Connected Load (MW)	Input energy (MU)	Total energy Billed Energy (MU)	% of energy consumption	T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
			Commercial/Industrial-HT	9736	3682998.93		8618.491	25.25%			7706.0406	7669.5661	99.53%	
			Others	87322	678664.84		1643.771	4.82%			1650.5251	1654.0951	100.22%	
	TOTAL			7547052	24013372.8	39107.84	34132.911	100.00%	4974.929	12.72%	21900.4785	22060.1367	100.73%	12.08%


5. High Loss Divisions

EDD DEOBAND Division had the highest T&D loss quantum of 233.782 Mu and the highest AT&C loss in percentage of 46%. Further the circle has the highest loss that need to be prioritized can be identified from the below chart.

Sl. No	Name of Division	Energy parameters		Losses		Collection Efficiency	AT & C loss (%)
		Input energy (MU)	Total energy Billed Energy (MU)	T&D loss (MU)	T&D loss (%)		
1	EUDD I MEERUT	216.179	175.037	41.142	19.03%	98.23%	20%
2	EUDD III MEERUT	365.756	308.669	57.087	15.61%	103.76%	12%
3	EUDD V MEERUT	265.858	222.753	43.105	16.21%	96.89%	19%
4	EDD II MEERUT	510.018	392.643	117.375	23.01%	103.24%	21%
5	EDD II MAWANA	220.706	179.721	40.985	18.57%	113.24%	8%
6	EDD II BARAUT	436.44	355.946	80.494	18.44%	85.97%	30%
7	EDD I BAGHPAT	355.212	309.259	45.953	12.94%	95.82%	17%
8	EDD I LONI	462.121	388.74	73.381	15.88%	98.98%	17%
9	EDD III LONI	283.482	206.919	76.563	27.01%	105.52%	23%
10	EDD MURADNAGAR	479.182	382.697	96.485	20.14%	98.14%	22%
11	EDD-1 HAPUR	576.006	481.366	94.64	16.43%	100.44%	16%
12	EDD-2 HAPUR	794.759	681.334	113.425	14.27%	99.51%	15%
13	EDD GARH	399.727	364.082	35.645	8.92%	90.74%	17%
14	EUDD BULANDSHAHAHAR	311.21	233.857	77.353	24.86%	99.96%	25%
15	EDD VI BULANDSHAHAHAR	257.904	219.14	38.764	15.03%	90.79%	23%
16	EDD KHURJA	469.98	355.352	114.628	24.39%	99.97%	24%
17	EDD V BULANDSHAHAHAR	203.171	144.181	58.99	29.03%	104.18%	26%
18	EUDD I MUZAFFARNAGAR	347.417	285.218	62.199	17.90%	102.77%	16%
19	EDD I MUZAFFARNAGAR	626.301	513.045	113.256	18.08%	104.15%	15%
20	EDD II MUZAFFARNAGAR	470.132	380.351	89.781	19.10%	103.11%	17%
21	EDD KHATAULI	263.875	212.642	51.233	19.42%	108.31%	13%

Sl. No	Name of Division	Energy parameters		Losses		Collection Efficiency	AT & C loss (%)
		Input energy (MU)	Total energy Billed Energy (MU)	T&D loss (MU)	T&D loss (%)		
22	EDD BUDHANA	402.982	269.825	133.157	33.04%	109.02%	27%
23	EDD IV SHAMLI	399.372	302.247	97.125	24.32%	104.20%	21%
24	EDD I SAHARANPUR	321.841	223.404	98.437	30.59%	102.60%	29%
25	EDD DEOBAND	552.491	318.709	233.782	42.31%	94.15%	46%
26	EDD BEHAT	279.666	218.212	61.454	21.97%	94.85%	26%
27	EDD II SAHARANPUR	301.044	240.322	60.722	20.17%	108.82%	13%
28	EDD NAKUR	611.751	399.091	212.66	34.76%	88.97%	42%
29	EDD RAMPUR MANIHARAN	308.319	209.453	98.866	32.07%	112.69%	23%
30	EDD IV NOIDA	501.115	413.864	87.251	17.41%	84.14%	31%
31	EUDD VIII NOIDA	206.195	140.191	66.004	32.01%	81.50%	45%
32	EUDD GREATER NOIDA	391.505	278.322	113.183	28.91%	90.13%	36%
33	EDD CHANDASI	464.247	404.051	60.196	12.97%	93.33%	19%
34	EDD SHAMBHAL	620.616	499.327	121.289	19.54%	99.56%	20%
35	EDD BABRALA	221.81	188.642	33.168	14.95%	91.36%	22%
36	EDD I AMROHA	393.46	354.649	38.811	9.86%	88.82%	20%
37	EDD II AMROHA	377.124	295.455	81.669	21.66%	108.82%	15%
38	EDD HASANPUR	430.757	357.9	72.857	16.91%	99.94%	17%
39	EDD I RAMPUR	395.597	286.9	108.697	27.48%	113.19%	18%
40	EDD II RAMPUR	328.769	255.268	73.501	22.36%	87.37%	32%
41	EDD MILAK	240.635	204.688	35.947	14.94%	95.50%	19%
42	EDD BILASPUR	331.857	277.287	54.57	16.44%	105.45%	12%
43	EDD I BIJNOR	287.881	228.032	59.849	20.79%	107.69%	15%
44	EDD I CHANDPUR	321.464	274.115	47.349	14.73%	97.12%	17%
45	EDD I DHAMPUR	236.383	199.711	36.672	15.51%	104.81%	11%

Losses T & D loss
(MU)

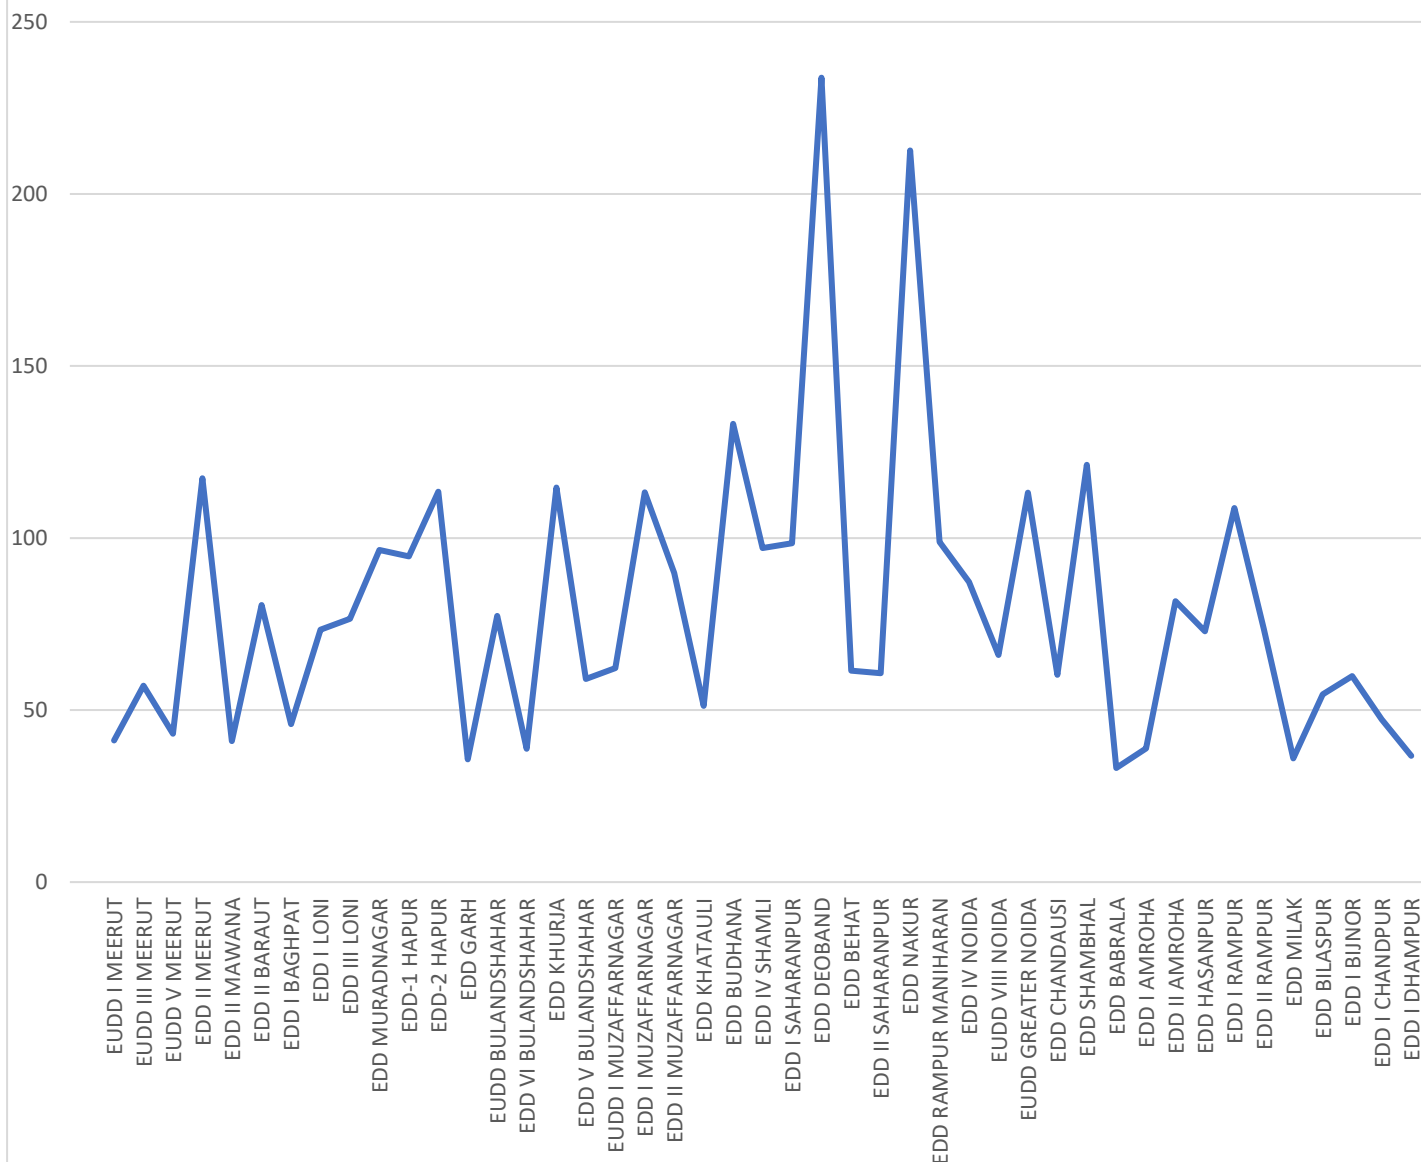

The list of top 10 Division with highest AT&C loss & T&D loss(MU) identified from the above chart are tabulated below:

Sl. No	Name of Division	Energy parameters		Losses		Collection Efficiency	AT & C loss (%)
		Input energy (MU)	Total energy Billed Energy (MU)	T&D loss (MU)	T&D loss (%)		
1	EDD II BARAUT	436.44	355.946	80.494	18.44%	85.97%	30%
2	EDD V BULANDSHAHAR	203.171	144.181	58.99	29.03%	104.18%	26%
3	EDD I SAHARANPUR	321.841	223.404	98.437	30.59%	102.60%	29%
4	EDD DEOBAND	552.491	318.709	233.782	42.31%	94.15%	46%
5	EDD BEHAT	279.666	218.212	61.454	21.97%	94.85%	26%
6	EDD NAKUR	611.751	399.091	212.66	34.76%	88.97%	42%
7	EDD IV NOIDA	501.115	413.864	87.251	17.41%	84.14%	31%
8	EUDD VIII NOIDA	206.195	140.191	66.004	32.01%	81.50%	45%
9	EUDD GREATER NOIDA	391.505	278.322	113.183	28.91%	90.13%	36%
10	EDD II RAMPUR	328.769	255.268	73.501	22.36%	87.37%	32%

Further it was observed that the collection efficiency is more than 100% across all the division as shown below:

Sl. No	Name of circle	Name of Division	Commercial Parameter		
			Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency
1	EUDC MEERUT	EUDD II MEERUT	295.25	298.4515	101.08%
2	EUDC MEERUT	EUDD III MEERUT	218.5008	226.7174	103.76%
3	EUDC MEERUT	EUDD IV MEERUT	333.7993	339.4262	101.69%
4	EDC I MEERUT	EDD I MEERUT	325.1065	367.5626	113.06%
5	EDC I MEERUT	EDD III MEERUT	218.5954	221.2591	101.22%
6	EDC I MEERUT	EDD IV MEERUT	110.6597	136.769	123.59%
7	EDC II MEERUT	EDD II MEERUT	162.6483	167.9151	103.24%
8	EDC II MEERUT	EDD I MAWANA	99.1309	107.4966	108.44%
9	EDC II MEERUT	EDD II MAWANA	61.3896	69.5156	113.24%
10	EUDC I GHAZIABAD	EUDD V GHAZIABAD	362.4667	365.7012	100.89%
11	EUDC I GHAZIABAD	EUDD IX GHAZIABAD	348.9256	354.9792	101.73%
12	EUDC II GHAZIABAD	EUDD II GHAZIABAD	578.4179	580.6612	100.39%

Sl. No	Name of circle	Name of Division	Commercial Parameter		
			Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency
13	EUDC II GHAZIABAD	EUDD VIII GHAZIABAD	335.8159	338.6517	100.84%
14	EUDC II GHAZIABAD	EUDD XI GZB (KHODA)	131.8474	133.0557	100.92%
15	EUDC III GHAZIABAD	EUDD III GHAZIABAD	187.3298	191.7205	102.34%
16	EUDC III GHAZIABAD	EUDD IV GHAZIABAD	289.8725	294.6252	101.64%
17	EUDC III GHAZIABAD	EUDD VII GHAZIABAD	446.2598	456.122	102.21%
18	EDC LONI	EDD II LONI	188.5517	198.211	105.12%
19	EDC LONI	EDD III LONI	144.9902	152.9967	105.52%
20	EDC GHAZIABAD	EDD MODINAGAR	201.4378	216.3545	107.41%
21	EDC HAPUR	EDD-1 HAPUR	315.7952	317.194	100.44%
22	EDC II BULANDSHAHAR	EDD I BULANDSHAHAR	463.3051	481.9673	104.03%
23	EDC II BULANDSHAHAR	EDD V BULANDSHAHAR	53.3988	55.6283	104.18%
24	EDC III BULANDSHAHAR	EDD III BULANDSHAHAR	71.7059	72.8345	101.57%
25	EDC III BULANDSHAHAR	EDD JAHANGIRABAD	101.5212	103.6179	102.07%
26	EUDC MUZAFFARNAGAR	EUDD I MUZAFFARNAGAR	219.4138	225.4987	102.77%
27	EUDC MUZAFFARNAGAR	EUDD II MUZAFFARNAGAR	163.6259	171.032	104.53%
28	EDC I MUZAFFARNAGAR	EDD I MUZAFFARNAGAR	279.6729	291.2724	104.15%
29	EDC I MUZAFFARNAGAR	EDD II MUZAFFARNAGAR	127.6517	131.6153	103.11%
30	EDC II MUZAFFARNAGAR	EDD KHATAULI	98.2373	106.4054	108.31%
31	EDC II MUZAFFARNAGAR	EDD BUDHANA	75.9603	82.8131	109.02%
32	EDC SHAMLI	EDD II SHAMLI	124.6715	131.9653	105.85%
33	EDC SHAMLI	EDD III SHAMLI	111.2382	119.6415	107.55%
34	EDC SHAMLI	EDD IV SHAMLI	103.3898	107.7316	104.20%
35	EUDC SAHARANUR	EUDD I SAHARANUR	228.2499	236.9725	103.82%
36	EUDC SAHARANUR	EUDD II SAHARANPUR	240.3013	251.9847	104.86%
37	EDC I SAHARANPUR	EDD I SAHARANPUR	120.1906	123.3105	102.60%
38	EDC II SAHARANPUR	EDD II SAHARANPUR	120.3747	130.9893	108.82%
39	EDC II SAHARANPUR	EDD RAMPUR MANIHARAN	67.6202	76.1982	112.69%

Sl. No	Name of circle	Name of Division	Commercial Parameter		
			Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency
40	EUDC-1 NOIDA	EUDD I NOIDA	1148.9534	1161.9763	101.13%
41	EUDC-1 NOIDA	EUDD V NOIDA	826.5217	837.1791	101.29%
42	EUDC-1 NOIDA	EUDD VII NOIDA	629.9709	637.335	101.17%
43	EUDC-2 NOIDA	EUDD II NOIDA	1121.8794	1127.4688	100.50%
44	EUDC-2 NOIDA	EUDD III NOIDA	1005.8935	1037.9541	103.19%
45	EDC MORADABAD	EDD II MORADABAD	134.7555	138.7236	102.94%
46	EDC AMROHA	EDD II AMROHA	110.1386	119.8574	108.82%
47	EDC AMROHA	EDD I GAJRAULA	225.2307	232.6745	103.30%
48	EUDC MORADABAD	EUDD II MORADABAD	223.4341	230.6848	103.25%
49	EDC RAMPUR	EDD I RAMPUR	209.9078	237.5884	113.19%
50	EDC RAMPUR	EDD BILASPUR	149.5301	157.6754	105.45%
51	EDC BIJNOR	EDD I BIJNOR	125.6672	135.3343	107.69%
52	EDC BIJNOR	EDD II BIJNOR	76.3997	81.4283	106.58%
53	EDC BIJNOR	EDD II CHANDPUR	77.5655	78.4644	101.16%
54	EDC DHAMPUR	EDD NAJIBABAD	127.6132	130.9496	102.61%
55	EDC DHAMPUR	EDD I DHAMPUR	107.0783	112.2243	104.81%
56	EDC DHAMPUR	EDD II DHAMPUR	95.0822	97.7369	102.79%
57	EDC DHAMPUR	EDD NAGINA	92.1576	96.099	104.28%

Further it was observed that the AT & C loss are comes in (-ve) of some division as shown below:

S.No	Name of Division	Losses		Commercial Parameter			AT & C loss (%)
		T&D loss (MU)	T&D loss (%)	Billed Amount in Rs. Crore	Collected Amount in Rs. Crore	Collection Efficiency	
1	EDD IV MEERUT	62.207	17.76%	110.6597	136.769	123.59%	-2%
2	EDD MODINAGAR	13.484	3.69%	201.4378	216.3545	107.41%	-3%
3	EUDD VII NOIDA	0.623	0.10%	629.9709	637.335	101.17%	-1%
4	EUDD III NOIDA	0.341	0.03%	1005.8935	1037.9541	103.19%	-3%

Further it was observed that the AT & C loss are comes to zero of some division as shown below:

Sl. No.	Name of Division	Energy Parameters		Losses		AT & C loss (%)
		Input Energy (MU)	Total Billed Energy (MU)	T&D loss (MU)	T&D loss (%)	
1	EUDD VIII GHAZIABAD	424.776	419.535	5.241	1.23%	0%
2	EUDD VII GHAZIABAD	564.587	553.178	11.409	2.02%	0%
3	EDD III BULANDSHAHAHAR	275.592	271.27	4.322	1.57%	0%
4	EDD JAHANGIRABAD	292.627	286.739	5.888	2.01%	0%
5	EUDD V NOIDA	908.11	892.602	15.508	1.71%	0%
6	EUDD II NOIDA	1300.872	1290.663	10.209	0.78%	0%

5.2.4. Feeder Wise T&D Losses Analysis

Table of No. of Feeders having T&D loss in different Range

Sl. No.	Range of T&D Loss	QTY (No. of Feeders)
1.	6-20%	1094
2.	20-40%	1466
3.	40-60%	1098
4.	60-80%	552
5.	80-100%	326

5.2.5. Feeder Wise AT&C Losses Analysis

Table of No. of Feeders having T&D loss in different Range

Sl. No.	Range of T&D Loss	QTY (No. of Feeders)
1.	6-20%	683
2.	20-40%	696
3.	40-60%	984
4.	60-80%	1331
5.	80-100%	1568

- **Most of the feeder In the range of 60 to 80% and 80 to 100% the are the rural area feeders.**
- **Some feeders with negative T&D losses also have negative AT&C losses.**
- **The details of the feeders with the highest AT&C losses, which fall within the top 10% of the total feeders, are provided in the table below.**

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
PTW_13014290817PTW	RURAL	AMR	0.16	0.01	96.2%	100.00%
FEEDER NO 8_14102230420FD8	URBAN		0.05	0.00	100.0%	100.00%
GOVINDGARH_14102491193GOV	RURAL	AMR	4.17	0.00	100.0%	100.00%
TVS ROAD PTW_11083191505TRP	RURAL	METERED	0.09	0.01	90.3%	100.00%
SAMANA PTW_16734291427SNG	RURAL	AMR	1.20	0.01	99.3%	100.00%
RANDHEDI PTW_13016190886RND	RURAL	AMR	0.64	0.01	98.7%	100.00%
SECTOR 1_15092111330SE1	URBAN		10.40	0.83	92.0%	99.99%
PANJAB NAGAR II PTW_12054391317PN2	RURAL		1.69	0.01	99.5%	99.99%
FEEDER 6_14101510059F06	URBAN	AMR	9.73	0.00	100.0%	99.99%
ALAMPUR_16734290863ALA	RURAL		3.93	0.00	100.0%	99.98%
SIRSALI PTW_13016390918SRL	RURAL	AMR	2.91	0.03	99.0%	99.98%
KAHROLA_16111190937KHL	RURAL	METERED	1.49	0.00	100.0%	99.97%
FEEDER 2_14101510410F02	URBAN	AMR	1.70	0.00	100.0%	99.97%
SHAMLI SHAMLA TOWN_13745490632SST	RURAL		0.50	0.00	99.9%	99.96%
SECTOR 16A & 16B_15092111330SE2	URBAN	AMR	3.75	0.00	99.9%	99.95%
BAJHEDA PTW_16734210162BAJ	RURAL	METERED	2.94	0.05	98.4%	99.95%
GANJHERI_13014390837GJR	RURAL		1.29	0.00	99.9%	99.94%
FEEDER NO 1_14102320078F01	URBAN		4.64	0.00	100.0%	99.94%
CHAKWALI PTW_13016390918CHL	RURAL	AMR	2.73	0.02	99.3%	99.92%
DODHLI 250_13022290591DLI	RURAL	METERED	0.35	0.00	99.9%	99.92%
HAPUR ROAD_11071230019HR4	URBAN	AMR	5.71	0.00	99.9%	99.92%
UMRI KALA PTW_13016390918UMR	RURAL	AMR	4.14	0.00	99.9%	99.92%
HALGOVA PTW_13016390918HAL	RURAL	METERED	4.29	0.01	99.9%	99.91%
KURDHEE-II_13014390831KR2	RURAL	AMR	4.93	0.05	98.9%	99.86%
FATEHPUR PTW_13016190878FTP	RURAL	METERED	0.89	0.01	98.5%	99.86%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
PTW_13014291474PTW	RURAL	METERED	0.94	0.07	92.2%	99.85%
R/L HAMIRPUR PTW_12036291059HAM	RURAL	METERED	4.16	0.22	94.8%	99.84%
KALYANPUR PTW_13027290559KAL	RURAL	AMR	0.19	0.00	99.9%	99.83%
KISHANPUR PTW_16112191130KIS	RURAL	AMR	0.33	0.02	93.2%	99.83%
SHIV NAGRI PTW_16734120194SHI	RURAL	AMR	0.78	0.15	80.5%	99.82%
ALAMNAGAR PTW_16734390845ALA	RURAL	AMR	3.25	0.03	99.1%	99.82%
KARODI PTW_13745290701KAR	RURAL	METERED	3.89	0.03	99.2%	99.81%
MUMTAJ NAGAR_11071330020MUM	URBAN	AMR	12.64	0.02	99.8%	99.80%
LANK TOWN_13745190659LAK	RURAL		1.67	0.01	99.5%	99.79%
TAROLI_12063491261TAR	RURAL	AMR	4.68	0.07	98.5%	99.78%
DHADIYAL-2_12063491268DH2	RURAL		3.16	0.01	99.8%	99.77%
FEEDER NO 1_14102220066F01	URBAN		0.00	0.00	99.8%	99.75%
ALLAUDINPUR PTW_12035691280ALL	RURAL	AMR	2.12	0.10	95.3%	99.74%
PASUA NANGLA_12063491263PSN	RURAL	METERED	0.85	0.00	99.5%	99.74%
HALALPUR PTW_11083191506HAP	RURAL	METERED	1.30	0.04	97.0%	99.73%
KHERI MADHTI PTW_13014290813MAK	RURAL	AMR	4.60	0.03	99.4%	99.71%
GURAWALI_16113391106GUR	RURAL	AMR	3.12	0.09	97.3%	99.70%
FEEDER NO 10_14102330458F10	URBAN		1.22	0.02	98.7%	99.69%
KURANA PTW_13016390921KHU	RURAL	AMR	1.49	0.05	96.7%	99.69%
RAGHUNATH PUR PTW_15093490534RHG	RURAL	AMR	3.87	0.08	97.8%	99.67%
INDUSTRIAL_14102410221IND	URBAN		3.24	0.01	99.6%	99.64%
BHARTAPUR(AG) PTW_13016290905BHA	RURAL	AMR	0.37	0.01	97.4%	99.60%
BUNKAR_14004311239BNK	RURAL	AMR	1.31	0.05	95.8%	99.59%
OSIKKA PTW_11083290782OSI	RURAL	METERED	2.69	0.11	96.0%	99.59%
LOHARA_16113391111LOH	RURAL	AMR	2.00	0.11	94.7%	99.56%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
DOBKA_16111390953DOB	RURAL	AMR	4.41	0.23	94.8%	99.55%
ASARA PTW_11083190756ASR	RURAL	AMR	5.95	0.12	98.0%	99.54%
TANDA MAZRA_13027290562TAN	RURAL		0.96	0.11	88.8%	99.53%
R/L UMARPUR PTW_12036291063UMA	RURAL	METERED	7.69	1.38	82.1%	99.41%
KHARAD PTW_13022190610KHA	RURAL	AMR	1.82	0.86	52.8%	99.37%
VAZIDPUR PTW_11083290761VAZ	RURAL	METERED	0.74	0.01	98.6%	99.34%
RANIYAWALI_16111190937RWL	RURAL	METERED	3.60	0.06	98.4%	99.34%
SUGARCAN PTW_13745290672SAG	RURAL	METERED	1.33	0.02	98.5%	99.34%
FEEDER NO 7_14102340459F07	URBAN		1.33	0.01	99.4%	99.30%
MORI PATTI PTW_12063391452MPA	RURAL		0.30	0.06	80.9%	99.30%
CHHAPKOLI TOWN_16734190861TWN	RURAL		0.86	0.01	98.9%	99.24%
KALINDI KUNJ_16111110269KAK	RURAL		7.24	0.06	99.1%	99.21%
JAINPUR PTW_13016190889JAI	RURAL	AMR	2.30	0.07	96.9%	99.21%
HURMANJPUR TOWN_13745190656RAM	RURAL		0.16	0.00	98.8%	99.14%
TYODI PTW_16734290855TOR	RURAL	AMR	2.34	0.14	94.0%	99.13%
KALSI_13016190872KAL	RURAL	METERED	2.74	0.03	98.7%	99.07%
NASRULA GARH_13016190894NSG	RURAL		2.06	0.39	80.9%	99.00%
HALWANI_13014290817HLW	RURAL	METERED	0.62	0.01	98.3%	98.99%
NANGLA PTW_13027290562NAN	RURAL	AMR	2.80	0.09	96.7%	98.95%
RAIPUR PTW_12047391336RAP	RURAL	METERED	2.41	0.93	61.2%	98.90%
BADOLI PTW_11083190740BAD	RURAL	AMR	4.90	0.51	89.6%	98.75%
SULTANPUR TOWN_13016190897SUT	RURAL		2.23	0.26	88.4%	98.74%
FEEDER NO 4_14101520409F04	URBAN		0.20	0.00	99.2%	98.73%
SALARPURA_13016190876SLP	RURAL	AMR	8.81	0.25	97.2%	98.72%
GUNGAKHERI PTW_11083291356GUN	RURAL	METERED	1.70	0.18	89.6%	98.65%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
MACHRI PTW_15093290523MCJ	RURAL	AMR	3.56	0.31	91.3%	98.63%
PALI PTW_11083390527PPT	RURAL	AMR	7.32	0.76	89.6%	98.55%
KAMRAJPUR PTW_12036391080NAG	RURAL	AMR	0.84	0.18	78.9%	98.54%
R/L EAST_12036210276RLE	RURAL	AMR	17.32	1.99	88.5%	98.49%
SAMATHAL PTW_12041191155SAM	RURAL	METERED	3.20	0.34	89.5%	98.40%
PURAMAHDEV PTW_11083490728PUR	RURAL	AMR	1.65	0.35	78.8%	98.39%
NANKAR PTW_12041191163NAN	RURAL	AMR	2.42	0.47	80.6%	98.38%
KAUSHALIYA PTW_15093490535KAU	RURAL	METERED	5.44	0.38	93.0%	98.30%
LAKH PTW_13745290709LAK	RURAL	AMR	2.05	0.18	91.0%	98.30%
ISHAKNAGAR PTW_11001120528INK	RURAL	AMR	3.20	0.22	93.2%	98.28%
PATTI GRAMIN_12063491496PTG	RURAL	METERED	3.01	0.09	97.0%	98.27%
KULEHDI PTW_13016190889KUL	RURAL	METERED	0.90	0.06	93.0%	98.25%
BHUMIYA KA PUL_11071531398BMP	URBAN	AMR	4.83	0.09	98.1%	98.24%
SEHAL PTW_16734390845SEH	RURAL	METERED	2.30	0.21	91.0%	98.21%
PATHARAWA PTW_13014290809PAW	RURAL	AMR	0.97	0.04	95.9%	98.21%
JADOOL PTW_16113391106JAD	RURAL	AMR	2.68	0.23	91.3%	98.21%
ISHAPUR PTW_16734290855ISH	RURAL	METERED	10.44	0.34	96.8%	98.19%
DOGHAT TOWN_13001420778DOT	RURAL	AMR	7.02	1.93	72.5%	98.15%
RAMPUR_12063391240RAM	RURAL	METERED	4.63	1.27	72.6%	98.12%
PANIYALI_13014390833PAN	RURAL	AMR	1.81	0.02	98.7%	98.11%
KANAKPUR PTW_16734290871KNP	RURAL	AMR	1.16	0.26	77.5%	98.07%
DAULATPUR PTW_13014390826DLP	RURAL		1.02	0.39	61.3%	98.06%
SARAWANI PTW_16734390852SAR	RURAL	AMR	2.43	0.92	62.4%	98.01%
ASARA PTW_11083190757ASA	RURAL	AMR	2.68	0.70	73.9%	98.01%
LALIYANA PTW_11083490722LAL	RURAL	AMR	3.28	0.60	81.9%	97.99%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
NAGLI NOOR PTW_13014390822NAG	RURAL		0.50	0.15	70.4%	97.97%
SORLA TOWN_16113391110SOR	RURAL	METERED	2.96	0.13	95.5%	97.92%
BHAGWAT PURA_11071530266BHA	URBAN	AMR	13.41	0.31	97.7%	97.90%
KAKRIPUR PTW_11083190751KAK	RURAL	AMR	2.66	0.30	88.6%	97.86%
GHASOLI PTW_11072491345GHA	RURAL	AMR	1.09	0.28	74.3%	97.86%
KAUL PTW_16734390843KOL	RURAL	AMR	3.27	1.41	57.0%	97.82%
NEW PADOLI_13014390838NPD	RURAL		9.19	0.64	93.0%	97.77%
FEEDER NO 6_16734110427FD6	URBAN		0.30	0.01	98.1%	97.77%
JAMUNA KHAS_12063391243JAM	RURAL	METERED	4.03	1.00	75.1%	97.74%
CHITORA PTW_15093490529CHI	RURAL	AMR	9.48	0.78	91.7%	97.70%
MOHNDA PTW_13016190887MOH	RURAL	METERED	7.39	0.98	86.7%	97.70%
JADOL PTW_16113191115JAD	RURAL	AMR	1.98	0.93	53.2%	97.67%
RAHAMAPUR_16111390954RAH	RURAL	AMR	4.10	0.38	90.6%	97.67%
JALALPUR JUNGLE PTW_11072130021JAL	RURAL	AMR	0.43	0.41	4.7%	97.66%
PARA KHALSA_12063291244PAR	RURAL	METERED	0.80	0.26	67.2%	97.59%
NENEHDA PTW_12063391241NNG	RURAL	METERED	0.16	0.11	30.9%	97.53%
SONTI PTW_11083190751SON	RURAL	AMR	2.49	0.54	78.2%	97.53%
NAGLA TOWN_11071490698NGL	RURAL		1.59	0.03	97.9%	97.50%
KHEDA_11074291022KAU	RURAL	METERED	7.36	0.42	94.3%	97.50%
NITHORA_15097121370NIT	RURAL	METERED	7.44	0.70	90.5%	97.47%
AYADNAGAR_16112291097AYA	RURAL	METERED	1.94	0.45	76.7%	97.43%
JAGOS PTW_11083190743JAG	RURAL	AMR	1.63	0.12	92.9%	97.41%
FEEDER NO 5_12042115013IN5	URBAN	AMR	0.17	0.00	97.3%	97.39%
BAMANPURA_16734190862BAM	RURAL	AMR	6.67	0.73	89.1%	97.37%
SADHARANPUR_16112291098SAD	RURAL	AMR	3.61	0.97	73.2%	97.32%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
SINGHWALI PTW_11083490728SIN	RURAL	AMR	2.90	0.83	71.4%	97.29%
KAKRALA PTW_12035691288KAK	RURAL	AMR	1.46	0.28	81.0%	97.28%
RAMGARI_16111190941RGI	RURAL	METERED	6.46	0.53	91.8%	97.28%
BHORA KHURD PTW_13022190610BHO	RURAL	AMR	1.30	0.62	52.1%	97.26%
ADAMPUR PTW_12047391336ADA	RURAL	METERED	2.90	0.95	67.1%	97.23%
KHERI KALA_11074291396KTN	RURAL	AMR	0.69	0.04	93.7%	97.19%
KHAPRANA PTW_11083290772KHA	RURAL	AMR	3.38	1.07	68.4%	97.18%
GWALIKHERA PTW_11083390724GWA	RURAL	AMR	3.91	0.94	76.0%	97.17%
BHOT-K PTW_12054291294BHO	RURAL	AMR	0.21	0.17	21.1%	97.17%
LOI PTW_11083290772LOI	RURAL	AMR	5.13	2.19	57.4%	97.14%
DHANORA PTW_11083290772DHA	RURAL	AMR	5.96	1.97	67.0%	97.06%
SHAHPUR-I PTW_16111190941SHI	RURAL	AMR	5.81	0.88	84.8%	97.04%
AKHTIYARPUR TOWN_16112391139AKH	RURAL	METERED	2.02	0.25	87.6%	96.99%
RAILWAY JUNCTION-I PTW_16111190941RLI	RURAL	AMR	5.02	1.06	78.9%	96.99%
SONDA PTW_15093230239SNP	RURAL		0.46	0.27	41.9%	96.98%
NAWADA_16112110118NAW	RURAL	AMR	8.13	0.88	89.2%	96.95%
KAITHALA PTW_16112391135KAI	RURAL	AMR	1.94	0.59	69.3%	96.94%
HESAWDA PTW_11083390732HPW	RURAL	METERED	2.45	0.81	66.7%	96.94%
HAIMADPUR_12047591337HAI	RURAL		2.54	0.20	92.2%	96.93%
CHHUR_11074291018CHR	RURAL	AMR	10.12	1.34	86.8%	96.92%
BONDHRA_16112291089BON	RURAL	AMR	5.33	1.40	73.8%	96.88%
BUDHANA MOD PTW_13022190602BHU	RURAL	AMR	1.27	0.36	71.6%	96.82%
PINNA PTW_13022190602PIN	RURAL	AMR	1.12	0.46	59.1%	96.82%
CHANDENA PTW_13016390929CHA	RURAL	AMR	4.11	0.46	88.7%	96.80%
DUBHEDI KURD TOWN_13745390689DKN	RURAL	METERED	4.01	0.21	94.8%	96.78%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
KAILLY PTW_16734190859KAI	RURAL	AMR	1.05	0.29	72.7%	96.73%
KALANDI JUNGLE PTW_11074291397KAJ	RURAL	METERED	1.91	0.77	59.7%	96.72%
FEEDER 12_14101120061F12	URBAN	AMR	1.75	1.13	35.3%	96.68%
BHATYANA PTW_16734290863BHA	RURAL	AMR	3.09	1.15	62.7%	96.67%
MULHEDA TOWN_11074291018MAE	RURAL	METERED	7.68	0.47	93.8%	96.66%
NAGLA TOWN_13027290562TOT	RURAL	AMR	4.46	0.16	96.4%	96.63%
SANKAL PUTTHI PTW_11083390724SAN	RURAL	AMR	5.07	1.43	71.8%	96.61%
BHORAKALA PTW_13022190610BHO	RURAL	AMR	2.15	1.29	39.8%	96.59%
PURAINA PTW_12054391317PUR	RURAL	AMR	0.67	0.22	66.5%	96.56%
KASERVA RURAL PTW_13745390682KWA	RURAL	AMR	1.70	0.26	84.7%	96.56%
KAKDIPUR PTW_11083190755KAK	RURAL	AMR	1.75	0.49	72.2%	96.55%
BANDAHERI PTW_13016190882BAN	RURAL	METERED	2.35	0.18	92.4%	96.54%
BAMNOLI PTW_11083290773BAM	RURAL	AMR	4.33	1.39	67.8%	96.51%
MUNDALI PTW_16734390843MUN	RURAL	AMR	2.47	1.17	52.6%	96.50%
BADHLI PTW_16734390852BAD	RURAL	AMR	2.86	1.39	51.4%	96.47%
DAULA PTW_11083490730DAU	RURAL	AMR	1.57	0.14	90.8%	96.40%
ATRADA JANGAL_16734190862ATJ	RURAL	AMR	4.16	1.99	52.2%	96.36%
ILNA_16113391106IIN	RURAL	AMR	3.97	0.54	86.5%	96.34%
BHOGAPUR TOWN_16734390846BTW	RURAL	AMR	2.60	0.29	88.7%	96.25%
KAPURGARH PTW_13022190610KAP	RURAL	AMR	1.20	0.63	47.6%	96.25%
UKHLINA PTW_11072490992UKH	RURAL	AMR	1.66	0.85	49.0%	96.25%
BHATAL PTW_16734390853BPT	RURAL	AMR	5.75	0.62	89.2%	96.24%
SUGARCANE PTW_13745290702SUG	RURAL	METERED	0.14	0.11	19.0%	96.24%
SISALI TOWN_16001110578STW	RURAL	AMR	3.32	0.15	95.5%	96.24%
MAINAPUTTI JUNGLE PTW_11074291019MIJ	RURAL	AMR	1.96	0.43	78.1%	96.24%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
RANCHHAD PTW_11083290763RAN	RURAL	AMR	3.73	1.51	59.6%	96.23%
BASOLI PTW_11083190750BAS	RURAL	AMR	1.40	0.16	88.7%	96.22%
GINAURA SHEKH PTW_16112391135GIN	RURAL	AMR	1.55	0.79	48.8%	96.20%
CHANDOK_16113391107CHA	RURAL	AMR	2.55	0.13	94.8%	96.19%
MADANPUR_16111190941MDR	RURAL	METERED	6.10	0.50	91.8%	96.18%
DANKOLA_13016190883DKA	RURAL	METERED	3.82	0.57	85.1%	96.18%
RAMNAGAR PTW_11083290774RAM	RURAL	AMR	3.59	1.36	62.0%	96.17%
BHUMMA PTW_13021210621BHG	RURAL	AMR	3.28	2.43	25.9%	96.16%
HASAN PUR LUHARI TOWN_13745290707HPW	RURAL	METERED	4.33	1.16	73.3%	96.16%
KALYANPUR PTW_11083490719KAL	RURAL	AMR	2.41	0.67	72.2%	96.15%
BICHPADI PTW_11083390734BIC	RURAL	AMR	2.18	0.46	78.9%	96.09%
BOHLA-2 PTW_11083190741BHA	RURAL	METERED	1.41	0.49	65.6%	96.07%
KIRTHAL PTW_11083190755KIR	RURAL	AMR	2.10	0.54	74.2%	96.06%
MUKANDPUR PTW_13022190583MUP	RURAL	AMR	0.95	0.29	69.7%	96.01%
BADHPURA_14102410222BAD	URBAN		10.34	0.45	95.6%	96.01%
AHROLA PTW_12054291304AHR	RURAL	METERED	3.09	0.51	83.5%	96.00%
RAJPURA PTW_16113191126RAJ	RURAL	AMR	1.78	1.00	44.2%	95.98%
FETEHPUR_13016190873FAT	RURAL	AMR	7.59	0.51	93.3%	95.96%
LOTI PTW_16734390852LOT	RURAL	AMR	1.80	0.90	49.7%	95.94%
DHINDAWALI PTW_13022190575DIN	RURAL	AMR	1.24	0.45	64.1%	95.89%
MUKTESHWARA PTW_16734390847MUK	RURAL	AMR	2.73	1.00	63.4%	95.88%
MALAKPUR TOWN_16113391109MTN	RURAL	METERED	3.04	0.29	90.6%	95.86%
NAUBATPUR PTW_16113191127NAU	RURAL	AMR	2.07	0.92	55.6%	95.83%
GT ROAD NEHRUPUR_16111115077GTN	URBAN	AMR	1.07	0.05	95.4%	95.82%
JAKHERA PTW_16734390854JAP	RURAL	AMR	3.10	1.54	50.3%	95.82%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
DHAROLI TOWN_16112291090DHT	RURAL	METERED	0.62	0.03	95.1%	95.81%
GURANA PTW_11083290769GUR	RURAL	AMR	3.06	1.10	64.0%	95.81%
AURANGABAD TOWN_	RURAL		2.00	0.14	93.0%	95.81%
MADONA_16112291093MND	RURAL	AMR	3.73	0.57	84.8%	95.79%
DOODHALI TOWN_13022290591DUD	RURAL	AMR	5.39	0.42	92.3%	95.79%
JAMALPUR_16113191119JMA	RURAL	AMR	3.19	0.91	71.5%	95.79%
BADAM PTW_11072490989BAD	RURAL	AMR	2.83	1.24	56.2%	95.79%
KHERI TOWN_13022190578KIW	RURAL	METERED	4.39	0.28	93.7%	95.78%
ARNIA BRANCH_16111110269ARN	RURAL	AMR	5.42	0.68	87.5%	95.77%
BASERA TAGA_12063391243BAS	RURAL	METERED	4.64	2.17	53.4%	95.74%
GOHAWAR PTW_12035691278GIW	RURAL	AMR	1.92	0.46	76.0%	95.74%
PALDI PTW_11083290764PAL	RURAL	AMR	4.85	1.94	60.0%	95.72%
CHOBLI PTW_11083190744CHO	RURAL	AMR	2.07	0.95	53.8%	95.71%
RAARDHANA_11074291022RJL	RURAL	METERED	7.66	0.57	92.6%	95.70%
BHAGWANTPUR_16113391105BHA	RURAL	AMR	5.43	0.41	92.4%	95.64%
SAMSAM NAGAR_14102491193SAM	RURAL	METERED	2.68	0.25	90.9%	95.63%
FDR-IV (SPARE)_14102591197F04	RURAL		15.16	0.75	95.1%	95.63%
SAIDPUR PTW_12035691278SAI	RURAL	AMR	3.17	0.61	80.9%	95.62%
PAROLI_13014391471PRI	RURAL	METERED	3.50	0.22	93.8%	95.59%
REDHAVALI TUBEWELL_16734290856RID	RURAL	AMR	1.28	0.66	48.2%	95.57%
KIRRA_16111110270KRA	RURAL	METERED	3.47	0.36	89.6%	95.56%
GREEN VILLAGE_11071510432GRE	URBAN	AMR	2.27	0.85	62.5%	95.56%
BHARNA PTW_16734390854BNT	RURAL	AMR	2.53	0.69	72.8%	95.54%
NAKUR ROAD_13016190901NAK	RURAL	AMR	11.95	1.57	86.9%	95.54%
CHANNA PTW_11083190760CHA	RURAL	AMR	2.76	1.09	60.3%	95.50%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
TANDA (R)_12054391321TAN	RURAL	AMR	4.78	4.48	6.2%	95.50%
SHERPUR PTW_16112291089SHE	RURAL	METERED	5.32	1.77	66.6%	95.48%
BALKA PTW_16113191115BAL	RURAL	AMR	1.79	1.54	14.2%	95.48%
LALPUR TOWN_16734190861LLT	RURAL	METERED	4.97	0.64	87.0%	95.48%
GESUPUR RURAL_16112291091GER	RURAL	METERED	4.00	0.36	91.1%	95.47%
GARHI PUKHTA RURAL PTW_13745490639GRP	RURAL	AMR	0.75	0.20	73.4%	95.46%
HARSAULI PTW_13027190555HAR	RURAL		2.91	0.86	70.3%	95.46%
NARAYANPUR_12063391242NAR	RURAL	METERED	5.32	1.88	64.6%	95.43%
PAWLA TOWN_11083490718PTN	RURAL	METERED	5.33	0.39	92.7%	95.42%
DHADIYAL_12063491268DHA	RURAL	AMR	3.22	1.11	65.4%	95.39%
MAZRA PTW_13022190578MAJ	RURAL	AMR	2.31	0.44	81.1%	95.37%
NARALI PTW_12047391199PTW	RURAL	AMR	4.34	2.72	37.3%	95.32%
AALHASHA_12047431418AAL	URBAN	AMR	12.72	0.70	94.5%	95.29%
NAGWA PTW_13027190544NAG	RURAL	AMR	1.77	0.41	76.5%	95.28%
TUMARIA PTW_12054391315TUM	RURAL		0.25	0.12	54.1%	95.27%
KARNAWAL PTW_11072490990KRW	RURAL	AMR	2.11	1.14	46.1%	95.27%
KALYANPUR_16113391104KAL	RURAL	METERED	1.24	0.49	60.7%	95.26%
CHANDUA NAGLA_12054291304CHN	RURAL	METERED	1.97	0.14	92.9%	95.22%
JUGSANA PTW_16113191116JUG	RURAL	AMR	2.34	0.76	67.5%	95.21%
JOGOPURA PTW_16734290860JOG	RURAL	AMR	2.75	2.02	26.7%	95.20%
TIVRA TOWN_16112291099TIV	RURAL	METERED	2.53	0.74	70.6%	95.20%
MALMAJRA PTW_11083290781MAL	RURAL	AMR	3.61	1.48	59.2%	95.20%
HADAULI PTW_13022190578HLW	RURAL	AMR	1.39	0.28	80.1%	95.20%
MULSAMPTW_11083290765MUL	RURAL	AMR	1.78	0.64	64.3%	95.17%
KASAMPUR BEHRODA JUNGLE PTW_11072591006KBJ	RURAL	AMR	1.08	0.45	58.5%	95.15%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
POISE P T W PTW_11083290770POI	RURAL		2.69	0.97	64.0%	95.15%
GADHI PTW_11083390710GAD	RURAL	METERED	3.56	0.85	76.1%	95.15%
BHAJOO PTW_13022190610BHA	RURAL	AMR	1.43	0.75	47.5%	95.14%
SHIVPURA_13014390829SPA	RURAL	AMR	3.15	0.57	81.8%	95.12%
ISAPUR SHARKI_12063491262ISA	RURAL	AMR	2.23	0.84	62.4%	95.12%
FAFUNDA_11072130021FAF	RURAL	AMR	7.46	2.42	67.6%	95.09%
GHATAYAN JUNGLE PTW_13021211325GHJ	RURAL	AMR	1.54	1.49	3.2%	95.06%
KASTALA PTW_11074191029KAS	RURAL	AMR	1.14	0.59	48.6%	95.06%
BASOLI PTW_11083191505BAP	RURAL	METERED	1.25	0.25	80.1%	95.02%
SIRSALGARH PTW_11083290774SIR	RURAL	AMR	4.93	2.05	58.4%	95.02%
GUDHA PTW_11074110145GUR	RURAL	AMR	0.60	0.27	54.4%	95.02%
RAIPUR ATERNA PTW_13027190550RAI	RURAL	AMR	0.92	0.42	53.9%	95.00%
ROSHANPUR PTW_13016190892ROS	RURAL	AMR	1.36	0.44	67.4%	95.00%
BIJOLI-2 JUNGLE PTW_11072591003BJ2	RURAL	AMR	1.01	0.61	39.8%	94.98%
KHAIRPUR PTW_16113191120KHR	RURAL	AMR	1.81	0.77	57.4%	94.96%
COLONY_12041191164COL	RURAL	METERED	4.86	0.25	94.9%	94.93%
GYASPUR PTW_15093490530GYG	RURAL	METERED	3.80	0.86	77.4%	94.91%
BUDHPUR PTW_11083190757BUD	RURAL	AMR	3.37	1.41	58.1%	94.90%
DOGHAT PTW_11083290773DOG	RURAL	METERED	4.45	2.10	52.9%	94.89%
BABRALA TOWN2_12041391207BT2	RURAL	AMR	8.15	0.45	94.5%	94.86%
NAIPURA_12035691281NAI	RURAL	AMR	4.10	0.37	91.0%	94.86%
KAMALA PTW_11083290767KAM	RURAL	AMR	5.52	2.33	57.8%	94.85%
MADHOPUR PTW_16734390852MAD	RURAL	AMR	3.01	1.95	35.2%	94.83%
SHOBHPUR PTW_11083390735SHO	RURAL	AMR	1.97	0.77	60.9%	94.82%
SAHAWALI PTW_13021140259SAP	RURAL	METERED	0.76	0.37	51.5%	94.73%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
ETMADPUR JUNGLE PTW_11072591002ETM	RURAL	AMR	3.21	1.67	47.9%	94.71%
TOMRI PTW_16112291092TOM	RURAL	AMR	2.82	1.50	46.6%	94.71%
INCHOLI_11071420007INC	RURAL	METERED	2.17	0.12	94.7%	94.69%
GARIMA GARDEN_15092210321GAR	URBAN	AMR	16.05	0.84	94.8%	94.68%
BUDHANA PTW_16113191116BUD	RURAL	AMR	2.31	1.13	51.2%	94.68%
NIRPURA PTW_11083290772NIR	RURAL	AMR	5.23	2.65	49.3%	94.67%
JANI PTW_11072490991JAN	RURAL	AMR	1.39	0.74	46.7%	94.65%
JAMANPUR PTW_13014290812JNP	RURAL	AMR	3.67	1.21	66.9%	94.64%
GURANA TOWN_11083290780GAN	RURAL	METERED	1.62	0.11	93.1%	94.63%
GANGNAULI-2 PTW_11083290779GA2	RURAL	AMR	1.10	0.69	37.0%	94.60%
BIJWARA PTW_11083290769BIJ	RURAL	AMR	5.54	1.68	69.7%	94.60%
PALLA DEVI_12063491496PLD	RURAL	METERED	3.61	1.10	69.5%	94.56%
BACHOOD PTW_11083190758BAC	RURAL	AMR	1.14	0.43	62.4%	94.55%
KAPASSI PTW_13014390823KAP	RURAL	AMR	0.96	0.37	61.3%	94.55%
SONDA HABIBPUR_16111190941SHR	RURAL	METERED	8.54	1.03	88.0%	94.53%
SUDNA PTW_16734190858SUD	RURAL	AMR	2.93	2.28	22.4%	94.52%
DEVI PTW_11083290763DEV	RURAL	AMR	3.91	1.80	53.9%	94.52%
KAILAWAN PTW_16113191117KAI	RURAL	METERED	5.11	1.58	69.1%	94.49%
NANDPURA JUNGAL PTW_11072490993NAN	RURAL	AMR	1.42	0.75	47.1%	94.49%
UMARPUR_13016110884UMA	RURAL		4.57	1.12	75.4%	94.47%
UBARPUR TUBEWELL_16734290856UBP	RURAL	AMR	2.48	1.21	51.2%	94.46%
DEDPURA_13016390923DDR	RURAL	AMR	6.01	1.08	82.0%	94.44%
GALHATA PTW_11083290767GAL	RURAL	AMR	2.22	0.95	57.2%	94.44%
NAGLA KALA_16112391132NAG	RURAL	AMR	3.46	0.44	87.3%	94.44%
BHAGWANPUR PTW_16112291088BHA	RURAL	METERED	0.95	0.42	55.1%	94.43%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
NAGAL PTW_11083190748NAG	RURAL	AMR	2.76	1.11	59.6%	94.42%
KAILMUNDI PTW_12047391201KAI	RURAL	AMR	8.06	3.19	60.5%	94.40%
MANGROLI PTW_11083290762MAN	RURAL	AMR	4.47	2.39	46.6%	94.37%
KARNAWAL JUNGLE PTW_11072490995KHI	RURAL	AMR	2.34	1.71	26.8%	94.35%
BHANWARA PTW_13027290559BHA	RURAL	AMR	1.45	0.24	83.6%	94.34%
KAKOR-LL PTW_11083190758KA2	RURAL	METERED	1.73	0.96	44.4%	94.33%
SINGHOLI TOWN_11083490722SIN	RURAL	AMR	3.96	0.42	89.4%	94.33%
NANGLA BADI PTW_11083490723NBP	RURAL	AMR	2.19	0.84	61.6%	94.32%
DADRI PTW_11083290767DAD	RURAL	AMR	3.41	1.62	52.6%	94.31%
MAVI TOWN_13745390686MIN	RURAL	METERED	3.01	1.80	40.0%	94.29%
BAPARSI + PANCHALI GAOU_11074291020BPT	RURAL	AMR	6.79	1.09	84.0%	94.29%
KHEDKI BHOOR KHALSA_12063291250KBK	RURAL	METERED	1.13	0.59	48.1%	94.27%
MANSOORPUR PTW_11083490722PTW	RURAL	AMR	3.96	0.61	84.6%	94.27%
BHAISOR_12041191149BHA	RURAL	AMR	2.66	1.69	36.5%	94.26%
MAHARPUR_12063491495MAH	RURAL	METERED	5.14	0.52	89.9%	94.26%
FATHEPUR TOWN_11072490995FTP	RURAL	METERED	1.78	0.17	90.5%	94.26%
BANDPUR PTW_11083490718BAN	RURAL	AMR	4.31	1.63	62.3%	94.24%
BAPARSI JUNGLE PTW_11074291018BAP	RURAL	AMR	1.61	0.67	58.2%	94.23%
KOTANA PTW_11083190745KOT	RURAL	AMR	2.70	0.83	69.2%	94.21%
DAULA PTW_11083390732DTW	RURAL	METERED	1.81	0.89	50.6%	94.21%
DATAWALI JUNGLE PTW_11072591011DAT	RURAL	AMR	1.78	0.92	48.1%	94.20%
FEEDER 8_15091310482FE8	URBAN	AMR	12.25	1.30	89.4%	94.20%
JAMUNIYA_12063391241JAM	RURAL	METERED	0.19	0.16	15.7%	94.18%
AKALPUR DEHAT_14102591195ADT	RURAL		6.81	1.06	84.4%	94.18%
KAPSAD PTW_11074291024KJE	RURAL	AMR	1.27	0.23	81.6%	94.18%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
JHINJHANA PTW_13745390682JHV	RURAL	METERED	0.75	0.14	81.1%	94.16%
SADHARANPUR PTW_11074191032SAD	RURAL	AMR	1.76	1.13	35.8%	94.16%
GOVINDPURI JUNGLE PTW_11072591001GVO	RURAL	AMR	1.40	0.93	33.9%	94.16%
DAURALA WEST_13003311016DAW	RURAL	AMR	8.12	0.52	93.6%	94.16%
BAJHERI PTW_13021140256BPT	RURAL	AMR	0.52	0.41	21.3%	94.15%
NIJAMPUR (J) PTW_13021210615NIJ	RURAL	AMR	0.95	0.55	42.0%	94.15%
TUGANA PTW_11083190748TUG	RURAL	AMR	3.68	1.07	70.9%	94.15%
SAIDPUR PTW_16734390842SAI	RURAL	AMR	1.44	0.49	65.8%	94.12%
KURALKI_13014390822KUR	RURAL	AMR	5.56	0.91	83.7%	94.12%
DANPUR_16111390944DAN	RURAL	AMR	6.54	2.31	64.7%	94.12%
UDAYPUR TOWN_16734390844UDA	RURAL	AMR	7.22	2.11	70.7%	94.11%
SEKHPURA PTW_11083290767SEK	RURAL	AMR	2.73	1.26	53.8%	94.09%
PAROLI PTW_16113191126PAR	RURAL	AMR	1.78	1.31	26.4%	94.09%
K R CHOPLA PTW_16734390851KRW	RURAL	AMR	4.38	0.18	95.8%	94.07%
SISOLA JUNGLE PTW_11072490996KSI	RURAL	METERED	0.13	0.06	54.6%	94.07%
SISOLI_13022190610SIS	RURAL	METERED	1.62	1.21	25.2%	94.05%
AHAMADPUR_13016390918AHA	RURAL	AMR	3.55	0.87	75.5%	94.04%
KURDI PTW_11083190753PTW	RURAL	AMR	1.55	0.93	39.7%	94.00%
ATALI PTW_13027190544ATA	RURAL	AMR	4.97	1.74	65.0%	93.98%
THASKA PTW_13016390929TSA	RURAL	AMR	4.09	0.75	81.7%	93.97%
SAKATPURA_12054291299SAK	RURAL	AMR	4.06	0.89	78.1%	93.95%
BHADURPUR MARKET_15094415070BPM	RURAL	AMR	0.99	0.45	54.0%	93.95%
RASNA PTW_11072490989RAS	RURAL	METERED	2.23	1.31	41.0%	93.91%
SARRORPUR JUNGLE PTW_11074291019SJL	RURAL	AMR	2.13	0.51	76.1%	93.89%
RATANPURI PTW_13027290559RAT	RURAL	AMR	1.68	0.61	63.9%	93.89%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
RAJPURA PTW_16113391110RAJ	RURAL	AMR	2.78	1.95	30.0%	93.88%
CHONKY PTW_11083190742CHO	RURAL	AMR	1.05	0.69	34.2%	93.88%
GAJRAULA PTW_12035590978GAJ	RURAL	AMR	4.05	1.36	66.6%	93.85%
SAMANA_16734291427SAM	RURAL	AMR	5.18	0.54	89.6%	93.84%
MATNORA PTW_16734390847MAT	RURAL	AMR	3.49	2.28	34.6%	93.80%
MULSAM PTW_11083290766MUS	RURAL	AMR	1.79	0.95	46.6%	93.79%
BHAINSROLI_16112291083BHA	RURAL	AMR	2.20	1.21	45.2%	93.77%
KANCHROTH_16112291095KAN	RURAL	AMR	1.29	0.75	42.2%	93.76%
MIRZAPUR_12063391238MIR	RURAL	AMR	3.31	1.59	52.0%	93.75%
TATINA_11072191402TTA	RURAL	AMR	7.24	1.78	75.4%	93.75%
FEEDER NO 6_15097110231IN6	URBAN	AMR	0.02	0.00	96.6%	93.75%
NAGLI SADHARAN_11074291017NSN	RURAL	METERED	3.21	0.28	91.2%	93.70%
JARODA PTW_13022290599JAR	RURAL	AMR	5.43	3.16	41.7%	93.70%
ISLAMNAGAR PTW_13016390917ISL	RURAL	AMR	5.40	1.78	67.0%	93.69%
NANGAL PTW_11083290778NAN	RURAL	AMR	4.02	2.76	31.3%	93.67%
NANU TOWN_11074291026NNT	RURAL	AMR	2.92	0.30	89.9%	93.67%
KHANPURA PTW_16113191116KHN	RURAL	AMR	2.64	2.09	21.0%	93.64%
SHIKOI PTW_16113391104SHI	RURAL	AMR	2.25	1.20	46.9%	93.61%
UDAY PUR_14102491188UDA	RURAL	AMR	10.15	2.84	72.0%	93.61%
ULDHAN PTW_16734290855ULD	RURAL	AMR	3.25	2.24	31.1%	93.58%
RAMGARH PTW_11083290762RAM	RURAL	AMR	4.30	2.20	48.8%	93.57%
GADARHEDI PTW_13014191473GDI	RURAL	METERED	0.58	0.34	41.8%	93.56%
TEDA PTW_11083390724TED	RURAL	AMR	2.99	1.93	35.6%	93.54%
KALAHATI PTW_13014290810KAL	RURAL	AMR	0.15	0.04	69.3%	93.54%
DANKOWALI PTW_13014390829DWL	RURAL	AMR	1.19	0.63	47.3%	93.53%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
BANDPUR PTW_11083490711BAN	RURAL	AMR	3.55	1.38	61.3%	93.51%
MAHADI RURAL PTW_13745390695MKP	RURAL	AMR	0.55	0.19	66.4%	93.49%
KALYANPUR_16113391104KTW	RURAL	METERED	4.66	0.62	86.7%	93.49%
KASER_16111390944KSR	RURAL	AMR	4.47	1.47	67.1%	93.47%
PEERGARH_12063191227PEE	RURAL	AMR	1.81	1.32	26.9%	93.46%
KAKKEPUR JUNGLE PTW_11074291019KAK	RURAL	AMR	3.66	2.31	37.0%	93.46%
CHANDANHEDI PTW_11083190747SEA	RURAL	AMR	3.31	1.68	49.4%	93.45%
SAIAYA KHEDA_16113191121SKD	RURAL	METERED	3.41	0.33	90.4%	93.45%
CHATKA PTW_13014190800CHT	RURAL	METERED	0.26	0.09	63.9%	93.45%
REHRA_12063491261REH	RURAL	METERED	4.94	3.36	31.8%	93.44%
ITARA PTW_11072120011IT2	RURAL	AMR	3.48	2.00	42.4%	93.42%
DAYALWALA PTW_14001310972DAY	RURAL	AMR	4.22	1.06	74.8%	93.39%
ISHAPUR_12047491217ISH	RURAL	METERED	1.73	1.16	33.1%	93.39%
MEGHRAJPUR JUNGLE PTW_11072590998MEG	RURAL	AMR	1.44	0.76	47.2%	93.38%
PANCHALI JUNGLE-I PTW_11074291020PAN	RURAL	AMR	1.53	0.69	54.9%	93.38%
MOHARSA PTW_16113391105MOH	RURAL	AMR	2.77	1.44	48.1%	93.37%
KALAND GAOU_11074291397KAL	RURAL	AMR	5.28	1.57	70.3%	93.34%
PAHASU TOWN_12002130939PHT	RURAL	AMR	9.45	1.00	89.4%	93.31%
LAKHAWATI_16112291083LAK	RURAL	AMR	1.31	0.65	50.3%	93.30%
KURDI KHET WEST PTW_11083190753KR1	RURAL	AMR	3.57	1.12	68.7%	93.30%
ILANA-I PTW_16113191121IL1	RURAL	METERED	3.40	1.31	61.4%	93.29%
RAMPUR SAFED_12063391243RAM	RURAL	METERED	3.78	2.21	41.5%	93.28%
FEEDER NO 3_14102330458F03	URBAN	AMR	13.90	0.83	94.0%	93.28%
BALSAWA_13014390823BHA	RURAL	AMR	5.15	0.89	82.7%	93.26%
PAVI PTW_11083490711PAV	RURAL	AMR	3.92	2.05	47.7%	93.26%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
GAAJIPUR PTW_11074191030GAZ	RURAL	AMR	2.44	1.01	58.7%	93.26%
SIYAL PTW_11072591011SAY	RURAL	AMR	0.23	0.15	34.6%	93.26%
BANKHANDA PTW_16734390844BAT	RURAL	AMR	0.71	0.24	65.6%	93.25%
CHOLA_16112391137CHO	RURAL	AMR	3.03	0.49	83.9%	93.24%
MUBARIKPUR PTW_13022290608MUB	RURAL	AMR	0.90	0.51	43.5%	93.23%
BHASKAR MANDI PTW_13745290706BMA	RURAL	METERED	1.90	0.65	65.8%	93.21%
BHANWADA PTW_13027291439BHJ	RURAL	METERED	2.17	0.65	70.2%	93.18%
DHANA TOWN_16734390849DHA	RURAL	AMR	4.54	0.61	86.6%	93.16%
CHANGIPUR PTW_12035691278CHA	RURAL	AMR	2.49	1.19	52.2%	93.16%
KHOLAHEDI PTW_13021220623KOL	RURAL	AMR	1.15	0.88	23.6%	93.16%
REHTA PTW_12035691278REH	RURAL	AMR	3.09	1.33	57.0%	93.15%
BHATIPURA JUNGLE PTW_11072590998BHA	RURAL	AMR	1.63	1.26	22.5%	93.15%
MAZARA PTW_13745290704MZP	RURAL	METERED	2.99	1.11	62.8%	93.14%
CHAMRAVVA-K PTW_12054291295CHA	RURAL		0.35	0.32	8.1%	93.13%
BIJOLI-1 JUNGLE PTW_11072591003BIJ	RURAL	AMR	1.61	1.14	28.9%	93.12%
NORTH WEST PTW_16112391138NWE	RURAL	AMR	4.27	2.13	50.2%	93.11%
SENGA_16112291084SEN	RURAL	AMR	4.08	0.89	78.1%	93.09%
PACHGWON JUNGLE PTW_11072590999PAN	RURAL	AMR	3.84	1.97	48.8%	93.09%
CHIRODI PTW_11074291024CIL	RURAL	METERED	2.57	0.49	81.0%	93.08%
WORLD BANK STW_11083490722WBS	RURAL	AMR	0.06	0.01	75.1%	93.07%
NIYAMU PTW_13022290585NIY	RURAL	AMR	2.50	1.62	35.2%	93.06%
NAN_16734290863NAN	RURAL	AMR	3.37	1.55	53.9%	93.05%
DHUMERA_16112291099DHU	RURAL	METERED	5.92	2.96	50.0%	93.04%
CHAMRAWAL PTW_11083490719CHA	RURAL	AMR	1.63	0.65	59.9%	93.03%
KILHORA PTW_16734290855KTW	RURAL	AMR	0.83	0.22	73.9%	93.02%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
SHUKARTAAL PTW_13022190574SHP	RURAL	METERED	0.66	0.32	51.0%	93.01%
MAVIKALAN PTW_11083490728MAV	RURAL	AMR	2.78	1.19	57.1%	93.01%
GUNGAKHERI TOWN_11083290761GIN	RURAL	METERED	2.34	0.26	88.7%	93.00%
TIGGI FEEDER_13014390836TIG	RURAL	AMR	6.03	0.96	84.1%	93.00%
RAMPURA PTW_12041191154RAM	RURAL	AMR	1.82	1.22	33.2%	92.99%
CHHATARI TOWN_12004320946CHT	RURAL	AMR	4.08	0.37	90.9%	92.99%
BHATAIL_16112291089BHA	RURAL	AMR	2.78	1.86	33.3%	92.98%
SURJAWALI PTW_16113191120SUR	RURAL	AMR	2.46	2.07	15.8%	92.97%
KEDWA PTW_11083290774KED	RURAL	AMR	4.56	1.70	62.7%	92.97%
PADLI PTW_13014290811PAD	RURAL	AMR	0.10	0.07	36.4%	92.94%
BHORA VAAS_16112391137BHO	RURAL	METERED	1.61	0.21	86.6%	92.94%
GANDUPAL_12063391238GAN	RURAL	AMR	4.38	1.99	54.6%	92.93%
JAMALPUR GAOU_11074291027JMG	RURAL	METERED	0.90	0.13	85.2%	92.93%
BICHOLA PTW_16113391105BIC	RURAL	AMR	1.78	0.98	45.2%	92.92%
NAGLAPATHORA PTW_13022190584NAG	RURAL		1.17	0.26	77.9%	92.92%
SHANKER TILA_16734391375SRT	RURAL	METERED	2.31	0.44	81.1%	92.91%
SHIKARPUR PTW_13022190610SHI	RURAL	AMR	1.17	0.62	46.7%	92.89%
R/L PURANI_12036191053PUR	RURAL	AMR	0.85	0.61	28.4%	92.89%
ALAMPUR_13016110287ALM	RURAL		7.69	1.99	74.2%	92.88%
DABHEDI PTW_13027290562DAB	RURAL	AMR	2.46	0.72	70.6%	92.85%
M A BAGHPAT PTW_15093221332BAG	RURAL	METERED	1.57	0.56	64.6%	92.84%
HIDDEN PTW_11074291396HIN	RURAL	AMR	2.24	0.85	62.1%	92.84%
ASARA PTW_11083290777ASA	RURAL	AMR	4.19	2.48	40.6%	92.83%
MUBARIKPUR PTW_16734390847MUB	RURAL	AMR	3.47	2.44	29.6%	92.83%
ARNAWALI PTW_11072490991ARN	RURAL	AMR	0.84	0.55	34.4%	92.81%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
HASANPUR PTW_13027190547HAS	RURAL	AMR	2.31	1.26	45.4%	92.81%
TIKRI PTW 2 PTW_11083290777TK2	RURAL	METERED	3.37	1.09	67.6%	92.80%
NORTH WEST_12063191231NWS	RURAL	METERED	6.72	3.22	52.0%	92.80%
SHAJAADPUR PTW_11074191030SHA	RURAL	AMR	3.44	2.13	38.1%	92.80%
AKILPUR_14101491189AKP	RURAL	METERED	6.43	1.36	78.8%	92.73%
BARWALA KARWADA PTW_13022290609BKA	RURAL	AMR	2.83	1.41	50.0%	92.73%
BHOGPUR DEHAT PTW_13016390929BDT	RURAL	AMR	5.11	0.86	83.2%	92.72%
PILAKHNI_13016190890PLK	RURAL	AMR	6.52	2.71	58.4%	92.71%
SAIDPUR TOWN_11083490712SPT	RURAL	AMR	0.57	0.09	84.5%	92.69%
MUKANDPUR PTW_11083190752MUK	RURAL	AMR	2.49	1.55	37.5%	92.69%
HASSANPUR_16734190861HAS	RURAL	METERED	1.60	0.31	80.4%	92.69%
SONTA PTW_13022190590SOP	RURAL	METERED	2.47	1.03	58.5%	92.69%
GOTKA PTW_11074291020GTR	RURAL	AMR	2.01	0.85	57.8%	92.68%
DHANORA PTW_11083290774DAN	RURAL	AMR	1.87	1.06	43.1%	92.67%
ABADGARH TOWN_13745290675AAB	RURAL	METERED	2.26	0.47	79.0%	92.67%
AGRA PTW_12035190968AGR	RURAL	AMR	3.17	1.27	60.1%	92.62%
KHIWAI PTW_11072490990KHI	RURAL	AMR	2.19	1.29	40.9%	92.61%
GADHI PTW_11083390738GIW	RURAL	METERED	2.00	1.40	29.9%	92.60%
GANGAWASH_16113391105GBS	RURAL	METERED	5.32	0.60	88.7%	92.60%
RAMPUR PTW_11072490990RAM	RURAL	AMR	1.78	1.07	40.1%	92.57%
MAVI KHURD PTW_11083390736MAV	RURAL	AMR	1.48	1.25	15.6%	92.57%
ROOKANPUR JUNGLE PTW_11072591008RUK	RURAL	AMR	1.32	0.65	50.2%	92.56%
DASTOI_16734290860DAT	RURAL	METERED	4.03	0.45	89.0%	92.55%
NINANA PTW_11083390714NIN	RURAL	METERED	3.68	2.50	32.1%	92.54%
BATNOR JUNGLE PTW_11074291014BRE	RURAL	AMR	2.50	1.55	37.9%	92.53%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
DAULATPUR TOWN_16113391101DAT	RURAL	METERED	0.83	0.19	77.6%	92.53%
SOHAJANI PTW_13022290605SOH	RURAL	AMR	3.12	2.26	27.5%	92.50%
CHAROLI TOWN_13022190580CLI	RURAL	AMR	3.57	0.44	87.7%	92.50%
MAHMUDPUR PTW_16113191117MAM	RURAL	AMR	2.34	1.05	55.2%	92.50%
GANGNAULI-2 TIKRI TOWN_11083290777GN2	RURAL	METERED	3.73	0.37	90.0%	92.49%
FATEHPUR PTW_11083390724FAT	RURAL	AMR	3.73	2.09	43.8%	92.49%
CHETTRA_12063291257CHE	RURAL	METERED	2.28	0.88	61.2%	92.48%
ROHTA PTW_11072490989ROH	RURAL	AMR	2.03	1.45	29.0%	92.48%
PAL_12063221429PAA	RURAL	METERED	2.30	1.91	17.1%	92.44%
JULHEDA TOWN_11074291026JUT	RURAL	AMR	2.23	0.27	87.9%	92.43%
BADA GAOU JUNGLE PTW_11072591012BAD	RURAL	AMR	1.03	0.57	44.9%	92.43%
DOODAHEDI PTW_13022191466DAW	RURAL	METERED	0.91	0.39	56.9%	92.42%
DAULA PTW_11083390724DAW	RURAL	METERED	3.51	1.67	52.5%	92.41%
GANGNAULI-1 PTW_11083290779GA1	RURAL	AMR	1.68	0.59	64.5%	92.41%
MALAKPUR_13014290812MAL	RURAL	AMR	2.94	0.47	84.0%	92.41%
BHABSA PTW_13016190899BHB	RURAL	METERED	0.91	0.25	72.2%	92.39%
KHADANA PTW_16113391105KHA	RURAL	AMR	2.24	1.26	43.8%	92.37%
DABKORA_16113311389DAB	RURAL	METERED	2.68	0.26	90.3%	92.37%
SOOJRA PTW_11083390727SOO	RURAL	METERED	2.19	0.95	56.5%	92.36%
ODHAPUR PTW_11083190743ODH	RURAL	AMR	2.19	0.66	70.0%	92.33%
BASI KHEAT PTW_13745491322BPT	RURAL	METERED	1.11	0.42	62.0%	92.26%
RADHANA JUNGLE_11074291018RRA	RURAL	METERED	2.88	1.70	40.8%	92.26%
SPM 1_13013220150SP1	URBAN	AMR	0.02	0.00	94.8%	92.24%
BARNAWA PTW_11083290773BAR	RURAL	AMR	3.90	1.65	57.8%	92.24%
DINKARPUR PTW_13022290600DRP	RURAL	AMR	1.14	0.74	35.2%	92.22%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
MAHAL PTW_11074291013MAG	RURAL	AMR	2.38	1.09	54.3%	92.21%
SHABAZPUR PTW_12035590972SHE	RURAL	AMR	2.80	1.52	45.8%	92.20%
FATEHPUR PTW_13016190872FAT	RURAL	METERED	3.23	1.00	69.1%	92.20%
SHALIMAR_15092210321SAH	URBAN	AMR	14.21	11.65	18.0%	92.20%
GURANA PTW_11083290780GUR	RURAL	AMR	2.45	0.26	89.6%	92.19%
BODAKI (T)_14101491186BOD	RURAL	METERED	0.64	0.34	46.4%	92.19%
GARHI PTW_16734390853GAR	RURAL	AMR	2.58	0.96	62.9%	92.18%
PILONA PTW_11074191028PEL	RURAL	AMR	1.10	0.90	18.1%	92.17%
MANGATPUR PTW_11083190745MAN	RURAL	AMR	1.55	0.86	44.6%	92.13%
FATEHPUR PTW_16113191115FAT	RURAL	METERED	1.58	2.20	-39.6%	92.13%
KAKRAULI JUNGLE_13021210615KAJ	RURAL	AMR	2.29	1.98	13.5%	92.12%
KEHRAKA PTW_11083490731KEH	RURAL	METERED	3.74	1.72	53.9%	92.12%
BEHARIPUR PTW_11083390727BEH	RURAL	METERED	2.18	1.46	32.6%	92.11%
CHAMROULA PTW_12035291272CHM	RURAL	METERED	0.79	0.65	18.4%	92.10%
KHEDI PATTI PTW_13745290666KPP	RURAL	AMR	1.73	0.88	49.0%	92.07%
SYAMPUR GAOU_11074291013SYR	RURAL	AMR	6.76	0.73	89.1%	92.07%
JABDA PTW_12063391237JAB	RURAL		3.28	2.85	13.0%	92.06%
TITOLI PTW_13745390682TTP	RURAL	AMR	0.90	0.23	74.7%	92.04%
GAWDI PTW_11083290776GAW	RURAL	AMR	2.50	1.52	39.3%	92.03%
HAIDEPUR PTW_13016190874HAI	RURAL	AMR	5.68	2.11	62.9%	92.03%
BAGHU_11083390710BAG	RURAL	AMR	7.97	2.08	73.9%	92.02%
SAKAPURI PTW_13014190797SAK	RURAL	METERED	0.52	0.24	54.7%	92.02%
MATHURAPUR_15094415070MTP	RURAL	METERED	4.67	1.87	59.9%	92.02%
DHANORA PTW_16112391383DHA	RURAL	AMR	2.38	0.94	60.4%	92.01%
CHANDORI JUNGLE PTW_11074291014CHI	RURAL	METERED	2.67	1.86	30.4%	92.01%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
TAPRI II PTW_13016290904TP2	RURAL	METERED	4.23	1.43	66.2%	92.00%
BAULI PTW_11083191505BUP	RURAL	METERED	0.88	0.28	67.8%	91.99%
MAVIKHURD PTW_11083290775KHU	RURAL	METERED	3.11	1.18	62.0%	91.99%
SHIVALA KALA PTW_12035691280SHI	RURAL	AMR	2.98	2.21	25.8%	91.97%
NAGLA LODHAI PTW_16113391112NAG	RURAL	AMR	4.49	2.44	45.8%	91.95%
R/L MEMAN SADAT PTW_12036391401MEM	RURAL	METERED	1.14	0.66	41.9%	91.94%
NORTH EAST_12063191231NES	RURAL	METERED	7.39	5.49	25.7%	91.94%
SHEKHUPURA_12063391238SHE	RURAL	AMR	2.83	2.59	8.4%	91.94%
SISANA_11083390710SIS	RURAL	METERED	3.79	1.20	68.2%	91.93%
LOI_11074291025LOI	RURAL	AMR	1.81	0.72	60.3%	91.92%
BHOJPUR PTW_15093290527BHO	RURAL	METERED	0.65	0.22	66.8%	91.92%
JHABIRAN PTW_13016190890JBN	RURAL	AMR	3.42	1.64	51.8%	91.91%
KHARKHRI TOWN_16734190858KHA	RURAL	METERED	3.98	1.49	62.6%	91.90%
RACHOTI JUNGLE PTW_11072590998RAC	RURAL	AMR	2.41	1.38	42.6%	91.89%
MOHANA PTW_16112391134MHP	RURAL		1.38	0.82	40.3%	91.87%
MONIPURA_16111390951MON	RURAL	METERED	3.20	0.86	73.1%	91.86%
FAGOTA PTW_16734290863FAG	RURAL	AMR	0.97	0.84	13.2%	91.85%
PAPRI PTW_16111390949PAP	RURAL	METERED	4.28	3.54	17.2%	91.85%
HARIYAKHERA PTW_11083390736HAR	RURAL	AMR	1.52	1.25	17.8%	91.82%
RABUPURA PTW_16112391138RAB	RURAL	AMR	0.75	0.34	55.3%	91.81%
KHAJOORI PTW_11074391045KHA	RURAL	AMR	2.16	0.80	63.1%	91.81%
PAVSARA PTW_16112291087PVS	RURAL	AMR	4.51	3.13	30.7%	91.78%
DURGANPUR KHET (WEST) PTW_13027190539DRP	RURAL	AMR	3.10	1.39	55.2%	91.74%
KERTU RURAL PTW_13745390677KRP	RURAL	AMR	2.65	0.72	72.7%	91.74%
BHABUKRA_14102491192BHA	RURAL	AMR	4.12	1.40	66.0%	91.69%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
MUNDET RURAL PTW_13745490645MUP	RURAL	AMR	2.50	1.05	58.0%	91.69%
BARODA RURAL_16734290871BHP	RURAL	METERED	5.60	2.16	61.5%	91.67%
KASAMPUR PTW_13021220624KAS	RURAL	AMR	2.66	1.63	38.6%	91.67%
MEERAPUR PTW_13022190602MEP	RURAL	AMR	1.01	0.66	34.8%	91.66%
KALYANPUR PTW_11072490990KAK	RURAL	AMR	3.72	2.68	28.0%	91.66%
UKLENA JUNGAL PTW_11072490993UKH	RURAL	AMR	0.71	0.41	42.7%	91.64%
RAHATNA PTW_11083290765MUM	RURAL	AMR	3.13	1.16	63.1%	91.62%
DHANORA PTW_11083290770DHP	RURAL	AMR	2.37	2.45	-3.2%	91.62%
BADAR JUNGLE PTW_11072491344BAD	RURAL	AMR	1.45	0.84	42.5%	91.61%
ROHTA PTW_11072490991ROH	RURAL	AMR	2.36	1.97	16.8%	91.60%
SAINI_11071490698SAI	RURAL	METERED	1.39	0.81	41.3%	91.60%
PIPLI GHOSI_12063391237PIP	RURAL	AMR	3.86	2.10	45.6%	91.58%
KANODA_11074291015KNA	RURAL	AMR	4.18	0.36	91.4%	91.55%
AMEHARA SAINI JUNGLE PTW_11072590999AMB	RURAL	AMR	1.69	0.97	42.3%	91.53%
CHITSONA_16112291093CHI	RURAL	AMR	3.46	0.43	87.5%	91.52%
TABAR PTW_13016190889TAB	RURAL	AMR	3.82	1.36	64.5%	91.51%
BARASIYA PTW_11083390733BAR	RURAL	METERED	2.72	1.72	36.8%	91.50%
CHANDPURA JUNGLE PTW_11072591007CHA	RURAL	AMR	1.48	1.22	17.4%	91.49%
NAWAJPUR PTW_13016190886NAW	RURAL	AMR	3.56	1.73	51.3%	91.49%
NARAYNA_12063191227NAR	RURAL	AMR	2.09	1.33	36.1%	91.49%
NANPURA_12035691286NAN	RURAL	AMR	1.09	0.35	67.7%	91.48%
DATTIYANA PTW_16734390851DAW	RURAL	AMR	2.63	0.73	72.1%	91.47%
MAKANPUR PTW_12047391199MAK	RURAL	METERED	2.27	1.78	21.5%	91.46%
BAGRAJPUR PTW_13022290599BAP	RURAL	AMR	2.80	1.82	35.0%	91.45%
DODHRA PTW_11083390734DOD	RURAL	AMR	2.09	1.00	52.2%	91.44%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
DHALNA_16113191119DHL	RURAL	AMR	4.00	0.97	75.8%	91.44%
WAJIDPUR PTW_13021210613WAZ	RURAL	AMR	3.91	3.32	15.1%	91.43%
SARAA ROAD PTW_13022191466SRA	RURAL	METERED	0.94	0.40	57.2%	91.42%
BADARKHA PTW_11083190746BAD	RURAL	AMR	2.25	1.44	35.9%	91.42%
DHARAKPUR PTW_16111390952DHA	RURAL	AMR	1.96	2.04	-4.4%	91.40%
TAHSIL_13014290820THL	RURAL	AMR	0.46	0.04	91.5%	91.38%
SHERPURPILO PTW_13014290811SHP	RURAL	METERED	0.66	0.49	26.9%	91.38%
BASEDI PTW_13022190594BAS	RURAL	AMR	1.95	1.33	31.9%	91.37%
IDRISHPUR PTW_11083290773IDR	RURAL	AMR	3.29	2.17	34.2%	91.31%
RAMPURA-K PTW_12054291294RAM	RURAL	AMR	0.79	0.37	53.5%	91.30%
BENDA KHET PTW_13745190663BDP	RURAL	METERED	1.39	0.89	35.7%	91.27%
KAIRANA RURAL PTW_13745390682KAI	RURAL	AMR	2.64	1.38	47.8%	91.27%
BHAGWANPUR_13016191481BWR	RURAL		4.47	1.85	58.6%	91.26%
NIRMANI PTW_13022290603NIR	RURAL	AMR	1.12	0.83	26.4%	91.26%
RAJPUR (J) PTW_13021210617RJU	RURAL	AMR	1.97	1.32	32.9%	91.25%
KALANDI JUNGLE PTW_11074291018KAL	RURAL	AMR	3.20	1.73	46.0%	91.24%
BANJARA BASTI RURAL PTW_13745390693BAN	RURAL	METERED	2.66	0.72	72.8%	91.23%
KORALA_12063291247KOR	RURAL	AMR	3.37	1.38	59.0%	91.22%
MURLIPUR JUNGLE PTW_11072591009MUR	RURAL	AMR	1.10	0.93	15.5%	91.19%
TEVDA (J) PTW_13021210615TDJ	RURAL	AMR	2.00	1.35	32.4%	91.19%
UKAWALI JUNGLE PTW_13027290552UKA	RURAL	AMR	0.96	0.51	47.0%	91.19%
KHEDI PATTI PTW_13745290670KHE	RURAL	AMR	0.37	0.14	61.3%	91.19%
DHAKA_16112291084KHR	RURAL	AMR	3.46	1.44	58.4%	91.17%
LALPUR JUNGLE PTW_11072591002LAG	RURAL	AMR	1.28	0.85	33.1%	91.15%
DHANSOLI PTW_12047491223DHA	RURAL	AMR	1.20	0.89	25.8%	91.15%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
RODOR TOWN_13016190872RAD	RURAL	AMR	7.94	1.05	86.8%	91.13%
AGAHPUR_12063291247AGA	RURAL	AMR	3.78	3.32	12.2%	91.11%
LUHARI PTW_11083190741LUH	RURAL	AMR	3.11	2.42	22.3%	91.11%
POISE PTW_11083290769POI	RURAL	AMR	4.11	2.17	47.2%	91.10%
NAGLI AZMABAD PTW_11074191032NAG	RURAL	AMR	1.40	0.62	55.8%	91.10%
BHANEDA JAT PTW_13022190579BHA	RURAL	AMR	0.88	0.71	18.7%	91.03%
MUKARI PTW_11083490730MUK	RURAL	AMR	1.20	0.35	71.1%	91.03%
NUNAVADEI_13014390825NDI	RURAL	METERED	5.54	1.78	67.9%	91.02%
GARHI ABDULLA RURAL PTW_13745490633GAP	RURAL	AMR	3.05	1.12	63.2%	91.00%
MUNDBHAR TOWN_13022190589MTW	RURAL	METERED	2.48	0.34	86.1%	91.00%
BARWALA PTW_11083190750BAR	RURAL	AMR	2.36	0.58	75.3%	90.97%
DHOLPUR TOWN_16734390841DHO	RURAL	AMR	4.77	0.72	84.9%	90.96%
DOUD SARAI-2_12063310333DD2	RURAL	METERED	6.86	1.81	73.5%	90.95%
R/L MEHMDABAB_12036191050MEH	RURAL	AMR	3.27	2.12	35.4%	90.95%
FAIJPURA TALVAR PTW_16113391108FAI	RURAL	AMR	3.60	3.17	12.0%	90.94%
R/L PATTI PTW_12036291062PAT	RURAL	METERED	0.39	0.19	51.1%	90.93%
KOTAL KHERA_12054411514KKR	RURAL		0.95	0.34	64.0%	90.92%
R/L THATJAT_12036291056THA	RURAL	AMR	2.82	0.47	83.4%	90.90%
FIROZPUR TOWN_11083490723FIR	RURAL	METERED	1.26	0.15	88.2%	90.89%
BULLEWALA_13016190893BUL	RURAL	METERED	5.89	1.28	78.2%	90.88%
MEERPUR TUBEWELL_16734290856MJE	RURAL	METERED	2.66	1.76	33.9%	90.88%
PARWANA TOWN_16113391106PAR	RURAL	METERED	2.49	0.62	75.1%	90.88%
DHANJU GAOU_11072490988DHG	RURAL	AMR	4.67	0.48	89.7%	90.87%
MEERPUR PTW_11072490990MEE	RURAL	AMR	1.05	0.72	31.7%	90.86%
PRABSA JUNGLE PTW_11074291016PRA	RURAL	AMR	4.55	3.50	23.1%	90.85%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
MALAKPUR PTW_13745390694MAL	RURAL	METERED	1.51	0.44	71.1%	90.84%
RAIPUR PTW_13014190788RAI	RURAL	METERED	2.47	1.75	29.2%	90.84%
AJAMABAD_16111211381AJM	RURAL	METERED	1.88	0.62	66.9%	90.84%
FEEDER NO 5_14102230076F05	URBAN		0.05	0.00	90.6%	90.83%
QASIMPUR PTW_13014290811KAS	RURAL	AMR	0.47	0.34	28.5%	90.82%
CHOWKPURI 2 PTW_12035110971CHK	RURAL	METERED	0.29	0.22	25.3%	90.82%
TAHARPUR PTW_12041191162TAH	RURAL	METERED	2.54	1.80	29.1%	90.80%
SIKHERA TOWN_11071420007SIK	RURAL		2.04	0.15	92.4%	90.80%
BHAIYAPUR_16113391107BHY	RURAL	AMR	2.74	1.20	56.1%	90.79%
UKAWALI PTW_11083490719UKA	RURAL	AMR	3.45	1.16	66.5%	90.78%
DHANORA PTW_16734190859DHA	RURAL	AMR	3.06	2.40	21.5%	90.77%
NOSHERA_13014290812NOS	RURAL	AMR	3.24	0.61	81.3%	90.76%
MEHENDI PUR_14102491192MPK	RURAL	AMR	8.20	3.20	61.0%	90.74%
CHHABARIA_11074291397CHH	RURAL	AMR	0.78	0.21	73.6%	90.74%
BARWALA MANDI PTW_13022290609BAL	RURAL	AMR	3.15	2.80	11.2%	90.74%
GANPATI VIHAR_11074291023GVR	RURAL	AMR	1.58	0.13	91.7%	90.73%
R/L HUSAINPUR_12036291056HRN	RURAL	AMR	7.94	1.21	84.8%	90.69%
SADPUR JUNGLE PTW_13021210613SAR	RURAL	AMR	4.03	1.95	51.7%	90.69%
KANYA PATHSHALA WALA PTW_13745190664KAN	RURAL	METERED	0.94	0.76	19.5%	90.67%
AURANGABAD RURAL PTW_16113191122ARR	RURAL	AMR	0.88	0.78	11.3%	90.66%
LAWAR TOWN 2_13003111013TW2	RURAL	METERED	2.70	0.29	89.2%	90.62%
PANCHALI JUNGLE-II PTW_	RURAL	METERED	1.32	0.23	82.7%	90.61%
BASI PTW_12035590980BAS	RURAL	AMR	1.58	1.17	26.3%	90.61%
HARSAULI PTW_13022291446HAT	RURAL	METERED	1.25	0.87	30.2%	90.61%
BHAMORI JUNGLE PTW_11074291022BHA	RURAL	AMR	4.65	1.17	74.8%	90.60%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
IMALIA PTW_12035691280IMA	RURAL	AMR	1.87	1.22	34.8%	90.59%
KHEDA TOWN_13027190547KHE	RURAL	AMR	4.60	0.58	87.3%	90.58%
SALEMPUR PTW_16113191120SAL	RURAL	AMR	3.04	2.79	8.3%	90.56%
CHANDORI PTW_11072490989CHA	RURAL	AMR	2.70	2.42	10.5%	90.56%
DEVAPUR PTW_12047391199DEV	RURAL	AMR	4.22	4.05	3.9%	90.53%
ASHARFABAD THAL PTW_11083190757ASH	RURAL	AMR	3.27	1.85	43.4%	90.52%
LADANPUR_12063291253LAD	RURAL	METERED	5.01	4.28	14.6%	90.50%
KHINDODA PTW_11083390735KHI	RURAL	AMR	2.30	1.10	52.4%	90.49%
BAFER PTW_11072190985BAF	RURAL	AMR	1.68	1.46	13.1%	90.48%
CHHAVI_12063391242CHH	RURAL	METERED	6.90	5.60	18.8%	90.47%
FEEDER NO 8_14102230071F08	URBAN		0.01	0.00	90.4%	90.46%
SAIDPUR PTW_11083490712SAI	RURAL	METERED	2.23	1.49	33.2%	90.45%
BHIROLI PTW_16113191116BHI	RURAL	AMR	2.60	2.53	2.7%	90.45%
GATTHINA PTW_11083390738GAT	RURAL	METERED	2.15	1.76	18.1%	90.42%
JAGAS PTW_11083190745JAG	RURAL	AMR	1.70	1.25	26.4%	90.41%
FEEDER NO 1_14102340455F01	URBAN		0.02	0.00	91.0%	90.41%
BANKHANDA TOWN_16734390851BAN	RURAL	METERED	3.16	1.08	66.0%	90.40%
MUBARIKPUR PTW_11083490723MUB	RURAL	AMR	3.12	1.32	57.7%	90.35%
KASERVA PTW_13027190556KAS	RURAL		0.98	0.65	33.7%	90.34%
JANGETHI GAOU_11074291023JAG	RURAL	AMR	2.26	0.26	88.3%	90.34%
WORLD BANK PTW_15093490531WOR	RURAL	AMR	2.93	1.59	45.7%	90.32%
KAILASH NAGAR_13027290559KNT	RURAL	AMR	1.02	0.24	76.6%	90.30%
KALCHINA PTW_15093290527KAL	RURAL	AMR	2.52	0.83	66.9%	90.30%
SAMBALHEDI PTW_13016390919SAM	RURAL	AMR	2.62	0.98	62.4%	90.27%
KAUL JUNGLE PTW_11072591010KAU	RURAL	AMR	1.27	1.09	14.0%	90.26%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
RURAL PTW_13745190655RUR	RURAL	AMR	1.57	1.07	32.1%	90.24%
BHONSATHLA_16112291089BHO	RURAL	AMR	5.19	4.11	20.7%	90.24%
KAMALPUR JUNGLE PTW_11072591009KAG	RURAL	METERED	0.65	0.60	8.0%	90.24%
TOFAPUR PTW_12035691282TOF	RURAL	AMR	2.90	1.51	47.9%	90.24%
DARIYAPUR PTW_16113191126DAR	RURAL	AMR	1.51	1.42	6.0%	90.24%
NAR MOH MADPUR_16111190942NMM	RURAL	METERED	4.99	1.07	78.4%	90.23%
SARAI PTW_13027190550SAR	RURAL	AMR	1.17	0.36	69.2%	90.23%
MUSTAFABAD PTW_12035291276MRL	RURAL	AMR	2.36	0.69	70.6%	90.23%
MOUR_14102491187MOU	RURAL	AMR	5.35	3.12	41.8%	90.22%
ANDAWALI JUNGLE PTW_11074291013AND	RURAL	AMR	1.74	1.16	33.4%	90.18%
SHAHPUR_16113191123SHP	RURAL	AMR	3.91	1.83	53.3%	90.17%
TIKOLA PTW_13021210620TIK	RURAL	AMR	2.80	2.26	19.1%	90.15%
BHADOLI PTW_15093490533BHA	RURAL	AMR	1.62	1.06	34.5%	90.15%
KOLKIKALAN_13016291428KOL	RURAL	AMR	3.86	1.44	62.8%	90.15%
RAMPUR_14102491192RAM	RURAL	AMR	8.74	3.31	62.1%	90.15%
LALNER_16111190939LAA	RURAL	AMR	5.24	2.30	56.1%	90.13%
AMARGARH TOWN_16113391101AGT	RURAL	METERED	2.16	0.34	84.5%	90.09%
TIKRI TOWN_13001420777TIK	RURAL	AMR	3.56	1.59	55.4%	90.08%
ANGADPUR PTW_11083290768ANG	RURAL	AMR	2.89	1.69	41.4%	90.08%
BHAGWANPUR JUNGLE PTW_11074291027BHA	RURAL	AMR	1.01	0.64	36.2%	90.08%
KALINA PTW_11072490990KAL	RURAL	AMR	1.61	1.28	20.5%	90.07%
RAHAMAPUR PTW_16111390949RAH	RURAL	METERED	4.29	3.30	23.0%	90.05%
AALDI RURAL PTW_13745190660ALD	RURAL	AMR	1.37	0.90	34.6%	90.05%
MATAUR JUNGLE PTW_11074291015MAT	RURAL	AMR	2.31	2.01	13.2%	90.03%
NAGLA RUMI_16111190942NGR	RURAL	METERED	3.20	0.70	78.1%	90.02%

FEEDER NAME	TYPE OF FEEDER (URBAN/MIXED/INDUSTRIAL/ AGRICULTURAL/RURAL)	TYPE OF FEEDER METER (AMI/AMR/OTHER)	RECEIVED AT FEEDER (FINAL IN MU)	FEEDER CONSUMPTION (IN MU)	T&D LOSSES	AT&C LOSSES
PARSOL_14102591455PAR	RURAL	METERED	6.28	1.66	73.5%	90.00%
BANAT PTW_13745290704BNP	RURAL	METERED	2.01	1.24	38.2%	89.98%
MURADPUR PTW_16734190858MUR	RURAL	AMR	1.88	1.86	1.2%	89.97%
BANA PTW_11074191029BAN	RURAL	AMR	3.44	2.63	23.5%	89.96%
GASUPUR_16112291091GAS	RURAL	AMR	1.45	1.38	4.2%	89.95%
LOYAN-I PTW_11083190744LO1	RURAL	AMR	1.46	0.77	47.4%	89.94%
AMWALI PTW_13745390679AAM	RURAL	AMR	1.22	0.45	63.1%	89.93%
NOORPUR PTW_15093490529NBT	RURAL	AMR	3.05	1.07	65.1%	89.92%
JAI JUNGLE PTW_11072591002JAJ	RURAL	AMR	2.08	1.66	20.0%	89.92%


Comments on Feeder and Division Discrepancies Observed


- The T&D loss for 1,819 feeders has shown a negative value. This was discussed with PVVNL during the audit and PVVNL informed that the discrepancy is due to the billing cycle, where some energy consumption for the current month is billed in the following month, leading to a negative T&D loss.*
- PVVNL did not provide any data or documentary evidence towards regarding their explanation for the negative AT&C losses, and the only reasoning provided was that collection efficiency is more than 100% for some of the divisions.*
- We have observed that the consumption for some 11 kV feeders is suddenly much higher than the feeder's input power. We discussed this issue with PVVNL, and they explained that the problem is due to incorrect tagging of some feeders. While they have cross-verified and corrected the values for some feeders, many others still show incorrect values and it can be concluded that PVVNL is not carrying out proper energy accounting and it should develop a proper protocol to verify and rectify the issues as soon as possible.*

5.3. Subsidy Computation and Analysis (Based on Quarterly Report)

Quarter -1

Format for Subsidy Billing and Collection (Quarterly Submission) Final																	
State: Uttar Pradesh												Reporting Quarter: FY: 2023-24, Q1 (April-June)					
DISCOM: PUVNL												Copy of subsidy bill: Yes/No					
Date of subsidy bill to State govt.:																	
Sr. No.	Consumer Category	Subsidy declared by State Govt.			Total energy forecasted for the category	Advance Subsidy amount				Total advance subsidy amount released by the State Govt.	Actual electricity supplied based on measurement through meters	Actual Subsidy amount				Difference in advance released & actual subsidy required and raised to State Govt.	Reconciled Amount released by the State Govt.
		Subsidy on energy Charges-per unit basis	Subsidy on Fixed Charges	Subsidy on other Variable Charges (if any)		Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total advance subsidy amount raised to the State Govt.			Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total actual subsidy required from the State Govt.		
		Rs/kWh	Rs/KW/BHP or other (please specify)	Rs/KWh or other (please specify)	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.
[1]	[2]	[3]	[3A]	[3B]	[4]	[5]=[3]*[4]	[6]	[7]	[8]=[5]+[6]+[7]	[9]	[10]	[11]=[3]*[10]	[12]	[13]	[14]=[11]+[12]+[13]	[15]=[9]-[14]	[16]
1	LMV-1 (Domestic Light, Fan & Power)																
1.1	(i). Lifeline Consumers (Rural and Urban)	3.50 Unit			302	106			106		310	109			109		
	(ii) Others (Other than Lifeline consumers (i.e. consumers who do not																
1.2	a) Rural Scheduled Un-Metered																
	b) Rural Scheduled Metered																
1.3	0 - 100 Unit	2.70/Unit			485	131			131		460	124			124		
1.4	101 - 150 Unit	2.65/Unit			211	56			56		230	61			61		
2	LMV-5 (Private Tube Wells/ Pumping Sets)																
2.1	a) Rural Scheduled Un-Metered		600/BHP/Month		2806418	-	505	-	505		2816690	-	507	-	507		
2.2	b) Rural Scheduled Metered		600/BHP/Month		1203252	-	217	-	217		1367615	-	246	-	246		
	Total					293	722		1014	985.02		294	753		1047		









 Supervising Engineer (Comm.)
 PUVNL, Meerut
 CE (Comm.)
 PUVNL, Meerut
 DT (Comm.)
 PUVNL, Meerut



Quarter -2

Format for Subsidy Billing and Collection (Quarterly Submission)																	
State: Uttar Pradesh																	
DISCOM: PUVNL																	
Date of subsidy bill to State govt.:																	
												Reporting Quarter: FY: 2023-24, Q2 (July-September)					
												Copy of subsidy bill: Yes/No					
Sr. No.	Consumer Category	Subsidy declared by State Govt.			Total energy forecasted for the category	Advance Subsidy amount				Total advance subsidy amount released by the State Govt.	Actual electricity supplied based on measurement through meters	Actual Subsidy amount				Difference in advance released & actual subsidy required and raised to Stae Govt.	Reconciled Amount released by the State Govt.
		Subsidy on energy Charges-per unit basis	Subsidy on Fixed Charges	Subsidy on other Variable Charges (if any)		Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total advance subsidy amount raised to the State Govt.			Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total actual subsidy required from the State Govt.		
		Rs./kWh	Rs/KW/BHP or other (please specify)	Rs/KWh or other (please specify)	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.
[1]	[2]	[3]	[3A]	[3B]	[4]	[5]=[3]*[4]	[6]	[7]	[8]=[5]+ [6]+[7]	[9]	[10]	[11]=[3]*[10]	[12]	[13]	[14]=[11]+[12]+[13]	[15]=[9]-[14]	[16]
1	LMV-1 (Domestic Light, Fan & Power)																
1.1	(I) Lifeline Consumers (Rural and Urban)	3.50 Unit			226	79			79		248	87			87		
	(II) Others (Other than Lifeline consumers (i.e. consumers who do not																
1.2	a) Rural Scheduled Un-Metered																
	b) Rural Scheduled Metered																
1.3	0 - 100 Unit	2.70/Unit			656	177			177		759	205			205		
1.4	101 - 150 Unit	2.65/Unit			286	76			76		380	101			101		
2	LMV-5 (Private Tube Wells/ Pumping Sets)																
2.1	a) Rural Scheduled Un-Metered		600/BHP/Month		2946739	-	530	-	530		2816690	-	507	-	507		
2.2	b) Rural Scheduled Metered		600/BHP/Month		1262888	-	227	-	227		1367615	-	246	-	246		
	Total					332	758		1090	1282.84		392	753		1146		

    
 EE (Comm) Superintending Engineer P.V.V.N.L. CE (Comm) C.E. (Comm) P.V.V.N.L. D. (Comm) P.V.V.N.L.

Quarter -3

Format for Subsidy Billing and Collection (Quarterly Submission) Final																	
State: Uttar Pradesh DISCOM: PAVNL Date of subsidy bill to State govt.:												Reporting Quarter: FY: 2023-24, Q3 (October-December) Copy of subsidy bill: Yes/No					
Sr. No.	Consumer Category	Subsidy declared by State Govt.			Total energy forecasted for the category	Advance Subsidy amount				Total advance subsidy amount released by the State Govt.	Actual electricity supplied based on measurement through meters	Actual Subsidy amount				Difference in advance released & actual subsidy required and raised to State Govt.	Reconciled Amount released by the State Govt.
		Subsidy on energy Charges-per unit basis	Subsidy on Fixed Charges	Subsidy on other Variable Charges (if any)		Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total advance subsidy amount raised to the State Govt.			Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total actual subsidy required from the State Govt.		
		Rs/kWh	Rs/KW/BHP or other (please specify)	Rs/KWh or other (please specify)	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.
[1]	[2]	[3]	[3A]	[3B]	[4]	[5]=[3]*[4]	[6]	[7]	[8]=[5]+ [6]+[7]	[9]	[10]	[11]=[3]*[10]	[12]	[13]	[14]=[11]+[12]+[13]	[15]=[9]-[14]	[16]
1	LMV-1 (Domestic Light, Fan & Power)																
1.1	(I). Lifeline Consumers (Rural and Urban)	3.50 Unit			244	85			85		327	114			114		
	(II) Others (Other than Lifeline consumers (i.e. consumers who do not																
1.2	a) Rural Scheduled Un-Metered																
	b) Rural Scheduled Metered																
1.3	0 - 100 Unit	2.70/Unit			441	119			119		422	114			114		
1.4	101 - 150 Unit	2.65/Unit			191	51			51		211	56			56		
2	LMV-5 (Private Tube Wells/ Pumping Sets)																
2.1	a) Rural Scheduled Un-Metered		600/BHP/Month		3005125	-	541	-	541		2805954	-	505	-	505		
2.2	b) Rural Scheduled Metered		600/BHP/Month		1287911	-	232	-	232		1471434	-	265	-	265		
	Total					255	773		1028	918.25		284	770		1054		

 Superintending Engineer (Comm)
P.V.V.N.L. Meerut
 C.E. (Comm.)
P.V.V.N.L. Meerut
 Dir (Comm)
P.V.V.N.L. Meerut

Quarter -4

Format for Subsidy Billing and Collection (Quarterly Submission) Final																		
State: Uttar Pradesh DISCOM: PUVNL Date of subsidy bill to State Govt.:												Reporting Quarter: FY: 2023-24, Q3 (October-December) Copy of subsidy bill: Yes/No						
Sr. No.	Consumer Category	Subsidy declared by State Govt.			Total energy forecasted for the category	Advance Subsidy amount				Total advance subsidy amount raised to the State Govt.	Total advance subsidy amount released by the State Govt.	Actual electricity supplied based on measurement through meters	Actual Subsidy amount				Difference in advance released & actual subsidy required and raised to Stae Govt.	Reconciled Amount released by the State Govt.
		Subsidy on energy Charges-per unit basis	Subsidy on Fixed Charges	Subsidy on other Variable Charges (if any)		Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total advance				Based on Energy Charge computed	Based on Fixed Charges	Based on other Variable Charges*	Total actual subsidy required from the State Govt.		
		Rs/kWh	Rs/KW/BHP or other (please specify)	Rs/KWh or other (please specify)	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Mus/BHP	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	Rs. Cr.	
[1]	[2]	[3]	[3A]	[3B]	[4]	[5]=[3]*[4]	[6]	[7]	[8]=[5]+ [6]+[7]	[9]	[10]	[11]=[3]*[10]	[12]	[13]	[14]=[11]+[12] +[13]	[15]=[9]-[14]	[16]	
1	LMV-1 (Domestic Light, Fan & Power)																	
1.1	(I). Lifeline Consumers (Rural and Urban)	3.50 Unit			244	85			85		327	114			114			
	(II) Others (Other than Lifeline consumers (i.e. consumers who do not																	
1.2	a) Rural Scheduled Un-Metered																	
	b) Rural Scheduled Metered																	
1.3	0 - 100 Unit	2.70/Unit			441	119			119		422	114			114			
1.4	101 - 150 Unit	2.65/Unit			191	51			51		211	56			56			
2	LMV-5 (Private Tube Wells/ Pumping Sets)																	
2.1	a) Rural Scheduled Un-Metered		600/BHP/Month		3005125	-	541	-	541		2805954	-	505	-	505			
2.2	b) Rural Scheduled Metered		600/BHP/Month		1287911	-	232	-	232		1471434	-	265	-	265			
	Total					255	773		1028	918.25		284	770		1054			

4/

EE (Comm)
Superintending Engineer (Comm)
P.V.V.N.L. Meerut

CE (Comm)
CE (Comm)
P.V.V.N.L. Meerut

Dir (Comm)
P.V.V.N.L. Meerut

Sl. No.		Q1	Q2	Q3	Q4	Annual
	Subsidy Based On Energy Charges					
1	1. LMV-1					
	Life line consumers (Rural and Urban) (Rs/kWh)	3.50	3.50	3.50	3.50	3.50
	Rural Scheduled Meter (Rs/kWh)					
	A) 0-100 Units (Rs/kWh)	2.70	2.70	2.70	2.70	2.70
	B) 101-150 Units (Rs/kWh)	2.65	2.65	2.65	2.65	2.65
	2.LMV-5					
	A) Rural Schedule Un-Metered (Rs/kWh)	NIL	NIL	NIL	NIL	NIL
	B) Rural Schedule Metered (Rs/kWh)	NIL	NIL	NIL	NIL	NIL
2	Subsidy Based On Fixed Charges					
	1. LMV-1					
	Life line consumers (Rural and Urban) (Rs/kWh)	NIL	NIL	NIL	NIL	NIL
	Rural Scheduled Meter (Rs/kWh)					
	A) 0-100 Units (Rs/kWh)	NIL	NIL	NIL	NIL	NIL
	B) 101-150 Units (Rs/kWh)	NIL	NIL	NIL	NIL	NIL
	2.LMV-5					
	A) Rural Schedule Un-Metered (Rs/kWh/BHP)	600.00	600.00	600.00	600.00	600.00
	B) Rural Schedule Metered (Rs/kWh/BHP)	600.00	600.00	600.00	600.00	600.00
3	Total Advance Subsidy amount Released by State Government					
	1. LMV-1					
	Life line consumers (Rular and Urban) (Rs.Cr.)	106.00	79.00	85.00	87.00	357.00
	Rural Scheduled Meter					
	A) 0-100 Units (Rs.Cr.)	131.00	177.00	119.00	116.00	543.00

Sl. No.		Q1	Q2	Q3	Q4	Annual
	Subsidy Based On Energy Charges					
	B) 101-150 Units (Rs.Cr.)	56.00	76.00	51.00	48.00	231.00
	2.LMV-5					
	A) Rural Schedule Un-Metered (Rs.Cr.)	505.00	530.00	541.00	235.00	1811.00
	B) Rural Schedule Metered (Rs.Cr.)	217.00	227.00	232.00	548.00	1224.00
	Total	1015.00	1089.00	1028.00	1034.00	4166.00
4	Total actual Subsidy required from the state govt.					
	1. LMV-1					
	Life line consumers (Rular and Urban) (Rs.Cr.)	109.00	87.00	114.00	75.00	385.00
	Rural Scheduled Meter					
	A) 0-100 Units (Rs.Cr.)	124.00	205.00	114.00	110.00	553.00
	B) 101-150 Units (Rs.Cr.)	61.00	101.00	56.00	54.00	272.00
	2.LMV-5					
	A) Rural Schedule Un-Metered (Rs.Cr.)	507.00	507.00	505.00	505.00	2024.00
	B) Rural Schedule Metered (Rs.Cr.)	246.00	246.00	265.00	265.00	1022.00
	Total	1047.00	1146.00	1054.00	1009.00	4256.00

The total sum of subsidies, as per the Bureau of Energy Efficiency (BEE) format, along with a detailed comparison of the balance sheet, is presented in the chapter 6 under the critical commentary section.

Note – Cumulative value of quarter wise subsidy is not match with the Subsidy amount taken in Balance Sheet

6. Energy Audit Findings

6.1. Review of Capacity of DISCOM'S Energy Accounting and Audit Wing

In Accordance to clause 5(g) of Bureau of energy efficiency (Manner and intervals for conduct of Energy audit in Electrical distribution companies) Regulation issued by BEE Ministry of Power (GOI) dated 7th Oct 2021 for conduct Mandatory Annual Energy Audit & periodic Energy Accounting in Electrical Distribution Companies and as per guidelines issued by BEE vide L. No 18/BEE/DISCOM/2021/1348-94 dated 13th may 2021 an Energy Audit cell (EAC) in PVVNL, Meerut is constituted.

6.2. Critical Analysis

Sl. No.	Pre-requisites	Comments from TPEA	Management Response
A.	Identify high loss areas so that corrective action can be taken.		
1.	Identification and mapping of all of the electrical network assets.	At present identification and mapping for all electrical network assets is not carried out by PVVNL. - PVVNL informed that the procurement of power is done by UPPCL centrally. Information Related to Input Energy Purchase (From Generation Source) is not available with PVVNL, and the same is left blank in the Form 1 data for all four quarters and the Annual Form. Only the Net Input Energy at DISCOM (Periphery after adjusting the transmission losses and energy traded), data is provided by PVVNL. - Due to non-availability of data of Energy Traded, it is not possible to verify the Net Input Energy data, as the verification cannot be done unless the traded energy data is provided. Also, during the audit, we discussed as to how the Net Input Energy is calculated without the data of Input Energy Purchase (From Generation Source), for which PVVNL has not provided any information.	UPPCL do Energy Purchase Centrally

2.	Identification and mapping of high tension and low-tension consumers.	At present PVVNL does not have mapping of HT Consumer and LT Consumers. Due to the absence of meters on distribution transformers, their losses are not calculated, and LT sales are inaccurately shown as zero. Consequently, all sales values are being incorrectly recorded under the 11-kV feeder.	We are focusing on DTR metering as found few.
3.	Discom shall ensure the installation of functional meters for all consumers, transformers and feeders in accordance with the trajectory set-out in the regulation.	PVVNL has initiated the process of installation of functional AMR meters for all HT consumers, transformers and feeders. However, the installation process is at a very initial level and the same should be expedited and installed on a faster pace. Same for LT consumers is yet to be done in accordance with the trajectory set-out in the regulation.	As per AMISP meter all it consumer replace by smart meter


4.	Development and implementation of information technology enabled energy accounting and audit system, including associated software.	SCADA System is available in the 132- kV level and above. PVVNL has RMS Software to collect the data from the H.T. Consumers. During audit it was observed that as per the data available with PVVNL, some feeder T&D losses were in negative; which is technically incorrect and PVVNL informed that the same is due to wrong tagging of the feeder, and the same cannot be corrected immediately, and the officials of PVVNL present during the audit concluded that the same shall be discussed with their commercial unit and resolved later. During Audit it was informed by PVVNL as -: • PVVNL has hired a third-party agency to analyse feeder data on a monthly basis. • The agency cross-checks the data discrepancies at the field level (Source of Data). • After cross-checking, any errors in reporting or data entry are corrected at PVVNL HQ, master sheet. • The agency provides a report of the erroneous data to PVVNL. • We have inquired with PVVNL about the steps taken in response to the report submitted by the third-party agency. • However, no information has been provided regarding the corrective actions taken by PVVNL. Some feeder values are extremely erroneous, with the feeder consumption values reaching into the thousands of Million Units, which is clearly inaccurate and highlights significant data integrity issues	SCADA data is available 132kV to above voltage
----	---	---	--



5.	All distribution transformers (other than high voltage distribution system upto 25kVA and other distribution system below 25 kVA) shall be metered with communicable meters. Existing non-communicable distribution transformer meters shall be replaced with communicable meters and integrated with advanced metering infrastructure.	PVVNL has started the metering in DTR network very few DTR has metered as on date of Audit and this metered data is also shown too much absurd data.	We are focusing on installation of AMR meter on DTR
----	---	--	---

6.	Unit wise energy accounting	PVVNL is conducting energy accounting based on unit/area-wise data to assess performance. Given the extensive infrastructure, energy accounting is carried out at the division level. However, since the DTRs (Distribution Transformers) in PVVNL are not equipped with meters, the calculation of LT (Low Tension) losses is currently not possible. Additionally, during the audit, we observed significant discrepancies in the data from some 11 kV feeders. To address these issues, PVVNL needs to equip the DTRs with communicable meters. Furthermore, if the data from the 11 kV feeders appear inconsistent or abstract, it is crucial to cross-check all data with field data to ensure accuracy.	We are focusing on installation of AMR meter on DTR
----	-----------------------------	--	--

Conclusion	We had asked Month-wise data for-: 1. Billed energy (MU) 2. Losses (T&D) 3. Commercial parameters Data Given 1. The month wise analysis of input energy and billed energy, has been done 2. The analysis of data shows T&D losses, as below 3. The analysis of Commercial Parameter has been done and data show below table								All Data provide as per CS-3/ CS-4 Portal.	
	Sl. No.	Months	Input Energy (MU)	Billed Energy (MU)	Unit Wises Losses	% of T&D Losses	Billing Efficiency	% of AT & C Losses		Progressive AT & C Losses
	1	Apr-23	2971.48	2412.82	558.67	18.80	81.20	27.76		27.76
	2	May-23	3532.57	2766.76	765.81	21.68	78.32	24.19		25.85
	3	Jun-23	4297.81	3165.86	1131.95	26.34	73.66	38.25		30.81
	4	Jul-23	3892.62	3283.22	609.40	15.66	84.34	26.31		29.61
	5	Aug-23	4272.09	3559.50	712.59	16.68	83.32	24.89		28.56
	6	Sep-23	3919.44	3497.67	421.77	10.76	89.24	10.10		25.54
	7	Oct-23	3225.94	3153.59	72.35	2.24	97.76	3.22		22.77
	8	Nov-23	2430.60	2646.38	-215.78	-8.88	108.88	-33.32		18.00
	9	Dec-23	2555.72	2301.50	254.22	9.95	90.05	-29.87		14.13
	10	Jan-24	2946.18	2407.83	538.35	18.27	81.73	16.73		14.36

11	Feb-24	2408.90	2565.38	-156.48	-6.50	106.50	0.85	13.47
12	Mar-24	2654.49	2372.39	282.10	10.63	89.37	-6.72	12.08

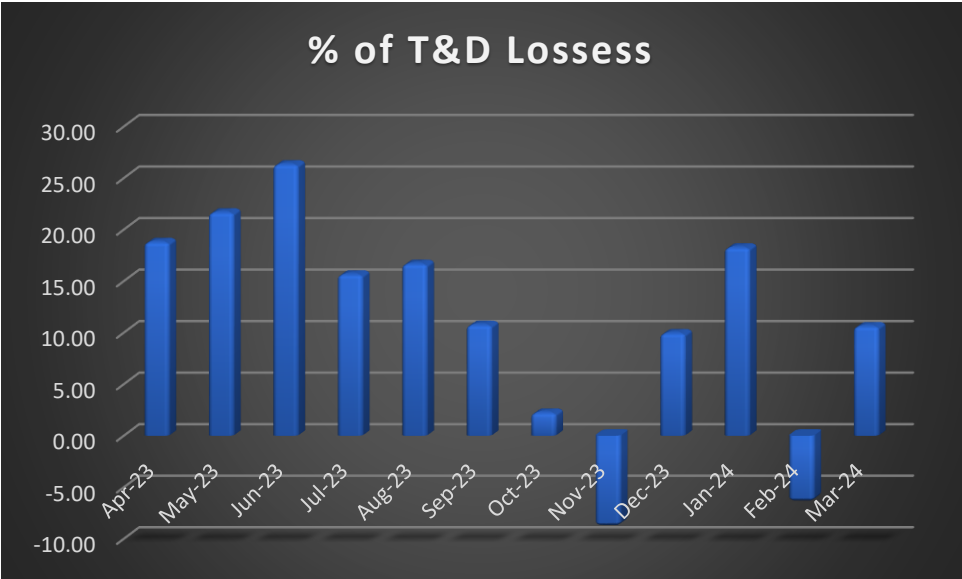

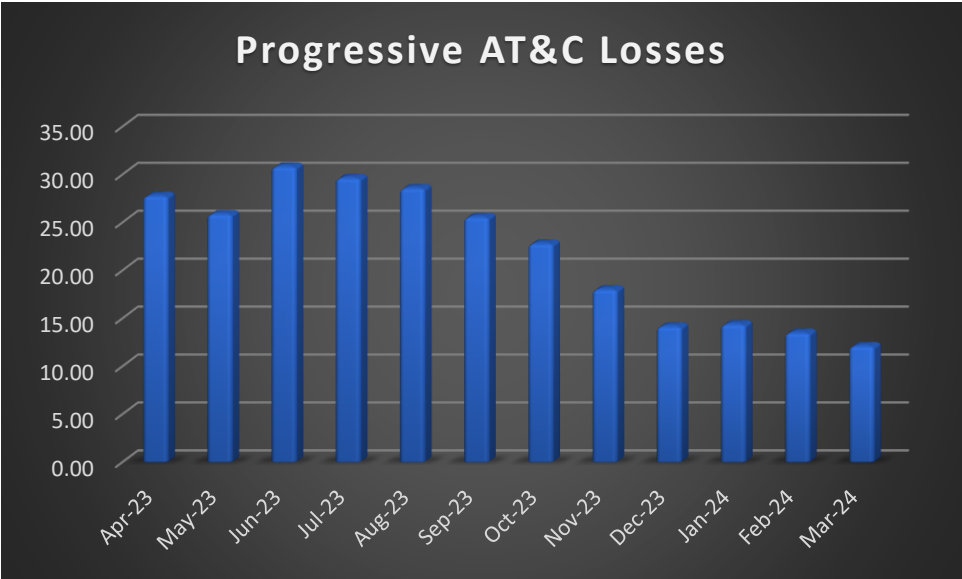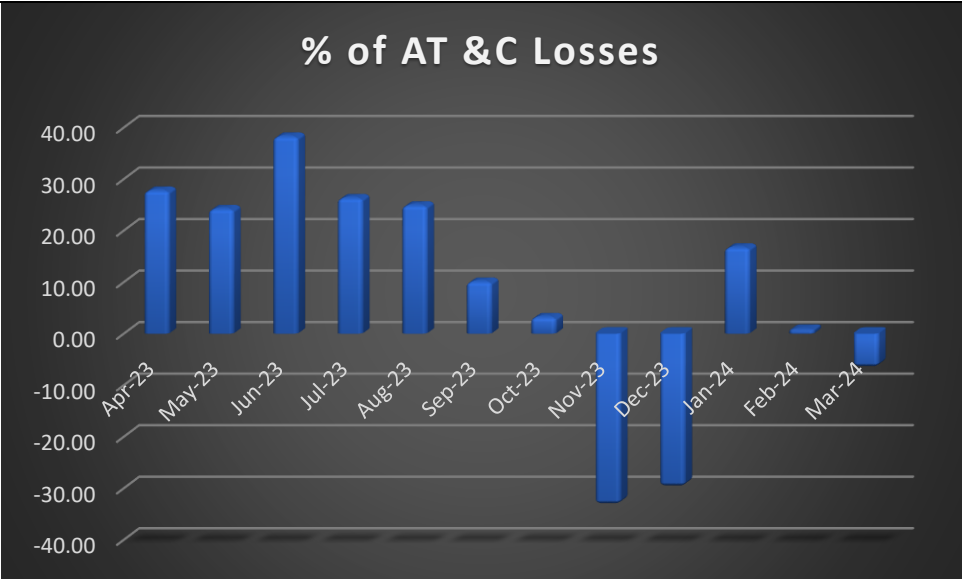

		<u>Comments</u> 1. Factors Contributing to Negative T&D Loss: A) The primary factor contributing to negative T&D loss is the billing cycle. B) The second factor is errors in the monitoring and metering system. 2. Input Energy And Billed figure are match with the Audited balance sheet figure. 3. Discrepancy Shown in Balance sheet and BEE Format Data A) During the Audit, it was observed and brought to the notice of PVVNL that there is discrepancy between the Collection Efficiency reported in the DISCOM's Balance Sheet and the Division-wise Collection Efficiency. B) PVVNL informed that the discrepancies (as per the above point) arises due to the exclusion of certain subsidy amounts in the BEE Annual Energy Form. The DISCOM explains that, accounting for these subsidies, the Collection Efficiency would be 100%. However, without considering these subsidies, the Collection Efficiency stands at 98.23%. Additionally, the Aggregate Technical and Commercial (AT&C) Loss, as per the Balance Sheet, is 14.27%, while as per the division wise losses the AT&C losses is 12.08% C) The reason for the discrepancies given by PVVNL was not justified in the opinion of the Ingenius Energy, as the exclusion of subsidies should have an opposite effect, i.e. the AT&C losses as per the Division wise losses should be greater than that as per the Balance Sheet but the same is just the opposite; PVVNL officials present concluded that the same shall be discussed with their commercial unit and resolved later.	
--	--	---	--

B.	Ensure that subsidy accounts are transparent; and the subsidy claims of the DISCOMs are on the basis of reliable data.		
1.	Subsidy Scheme	The State Govt. subsidy is only for Lifeline Domestic Consumers with very low power consumption and the LMV-5 Rural Area (Tube Well and Pumping Sets) Consumer.	
	Conclusion	Quarter wise Subsidy Data in the BEE Proforma format is submitted Consolidated Annual Subsidy data of F.Y. 23-24 is not submitted When we added all the quarterly data and cross-checked it with the audited balance sheet, the values did not match.	

Sl. No.	Subsidy Details	Q1	Q2	Q3	Q4	Cumulative (Annual)
A.	As Per Quarterly Form Submitted to BEE					
1	Total Advance Subsidy amount Released by State Government	1015.00	1089.00	1028.00	1034.00	4166.00
2	Total actual Subsidy required from the state govt.	1047.00	1146.00	1054.00	1009.00	4256.00
B.	As per Balance Sheet					
1	Subsidy claimed during the year	-----	-----	-----	-----	4272.81
2	Subsidy received against subsidy claimed during the year	-----	-----	-----	-----	4272.81

6.2.1. Data Gaps

The Audit firm has raised the data gaps to the DISCOM has submitted the details to the Audit firm. The summary of data gaps raised and response from DISCOM is summarized in the table below:

Sl. No.	Data Gaps raised By Energy Auditor	Response Shared By DISCOM	Status of Data Submission By DISCOM
1	Wrong Tagging of Consumer – Feeders are having wrong tagging.	Feeder tagging with correct feeder code should be updated in Billing Master. Any change of feeder master/ New feeder Creation should not allow without DISCOM permission.	Submitted
2	Energy at 11 kV to LT Level Supply through alternative feeder in case of breakdown of Main Feeder	A strict Discipline has to be followed by line man/Field staff. Any change over of supply should set right with in minimum time.	Submitted
3	Wrong assessed Input Energy due to defective feeder meter	Defective Meter should be replaced within 3 days by test Division. Material CT or PT Units belongs to decentralized category. Repairing of CT /PT units is to be done by Distribution circle Promptly.	Submitted

6.2.2. Summary of Key Responses of DISCOM Management on Comment by Energy Auditor

The Auditor has identified the key issues concerning Energy Accounting/Audit and DISCOM's management has responded to the same as summarized in the table below:

Sl. No.	Comments by Energy Auditor	Response of DISCOM's Management
1	Kindly Provide the filled in Format as per BEE	Provided BY PVVNL
2	Quarterly Format as per BEE	Provided By PVVNL
3	Kindly provide the identification and mapping of all of the electrical network assets	Division Wise Dashboard were shown
4	Kindly Provide the identification and mapping of high tension and low- tension consumer	Feeder wise Dashboard maps for 11kV feeder were shown.
5	Kindly Provide the details of the energy accounting data – generated from a metering system or till such time the metering system is not in place, by an agreed method of assumption as may be prescribed by the state commission.	Metering is provided and home-grown software is used as per tariff category.

Sl. No.	Comments by Energy Auditor	Response of DISCOM's Management
6	Whether the metering of distribution transformers at high voltage distribution system up to 25kVA is done on cluster metering? if not what is the action plan	NO HVDS installation
7	Energy (electrical) purchase report for the year 2023-24	Provided By PVVNL
8	Open access consumer and their details	Provided By PVVNL
9	Peak Demand of the system	Provided By PVVNL
10	Energy Conservation Schemes implemented	Provided By PVVNL
11	Energy Conservation Schemes to be implemented	Provided By PVVNL
12	Power Distribution Transformer	Provided By PVVNL
13	Maintenance practices – Power substation, HT lines, Lt lines & DTR	Provided By PVVNL
14	Average Billing Rate	Category wise consumer and total billed energy of those consumer is provided by PVVNL

7. Conclusion and Action Plan

7.1 Summary of Key Findings & Critical Comments

1. PVVNL informed that the procurement of power is done by UPPCL centrally. Information Related to Input Energy Purchase (From Generation Source) is not available with PVVNL, and the same is left blank in the Form 1 data for all four quarters and the Annual Form. Only the Net Input Energy at DISCOM (Periphery after adjusting the transmission losses and energy traded), data is provided by PVVNL.
2. Due to non-availability of data of Energy Traded, it is not possible to verify the Net Input Energy data, as the verification cannot be done unless the traded energy data is provided. Also, during the audit, we discussed as to how the Net Input Energy is calculated without the data of Input Energy Purchase (From Generation Source), for which PVVNL has not provided any information.
3. During the Audit, it was observed and brought to the notice of PVVNL that there is discrepancy between the Collection Efficiency reported in the DISCOM's Balance Sheet and the Division-wise Collection Efficiency.
4. PVVNL informed that the discrepancies (as per the above point) arises due to the exclusion of certain subsidy amounts in the BEE Annual Energy Form. The DISCOM explains that, accounting for these subsidies, the Collection Efficiency would be 100%. However, without considering these subsidies, the Collection Efficiency stands at 98.23%. Additionally, the Aggregate Technical and Commercial (AT&C) Loss, as per the Balance Sheet, is 14.27%, while as per the division wise losses the AT&C losses is 12.08%.
5. The reason for the discrepancies given by PVVNL was not justified in the opinion of the Ingenius Energy, as the exclusion of subsidies should have an opposite effect, i.e. the AT&C losses as per the Division wise losses should be greater than that as per the Balance Sheet but the same is just the opposite; PVVNL officials present concluded that the same shall be discussed with their commercial unit and resolved later.
6. During the audit it was reported by PVVNL that after quarter 2, there were significant changes and updates made to the software from where feeder data is collected. As a result, the data for Quarter 3 is more erroneous. However, the overall annual data is totality is correct, and for the same reason the T&D loss for Quarter 3 appeared as a negative value.
7. Most of the feeder In the range of 60 to 80% and 80 to 100% they are the rural area feeders.
8. The T&D loss for 1,819 feeders has shown a negative value. This was discussed with PVVNL during the audit and PVVNL informed that the discrepancy is due to the billing cycle, where some energy consumption for the current month is billed in the following month, leading to a negative T&D loss.
9. PVVNL did not provide any data or documentary evidence towards regarding their explanation for the negative AT&C losses, and the only reasoning provided was that collection efficiency is more than 100% for some of the divisions.
10. We have observed that the consumption for some 11 kV feeders is suddenly much higher than the feeder's input power. We discussed this issue with PVVNL, and they explained that the problem is due to incorrect tagging of some feeders. While they have cross-verified and corrected the values for some feeders, many others still show incorrect values and it can be concluded that PVVNL is not carrying out

proper energy accounting and it should develop a proper protocol to verify and rectify the issues as soon as possible.

11. During Audit it was informed by PVVNL as -:

- PVVNL has hired a third-party agency to analyse feeder data on a monthly basis.
- The agency cross-checks the data discrepancies at the field level (Source of Data).
- After cross-checking, any errors in reporting or data entry are corrected at PVVNL HQ, master sheet.
- The agency provides a report of the erroneous data to PVVNL.
- We have inquired with PVVNL about the steps taken in response to the report submitted by the third-party agency.
- However, no information has been provided regarding the corrective actions taken by PVVNL.

7.2 Recommendations and Best Practices- Energy Accounting , Loss Reduction and Energy Conservation

1. Install and repair all the Distribution Transformer Meters and Feeders Meters

Properly functioning Distribution Transformer (DTR) meters and feeder meters are essential for accurately tracking energy usage and performing energy accounting within the system. This ensures that every unit of energy is accounted for, aiding in the detection of discrepancies, optimizing energy distribution, and maintaining overall system efficiency.

2. The proper indexing of all consumers to improve operational efficiency and it help in reduce the loss.

Proper indexing and DTR metering enable us to identify high-loss areas and subsequently reduce these losses.

3. Use of smart meters or image-based meter reading & billing, for LT consumers

For LT consumers, the meter reading system should be automated, either by implementing smart meters or by image based automated meter reading software; where the reader has to capture the image of the meter, and the reading as well as billing is done through software.

4. Regular thermography of panels & switchgears

Electrical Thermography helps to detect any electrical problem before it arises. Thermography is a non-destructive test method gives the following benefits in addition to energy efficiency improvement.

- Determines if the components and system have been properly installed and are not damaged
- Reduces downtime
- Reduces the risk of equipment failure
- Increases safety
- Improves insurability
- Reduces liability exposure of the designers
- Improves system performance
- Determines whether components and systems operate properly and meet the design intent

- Determines if components and systems are following the project specifications and design
- Reduces construction schedule delay
- It is therefore recommended to carry out thermography of all panels & switchgears at regular intervals.

5. Implementation of SCADA system in the PVVNL at all voltage level

The implementation of a Supervisory Control and Data Acquisition (SCADA) system in the PVVNL (Paschimanchal Vidyut Vitran Nigam Limited) at all voltage levels is crucial for several reasons:

1. **Real-Time Monitoring and Control:** SCADA systems enable real-time monitoring and control of the electrical grid across different voltage levels. This allows for immediate detection and response to any anomalies, ensuring the reliable and stable operation of the power distribution network.
2. **Improved Efficiency:** By automating many of the manual processes involved in grid management, SCADA systems increase the overall efficiency of the power distribution network. This reduces operational costs and minimizes the risk of human error.
3. **Enhanced Reliability and Safety:** SCADA systems provide advanced fault detection and isolation features. This helps in quickly identifying faults in the network and taking necessary actions to prevent outages or equipment damage, thereby enhancing the reliability and safety of the power supply.
4. **Data Collection and Analysis:** SCADA systems collect vast amounts of data from various points in the network. This data can be analyzed to identify trends, optimize operations, and plan for future expansions or upgrades.
5. **Remote Accessibility:** SCADA systems allow for remote monitoring and control of the grid. This is particularly important for managing geographically dispersed assets, reducing the need for on-site personnel, and enabling quicker responses to issues.
6. **Regulatory Compliance:** Implementing SCADA helps in ensuring that the power distribution network meets regulatory standards and guidelines. It provides the necessary tools for accurate reporting and compliance with industry regulations.

Overall, the implementation of SCADA at all voltage levels in PVVNL is essential for modernizing the grid, improving operational efficiency, enhancing safety, and ensuring a reliable power supply to consumers.

7.3 Summary Energy Balance and Losses

Sl. No.	Energy Input Details	UoM	Value
1	Input Energy Purchase (From Generation Source)	MU	-----
2	Net Input Energy (at DISCOM Periphery after adjusting the transmission losses and energy traded)	MU	39107.84
3	Total Energy billed (is the Net Energy billed, adjusted for energy traded)	MU	34132.91
4	Transmission and distribution (T&D) loss details	MU	4974.93
		%	12.72 %
5	Collection Efficiency	%	100.73 %
6	Aggregate Technical & Commercial Loss	%	12.08 %

7.4 Action Plan for Line Loss Reduction

Following energy conservation Measures (ECMs) is adopted for line loss reduction

1. Installation of Smart Meters.
2. Installation of Automatic Power factor controller (Capacitor Bank).
3. System improvement & automation.
4. Improvement in metering system.
5. Replacing of conventional/ non-star rated transformer into energy efficient transformers.
6. Replacement of all conventional mechanical energy meters with static digital energy meters having less power consumption and more accuracy.
7. Laying of AB cable in theft prone area where loss are in higher side.
8. HVD system to reduce low tension line losses.
9. Replacing worm out /Under sized conductors.
10. Increase in HT/LT Ratio.
11. Preventive & Periodic maintenance of line & transformer.
12. Load balancing of distribution transformers.
13. MIS Based periodic reporting of unit wise business parameters.
14. Installation of solar generation plant & solar pumps.
15. Strengthening of energy accounting infrastructure- 100% consumer metering.
16. GIS based asset mapping of all 33/11KV Substations, 11KV Lines and distribution transformers has been completed.

17. 11KV Feeder wise base line technical data i.e., length, Peak load, VR and technical loss calculated by algorithm & published in power BI.
18. Feeder wise baseline commercial loss is being collected by subtracting technical loss for total T&D loss.
19. Selection/priority of area must be made under:
 - I. Feeder having VR more than 15%.
 - II. Feeder having VR more than 9 to 15%.
 - III. Feeder having peak load more than 100 Amp. & length more than 30KM.
 - IV. High T&D loss feeder.
 - V. High commercial loss feeder.

7.5. Action plan for monitoring and reporting

1. Unified dashboard for all feeder monitoring.
2. Substation wise dashboard for all substation monitoring
3. Division dashboard for monitoring all division data.
4. Critical Parameters dashboard for KPI.
5. Energy Audit Management Tool.
6. Energy Directorate Portal. All the input injected point.
7. DT Monitoring BCITS Portal.
8. RAPDRP & Non RAPDRP for Billing
9. RTDAS
10. 1912 customer care.

7.6. Action plan for automated energy accounting

Automated energy accounting is a critical component of modern electricity distribution systems. It allows for accurate and efficient tracking of energy usage, which helps identify energy waste, reduce energy consumption, and improve billing accuracy. In this report, we will outline an action plan for implementing automated energy accounting in an electricity distribution company.

Step 1: Evaluate Current Energy Accounting System

The first step is to evaluate the current energy accounting system to identify areas that need improvement. This will involve reviewing the current processes, systems, and data management practices. The evaluation should consider the following factors:

- Accuracy of billing and metering

- Timeliness of bill generation
- Data management practices
- Energy usage tracking capabilities
- Customer feedback and complaints

Step 2: Identify Automated Energy Accounting System Requirements

After evaluating the current energy accounting system, the next step is to identify the requirements for an automated energy accounting system. This will involve considering the following factors:

- Energy usage tracking capabilities
- Billing accuracy and timeliness
- Integration with existing systems
- Data management capabilities
- Scalability and flexibility

Step 3: Research and Select an Automated Energy Accounting System

Once the requirements are identified, the next step is to research and select an automated energy accounting system. This will involve reviewing available options and selecting a system that meets the identified requirements. The selected system should have the following features:

- Real-time energy usage tracking
- Automated billing and metering
- Data management and analysis capabilities
- Integration with existing systems
- User-friendly interface

Step 4: Develop Implementation Plan

After selecting an automated energy accounting system, the next step is to develop an implementation plan. This will involve determining the following:

- Timeline for implementation
- Resource requirements
- Roles and responsibilities
- Training requirements
- Data migration plan

Step 5: Implementation and Testing

Once the implementation plan is developed, the next step is to implement and test the automated energy accounting system. This will involve the following:

- Installation and configuration of the system
- Data migration from the old system to the new system
- User training
- System testing

Step 6: Rollout and Monitoring

After successful testing, the next step is to rollout the automated energy accounting system to all customers. This will involve communicating the changes to customers and ensuring a smooth transition. Once rolled out, the system should be continuously monitored to identify any issues and improve the system's performance.


In conclusion, implementing an automated energy accounting system can help PVVNL improve billing accuracy, reduce energy waste, and enhance data management capabilities. The action plan outlined above provides a framework for implementing an automated energy accounting system in an electricity distribution company. By following this plan, the company can successfully implement the system and achieve its energy accounting goals.

Certification

Ingenius Energy Consultancy Pvt. Ltd., had conducted an Annual Energy audit at Pashchimanchal Vidyut Vitran Nigam Limited.

The undersigned Accredited Energy Auditor by BEE, Ameet Jain (AEA – 0280), hereby certify that -


- I. The data collection has been carried out diligently and truthfully.
- II. All reasonable professional skill, care and diligence had been taken in preparing the Energy Audit Report and the contents there of are a true representation of the facts.
- III. Adequate training provided to personnel involved in daily operation after implementation of recommendation.
- IV. The Energy Audit has been carried out in accordance with the Bureau of Energy Efficiency (Manner and intervals of time for the conduct of Energy Audit) Regulation, 2010.

Signature : 

Name of the Accredited Energy Auditor: **AMEET JAIN**

Accreditation Detail : **AEA- 0280**

Seal :



8. Annexures

8.1. Introduction of Verification Firm

Ingenius Energy Consultancy specializes in solving energy efficiency challenges in today's highly demanding environments. We help companies to improve their energy efficiency by reviewing and modernizing processes and introducing automation to systems and devices. We strive to satisfy customers in Energy Auditing and Consulting almost from all industry sectors across India. Based on our expertise and industry standards, we customize and scale our solutions for the needs of any company or community.

Ingenius Energy Consultancy was established in 2018 with a vision to serve the industry and deliver best solutions for Energy Conservation and Management of International Standards. We possess sufficient Infrastructure and a Team of Management and Technical professionals having vast diversified industrial experience of Consultancy & Training in Manufacturing and Service industry. Some of them are lead auditors from Bureau of Energy Efficiency (B.E.E.) Government of India.

Sl. No.	Name	Qualification	Experience	Contact Detail
1	Mr. Ameet Jain	Accredited Energy Auditor (AEA-0280), Director of M/s Ingenious Energy Consultancy (Team Leader)	15 yrs.	9981900123
2	Mr. Ashok Ghuha	Electrical Engineer Ex. Additional Chief Engineer (CSPDCL Durg)	33 yrs.	
2	Mr. Sagar Verma	Mechanical Engineer	3.5 yrs.	
3	Mr. Kuldeep Dewangan	Electrical Engineer	1.5 months	

8.2. Minutes of Meeting

Minutes of Meeting with Pashchimanchal Vidyut Vitran Nigam Limited (PVVNL), Urja Bhawan, Meerut & Ingenius Energy Consultancy Pvt. Ltd.

Pashchimanchal Vidyut Vitran Nigam Limited (PVVNL) Meerut (Team Member)	Ingenius Energy Consultancy Pvt Ltd. (Team Member)
1. Mr. Rahul Nanda (S.E. Commercial- III)	1. Mr. Ameet Jain (AEA)
2. Mr. Vivek Patel (Executive Engineer HV Cell)	2. Mr. Ashok Kumar Guha (Sector Expert)
	3. Mr. Sagar Verma (Energy Engineer)
	4. Mr. Kuldeep Dewangan (Energy Engineer)

A meeting was held on the 24th July 2024 between PVVNL and Ingenius Energy Consultancy to finalize the modality of carrying out Annual Energy Audit stipulated by BEE. The following points were discussed:

1. All the four quarter proforma was thoroughly analyzed and the cumulative annual proforma of F.Y. 2023-24, was filled in consultation and as per the data provided by PVVNL.
2. PVVNL, provided the following document for net input energy (Month wise), Billed Energy (Month Wise), No. of consumer, No. of Dt's, No. of Circle i.e. revenue department, Internal department, Fact Sheet & Software Data Base.
3. It was informed that the power purchase detail is not available with PVVNL as the same is done by UPPCL and data is not available, as per the format of BEE with PVVNL.
4. During audit it was observed that as per the data available with PVVNL, some feeder T&D losses were in negative; which is technically incorrect and PVVNL informed that the same is due to wrong tagging of the feeder, and the same cannot be corrected immediately, and the officials of PVVNL present during the audit concluded that the same shall be discussed with their commercial unit and resolved later.
5. During the Audit, it was observed and brought to the notice of PVVNL that there is discrepancy between the Collection Efficiency reported in the DISCOM's Balance Sheet and the Division-wise Collection Efficiency.
6. PVVNL informed that the discrepancies (as per the above point) arises due to the exclusion of certain subsidy amounts in the BEE Annual Energy Form. The DISCOM explains that, accounting for these subsidies, the Collection Efficiency would be 100%. However, without considering these subsidies, the Collection Efficiency stands at 98.23%. Additionally, the Aggregate Technical and Commercial (AT&C) Loss, as per the Balance Sheet, is 14.27%, while as per the division wise losses the AT&C losses is 12.08%
7. The reason for the discrepancies given by PVVNL was not justified in the opinion of the Ingenius Energy, as the exclusion of subsidies should have an opposite effect, i.e. the AT&C losses as per the Division wise losses should be greater than that as per the Balance Sheet but the same is just the opposite; PVVNL officials present concluded that the same shall be discussed with their commercial unit and resolved later.

8. The meeting ended with the conclusion to prepare the Final Energy Accounting Report with the data as available and provided by PVVNL.

Signature

Pashchimanchal Vidyut Vitran Nigam Limited
(PVVNL) Meerut (Team Member)

Ingenius Energy Consultancy Pvt Ltd.
(Team Member)

1. Mr. Rahul Nanda (S.E. Commercial- III)

1. Mr. Ameet Jain (AEA, Team Leader)

2. Mr. Vivek Patel (Executive Engineer HV Cell)

2. Mr. Ashok Kumar Guha (Sector Expert)

3. Mr. Sagar Verma (Energy Engineer)

4. Mr. Kuldeep Dewangan (Energy Engineer)

8.3. Check List Prepared by Auditing Firm

List of documents required:

- Energy Purchase Documents.
- Consumer category wise details.
- Annual EHT sales Data.
- Month wise input and billed energy.
- T&D losses computation approach.
- Un-metered energy consumption approach.
- Internal field audit report of input and billed energy.
- Performance of DISCOM on distribution losses.
- Outcome of internal filed audit.
- Measures taken to reduce losses and improve losses.
- Zone/circle/Division/Sub-division wise loss computation.
- Reduction achieved, measures adopted for energy conservation and quantity of energy saved.
- Report on distribution losses.
- List of measuring equipment's and calibration certificates and frequency of calibration.
- Write up on energy scenario.
- Generation via solar, DG and any other source and share of energy consumption.
- Net Input Energy Computation Details.
- Category wise consumer's details.
- Category wise consumers connected load and % load
- Bifurcation of Billed Energy (metered billed energy and unmetered billed energy).
- Disconnected consumer's details
- Loss Analysis report
- Write up on procedure followed Technical loss analysis.

8.4. Brief Approach, Scope & Methodology for Audit

Scope of annual energy accounting is as per guidelines and notification from Bureau of Energy Efficiency, New Delhi dated 6th October, 2021



8.5 Infrastructure Details

The Infrastructure details of the DISCOM are as shown in the table below:


1	Parameters	Total
i	Number of circles	29
ii	Number of divisions	95
iii	Number of sub-divisions	255
iv	Number of feeders	7339
v	Number of DTs	677923
vi	Number of consumers	7547052

2	Parameters	66kV and above	33kV	11/22kV	LT
a.	Number of conventional metered consumers	18	358	2808	7017713
i.					
ii	Number of consumers with 'smart' meters				188867
iii	Number of consumers with 'smart prepaid' meters				
iv	Number of consumers with 'AMR' meters			6775	7828
v	Number of consumers with 'non-smart prepaid' meters				
vi	Number of unmetered consumers				332644
vii	Number of total consumers	18	358	9583	7547052
b.i.	Number of conventionally metered Distribution Transformers				56294
ii	Number of DTs with communicable meters				
iii	Number of unmetered DTs				593418
iv	Number of total Transformers				649712
c.i.	Number of metered feeders	1	1	2148	
ii	Number of feeders with communicable meters			4913	
iii	Number of unmetered feeders	0			
iv	Number of total feeders	1	1	7061	0
d.	Line length (ct km)				
e.	Length of Aerial Bunched Cables				
f.	Length of Underground Cables				

8.6. Electrical Distribution System

- Energy Flow from generation to transmission at 220kV/132kV
- Energy Flow between 220/132/33kV and 33kV/11kV system
- Energy Flow between 33kV/11kV feeders and distribution transformers, or high voltage distribution system.
- Energy flow between distribution transformer, or high Voltage distribution system to end consumer, including ring main system.
- Energy flow between feeder to end consumer & energy flow between 132kV/ 33kV/11kV directly to end consumer.

Energy Flow Diagram

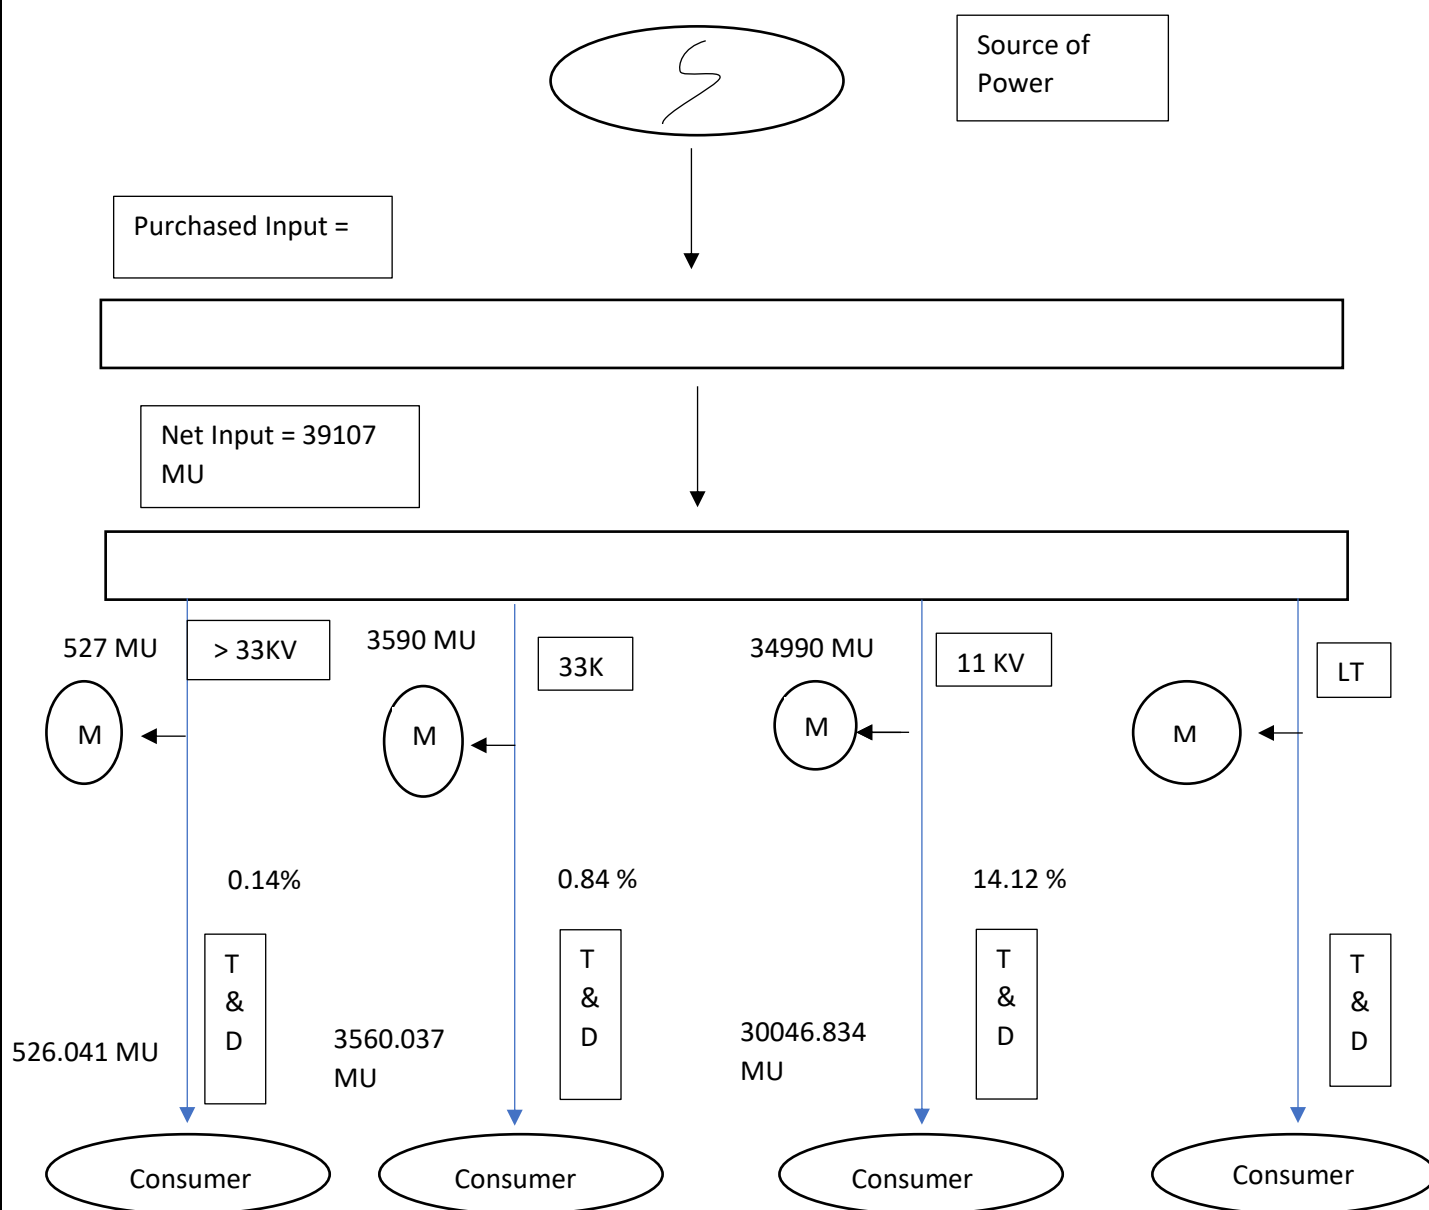

8.7. Voltage wise Input Energy

3	Voltage level	Particulars	MU	Reference
i	66kV and above	Long-Term Conventional	39,108	Includes input energy for franchisees
		Medium Conventional	0	
		Short Term Conventional		
		Banking	0	
		Long-Term Renewable energy		
		Medium and Short-Term RE	0	Includes power from bilateral/ PX/ DEEP
		Captive, open access input		Any power wheeled for any purchase other than sale to DISCOM. Does not include input for franchisee.
		Sale of surplus power		
		Quantum of inter-state transmission loss		As confirmed by SLDC, RLDC etc
		Power procured from inter-state sources	39,108	Based on data from Form 5
		Power at state transmission boundary	39,108	
ii	33kV	Long-Term Conventional		
		Medium Conventional	0	
		Short Term Conventional	0	
		Banking	0	
		Long-Term Renewable energy	0	
		Medium and Short-Term RE	0	
		Captive, open access input	0	
		Sale of surplus power	0.000	

3	Voltage level	Particulars	MU	Reference
		Quantum of intra-state transmission loss	0	
		Power procured from intra-state sources	0	
iii		Input in DISCOM wires network	39,108	
iv	33 kV	Renewable Energy Procurement		
		Small capacity conventional/ biomass/ hydro plants Procurement		
		Captive, open access input		
v	11 kV	Renewable Energy Procurement		
		Small capacity conventional/ biomass/ hydro plants Procurement		
		Sales Migration Input		
vi	LT	Renewable Energy Procurement		
		Sales Migration Input		
vii		Energy Embedded within DISCOM wires network	0	
viii		Total Energy Available/ Input	39,108	

8.8. Voltage wise Sales Energy

4	Voltage level	Energy Sales Particulars	MU	Reference
i	LT Level	DISCOM' consumers		Include sales to consumers in franchisee areas, unmetered consumers
		Demand from open access, captive		Non DISCOM's sales
		Embedded generation used at LT level		Demand from embedded generation at LT level
		Sale at LT level	0	
		Quantum of LT level losses	0	
		Energy Input at LT level		
ii	11 kV Level	DISCOM' consumers	30,047	Include sales to consumers in franchisee areas, unmetered consumers
		Demand from open access, captive		Non DISCOM's sales
		Embedded generation at 11 kV level used		Demand from embedded generation at 11kV level
		Sales at 11 kV level	30,047	
		Quantum of Losses at 11 kV	4,944	
		Energy input at 11 kV level	34,990	
iii	33 kV Level	DISCOM' consumers	3,560	Include sales to consumers in franchisee areas, unmetered consumers
		Demand from open access, captive		Non DISCOM's sales
		Embedded generation at 33 kV or below level		This is DISCOM and OA demand met via energy generated at same voltage level
		Sales at 33 kV level	3,560	
		Quantum of Losses at 33 kV	30	

4	Voltage level	Energy Sales Particulars	MU	Reference
		Energy input at 33kV Level	3,590	
iv	> 33 kV	DISCOM' consumers	526.0408454	Include sales to consumers in franchisee areas, unmetered consumers
		Demand from open access, captive		Non DISCOM's sales
		Cross border sale of energy		
		Sale to other DISCOMs		
		Banking		
		Energy input at > 33kV Level	527	
		Sales at 66kV and above (EHV)	526	
Total Energy Requirement			39,108	
Total Energy Sales			34,133	

8.9. Details of Consumer and Connection

Type of Consumers	Category of Consumers (EHT/HT/LT/Others)	Voltage Level (In Voltage)	No of Consumers
LMV-1 Domestic light fan & power	LT	230 V	6290631
LMV-2 Non-domestic light fan & power	LT	230/400	581869
LMV-3 Public lamps	LT	230/400	6641
LMV-4 Light, fan & power for public/private institution	LT	230/400	47294
LMV-5 Private tube well/pumping sets	LT	230/400	505168
LMV-6 Small & medium power upto 100 HP/75kw	LT	230/400	72326
LMV-7 Public water works	LT	230/400	5788
LMV-8 State tube wells & pumps canal upto 100 hp	LT	230/400	4984

Type of Consumers	Category of Consumers (EHT/HT/LT/Others)	Voltage Level (In Voltage)	No of Consumers
LMV-9 Temporary supply	LT	230/400	8035
LMV- 10 Departmental employees	LT	230/400	13637
LMV-11 Electric Vehicle Charging			930
HV-1 Non industrial bulk load	HT	11kV& 33kV	2805
HV-2 Large & heavy power above 100 BHP (75 kw)	HT	33kV& 66kV	6931
HV-3 Railway traction	HT	33kV	6
HV-4 Lift irrigation & p. canal above 100 BHP (75kw)	HT	33kV	4
Other			3