WaterOne

Water District No. 1 of Johnson County



Ice on the Kansas River near WaterOne's Intake and Presedimentation Facility.

WATER QUALITY REPORT 2026

WHAT IS THIS REPORT?

This report is to let you - our customers - know that water produced by WaterOne meets or surpasses all standards for safe, high-quality water.

WaterOne is required by drinking water regulations to make this water quality report available to customers. It's like a nutritional label for the substance you probably consume the most - water!

This data and information can be complex, so in addition to the regulatory language we've tried to make it relatable. Congress, the Environmental Protection Agency (EPA), and WaterOne want to be sure that consumers know what's in their drinking water.

Please share this information with anyone who drinks this water (or their guardians), especially those who may not have received this report directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this report in a public place or distributing copies by hand, mail, email, or another method. To request a paper copy, contact Customer Service at (913) 895-1800.

WATER AT A GLANCE

ALL DRINKING WATER, including bottled water, can reasonably be expected to contain at least small amounts of some impurities. The presence of impurities does not necessarily indicate that water poses a health risk.

In order to ensure that tap water is safe to drink, the EPA has regulations that limit the amount of certain impurities in water provided by public water systems and require monitoring for these impurities.

WHAT DO WE TEST FOR?


WaterOne tests for over 100 regulated and unregulated contaminants in drinking water. Our state-of-the art water quality lab utilizes multiple monitoring systems, and our water is continuously checked every single day of the year to ensure the finest water reaches our customers' taps.

As required by law, all data in this report is from 2025. **If a known health-related contaminant is not listed in this report, WaterOne did not detect it in the water.**

HOW MUCH WATER DOES WATERONE PRODUCE?

In 2025, WaterOne treated a total of 25.5 billion gallons of water - approximately 5 billion gallons of Kansas River water, 13.1 billion gallons of Missouri River water, 7 billion gallons from its Wolcott Collector Well (adjacent to the Missouri River), and 0.4 billion gallons of water from wells south of the Kansas River.

WaterOne customers consume between 36 to 132 million gallons per day (MGD), depending on the time of year. The most water consumed in one day was 157.5 MGD, set on July 23, 2012.

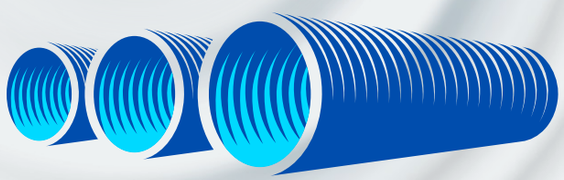

ENSURING SAFE, RELIABLE WATER


Some people may be more vulnerable to impurities in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, some elderly people, and infants can be particularly at risk from infections.

These people should seek advice about drinking water from their health care providers. Guidelines from the EPA and Centers for Disease Control and Prevention (CDC) on appropriate means to lessen the risk of infection by Cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline at (**800) 426-4791**.


MORE ABOUT WATERONE

WHERE DOES YOUR WATER COME FROM?

WaterOne's award-winning drinking water comes from the Kansas and Missouri Rivers. With multiple water sources, we have less vulnerability during drought and an ample supply of fresh water year-round.

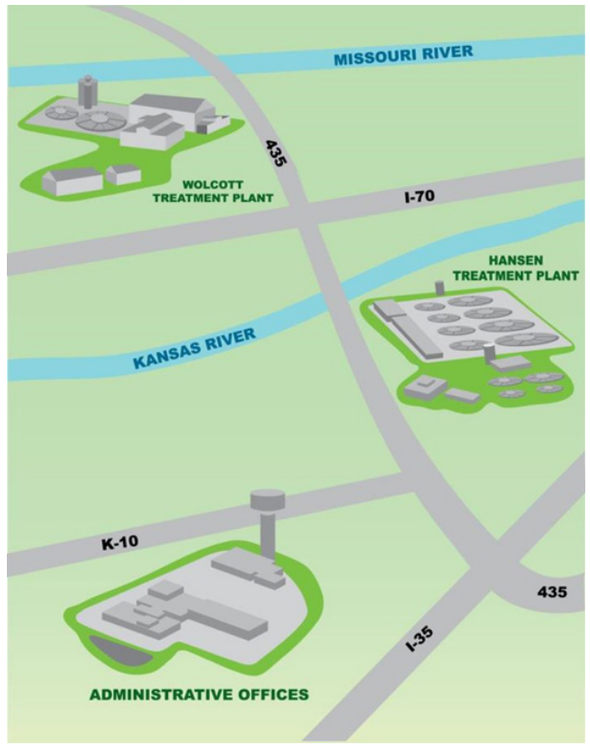

CUSTOMER SATISFACTION

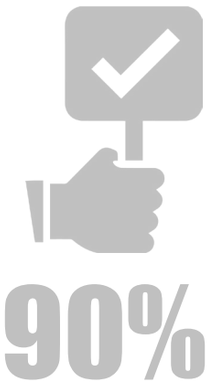

90%


We're proud to carry an average overall customer satisfaction score above 90%. Our customers consistently give us high marks for water quality, reliability, customer service, and the responsiveness of our friendly, professional staff.

GREAT VALUE

WaterOne customers enjoy some of the lowest rates for award-winning water service in the metro area.

Did you know?

1 PENNY buys you 2 gallons of WaterOne tap water.

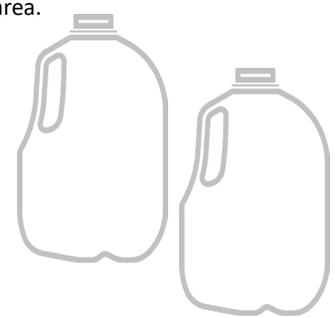

Based on 2025 rates for average residential customers.



PROTECTING YOU FROM LEAD

WaterOne is passionate about producing safe water. We are protectors of public health, and given the water quality challenges experienced by other communities, we are proud to confirm that your water is high-quality. We are committed as water quality experts to helping advise homeowners, businesses, and schools on safeguarding lead exposure from interior plumbing.

WaterOne's treated water is lead-free when it reaches your property. It then continues through your private service line and into your building. Risk of lead exposure comes from plumbing, where it's possible for lead in pipes, solder, fittings, or fixtures to leach into drinking water under certain conditions.

To protect our customers, WaterOne follows a triple-barrier approach to lead protection.

1. **We have no evidence of the presence of lead in our distribution system.**
2. Our treatment process carefully controls pH and alkalinity, which helps inhibit purified drinking water from picking up impurities from plumbing materials. Our water chemistry is designed to micro-deposit minerals (calcium and magnesium) to form a protective barrier between water and plumbing materials.
3. WaterOne is committed to quality control above and beyond the testing required by state and federal regulations. Learn more at **waterone.org/lead**.

Service Line Lookup Tool

Service lines are the pipes that bring water from the water main to the meter and into a customer's property. To see a map of the material status of all recorded service lines in WaterOne's service area, visit **waterone.org/LineLookup**.

Important Information about Lead

The EPA has asked us to share the following health information statement with you per 40 CFR 141.154.

There is no safe level of lead in drinking water. Exposure to lead in drinking water can cause serious health effects in all age groups. Infants and children can have decreases in IQ and attention span. Lead exposure can lead to new learning and behavior problems or exacerbate existing learning and behavior problems. The children of women who are exposed to lead before or during pregnancy can have increased risk of these adverse health effects. Adults can have increased risks of heart disease, high blood pressure, kidney or nervous system problems.

Lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. WaterOne is responsible for providing high quality drinking water and removing lead pipes but cannot control the variety of materials used in plumbing components in your home. You share the responsibility for protecting yourself and your family from the lead in your home plumbing. You can take responsibility by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Before drinking tap water, flush your pipes for several minutes by running your tap, taking a shower, doing laundry or a load of dishes. You can also use a filter certified by an American National Standards Institute accredited certifier to reduce lead in drinking water. If you are concerned about lead in your water and wish to have your water tested, contact WaterOne at (913) 895-1800. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at **https://www.epa.gov/safewater/lead**.

WATER QUALITY DATA

TERMS, ABBREVIATIONS & SYMBOLS

Some of the terms used in this report are unique to the water industry and might not be familiar to all customers. Explanations are provided below.

Action Level (AL): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.

Contaminant: Any physical, chemical, biological, or radiological substance or matter in water.

Hazard Index (HI): A calculation used by the EPA to understand health risk from chemical mixtures.

Herbicide: Any chemical(s) used to control undesirable vegetation.

Maximum Contaminant Level (MCL): The highest level of a contaminant allowed in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants as water travels to customer's taps.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

Not Detected (ND): Not detected in the water.

Nephelometric Turbidity Units (NTU): A measure of the clarity of water.

Parts per million (ppm): Or milligrams per liter.

Parts per billion (ppb): Or micrograms per liter.

Parts per trillion (ppt): Or nanograms per liter.

Pesticide: Generally, any substance or mixture of substances intended for preventing, destroying, repelling, or mitigating any pest.

pH Units: A measure of acidity or alkalinity of the water.

Picocuries per liter (pCi/L): A measure of radioactivity.

Saturation Index (S.I.): Measure of corrosivity.

Secondary Maximum Contaminant Level (SMCL): Secondary MCLs for various water quality indicators are established to protect public welfare.

Treatment Technique (TT): A required process intended to reduce the level of a contaminant in drinking water.

µmhos/cm: Or micromhos/cm; a measure of the ability of a solution to carry an electric current.

SOURCES OF DRINKING WATER

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

Contaminants in drinking water sources may include:

- **Microbial contaminants,** such as viruses and bacteria, which may come from wildlife or septic systems.
- **Inorganic contaminants,** such as salts and metals, which can occur naturally or result from urban storm water runoff, industrial or domestic wastewater discharges or farming.
- **Pesticides and herbicides,** which may come from a variety of sources such as farming, urban storm water runoff and home or business use.
- **Organic chemical contaminants,** including synthetic and volatile organic chemicals, which are byproducts of industrial processes, and can also come from gas stations, urban storm water runoff and septic systems.
- **Radioactive contaminants,** which can occur naturally.

WATER QUALITY | WHAT IS IN THE WATER?

All data is for January 1 to December 31, 2025, except as noted.

REGULATED PARAMETERS

Parameter	MCL	MCLG	WaterOne Result	WaterOne Range	Sample Data	Met Standard	Source *According to the EPA, here are common sources of contaminants in water*
Inorganic Contaminants							
Arsenic	10 ppb	0 ppb	1.8 ppb	ND (1.0) ppb - 1.8 ppb	Monthly	✓	Erosion of natural deposits; run-off from orchards, glass and electronics production waste.
Barium	2 ppm	2 ppm	0.04 ppm	0.02 ppm - 0.04 ppm	Monthly	✓	Discharge of drilling wastes; discharge from metal refineries, erosion of natural deposits.
Chromium	100 ppb	100 ppb	2.9 ppb	1.4 ppb - 2.9 ppb	Monthly	✓	Discharge from steel and pulp mills, erosion of natural deposits.
Copper	AL=1.3 ppm	1.3 ppm	0.02 ppm [2]	0 samples exceeding; 2025	Annually	✓	Corrosion of household plumbing, erosion of natural deposits; leaching from wood preservatives.
Fluoride	4 ppm	4 ppm	0.75 ppm	ND (0.15) ppm - 0.75 ppm	Monthly	✓	Erosion of natural deposits; water additive (oral health); discharge - fertilizer and aluminum factories.
Lead [1]	AL=15 ppb	0 ppb	4.1 ppb [2]	ND (1.0) ppb-13.4 ppb. 0 samples exceeding; 2025	Annually	✓	Corrosion of household plumbing systems; erosion of natural deposits.
Nitrate	10 ppm	10 ppm	1.7 ppm	ND (0.05) ppm - 1.7 ppm	Annually	✓	Fertilizer run-off; leaching from septic tanks, sewage; erosion of natural deposits.
Selenium	50 ppb	50 ppb	3.2 ppb	ND (1.0) ppb - 3.2 ppb	Monthly	✓	Discharge from petroleum and metal refineries; erosion of natural deposits; discharge from mines.
Disinfectants/Disinfection By-Products							
Bromate	10 ppb	0 ppb	5.8 ppb	ND (1.0) ppb - 6.6 ppb	Monthly	✓	By-product of drinking water disinfection.
Chloramines	MRDL=4 ppm	MRDLG=4 ppm	3.1 ppm [3]	1.2 ppm - 3.9 ppm	Daily	✓	Water additive used to control microbes.
Haloacetic Acids (HAA)	60 ppb	n/a	17 ppb	6.4 ppb - 20.8 ppb	Monthly	✓	By-product of drinking water disinfection.
Total Trihalomethanes (THM)	80 ppb	n/a	33 ppb	2.5 ppb - 18 ppb	Monthly	✓	By-product of drinking water disinfection.
Microbiological Contaminants							
Total Coliforms	Presence in ≥ 5% of monthly samples	0 (<1/100 mls)	0.8%	0 - 0.83% positive samples/ month	Daily	✓	Naturally present in the environment.
Total Organic Carbon (TOC)	Removal ratio [4] (1.0 required)	TT	1.6	1.6 - 2.0 RAA Removal Ratio	Monthly	✓	Naturally present in the environment.
Turbidity	TT NTU	TT NTU	0.23 NTU [5]	100% lowest monthly % meeting 0.3 NTU	Daily	✓	Soil run-off.
Radiological Contaminants							
Beta Particle & Photon Radioactivity	50 pCi/L	0 pCi/L	6.2 pCi/L [6]	5.2 pCi/L - 6.2 pCi/L	Annually	✓	Decay of natural and man-made deposits.
Radium-228	5 pCi/L	0 pCi/L	0.67 pCi/L	ND (0.54) pCi/L - 0.67 pCi/L	Annually	✓	Erosion of natural deposits.
Uranium	30 ppb	0 ppb	1.15 ppb	ND (0.32) ppb - 1.15 ppb	Annually	✓	Erosion of natural deposits.
Synthetic Organic Contaminants							
Atrazine	3 ppb	3 ppb	0.14 ppb	ND (0.1) ppb - 0.14 ppb	Monthly	✓	Runoff from herbicide used on row crops.

1. The Lead and Copper Rule (LCR) results presented in this report are representative of a set of in-home samples that are determined to be at the highest risk for lead presence using the criteria set forth in the LCR. These do not represent the water quality in the supply water from the distribution system. The Lead and Copper rules require water systems to develop and maintain a Service Line Inventory. The service line is the underground pipe that supplies your home or building with water. To view the Service Line Inventory, which lists the material type(s) for your location, you may view the inventory at waterone.org/linelookup.
2. Data from 2025 annual monitoring. This value is the 90th percentile result. The 95th percentile value for lead is 4.7 ppb; the 95th percentile value for copper is 0.0184 ppm.
3. WaterOne is required to maintain a minimum chloramine residual of 1.0 ppm throughout its distribution system by the Kansas Dept. of Health & Environment as a means to provide some measure of protection against microbiological contamination. Maximum residual compliance is based on monthly averages.
4. Monthly TOC removal ratio is calculated as the ratio between the actual TOC removal achieved and the TOC rule removal requirements.
5. This is the highest turbidity measurement for 2025. Compliance is based on 95% of monthly samples being less than 0.3 NTU. Turbidity is measured as an indicator of the effectiveness of the water treatment process. The lower the turbidity, the more effective the treatment process.
6. EPA considers 50 pCi/L to be the level of concern for beta particles.



UNREGULATED PARAMETERS

WaterOne conducted testing according to the EPA guidelines for the following Unregulated Parameters.

Parameter	Federal Level Recommended	Goal	WaterOne Results (Ave.)	Range
Alkalinity, Total*	300 ppm	> 40 ppm	63 ppm	46 ppm - 83 ppm
Bromide	n/a	n/a	77 ppb	50 ppb - 136 ppb
Bromodichloromethane	n/a	0 ppb	1.7 ppb	ND (1.0) ppb - 3.8 ppb
Calcium	n/a	n/a	29 ppm	27 ppm - 31 ppm
Carbon, Total Organic (TOC)	10,000 ppm	n/a	2.7 ppm	2.3 ppm - 3.3 ppm
Chloroform	n/a	70 ppb	7.1 ppb	2.5 ppb - 15 ppb
Conductivity	1,500 µmhos/cm	n/a	495 µmhos/cm	450 - 540 µmhos/cm
Dichloroacetic acid**	n/a	0 ppb	8.2 ppb	3.9 ppb - 13.6 ppb
Hardness, Calcium*	200 ppm	> 60 ppm	79 ppm	64 ppm - 120 ppm
Hardness, Total*	400 ppm	200 ppm	135 ppm	110 ppm - 157 ppm
Lithium***	n/a	n/a	21.9 ppb	ND (9.0) ppb - 33.9 ppb
Magnesium	150 ppm	50 ppm	12 ppm	11 ppm - 13 ppm
Manganese	50 ppb	50 ppb	1.8 ppb	ND (1.0) ppb - 16.6 ppb
Monochloroacetic acid	n/a	70 ppb	2.1 ppb	ND (1.0) ppb - 7.6 ppb
Nickel	100 ppb	100 ppb	1.8 ppb	ND (1.0) ppb - 10 ppb
pH	8.5 pH units	> 9.0 pH units	9.6 pH units	9.1 pH units - 9.8 pH units
Phosphorus, Total	n/a	n/a	0.1 ppm	0.1 ppm - 0.2 ppm
Potassium	100 ppm	20 ppm	7.0 ppm	6.6 ppm - 7.8 ppm
Silica	50 ppm	n/a	12.5 ppm	5 ppm - 23 ppm
Sodium	100 ppm	20 ppm	56 ppm	44 ppm - 62 ppm
Trichloroacetic acid	n/a	20 ppb	1.1 ppb	ND (1.0) ppb - 1.8 ppb

* As $CaCO_3$
** The MCLG for Dicholoroacetic acid is listed as zero (in ppm) in the Regulatory Statutes.
*** The EPA has not set an MCL or MCLG for Lithium.

CONSTITUENTS HAVING SECONDARY MCL'S

Monitored in the interest of consumers and to assist regulators in developing future regulations.

Parameter	Federal Level Recommended (SMCL)	WaterOne Results (Avg.)	Range (Low - High)
Aluminum*	200 ppb	9.9 ppb	ND (1.0) ppb - 97.4 ppb
Chloride	250 ppm	39 ppm	24 ppm - 74 ppm
Copper	1000 ppb	1.8 ppb	ND (1.0) ppb - 4.9 ppb
Corrosivity**	0 S.I.	1.1 S.I.	0.79 S.I. - 1.4 S.I.
Fluoride	2.0 ppm	0.5 ppm	ND (0.15) ppm - 0.75 ppm
Odor-Threshold (T.O.N.)	3 T.O.N.	4 T.O.N.	1 T.O.N. - 5 T.O.N.
Sulfate	250 ppm	156 ppm	96 ppm - 216 ppm
Total Dissolved Solids (TDS)	500 ppm	323 ppm	280 ppm - 360 ppm
Zinc	5000 ppb	5 ppb	ND (5.0) ppb - 64 ppb

* The MCLG for Aluminum is listed as 50 ppb - 200 ppb in the Regulatory Statutes.
**Positive values indicate tendency of water to be non-corrosive. Non-corrosive water reduces the likelihood of lead or copper leaching into the water from premise plumbing.

DROP BY DROP

It may be difficult to picture how much of a measured substance is in water. To help you visualize the units of measure reported here, this is what these amounts are equivalent to:



Part Per Million (ppm)
1 drop in a hot tub = 1 ppm



Part Per Billion (ppb)
1 drop in an Olympic size swimming pool = 1 ppb



Part Per Trillion (ppt)
1 drop in a 6-acre lake = 1 ppt

More information about contaminants and potential health effects can be found at the Environmental Protection Agency's Safe Drinking Water Hotline at (**800) 426-4791** or at **epa.gov/safewater.**

OUR TREATMENT PROCESS

The water treatment process is a little different at each WaterOne facility depending on the systems in use. However, water generally follows these steps to go from the river to your tap.

1. **Intake -** Raw water is drawn from our fresh water sources - the Kansas and Missouri Rivers, adjacent horizontal collector wells, and conventional wells on the Kansas River. Surface water is mechanically screened to filter out natural debris.




RAW WATER

2. **Disinfection -** Water is disinfected to break down illness-causing microorganisms as well as taste and odor compounds. Depending on the treatment plant, water is treated either by contact with chlorine or ozone, a powerful and natural method of disinfection.



OZONE OR CHLORINE


3. **Sedimentation -** Water is transferred to mixing basins at our treatment plants where we add alum, lime, and polymer. This process causes small organic particles to clump together in a reaction called flocculation. Over time, the sedimentation clumps settle to the bottom of the basin and are strained out. Fluoride occurs naturally in our water but is also supplemented in the treated water. Depending on the profile of the raw water, lime and possibly soda ash are added which softens the mineral content of the water. Water then flows to a second basin, where it is mixed with carbon dioxide to balance pH and re-strained for sedimentation.

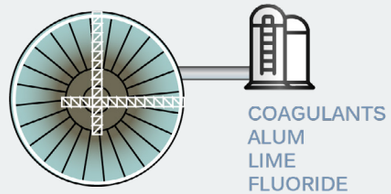

SEDIMENTATION BASINS

COAGULANTS
ALUM
LIME
FLUORIDE
SODA ASH
Co2

4. **Filtration -** Water is filtered to remove microscopic particles of matter. At one treatment plant, water is strained through filter beds containing layers of fine, granular materials. Another WaterOne treatment plant uses a membrane filtration system. As smaller, suspended particles are removed, cloudiness diminishes and clear water emerges.

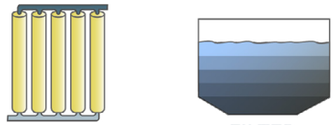

MEMBRANE FILTRATION OR FILTER BASINS

5. **Storage & Distribution -** To protect against bacteria and other microbes, chloramines are added before the water flows into the distribution system - clean, fresh, and delicious.



FINISHED WATER STORAGE

DISINFECTANT

WaterOne
Water District No. 1 of Johnson County

Water touches everything we care about.

WaterOne is an independent public utility. We've been proudly serving the Johnson County, Kansas area since 1957. Every day, nearly half a million customers rely on WaterOne to provide fresh, clean water on demand. It's a responsibility we deliver on.

ATTEND A BOARD MEETING!

As an independent, non-profit water utility founded by customers and for customers, we welcome your insight and questions. Our organization is guided by a Governing Board, which is selected at-large from our service area in local, public elections. They encourage your participation as a customer or interested party, especially as it relates to helping us achieve our vision of striving for excellence.

Learn more at waterone.org/Board

Regular Board Meetings

Second Tuesday of each month at 7 PM

WaterOne Administrative Offices
10747 Renner Boulevard
Lenexa, Kansas 66219

GOVERNING BOARD

Whitney Wilson, Chair
Melanie Kraft, Vice Chair
Renee Dinsmore
Jennifer Gunby
Kay Heley
Jill Westra
Ullyses Wright

In an emergency,
would we reach you?

NotifyJoCo

Sign up for emergency alerts at
www.notifyjoco.org



Contact Us

10747 Renner Blvd.
Lenexa, KS 66219

Customer Service: (913) 895-1800

24-Hour Emergency Contact Available

---

*This report is available 24/7 at **waterone.org/2026Report**.*
To request a paper copy, contact Customer Service at (913) 895-1800.
*To see a plain-text version with translation and accessibility options, visit **waterone.org/H2OReports.***

*Este informe está disponible 24/7 en **waterone.org/2026Report**.*
Para solicitar una copia impresa, comuníquese con Atención al Cliente al (913) 895-1800.
*Para ver una versión en texto simple con opciones de traducción y accesibilidad, visite **waterone.org/H2OReports**.*

WaterOne.org