


Equipment Details	
MOV-201	
Station Inlet Limit Valve	
Actuator Details	
Make	EIM
Model	3KPK9
S/N	094664A08 3KPK-9
Rating	4HP, 12A
Operation Philosophy	ESD Valve
ESD Interlock	i-1
Installation Year	2008
Valve Details	
Make	AUDCO
Size	10"
Series	600#
Sealant	AUDCO/733 or 1033

ESD Interlock for MOV ESD Operation		
S. No	NABHA ESD/ALARM INTERLOCK DETAILS	INTERLOCKS
1	ESD FROM MCC THROUGH SCADA	<i>I-1</i>
2	ESD FROM SCC & ESD PB @ PLC PANEL (ESD-204)	<i>I-2</i>
3	ESD FROM FIELD PUSH BUTTONS :	<i>I-3</i>
	ESD -201 (NEAR SRB)	
	ESD -202 (DELIVERY AREA)	
	ESD-203 (NEAR CONTROL ROOM)	<i>I-4</i>
4	NABHA DELIVERY LINE PR. HI-HI : PS-202	
5	NABHA DELIVERY LINE PR. LO-LO : PS-203	
6	LPG STORAGE VESSELS LEVEL HI-HI	<i>I-6</i>
7	STATION INLET PRESSURE LO-LO : PS-201	<i>I-7</i>
8	STATION OUTLET PRESSURE LO-LO : PS-205	<i>I-8</i>
9	STATION OUTLET PRESSURE HI-HI : PS-204	<i>I-9</i>
10	ESD FROM MARKETING (Nabha BP)	<i>I-10</i>
11	ESD FROM PIPELINE ABNORMAL CONDITIONS	<i>I-11</i>

*** For field location of MOV 201, refer process piping diagram on next page**



PANIPAT JALANDHAR LPG PIPELINE, NABHA DELIVERY STATION PROCESS PIPING

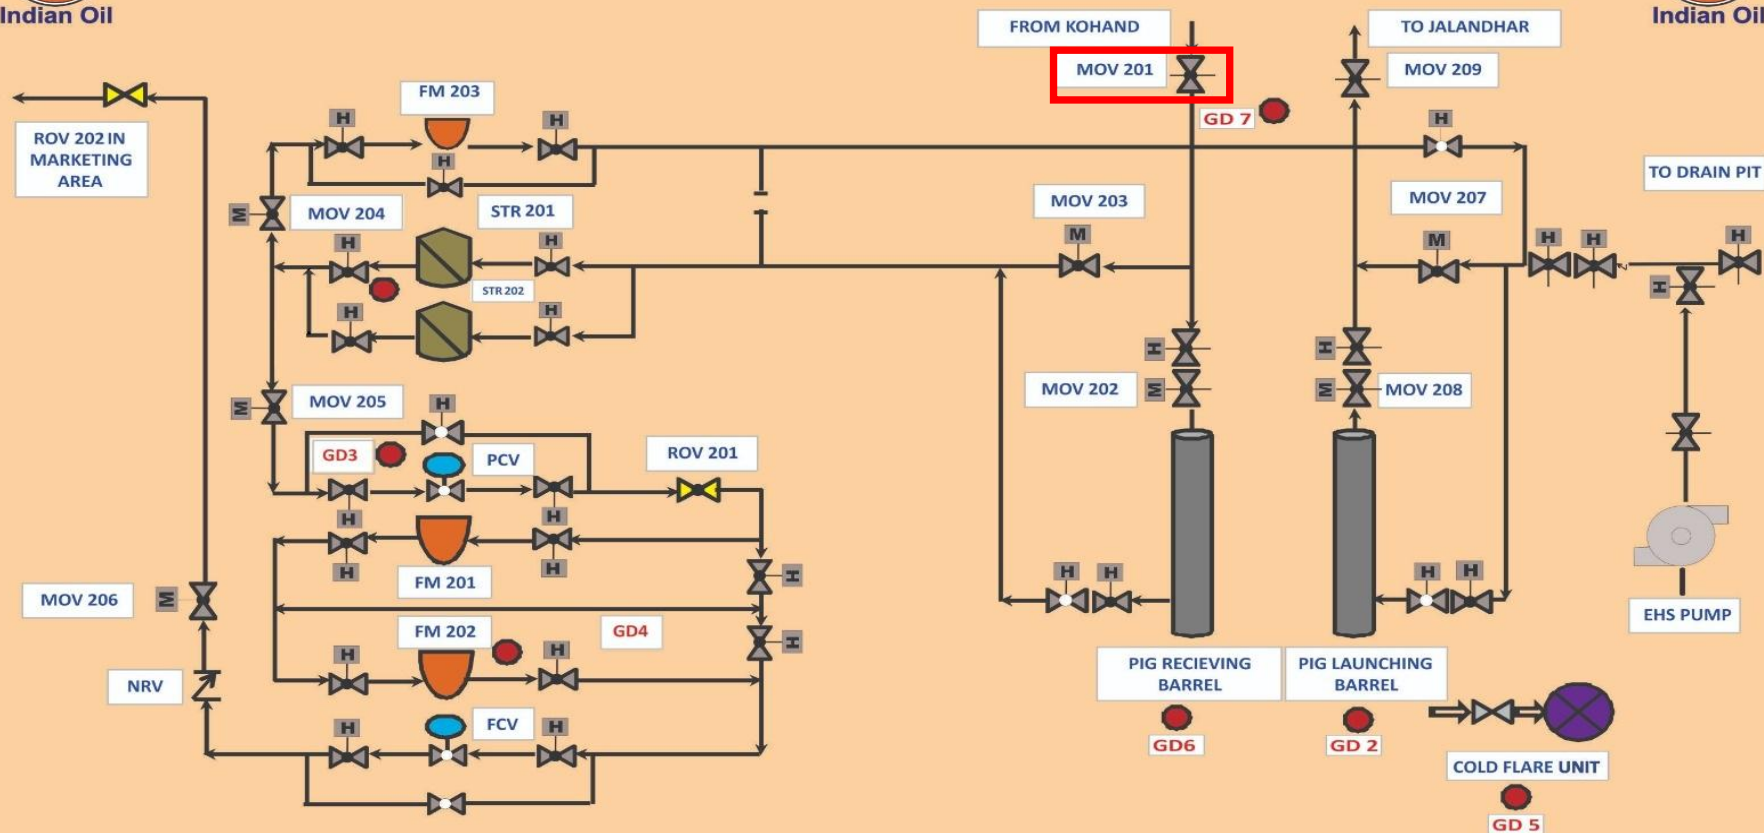

LEGENDS:

