


Equipment Details	
MOV-205	
Nabha BP Delivery Inlet Valve	
Actuator Details	
Make	EIM
Model	DDGA 903E
S/N	095410A09 DDGA 903E
Rating	0.5HP, 2A
Operation Philosophy	ESD Valve
ESD Interlock	i-1,2,3,4,5,6,7,10,11
Installation Year	2008
Valve Details	
Make	VIRGO
Size	8"
Series	600#
Sealant	AUDCO/733 or 1033

ESD Interlock for MOV ESD Operation		
S. No	NABHA ESD/ALARM INTERLOCK DETAILS	INTERLOCKS
1	ESD FROM MCC THROUGH SCADA	I-1
2	ESD FROM SCC & ESD PB @ PLC PANEL (ESD-204)	I-2
3	ESD FROM FIELD PUSH BUTTONS :	
	ESD -201 (NEAR SRB)	I-3
	ESD -202 (DELIVERY AREA)	
	ESD-203 (NEAR CONTROL ROOM)	
4	NABHA DELIVERY LINE PR. HI-HI : PS-202	I-4
5	NABHA DELIVERY LINE PR. LO-LO : PS-203	I-5
6	LPG STORAGE VESSELS LEVEL HI-HI	I-6
7	STATION INLET PRESSURE LO-LO : PS-201	I-7
8	STATION OUTLET PRESSURE LO-LO : PS-205	I-8
9	STATION OUTLET PRESSURE HI-HI : PS-204	I-9
10	ESD FROM MARKETING (Nabha BP)	I-10
11	ESD FROM PIPELINE ABNORMAL CONDITIONS	I-11

* For field location of MOV 205, refer process piping diagram on next page



PANIPAT JALANDHAR LPG PIPELINE, NABHA DELIVERY STATION PROCESS PIPING

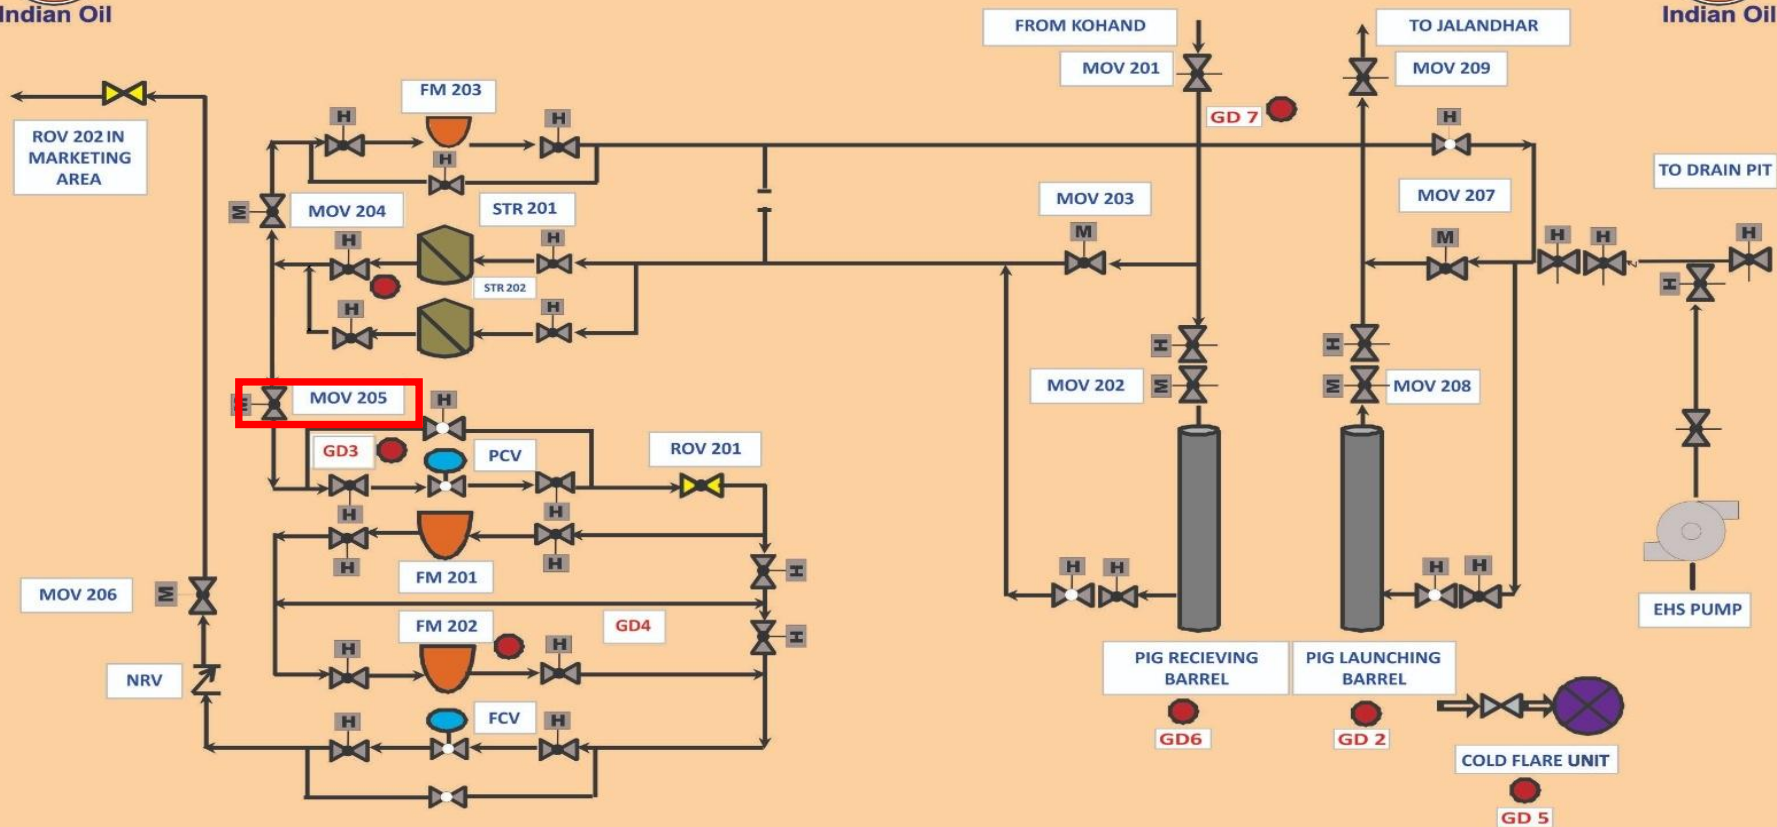

LEGENDS:

-  **GATE VALVE**
-  **BALL VALVE**
-  **GLOBE VALVE**

-  **MOTOR OPERATED VALVE**
-  **HAND OPERATED VALVE**
-  **PNEUMATIC VALVE**

-  **PRESSURE/FLOW CONTROL VALVE**
-  **NON RETURN VALVE**
-  **GAS DETECTOR**

- | | |
|---|------------------------|
|  | MASS FLOW METER |
|  | BASKET STRAINER |
|  | EHS WATER PUMP |