


Equipment Details	
MOV-206	
Nabha BP Delivery Manifold Valve	
Actuator Details	
Make	ROTORK
Model	IQ12
S/N	Z524880108
Rating	0.21HP, 0.9A
Operation Philosophy	ESD Valve
ESD Interlock	i-1,2,3,4,5,6,7,10,11
Installation Year	2008
Valve Details	
Make	OSWAL
Size	8"
Series	300#
Sealant	AUDCO/733 or 1033

ESD Interlock for MOV ESD Operation		
S. No	NABHA ESD/ALARM INTERLOCK DETAILS	INTERLOCKS
1	ESD FROM MCC THROUGH SCADA	I-1
2	ESD FROM SCC & ESD PB @ PLC PANEL (ESD-204)	I-2
3	ESD FROM FIELD PUSH BUTTONS :	
	ESD -201 (NEAR SRB)	I-3
	ESD -202 (DELIVERY AREA)	
	ESD-203 (NEAR CONTROL ROOM)	
4	NABHA DELIVERY LINE PR. HI-HI : PS-202	I-4
5	NABHA DELIVERY LINE PR. LO-LO : PS-203	I-5
6	LPG STORAGE VESSELS LEVEL HI-HI	I-6
7	STATION INLET PRESSURE LO-LO : PS-201	I-7
8	STATION OUTLET PRESSURE LO-LO : PS-205	I-8
9	STATION OUTLET PRESSURE HI-HI : PS-204	I-9
10	ESD FROM MARKETING (Nabha BP)	I-10
11	ESD FROM PIPELINE ABNORMAL CONDITIONS	I-11

* For field location of MOV 206, refer process piping diagram on next page



PANIPAT JALANDHAR LPG PIPELINE, NABHA DELIVERY STATION PROCESS PIPING

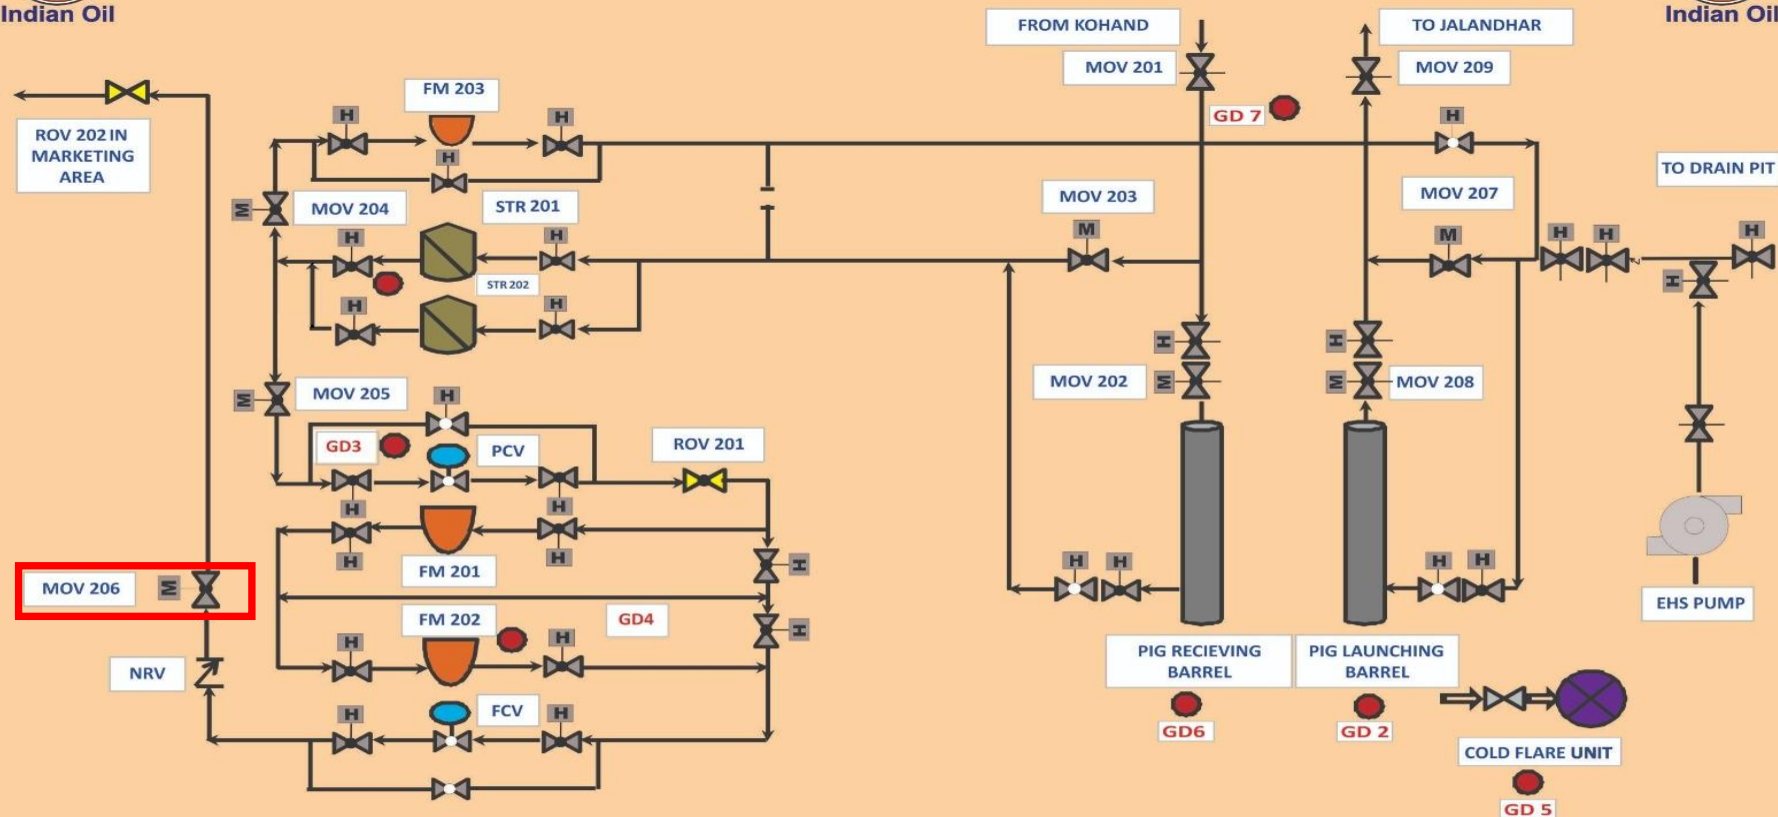

LEGENDS:

Gate Valve
Ball Valve
Globe Valve

MOTOR OPERATED VALVE
HAND OPERATED VALVE
PNEUMATIC VALVE

PRESSURE/FLOW CONTROL VALVE
NON RETURN VALVE
GAS DETECTOR

MASS FLOW METER
BASKET STRAINER
EHS WATER PUMP