


Equipment Details	
MOV-207	
Bypass Line Outlet Valve	
Actuator Details	
Make	EIM
Model	DDGA 903E
S/N	095410A06 DDGA 903E
Rating	0.5HP, 2A
Operation Philosophy	ESD Valve
ESD Interlock	i-1,2,3,7,8,9,11
Installation Year	2008
Valve Details	
Make	VIRGO
Size	8"
Series	600#
Sealant	AUDCO/733 or 1033

ESD Interlock for MOV ESD Operation		
S. No	NABHA ESD/ALARM INTERLOCK DETAILS	INTERLOCKS
1	ESD FROM MCC THROUGH SCADA	I-1
2	ESD FROM SCC & ESD PB @ PLC PANEL (ESD-204)	I-2
3	ESD FROM FIELD PUSH BUTTONS :	
	ESD -201 (NEAR SRB)	I-3
	ESD -202 (DELIVERY AREA)	
	ESD-203 (NEAR CONTROL ROOM)	
4	NABHA DELIVERY LINE PR. HI-HI : PS-202	I-4
5	NABHA DELIVERY LINE PR. LO-LO : PS-203	I-5
6	LPG STORAGE VESSELS LEVEL HI-HI	I-6
7	STATION INLET PRESSURE LO-LO : PS-201	I-7
8	STATION OUTLET PRESSURE LO-LO : PS-205	I-8
9	STATION OUTLET PRESSURE HI-HI : PS-204	I-9
10	ESD FROM MARKETING (Nabha BP)	I-10
11	ESD FROM PIPELINE ABNORMAL CONDITIONS	I-11

* For field location of MOV 207, refer process piping diagram on next page



PANIPAT JALANDHAR LPG PIPELINE, NABHA DELIVERY STATION PROCESS PIPING

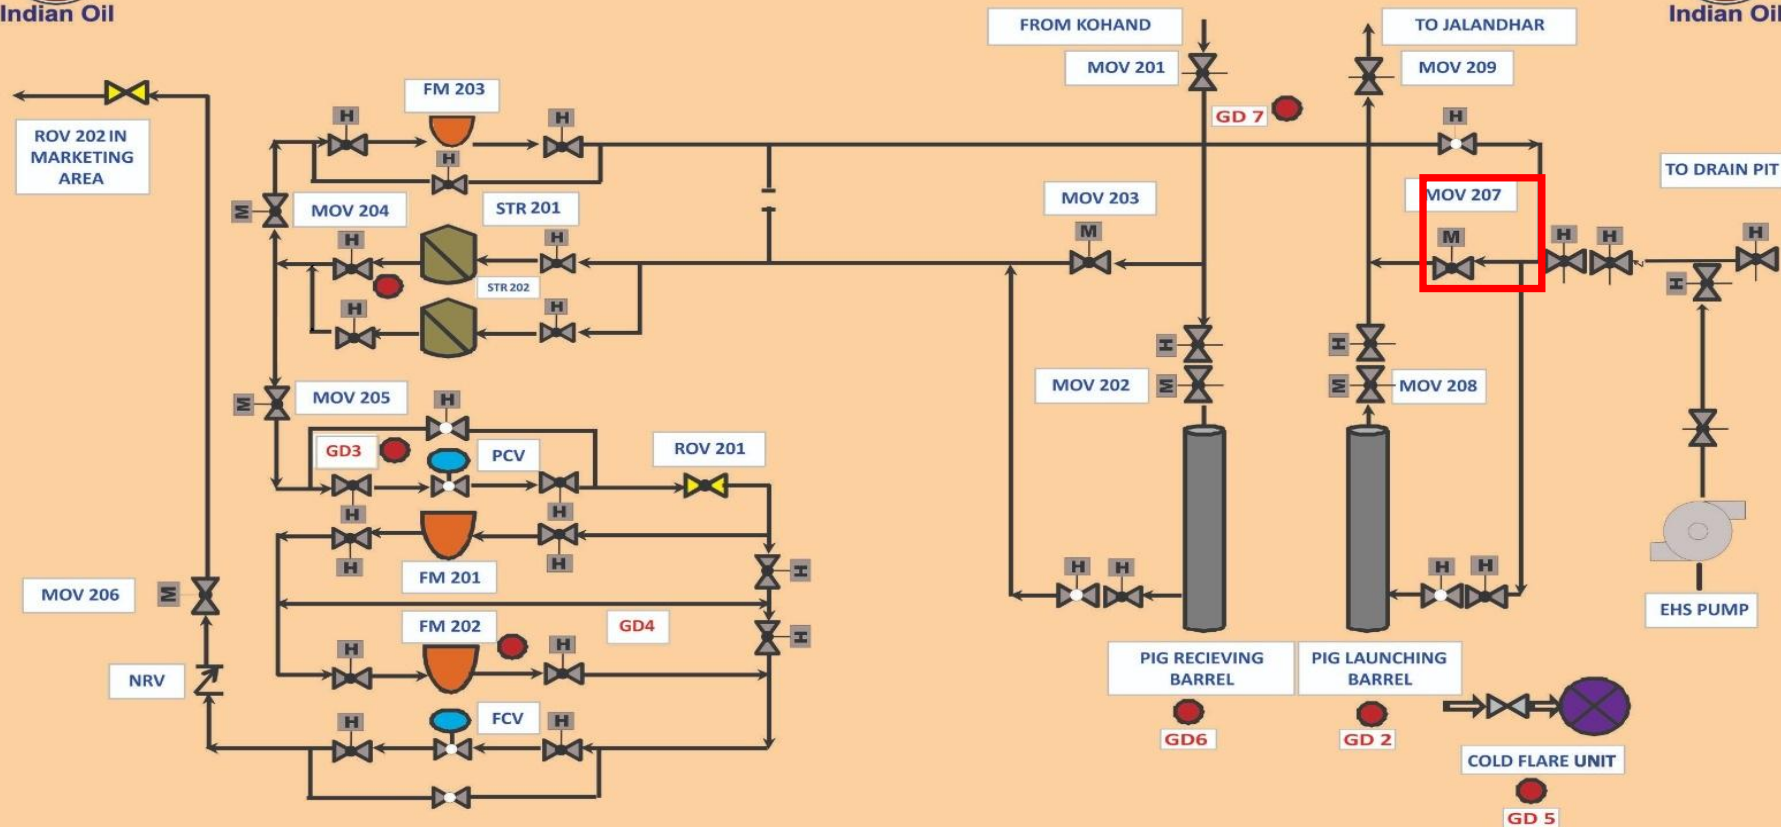

LEGENDS:

- GATE VALVE
- BALL VALVE
- GLOBE VALVE

- MOTOR OPERATED VALVE
- HAND OPERATED VALVE
- PNEUMATIC VALVE

- PRESSURE/FLOW CONTROL VALVE
- NON RETURN VALVE
- GAS DETECTOR

- MASS FLOW METER
- BASKET STRAINER
- EHS WATER PUMP