

Equipment Details	
MOV-208	
SLB Outlet Valve	
Actuator Details	
Make	EIM
Model	3KPK-9
S/N	094664A12 3KPK-9
Rating	4HP, 12A
Operation Philosophy	ESD Valve
ESD Interlock	i-1,2,3,7,8,9,11
Installation Year	2008
Valve Details	
Make	AUDCO
Size	10"
Series	600#
Sealant	AUDCO/733 or 1033

ESD Interlock for MOV ESD Operation		
S. No	NABHA ESD/ALARM INTERLOCK DETAILS	INTERLOCKS
1	ESD FROM MCC THROUGH SCADA	I-1
2	ESD FROM SCC & ESD PB @ PLC PANEL (ESD-204)	I-2
3	ESD FROM FIELD PUSH BUTTONS :	
	ESD -201 (NEAR SRB)	I-3
	ESD -202 (DELIVERY AREA)	
	ESD-203 (NEAR CONTROL ROOM)	
4	NABHA DELIVERY LINE PR. HI-HI : PS-202	I-4
5	NABHA DELIVERY LINE PR. LO-LO : PS-203	I-5
6	LPG STORAGE VESSELS LEVEL HI-HI	I-6
7	STATION INLET PRESSURE LO-LO : PS-201	I-7
8	STATION OUTLET PRESSURE LO-LO : PS-205	I-8
9	STATION OUTLET PRESSURE HI-HI : PS-204	I-9
10	ESD FROM MARKETING (Nabha BP)	I-10
11	ESD FROM PIPELINE ABNORMAL CONDITIONS	I-11

* For field location of MOV 208, refer process piping diagram on next page




Indian Oil

PANIPAT JALANDHAR LPG PIPELINE, NABHA DELIVERY STATION PROCESS PIPING



Indian Oil

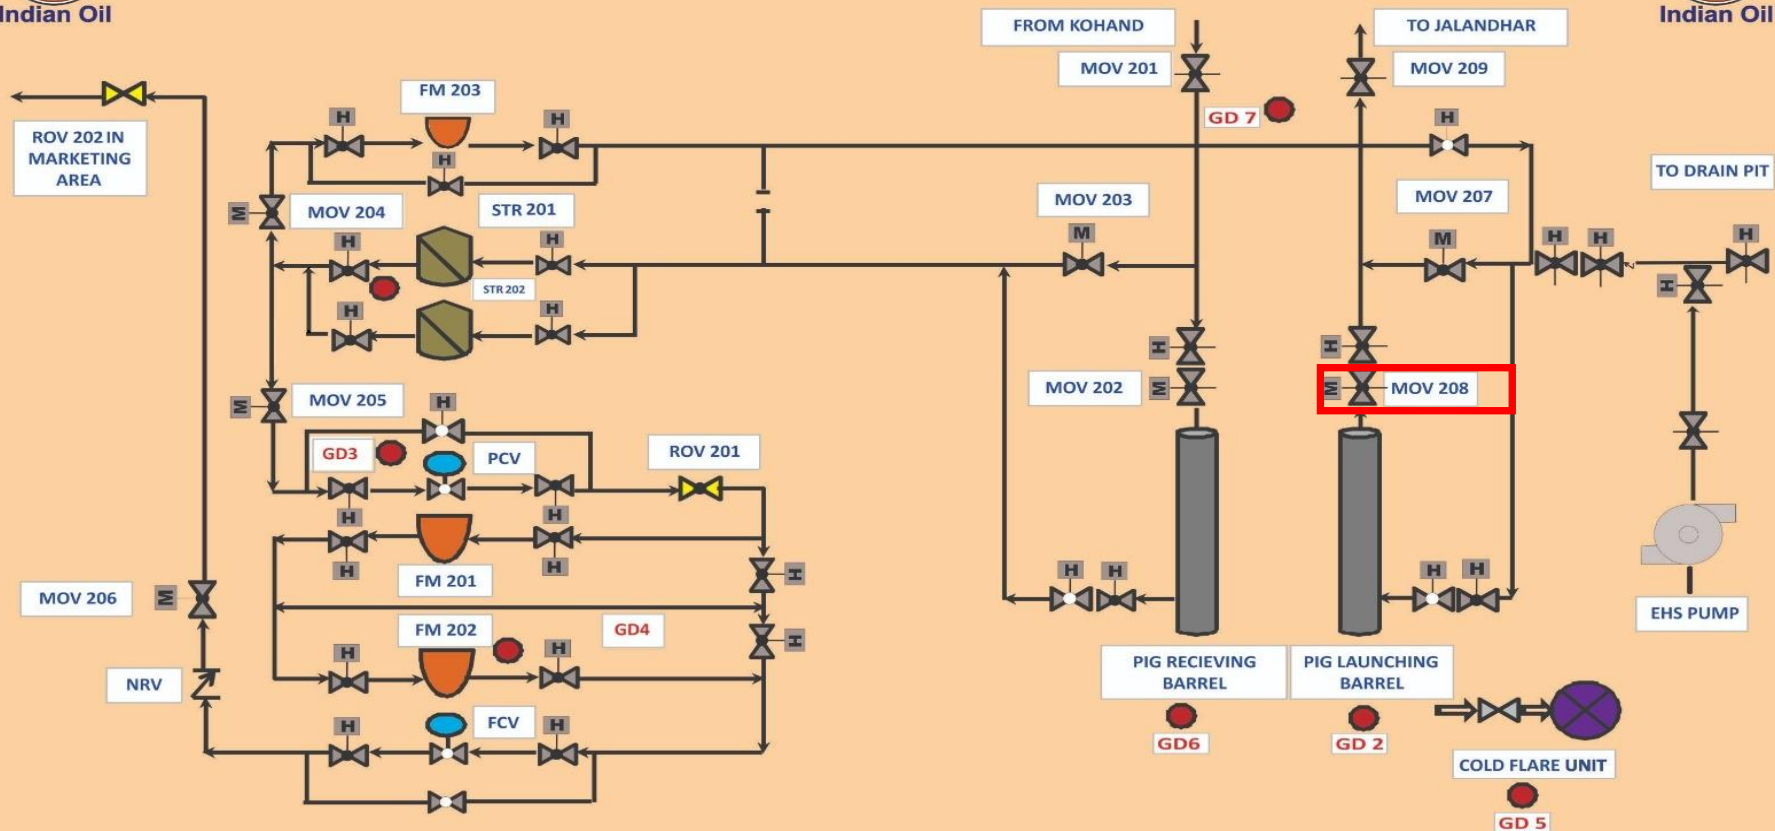

LEGENDS:

Gate Valve

Ball Valve

Globe Valve

MOTOR OPERATED VALVE

HAND OPERATED VALVE

PNEUMATIC VALVE

PRESSURE/FLOW CONTROL VALVE

NON RETURN VALVE

GAS DETECTOR

MASS FLOW METER

BASKET STRAINER

EHS WATER PUMP