


Equipment Details/ उपकरण का विवरण

Strainer 202	
Make	RAK DIN ENGINEERS
Serial No.	2251-A-07
Filter Type	Simplex Filter
Line Size	8"
Degree of Filtration	60 mesh
Hydro Test Pressure	152 Kg/ sq. cm.

➤ Field Location of Strainer 202 (Marked in Red)

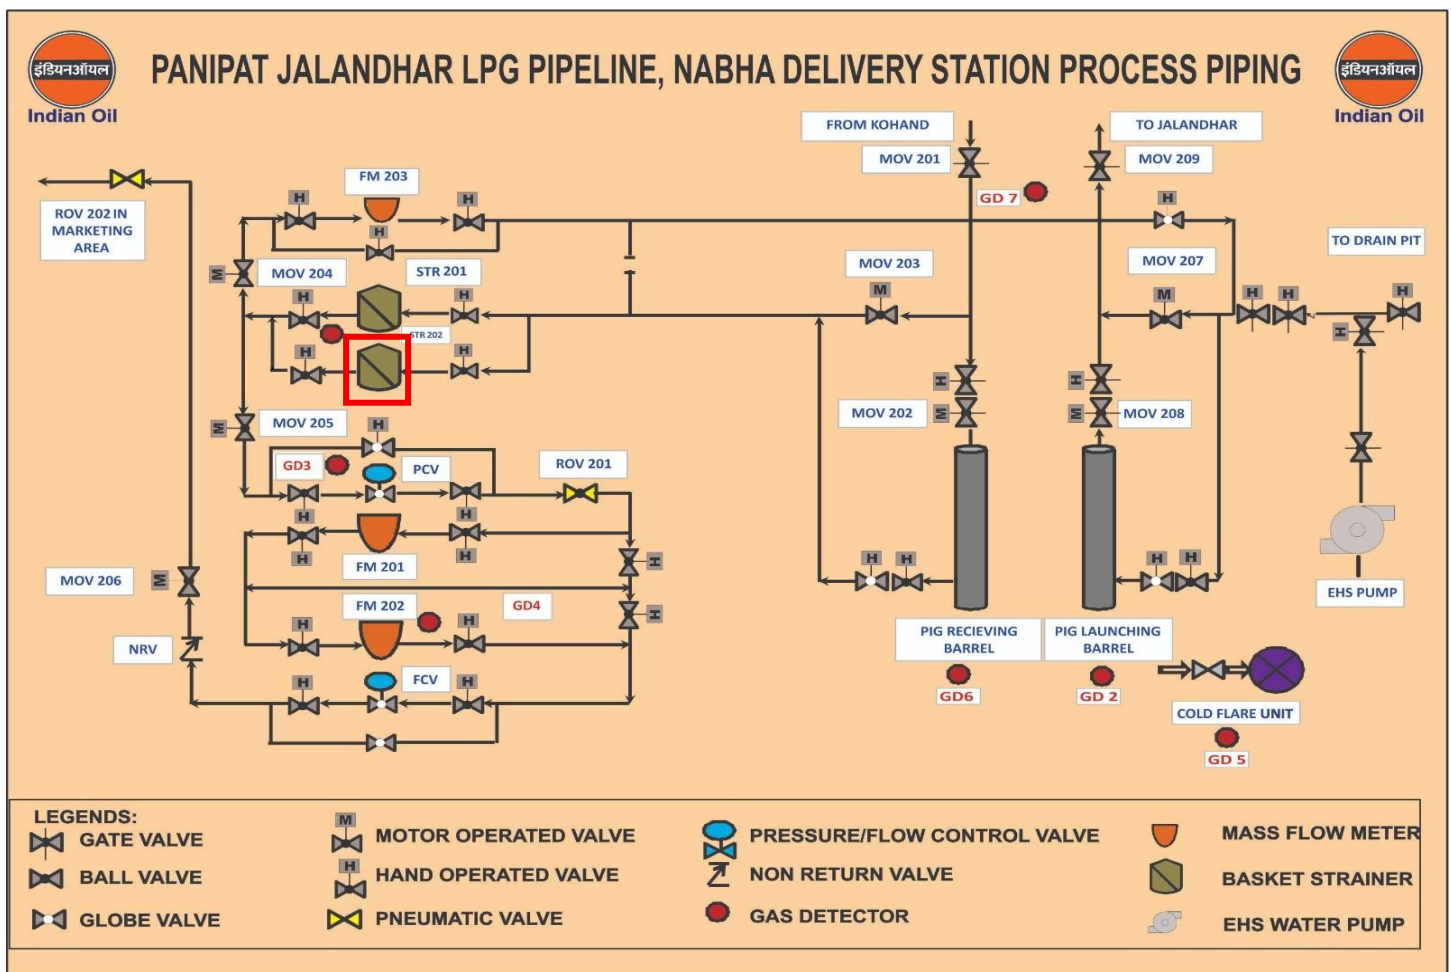

✓ For Standard operating Procedure (SOP) refer next page

**Procedure for taking Strainer in Line and isolating strainer from line/
स्ट्रेनर को लाइन में लेने एवं अलग करने के प्रक्रिया**

Sr. No. क्र० सं०	Activity / Description गतिविधि / विवरण	Responsibility ज़िम्मेदारी
	B. Procedure for taking Strainer-202 in line and isolating Strainer-201 from line B. स्ट्रेनर-202 को लाइन में लेने और स्ट्रेनर-201 को लाइन से अलग करने की प्रक्रिया	
1.	Open HOV-207 (Downstream HOV) and HOV-205 (Upstream HOV) of Strainer-202. स्ट्रेनर-202 के HOV-207 (डाउनस्ट्रीम HOV) और HOV-205 (अपस्ट्रीम HOV) को खोलें।	Shift Personnel Nabha शिफ्ट कार्मिक, नाभा
2.	Close HOV-204 (Upstream HOV) and HOV-206 (Downstream HOV) of Strainer-201. स्ट्रेनर-201 के HOV-204 (अपस्ट्रीम HOV) और HOV-206 (डाउनस्ट्रीम HOV) को बंद करें।	-Do-