



Span model v4 vs calibrated window baselines


V4 synthetic: AI token recall

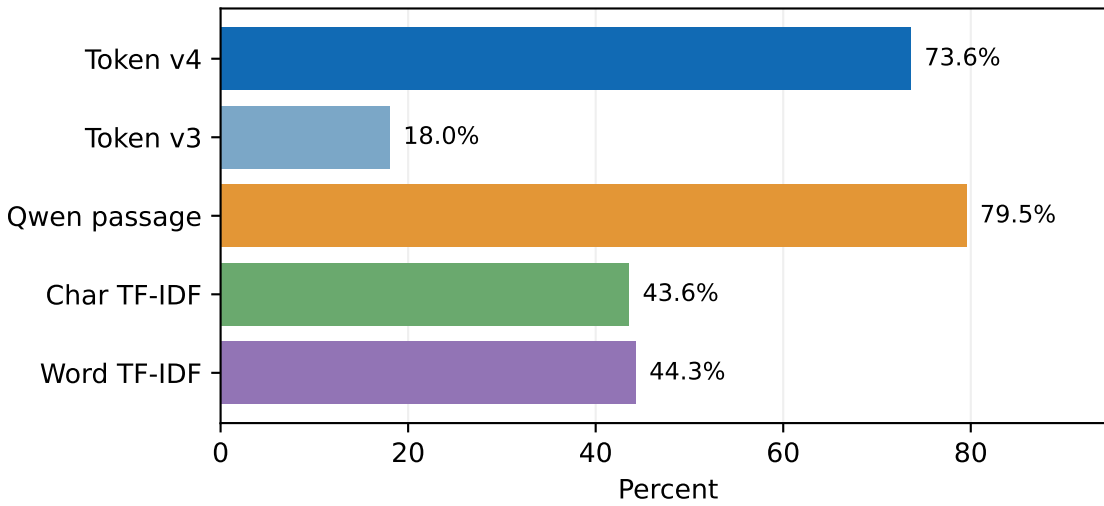


V4 synthetic: human token FPR

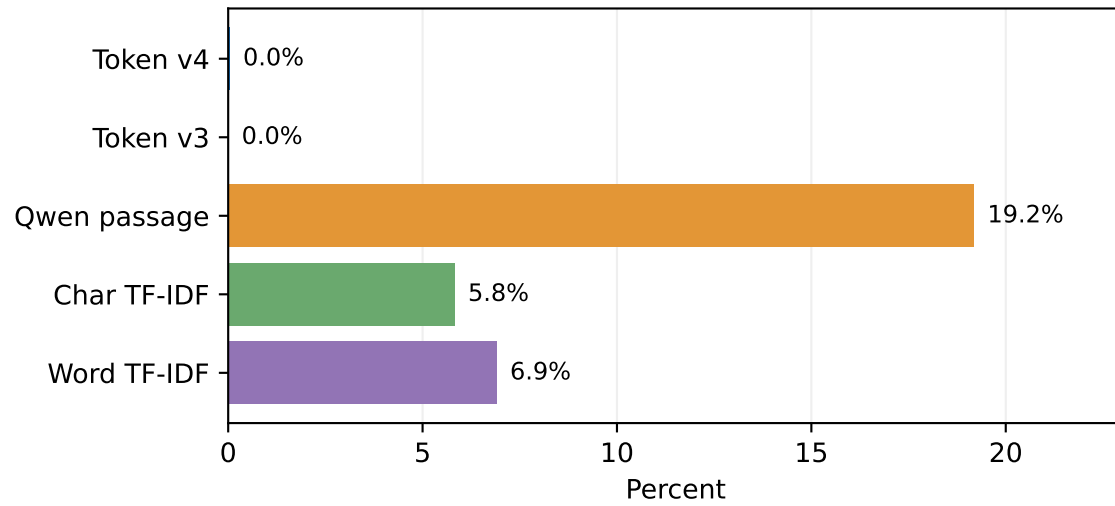


AITDNA mixed: AI token recall

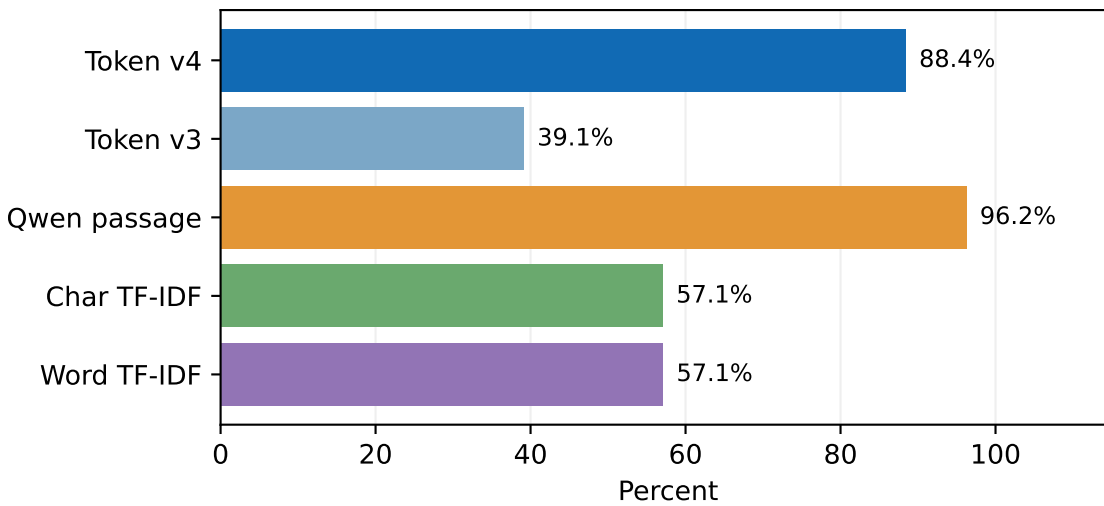


AITDNA mixed: human token FPR

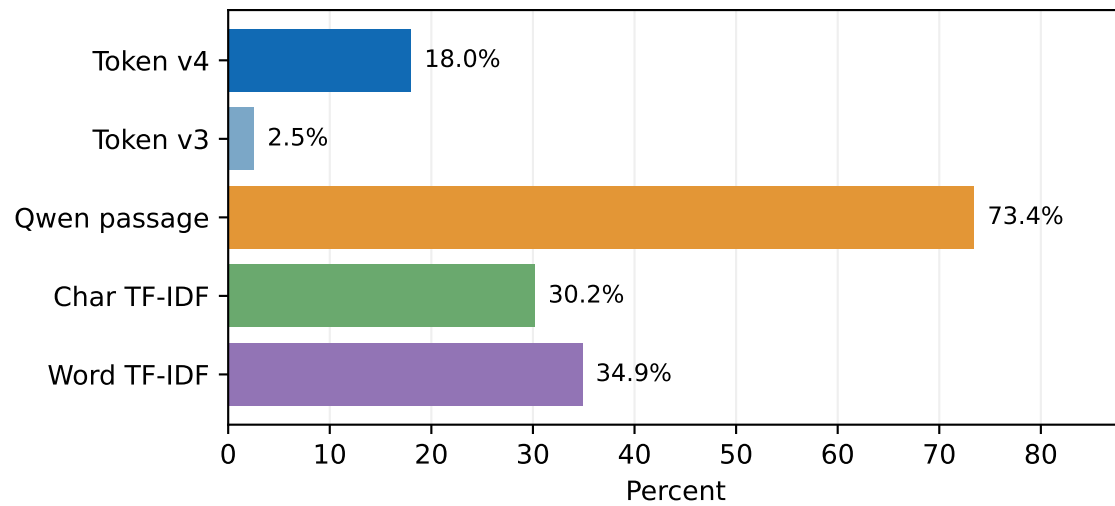

Locked human: docs falsely highlighted

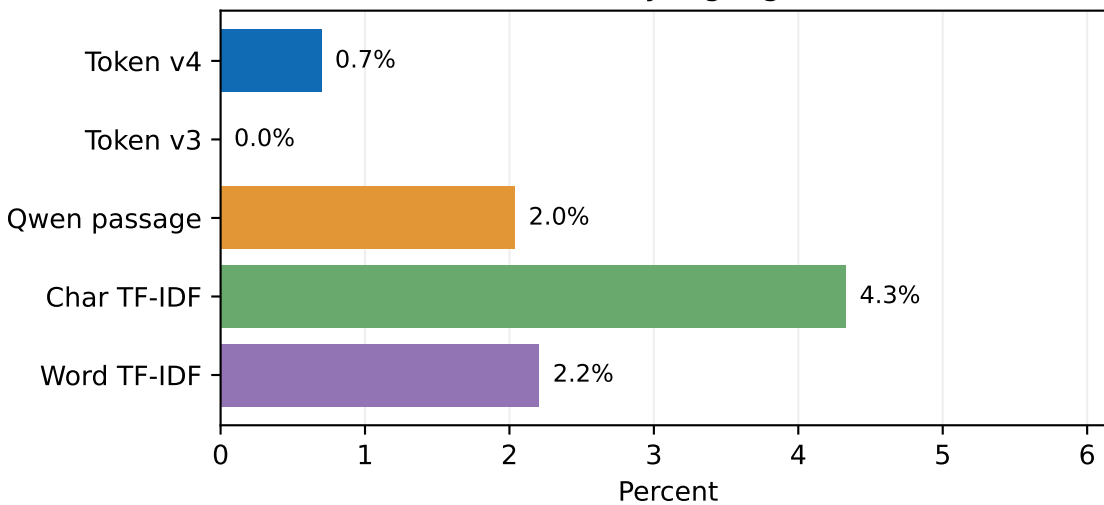

CoAuthor: AI token recall

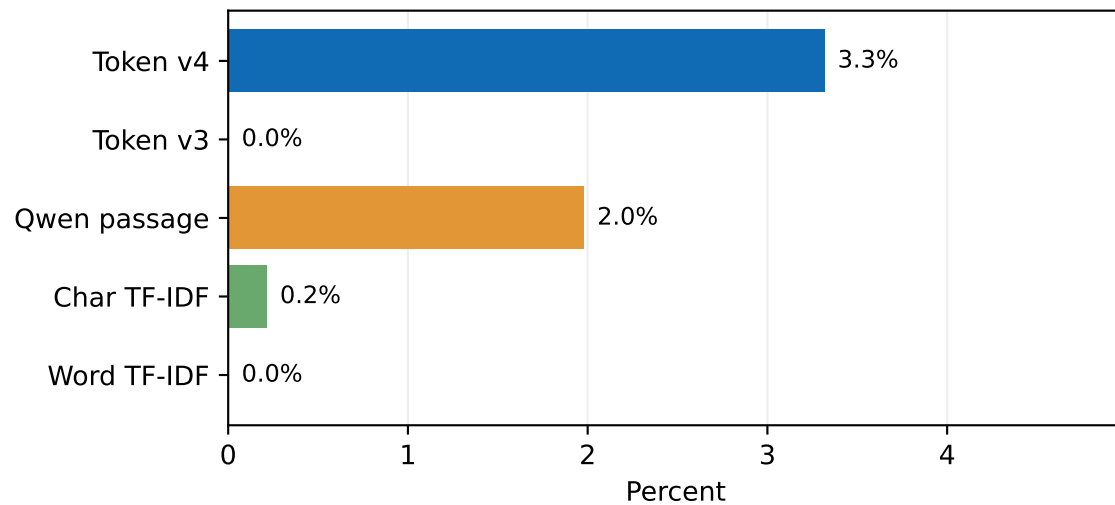

All thresholds set independently at 5% document-any false highlight on the same pure-human calibration set.
AITDNA and CoAuthor are real collaboration sets; CoAuthor includes many very short model insertions.