

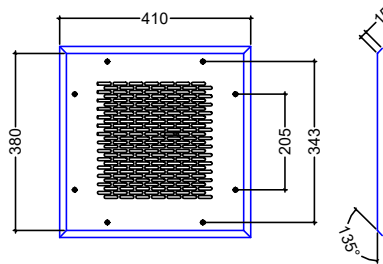


SECTIONAL FRONT VIEW

SECTIONAL SIDE VIEW

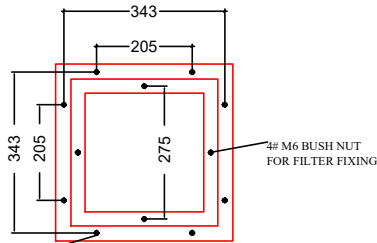


SLOT SIZE

8# M6 BUSH NUT
FOR GRILL FIXING

4# M6 BUSH NUT
FOR FILTER FIXING

FILTER SIZE X x Y x Z	MEDIA DEPTH mm	AIR FLOW CFM	FLANGE SIZE O x P	BOX SIZE A x B x C	S.S GRILL D x E	EXTRUDED AL. DUCT DAMPER	CEILING CUT OUT
Length x Width x Depth mm			Length x Width x Depth mm	Length x Width x Depth mm	Length x Width mm	Length x Width x Depth mm	
305X305X150	115	125	380X380	255X255X375	410X410	210x150x110	370X370

HOUSING SPECIFICATIONS		FILTER SPECIFICATIONS	
TYPE	BOTTOM LOADING	SIZE	X x Y x Z
SIZE	A x B x C	FILTER MEDIA	MICRO GLASS FIBRE
M.O.C.	CRCA SHEET	FILTER GRADE	H-13 (99.97% at 0.3 mic)
AIR ENTRY	SIDE ENTRY	M.O.C.	ALUMINIUM
FILTER ENTRY	BOTTOM ENTRY	FILTER ENTRY	FROM CLEAN ROOM
PERFORATED GRILL	SS-304 18G/ Al Powder coat	IPD	25 MM OF WG
		FPD	60 MM OF WG

CLIENT: APFY PHARMA	
DRAWING TITLE: GI POWDER COATED HOUSING SIDE CONNECTION FOR FLANGE TYPE HEPA FILTER 305X305X150 MM	
 TRUE AIR PLOT NO. F-120, INDUSTRIAL AREA, PHASE VII, S.A.S. NAGAR (MOHALLI) Email : trueair1994@gmail.com	
DRAWING NO.	TA-STANDARD-02-FIT HEPA HOUSING
SCALE: NTS	DATE: 01.09.2020
DRN: RT	CHKD: SK
APPD: VS	
<small>THE INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND NOT FOR PUBLICATION. BEING THE PROPERTY OF TRUE AIR, THE INFORMATION IS ISSUED ON THE UNDERSTANDING THAT NO PART THEREOF SHALL BE COPIED OR COMMUNICATED TO A THIRD PARTY WITHOUT WRITTEN AUTHORIZATION FROM TRUE AIR, MOHALLI.</small>	