



AMIN CONTRACTORS

---

# **FIRE RISK ASSESSMENT**

**(REGULATORY REFORM ORDER  
2005) ENGLAND AND WALES**

12, January, 2025

**PRIORITISING SAFETY,  
ENSURING COMPLIANCE**

---



**Prepared By**  
Amin Contractors Ltd

+44 7572 549771  
info@amincontractors.co.uk  
www.amincontractors.co.uk  
Ashfield Street London, E1 2HA

# Fire Risk Assessment

Date:

---

**Address of premises:**

147 Wembley Hill Road, Wembley,  
HA9 8DU

**Assessment Date:**

27/11/24

**Next Assessment Date:**

27/11/24

**Assessor:**

Mohammed Shahinul Amin

**Responsible person (e.g. employer) or person having control of premises:**

Landlord

**Dear Client,**

Thank you for inviting us to do a Fire Risk Assessment on your premises. We've kept your concerns in mind during our inspection and testing. Let's discuss the recommendations found in this report and see what works best for you.

**Thanks,****Assessor Statement**

The purpose of this PAS 79-2:2020 (Annex A) Housing risk report is to provide a non-invasive assessment of the risk to life from fire in these premises, and, where appropriate, to make recommendations to ensure compliance with fire safety legislation. This report does not address the risk to property or business continuity from fire. I certify that to the best of my knowledge, the information contained in this fire risk assessment is correct, based on information provided at the time the assessment was undertaken.

**Fire Risk Assessment Review:**

This fire risk assessment should be reviewed by a competent person by the date indicated above or at such earlier time as there is reason to suspect that it is no longer valid, or there has been significant change in the matters to which it relates, or if a fire occurs.

**Report compliance:**

This report is intended to assist you in compliance with Article 9 of the Regulatory Reform (Fire Safety) Order 2005 which requires that a fire risk assessment be carried out.

# Test Wembly Property



**Property: Test Wembly Property**

Assessment ID: 1

Date: 29 January 2025

## Fire Risk Assessment: Form 1

### Primary Information

| Index ID | Detail                                                                   | Value                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                   |
|----------|--------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| 0.01     | Responsible person (e.g. employer) or person having control of premises? | Landlord                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| 0.02     | Address of premises?                                                     | 147 Wembley Hill Road, Wembley, HA9 8DU                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                 |
| 0.03     | Person(s) consulted?                                                     | Landlord                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| 0.04     | Assessor?                                                                | Mohammed Shahinul Amin                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                  |
| 0.05     | Assessors statement?                                                     | The purpose of this PAS 79-2:2020 (Annex A) Housing risk report is to provide a non-invasive assessment of the risk to life from fire in these premises, and, where appropriate, to make recommendations to ensure compliance with fire safety legislation. This report does not address the risk to property or business continuity from fire. I certify that to the best of my knowledge, the information contained in this fire risk assessment is correct, based on information provided at the time the assessment was undertaken. |
| 0.06     | Report validated by?                                                     | -                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| 0.07     | Date of fire risk assessment?                                            | 27/11/24                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| 0.08     | Date of previous fire risk assessment?                                   | 27/11/24                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| 0.09     | Suggested date for review?                                               | 27/11/24                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                |
| 0.10     | Fire Risk Assessment Review?                                             | This fire risk assessment should be reviewed by a competent person by the date indicated above or at such earlier time as there is reason to suspect that it is no longer valid, or there has been significant change in the matters to which it relates, or if a fire occurs.                                                                                                                                                                                                                                                          |
| 0.11     | Report compliance?                                                       | -                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| 1.01     | Number of floors at ground level and above                               | -                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| 1.02     | Number of floors entirely below ground level                             | -                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |

| Index ID | Detail                                                               | Value |
|----------|----------------------------------------------------------------------|-------|
| 1.03     | Floors on which car parking is provided                              | -     |
| 1.04     | Number of flats                                                      | -     |
| 1.05     | Approximate gross floor area                                         | -     |
| 1.06     | Brief details of construction and approximate age of building        | -     |
| 1.07     | Occupancy                                                            | -     |
| 2.01     | Approximate maximum number of employees at any one time              | -     |
| 2.02     | Approximate maximum number of residents and visitors at any one time | -     |
| 3.01     | Sleeping occupants                                                   | -     |
| 3.02     | Occupants in remote areas and lone workers                           | -     |
| 3.03     | Others                                                               | -     |
| 3.04     | Disabled occupants (if known)                                        | -     |
| 4.01     | Fires in the past                                                    | -     |
| 4.02     | Cost of past fire losses                                             | -     |
| 5.01     | Detail here if required                                              | -     |
| 6.01     | The following fire safety legislation applies to these premises      | -     |

| Index ID | Detail                                                                                       | Value |
|----------|----------------------------------------------------------------------------------------------|-------|
| 6.02     | The above legislation is enforced by                                                         | -     |
| 6.03     | Other legislation that makes significant requirements for fire precautions in these premises | -     |
| 6.04     | The other legislation referred to above is enforced by                                       | -     |
| 6.05     | Is there an alterations notice in force?                                                     | -     |
| 6.06     | Relevant information and deficiencies observed                                               | -     |
| 6.07     | Other information if required                                                                | -     |
| 6.08     | Risk Likelihood?                                                                             | 2     |
| 6.09     | Risk Severity?                                                                               | 3     |
| 6.10     | Risk Rating Score?                                                                           | 2     |

### **Fire Hazards and Their Elimination or Control**

| Index ID | Detail                                                                 | Values | Control Measures |
|----------|------------------------------------------------------------------------|--------|------------------|
| 7.01     | Are reasonable measures taken to prevent fires of electrical origin?   | Yes    | -                |
| 7.02a    | Are fixed installations periodically inspected and tested?             | Yes    | -                |
| 7.02b    | Is portable appliance testing carried out?                             | Yes    | -                |
| 8.01     | Are reasonable measures taken to prevent fires as a result of smoking? | Yes    | -                |
| 8.02a    | Is smoking prohibited in appropriate areas?                            | Yes    | -                |
| 8.02b    | Are there suitable arrangements for those who wish to smoke?           | Yes    | -                |

| Index ID | Detail                                                                                                                                    | Values | Control Measures |
|----------|-------------------------------------------------------------------------------------------------------------------------------------------|--------|------------------|
| 8.02c    | Did the smoking policy appear to be observed at the time of inspection?                                                                   | Yes    | -                |
| 8.02d    | Are "No smoking" signs provided in the common areas?                                                                                      | Yes    | -                |
| 9.01     | Does basic security against arson by outsiders appear reasonable?                                                                         | Yes    | -                |
| 9.02     | Is there an absence of unnecessary fire load in close proximity to the premises or available for ignition by outsiders?                   | Yes    | -                |
| 10.01    | Is there satisfactory control over the use of portable heaters?                                                                           | Yes    | -                |
| 10.02    | Are fixed heating and ventilation installations subject to regular maintenance?                                                           | Yes    | -                |
| 11.01    | Are reasonable measures taken to prevent fires as a result of cooking?                                                                    | Yes    | -                |
| 12.01    | Does the building have a lightning protection system?                                                                                     | Yes    | -                |
| 13.01    | Is the overall standard of housekeeping adequate?                                                                                         | Yes    | -                |
| 13.02a   | Do combustible materials appear to be separated from ignition sources?                                                                    | Yes    | -                |
| 13.02b   | Is unnecessary accumulation or inappropriate storage of combustible materials or waste?                                                   | Yes    | -                |
| 13.02c   | Are gas and electricity intake/meter cupboards adequately secured and kept clear of combustible materials?                                | Yes    | -                |
| 14.01    | Is there satisfactory control over works carried out in the building?                                                                     | Yes    | -                |
| 15.01    | Are the general fire precautions adequate to address the hazards associated with dangerous substances used or stored within the premises? | Yes    | -                |
| 16.01    | Hazards                                                                                                                                   | Yes    | -                |
| 17.01    | Is the design and maintenance of the means of escape considered adequate?                                                                 | Yes    | -                |
| 17.02a   | Are there reasonable distances of travel:                                                                                                 | Yes    | -                |
| 17.02a1  | Where there is escape in a single direction?                                                                                              | Yes    | -                |
| 17.02a2  | Where there are alternative means of escape?                                                                                              | Yes    | -                |
| 17.02b   | Is there adequate provision of exits?                                                                                                     | Yes    | -                |
| 17.02c   | Do fire exits open in the direction of escape, where necessary?                                                                           | Yes    | -                |
| 17.02d   | Are the arrangements provided for securing exits satisfactory?                                                                            | Yes    | -                |
| 17.02e   | Is the fire-resisting construction protecting escape routes and staircases of a suitable standard and maintained in sound condition?      | Yes    | -                |



| Index ID | Detail                                                                                                                                                                                                       | Values | Control Measures |
|----------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------|------------------|
| 17.02f   | Is the fire resistance of doors to staircases and the common areas considered adequate, and are the doors maintained in sound condition?                                                                     | Yes    | -                |
| 17.02g   | Are suitable self closing devices fitted to fire doors in the common areas?                                                                                                                                  | Yes    | -                |
| 17.02h   | Is the fire resistance of doors to meter cupboards/store rooms/plant rooms in common areas considered adequate, and are they adequately secured and/or fitted with suitable self-closing devices?            | Yes    | -                |
| 17.02i   | Is the fire resistance of flat entrance doors considered adequate, and are the doors maintained in sound condition?                                                                                          | Yes    | -                |
| 17.02j   | Are suitable self closing devices fitted to flat entrance fire doors and, where fitted, maintained in good working order?                                                                                    | Yes    | -                |
| 17.02k   | Are there adequate smoke control provisions to protect the common escape routes, where necessary?                                                                                                            | Yes    | -                |
| 17.02l   | Are all escape routes clear of obstructions?                                                                                                                                                                 | Yes    | -                |
| 17.02m   | Are all fire exits easily and immediately openable?                                                                                                                                                          | Yes    | -                |
| 17.02n   | Are there reasonable arrangements for means of escape for disabled people?                                                                                                                                   | Yes    | -                |
| 18.01a   | Adequate levels of compartmentation between floors and between flats and the common escape routes?                                                                                                           | Yes    | -                |
| 18.01b   | Reasonable limitation of linings that may promote fire spread?                                                                                                                                               | Yes    | -                |
| 18.01c   | As far as can be reasonably be ascertained, reasonable fire separation within any roof space?                                                                                                                | Yes    | -                |
| 18.01d   | Adequately fire protected service risers and/or ducts in common areas, that will restrict the spread of fire and smoke?                                                                                      | Yes    | -                |
| 18.02    | As far as can be reasonably be ascertained, are fire dampers provided necessary to protect critical means of escape against passage of fire, smoke and products of combustion in the early stages of a fire? | Yes    | -                |
| 19.01    | Has a reasonable standard of emergency escape lighting system been provided?                                                                                                                                 | Yes    | -                |
| 20.01    | Is there a reasonable standard of fire safety signs and notices?                                                                                                                                             | Yes    | -                |
| 21.01    | Is a reasonable fire detection and fire alarm system provided in common areas, where necessary?                                                                                                              | Yes    | -                |
| 21.02    | If there is a communal fire detection and fire alarm system, does it extend into the dwellings?                                                                                                              | Yes    | -                |



| Index ID | Detail                                                                                                                                                             | Values | Control Measures                                                                                                                                       |
|----------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
| 21.03    | Where appropriate, has a fire alarm zone plan been provided?                                                                                                       | Yes    | -                                                                                                                                                      |
| 21.04    | Where appropriate, are there adequate arrangements for silencing and resetting an alarm condition?                                                                 | Yes    | -                                                                                                                                                      |
| 22.01    | Is there reasonable provision of manual fire extinguishing appliances?                                                                                             | No     | Are extinguishers required in common areas? Replace the non standard fire extinguishers with BS/LPC approved extinguishers in the following locations. |
| 22.02    | Are all fire extinguishing appliances readily accessible?                                                                                                          | No     | Remove obstructions in the following places:                                                                                                           |
| 23.01a   | Sprinkler system?                                                                                                                                                  | Yes    | -                                                                                                                                                      |
| 23.01b   | Misting system?                                                                                                                                                    | Yes    | -                                                                                                                                                      |
| 24.01    | Type of other fixed system(s) installed                                                                                                                            | Yes    | -                                                                                                                                                      |
| 24.02    | Are there appropriately sited facilities for electrical isolation of any photovoltaic (PV) cells, with appropriate signage, to assist the fire and rescue service? | Yes    | -                                                                                                                                                      |
| 25.01    | Safety assistance                                                                                                                                                  | Yes    | -                                                                                                                                                      |
| 25.02    | Fire safety at the premises is managed by                                                                                                                          | Yes    | -                                                                                                                                                      |
| 25.03    | Is there a suitable record of the fire safety arrangements?                                                                                                        | Yes    | -                                                                                                                                                      |
| 25.04    | Evacuation strategy                                                                                                                                                | Yes    | -                                                                                                                                                      |
| 25.05    | Are procedures in the event of a fire appropriate and properly documented, where appropriate?                                                                      | Yes    | -                                                                                                                                                      |
| 25.06    | Are routine in-house inspections of fire precautions undertaken?                                                                                                   | Yes    | -                                                                                                                                                      |
| 26.01    | Are all staff given adequate fire safety instruction and training on induction?                                                                                    | Yes    | -                                                                                                                                                      |
| 26.02    | When the employees of another employer work in the premises, is appropriate information on the fire risks and fire safety measures provided?                       | Yes    | -                                                                                                                                                      |
| 27.01    | Is there adequate maintenance of the premises?                                                                                                                     | Yes    | -                                                                                                                                                      |
| 27.02    | Is weekly testing and periodic servicing of fire detection and alarm system undertaken?                                                                            | No     | Ensure that weekly fire alarm test and periodic servicing are carried out and recorded by competent persons.                                           |
| 27.03    | Is monthly and annual testing routines for emergency lighting?                                                                                                     | No     | Ensure that monthly, six monthly and annual emergency lighting carried out and recorded by competent persons                                           |
| 27.04    | Is annual maintenance of fire extinguishing appliances undertaken?                                                                                                 | No     | Ensure that monthly checks, and annual maintenance of portable fire fighting appliances are carried out and recorded by competent persons              |

| Index ID | Detail                                                                                                       | Values | Control Measures |
|----------|--------------------------------------------------------------------------------------------------------------|--------|------------------|
| 27.05    | Are six-monthly inspection and annual testing of rising mains undertaken?                                    | Yes    | -                |
| 27.06    | Are weekly and monthly testing, six monthly inspection and annual testing of fire-fighting lift(s) provided? | Yes    | -                |
| 27.07    | Other relevant inspections or tests                                                                          | Yes    | -                |
| 28.01a   | Fire alarm tests (where relevant)?                                                                           | Yes    | -                |
| 28.01b   | Emergency escape lighting tests?                                                                             | Yes    | -                |
| 28.01c   | Maintenance and testing of other fire protection equipment?                                                  | Yes    | -                |
| 29.09    | Is the fire emergency plan available to the enforcing authority?                                             | Yes    | -                |
| 29.10    | Are Personal Emergency Evacuation Plans (PEEPS) required and in place?                                       | Yes    | -                |
| 29.01    | Is there a suitably located premises information box for the fire and rescue service?                        | Yes    | -                |
| 29.02    | Are there arrangements to keep the premises information box up to date?                                      | Yes    | -                |
| 30.01    | Has information on fire procedures been disseminated to residents?                                           | Yes    | -                |
| 30.02    | Is fire safety information disseminated to residents?                                                        | Yes    | -                |

### **Action Plan**

| Index ID | Detail                                                                                  | Value | Control Measures                                                                                                                                       |
|----------|-----------------------------------------------------------------------------------------|-------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
| 22.01    | Is there reasonable provision of manual fire extinguishing appliances?                  | No    | Are extinguishers required in common areas? Replace the non standard fire extinguishers with BS/LPC approved extinguishers in the following locations. |
| 22.02    | Are all fire extinguishing appliances readily accessible?                               | No    | Remove obstructions in the following places:                                                                                                           |
| 27.02    | Is weekly testing and periodic servicing of fire detection and alarm system undertaken? | No    | Ensure that weekly fire alarm test and periodic servicing are carried out and recorded by competent persons.                                           |
| 27.03    | Is monthly and annual testing routines for emergency lighting?                          | No    | Ensure that monthly, six monthly and annual emergency lighting carried out and recorded by competent persons                                           |
| 27.04    | Is annual maintenance of fire extinguishing appliances undertaken?                      | No    | Ensure that monthly checks, and annual maintenance of portable fire fighting appliances are carried out and recorded by competent persons              |

# FIRE RISK ASSESSMENT RISK REGISTER

## Risk Value Matrix

| Likelihood | Value | Severity of Outcome(s)                                    |
|------------|-------|-----------------------------------------------------------|
| Negligible | 1     | Negligible                                                |
| Low        | 2     | Minor injury to occupants, first aid required             |
| Moderate   | 3     | Moderate Injury to occupants, medical attention required. |
| High       | 4     | Occupants required hospitalisation.                       |
| Extreme    | 5     | Major loss of life.                                       |

| Likelihood |   |    |    |    |    |
|------------|---|----|----|----|----|
| Severity   | 1 | 2  | 3  | 4  | 5  |
|            | 2 | 4  | 6  | 8  | 10 |
|            | 3 | 6  | 9  | 12 | 15 |
|            | 4 | 8  | 12 | 16 | 20 |
|            | 5 | 10 | 15 | 20 | 25 |

Likelihood

2

Severity

3

Risk Rating Score:



2

| Risk Rating | Action PAS 79-1:2020                                                                                                                                                                                                                                                                                                                                                                      |
|-------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Trivial     | Record findings and review in 12 months                                                                                                                                                                                                                                                                                                                                                   |
| Tolerable   | No major additional controls required. However, There might be a need for improvements that involve minor or limited costs.                                                                                                                                                                                                                                                               |
| Moderate    | It is essential that efforts are made to reduce the risk. Risk reduction measures should be implemented within a defined time period.<br>Where moderate risk is associated with consequences that constitute extreme harm, further assessment might be required to establish more precisely the likelihood of harm as a basis for determining the priority for improved control measures. |
| Substantial | Considerable resources might have to be allocated to reduce the risk. If the building is unoccupied, it should not be occupied until the risk has been reduced. If the building is occupied, urgent action should be taken.                                                                                                                                                               |
| Intolerable | Building (or relevant area) should not be occupied until the risk is reduced.                                                                                                                                                                                                                                                                                                             |

## Fire Risk Assessment Review

*Assessments should be kept under constant review, and in any case reviewed whenever circumstance change which affect the validity of the current assessment. Whilst there is no maximum period between assessments, it is recommended that the review period should not exceed 12 months.*

## Reference Images

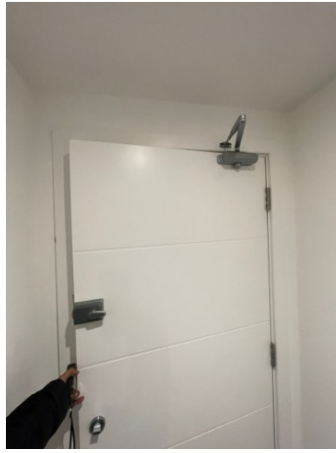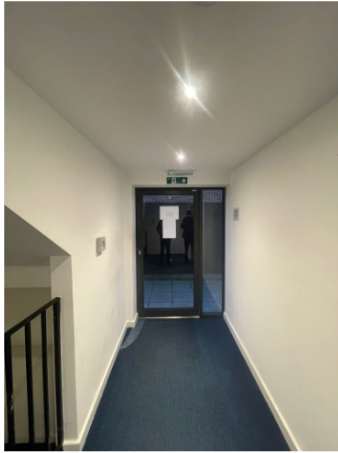




AMIN CONTRACTORS

# EMERGENCY LIGHTING

Four storey building converted to flats.

- Non maintained Emergency Lighting
- Maintained emergency Lighting (Exit Doors)

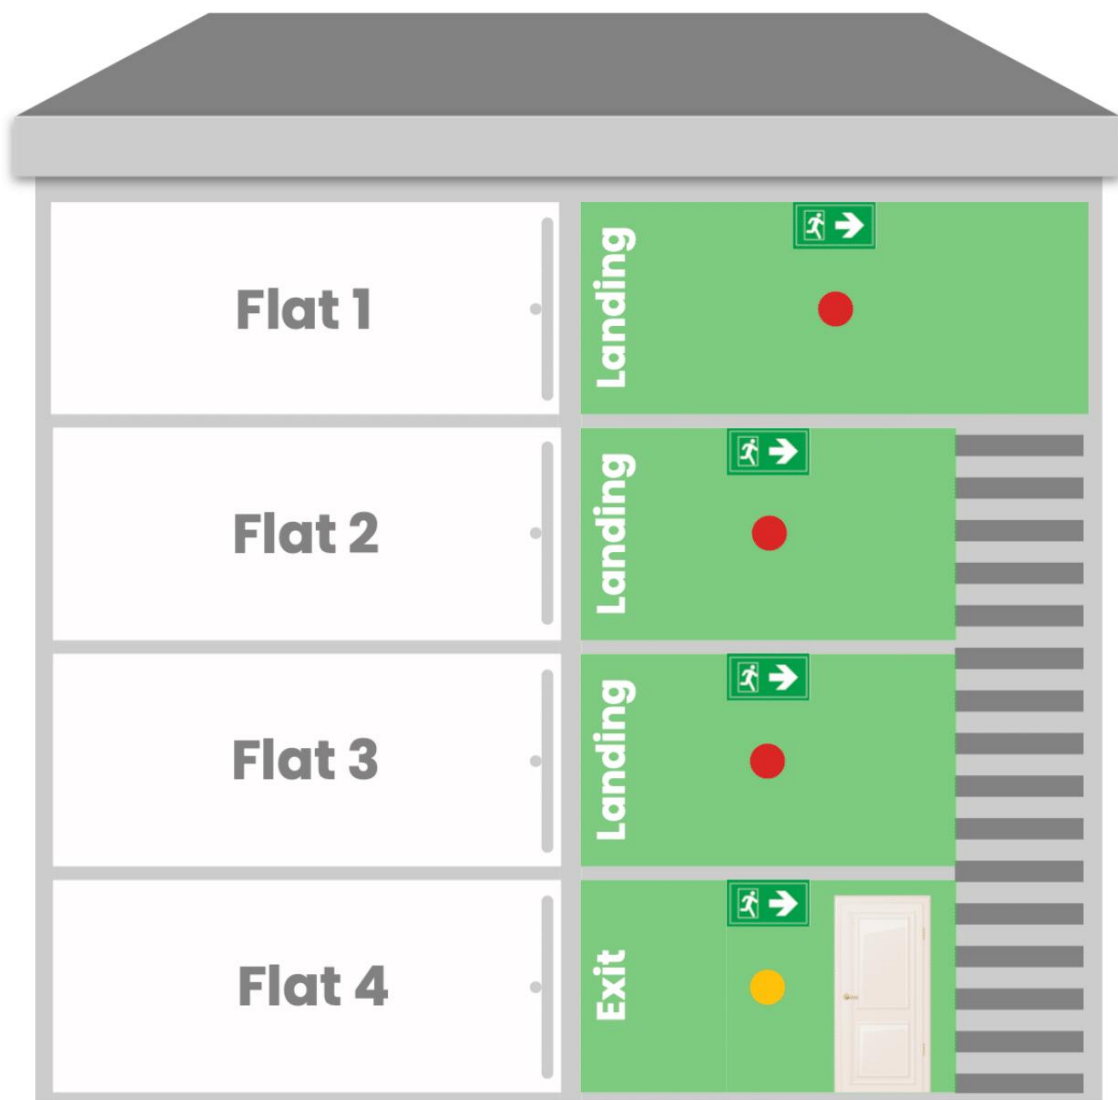

## The Updated Fire Alarm Grades

Grade A-C – Fire detection system incorporating control and indicating equipment to BS EN 54-2, power supply to BS EN 54-4, and installed to BS 5839 Part 1, with some very minor exceptions.



### Grade A-C

Separate detectors, sounders, central control, and indicating equipment with backup power. Equipment must meet other British Standards (BS EN 54).




### LD1 – HIGH PROTECTION

All areas where a fire could start

Examples:

- Hallways
- Landings
- Living Rooms
- Kitchens
- Bedrooms
- Airing Cupboards
- Meter Cupboards

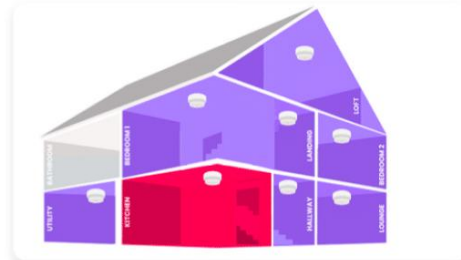


### LD2 – MEDIUM PROTECTION

Escape routes and high risk areas

Examples:

- Hallways
- Landings
- Living Rooms
- Kitchens

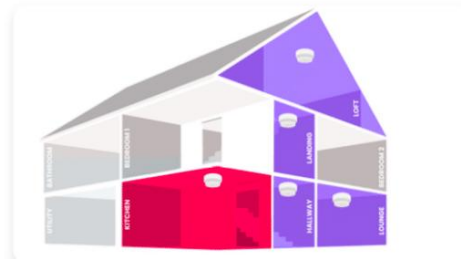

### LD3 – MINIMUM PROTECTION

Escape routes

Examples:

- Hallways
- Landings




## Fire Boarding



Fire rated encasement is required for ceilings and electrics in all common areas.



### Compliant

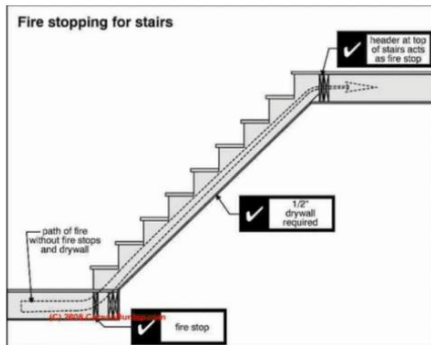


### Non-Compliant

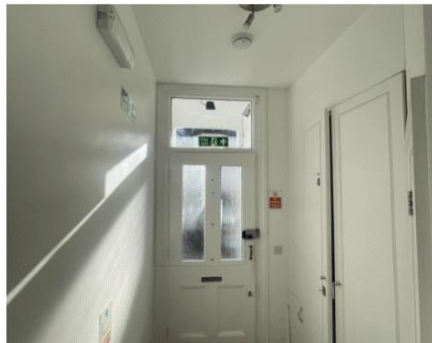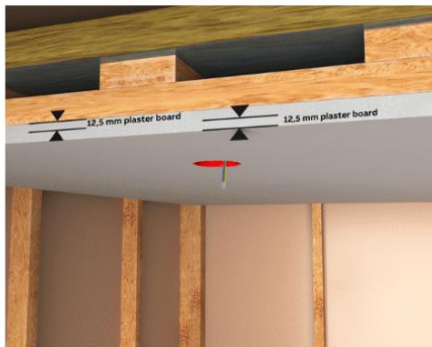



# Fire Door Compliance

Flat Entrance Doors  
New regulations from January 2023

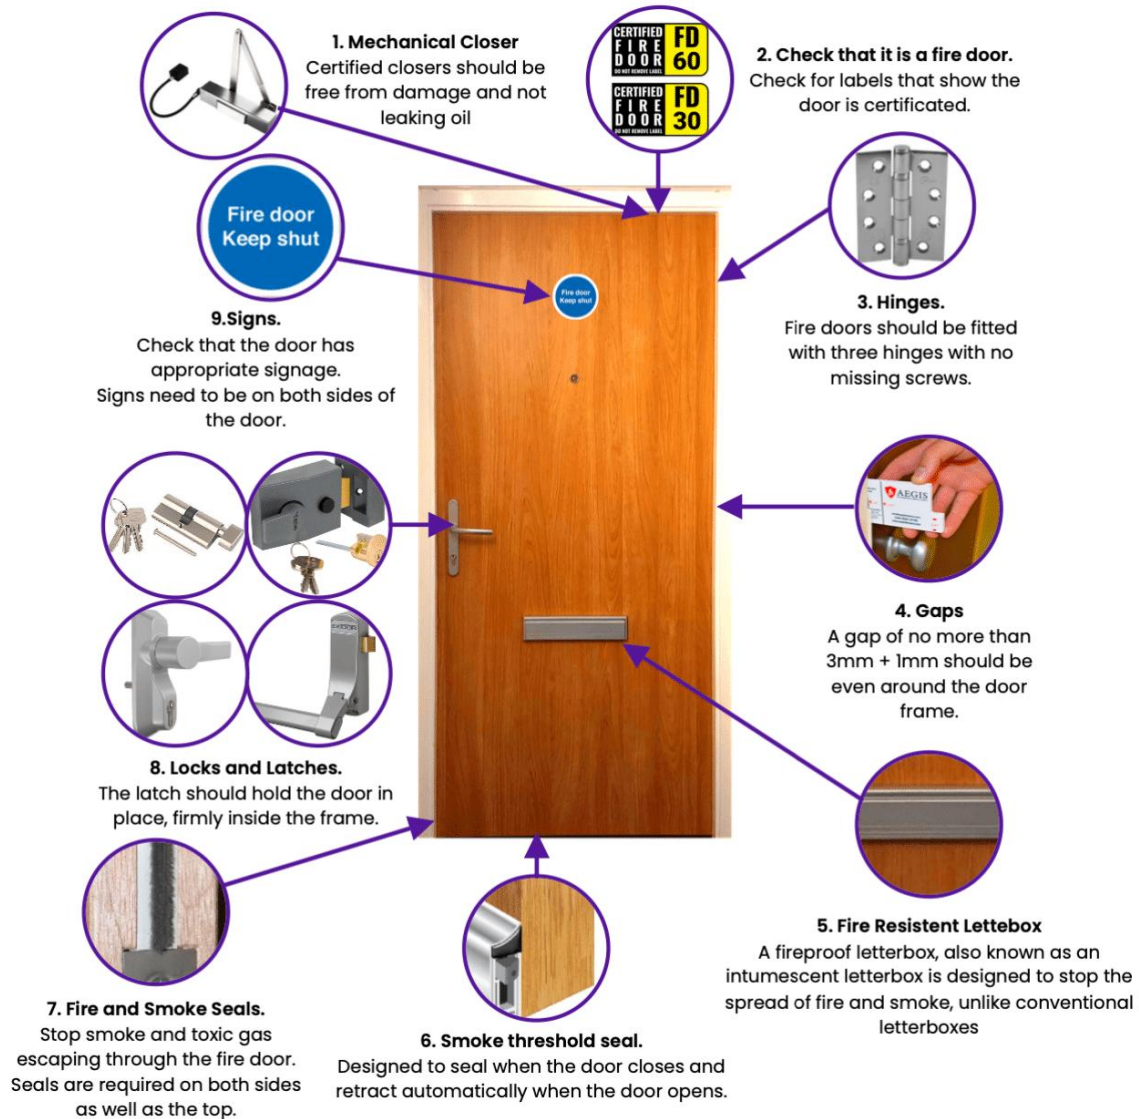

## BS CODES

Lever Handles & Knob Furniture: BS EN 1906: 2012  
Panic Exit Devices: BS EN 1125: 2008  
Locks and Latches: BS EN 12209: 2016  
Cylinders for Locks: BS EN 1303: 2015  
Single Axis Hinges: BS EN 1935: 2002


Door & Window Bolts: BS EN 12051: 2000  
Fire Door Closers BS EN 1154: 1997  
Electrically Powered Hold Open Devices: BS EN 1155: 1997  
Fire-Rated Glass: BS 6206  
Letter Plates/Letter Boxes: BS EN 13724: 2013



AMIN CONTRACTORS

## Fire Door Compliance

Landlords, HMO's & Kitchen Doors  
New regulations from January 2023

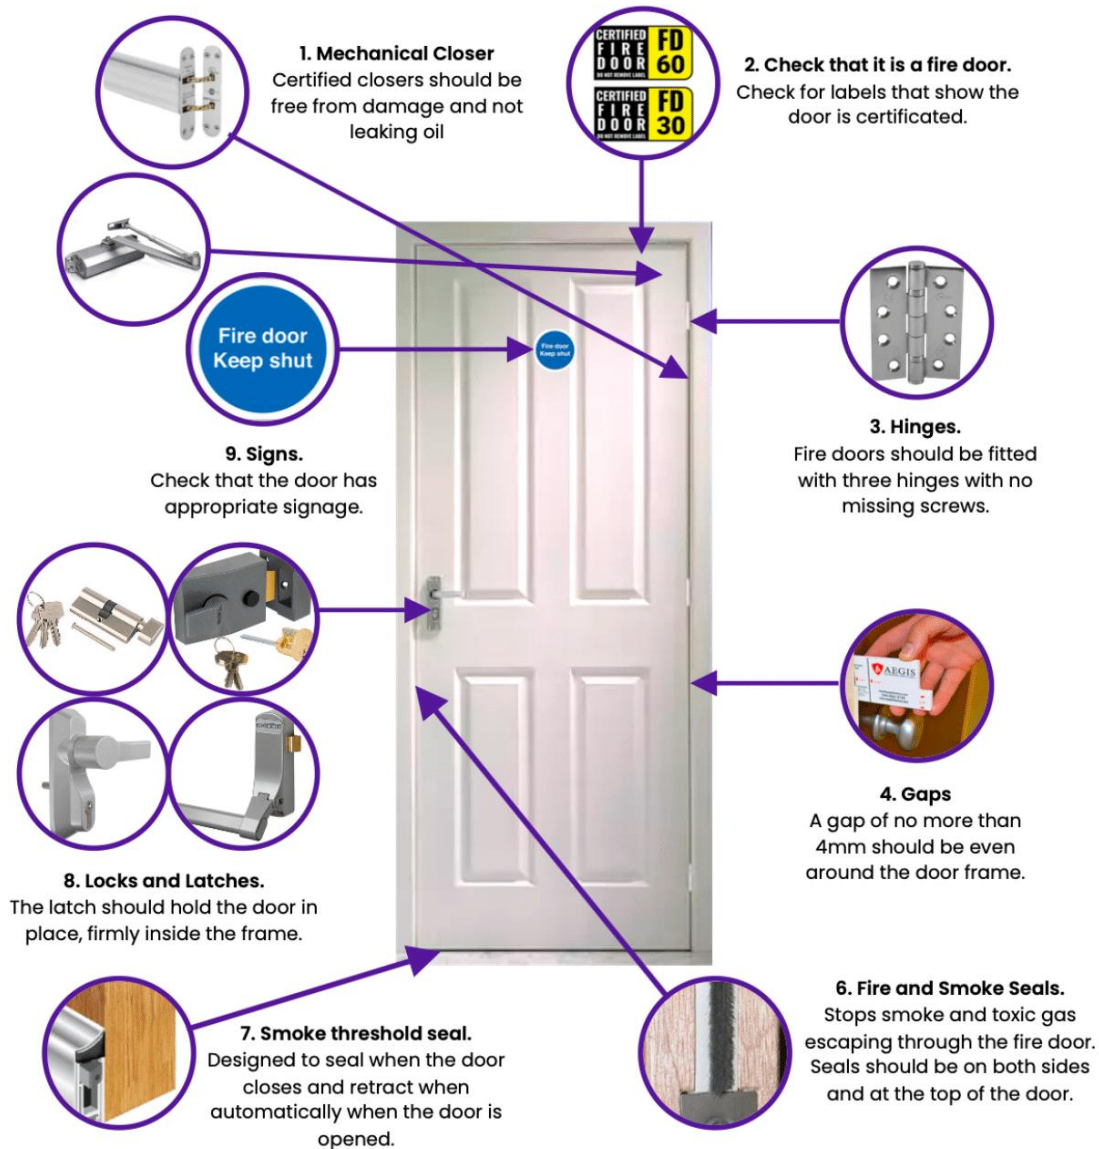

### BS CODES:

Lever Handles & Knob Furniture: BS EN 1906: 2012  
Panic Exit Devices: BS EN 1125: 2008  
Locks and Latches: BS EN 12209: 2016  
Cylinders for Locks: BS EN 1303: 2015  
Single Axis Hinges: BS EN 1935: 2002

Door & Window Bolts: BS EN 12051: 2000  
Fire Door Closers BS EN 1154: 1997  
Electrically Powered Hold Open Devices: BS EN 1155: 1997  
Fire-Rated Glass: BS 6206  
Letter Plates/Letter Boxes: BS EN 13724: 2013