

Table B.52.20 – Reduction factors for group of more than one multi-core cable to be applied to reference current-carrying capacities for multi-core cables in free air – Method of installation E in Tables B.52.8 to B.52.13

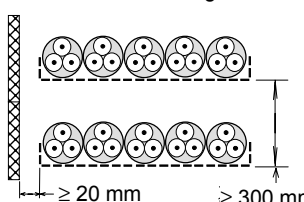

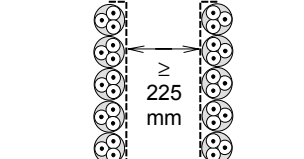
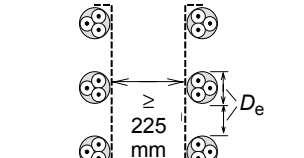
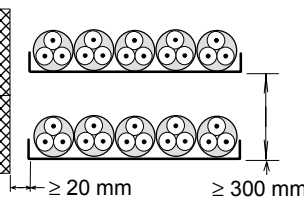
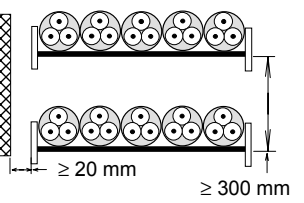
Method of installation in Table A.52.3			Number of trays or ladders	Number of cables per tray or ladder					
				1	2	3	4	6	9
Perforated cable tray systems (note 3)	31	Touching 	1 2 3 6	1,00 1,00 1,00 1,00	0,88 0,87 0,86 0,84	0,82 0,80 0,79 0,77	0,79 0,77 0,76 0,73	0,76 0,73 0,71 0,68	0,73 0,68 0,66 0,64
		Spaced 	1 2 3	1,00 1,00 1,00	1,00 0,99 0,98	0,98 0,96 0,95	0,95 0,92 0,91	0,91 0,87 0,85	– – –
Vertical perforated cable tray systems (note 4)	31	Touching 	1 2	1,00 1,00	0,88 0,88	0,82 0,81	0,78 0,76	0,73 0,71	0,72 0,70
		Spaced 	1 2	1,00 1,00	0,91 0,91	0,89 0,88	0,88 0,87	0,87 0,85	– –
Unperforated cable tray systems	31	Touching 	1 2 3 6	0,97 0,97 0,97 0,97	0,84 0,83 0,82 0,81	0,78 0,76 0,75 0,73	0,75 0,72 0,71 0,69	0,71 0,68 0,66 0,63	0,68 0,63 0,61 0,58
Cable ladder systems, cleats, etc. (note 3)	32 33 34	Touching 	1 2 3 6	1,00 1,00 1,00 1,00	0,87 0,86 0,85 0,84	0,82 0,80 0,79 0,77	0,80 0,78 0,76 0,73	0,79 0,76 0,73 0,68	0,78 0,73 0,70 0,64

Table B.52.20 (continued)

Method of installation in Table A.52.3			Number of trays or ladders	Number of cables per tray or ladder					
				1	2	3	4	6	9
		Spaced							
			1	1,00	1,00	1,00	1,00	1,00	—
			2	1,00	0,99	0,98	0,97	0,96	—
			3	1,00	0,98	0,97	0,96	0,93	—

NOTE 1 Values given are averages for the cable types and range of conductor sizes considered in Tables A.52.8 to A.52.13. The spread of values is generally less than 5 %.

NOTE 2 Factors apply to single layer groups of cables as shown above and do not apply when cables are installed in more than one layer touching each other. Values for such installations may be significantly lower and has to be determined by an appropriate method.

NOTE 3 Values are given for vertical spacing between cable trays of 300 mm and at least 20 mm between cable trays and wall. For closer spacing the factors should be reduced.

NOTE 4 Values are given for horizontal spacing between cable trays of 225 mm with cable trays mounted back to back. For closer spacing the factors should be reduced.