Irrigation Operations Report

Scenario: **Simulate Dry Spell** | Villages: All | Risk: All | Last 21 days

28	21	21	35,436	27/28
PLOTS IN SCOPE	NEED IRRIGATION	HIGH-URGENCY	WATER DEMAND (m³)	SENSORS ONLINE

Farm summary and risk overview

28 plots across 6 villages (56.0 ha) are in scope. **21** are high urgency, **7** medium and **0** low. 21 plots have an irrigation action (including 0 rainfall adjustment and 10 deferred by the water budget); 0 need a sensor review. Estimated demand is **35,436 m³**, of which 19,686 m³ fits the daily budget.

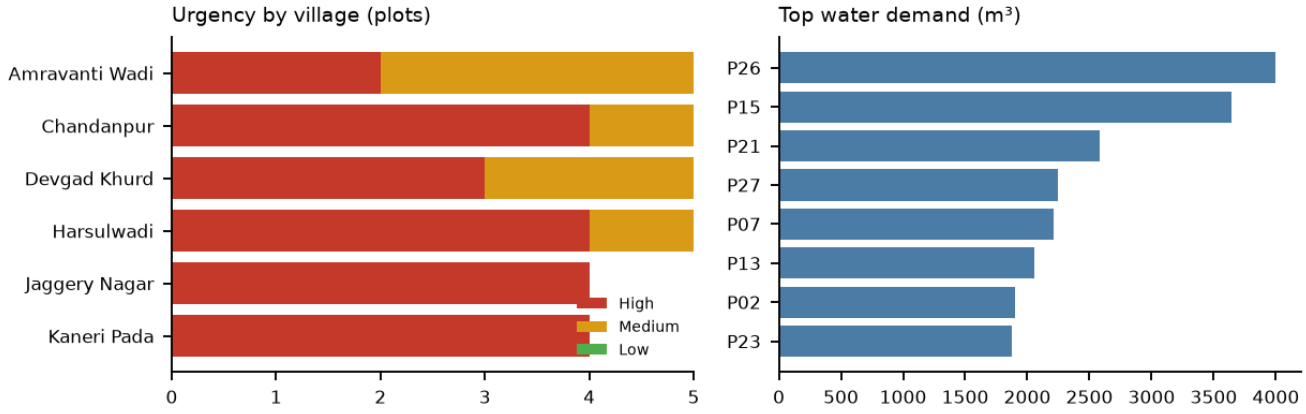

Recommended actions

Action	Plots
Irrigate soon	11
Restricted water availability	10
Monitor conditions	7

Plot detail

Plot	Village	Moist. %	Urgency	Recommended action	Water m³	Hours
CS-P27	Kaneri Pada	14.6	High	Irrigate soon	2,250	20.8
CS-P21	Jaggery Nagar	5.3	High	Irrigate soon	2,583	20.8
CS-P28	Kaneri Pada	5.6	High	Irrigate soon	1,167	20.8
CS-P26	Kaneri Pada	12.1	High	Irrigate soon	4,000	12.5
CS-P25	Kaneri Pada	23.5	High	Irrigate soon	1,875	12.5
CS-P09	Chandanpur	14.4	High	Irrigate soon	1,100	16.7
CS-P22	Jaggery Nagar	6.3	High	Irrigate soon	750	20.8
CS-P24	Jaggery Nagar	11.2	High	Irrigate soon	1,125	12.5
CS-P03	Amravanti Wadi	19.7	High	Irrigate soon	1,211	9.6
CS-P23	Jaggery Nagar	9.4	High	Irrigate soon	1,875	12.5
CS-P10	Chandanpur	25.9	High	Irrigate soon	1,750	20.8
CS-P08	Chandanpur	21.5	High	Restricted water availability	1,000	12.5
CS-P07	Chandanpur	23.1	High	Restricted water availability	2,215	19.8
CS-P02	Amravanti Wadi	11.0	High	Restricted water availability	1,900	16.7

Plot	Village	Moist. %	Urgency	Recommended action	Water m³	Hours
CS-P14	Devgad Khurd	27.2	High	Restricted water availability	1,417	20.8
CS-P18	Harsulwadi	27.0	High	Restricted water availability	667	6.9
CS-P15	Devgad Khurd	28.6	High	Restricted water availability	3,640	12.1
CS-P16	Harsulwadi	26.6	High	Restricted water availability	520	5.8
CS-P19	Harsulwadi	28.7	High	Restricted water availability	1,202	12.0
CS-P17	Harsulwadi	24.9	High	Restricted water availability	1,136	9.5
CS-P13	Devgad Khurd	30.2	High	Restricted water availability	2,053	13.7
CS-P06	Chandanpur	27.1	Medium	Monitor conditions	-	-
CS-P11	Devgad Khurd	30.3	Medium	Monitor conditions	-	-
CS-P01	Amravanti Wadi	32.9	Medium	Monitor conditions	-	-
CS-P12	Devgad Khurd	33.1	Medium	Monitor conditions	-	-
CS-P20	Harsulwadi	28.0	Medium	Monitor conditions	-	-
CS-P04	Amravanti Wadi	32.5	Medium	Monitor conditions	-	-
CS-P05	Amravanti Wadi	31.7	Medium	Monitor conditions	-	-

Data notes and disclaimer

All farms, plots, readings and recommendations in this report are SYNTHETIC and generated for demonstration. The model is trained on synthetic labels and has not been validated on real sugarcane farms. Outputs are decision-support suggestions, not agronomic or engineering advice.

Urgency is a model estimate; the action, quantity and duration come from a separate transparent rule engine (see Methodology). Water depth is capped at 75 mm per event and adjusted for forecast rain and system efficiency.