
LED7 fitted lapse distributions and abort RT
Type 8: lapse PDF | data + model · Type 9: lapse PDF | data + model

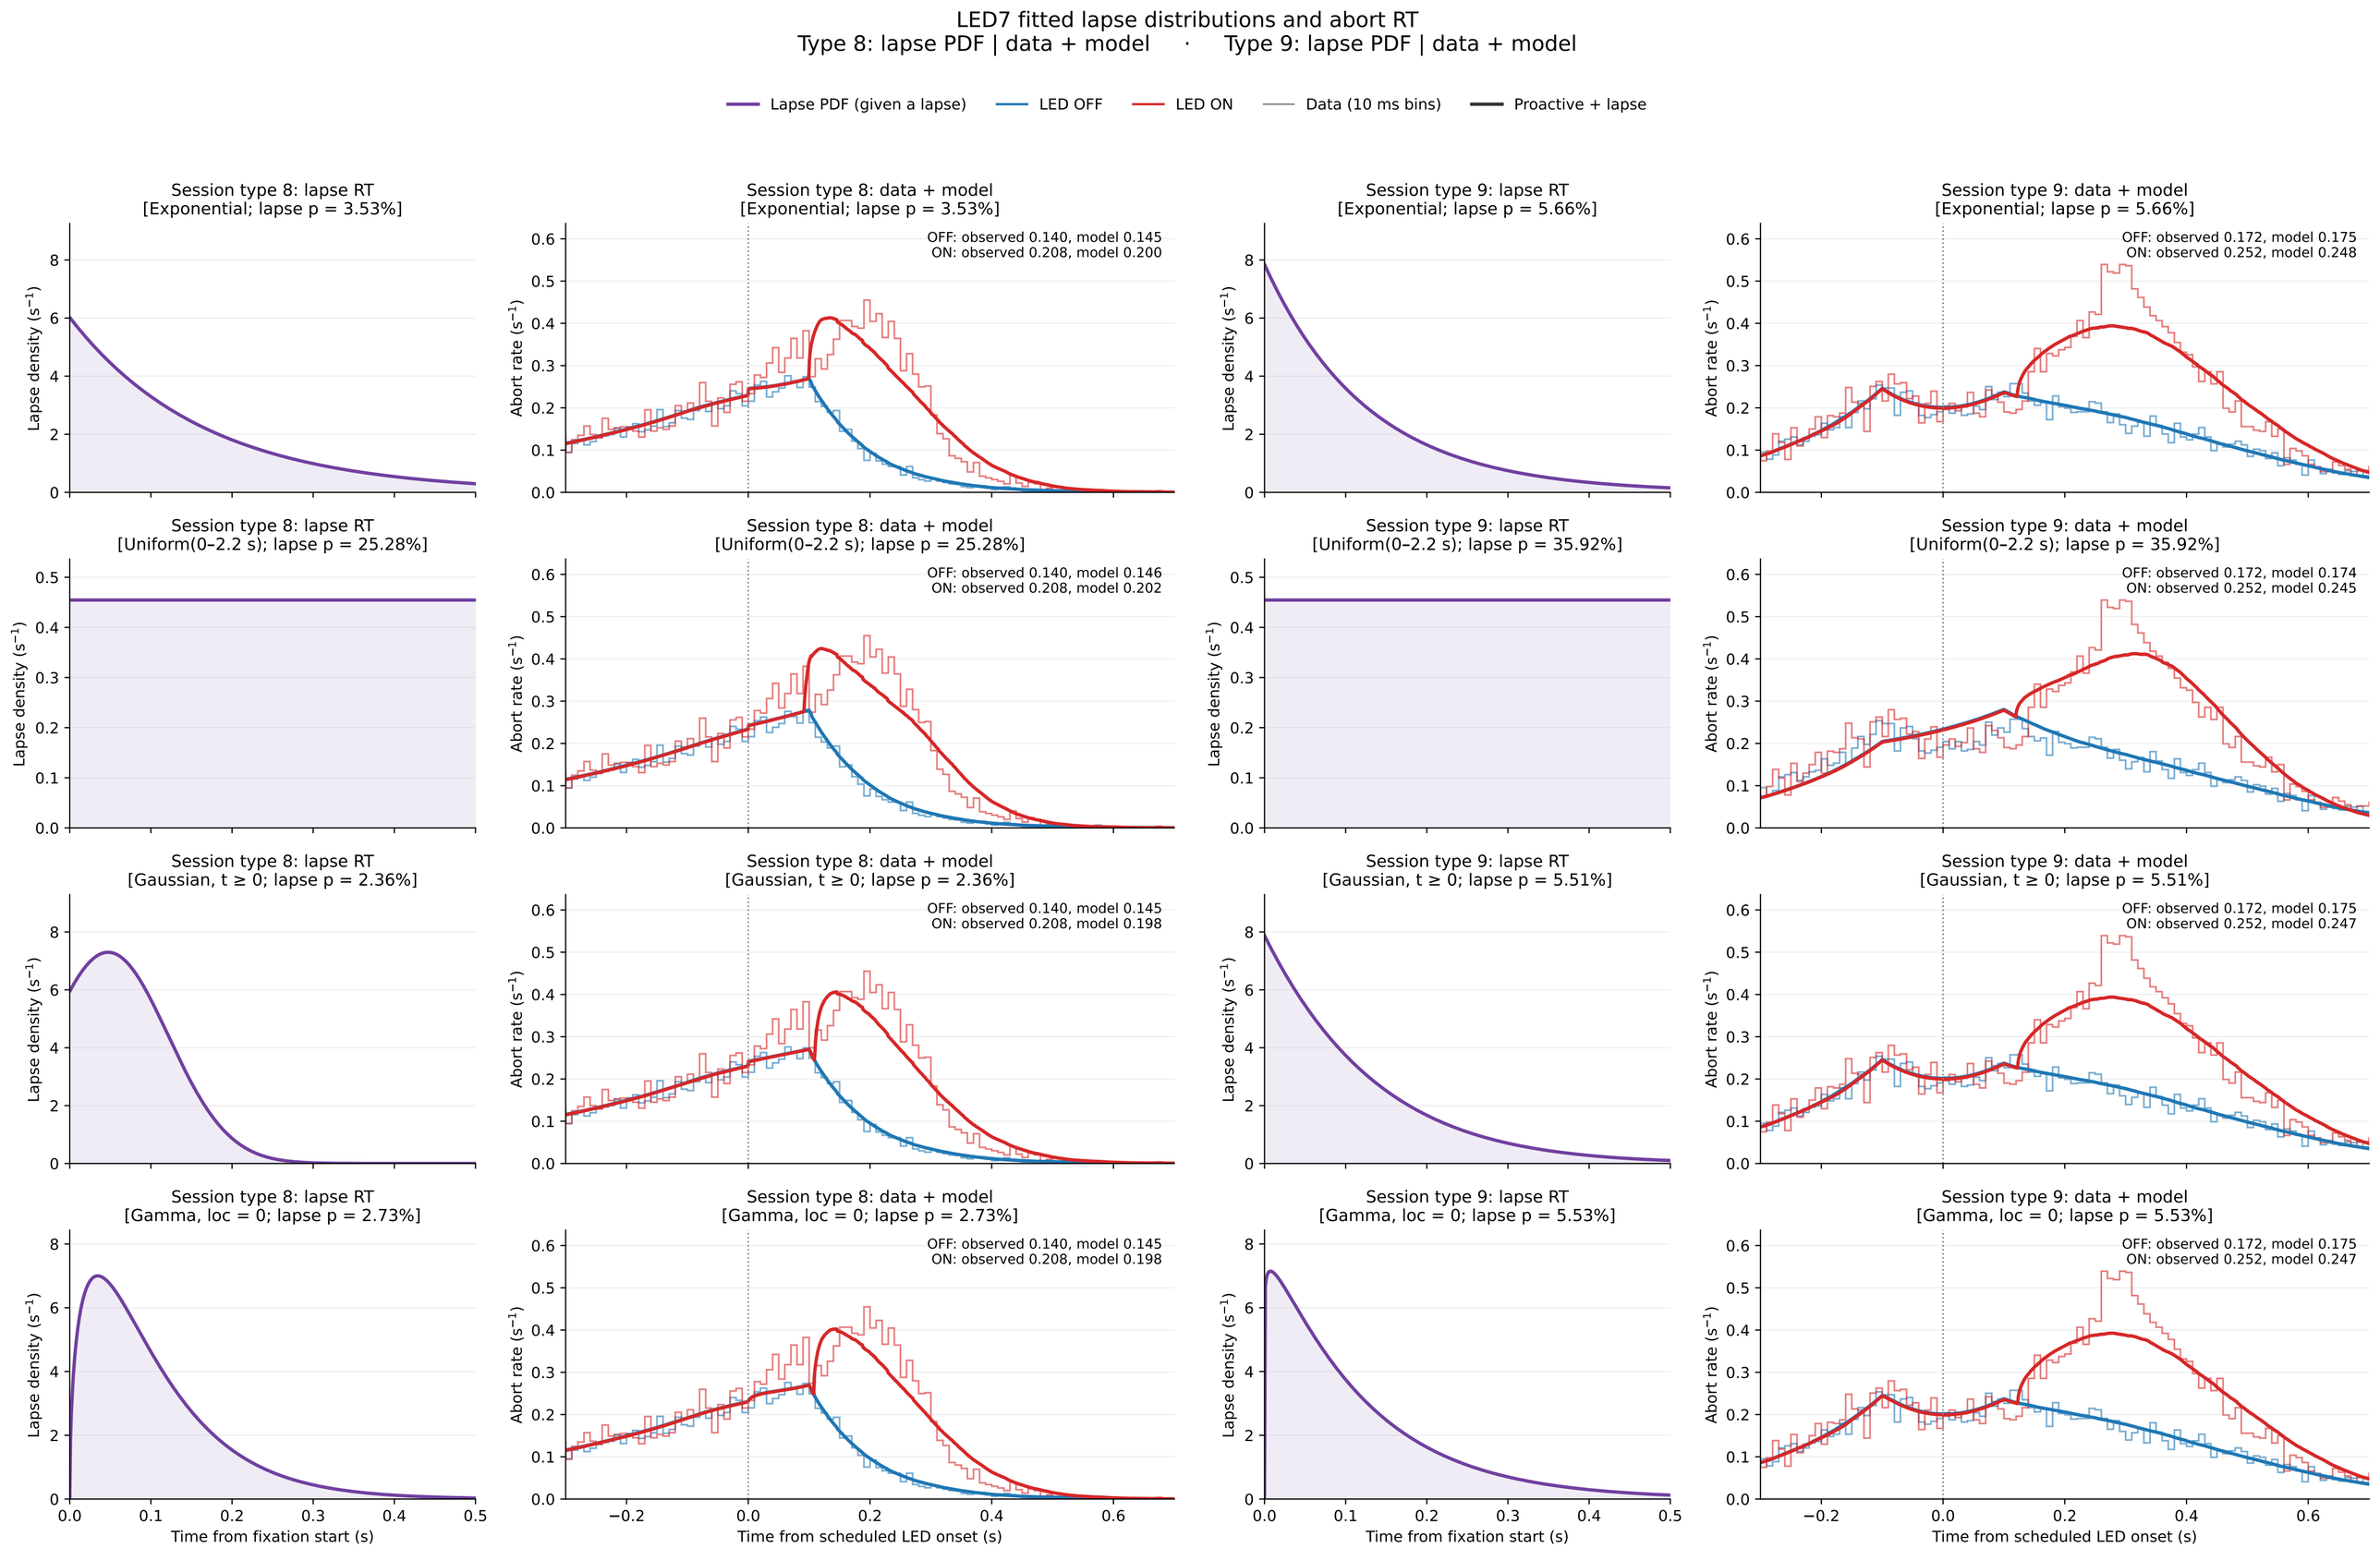

Lapse PDFs: unit area on full support, shown over 0–0.5 s; p is the mixture lapse probability. Uniform support is 0–2.2 s.
Abort panels retain trial-pooled event-or-censored denominators; OFF zero is scheduled, ON zero is actual LED onset.