Human RT | delay-prior sensitivity: 300 → 500 ms

Same trials, likelihood, priors for all other parameters, initialization, seed and SVI stopping rule

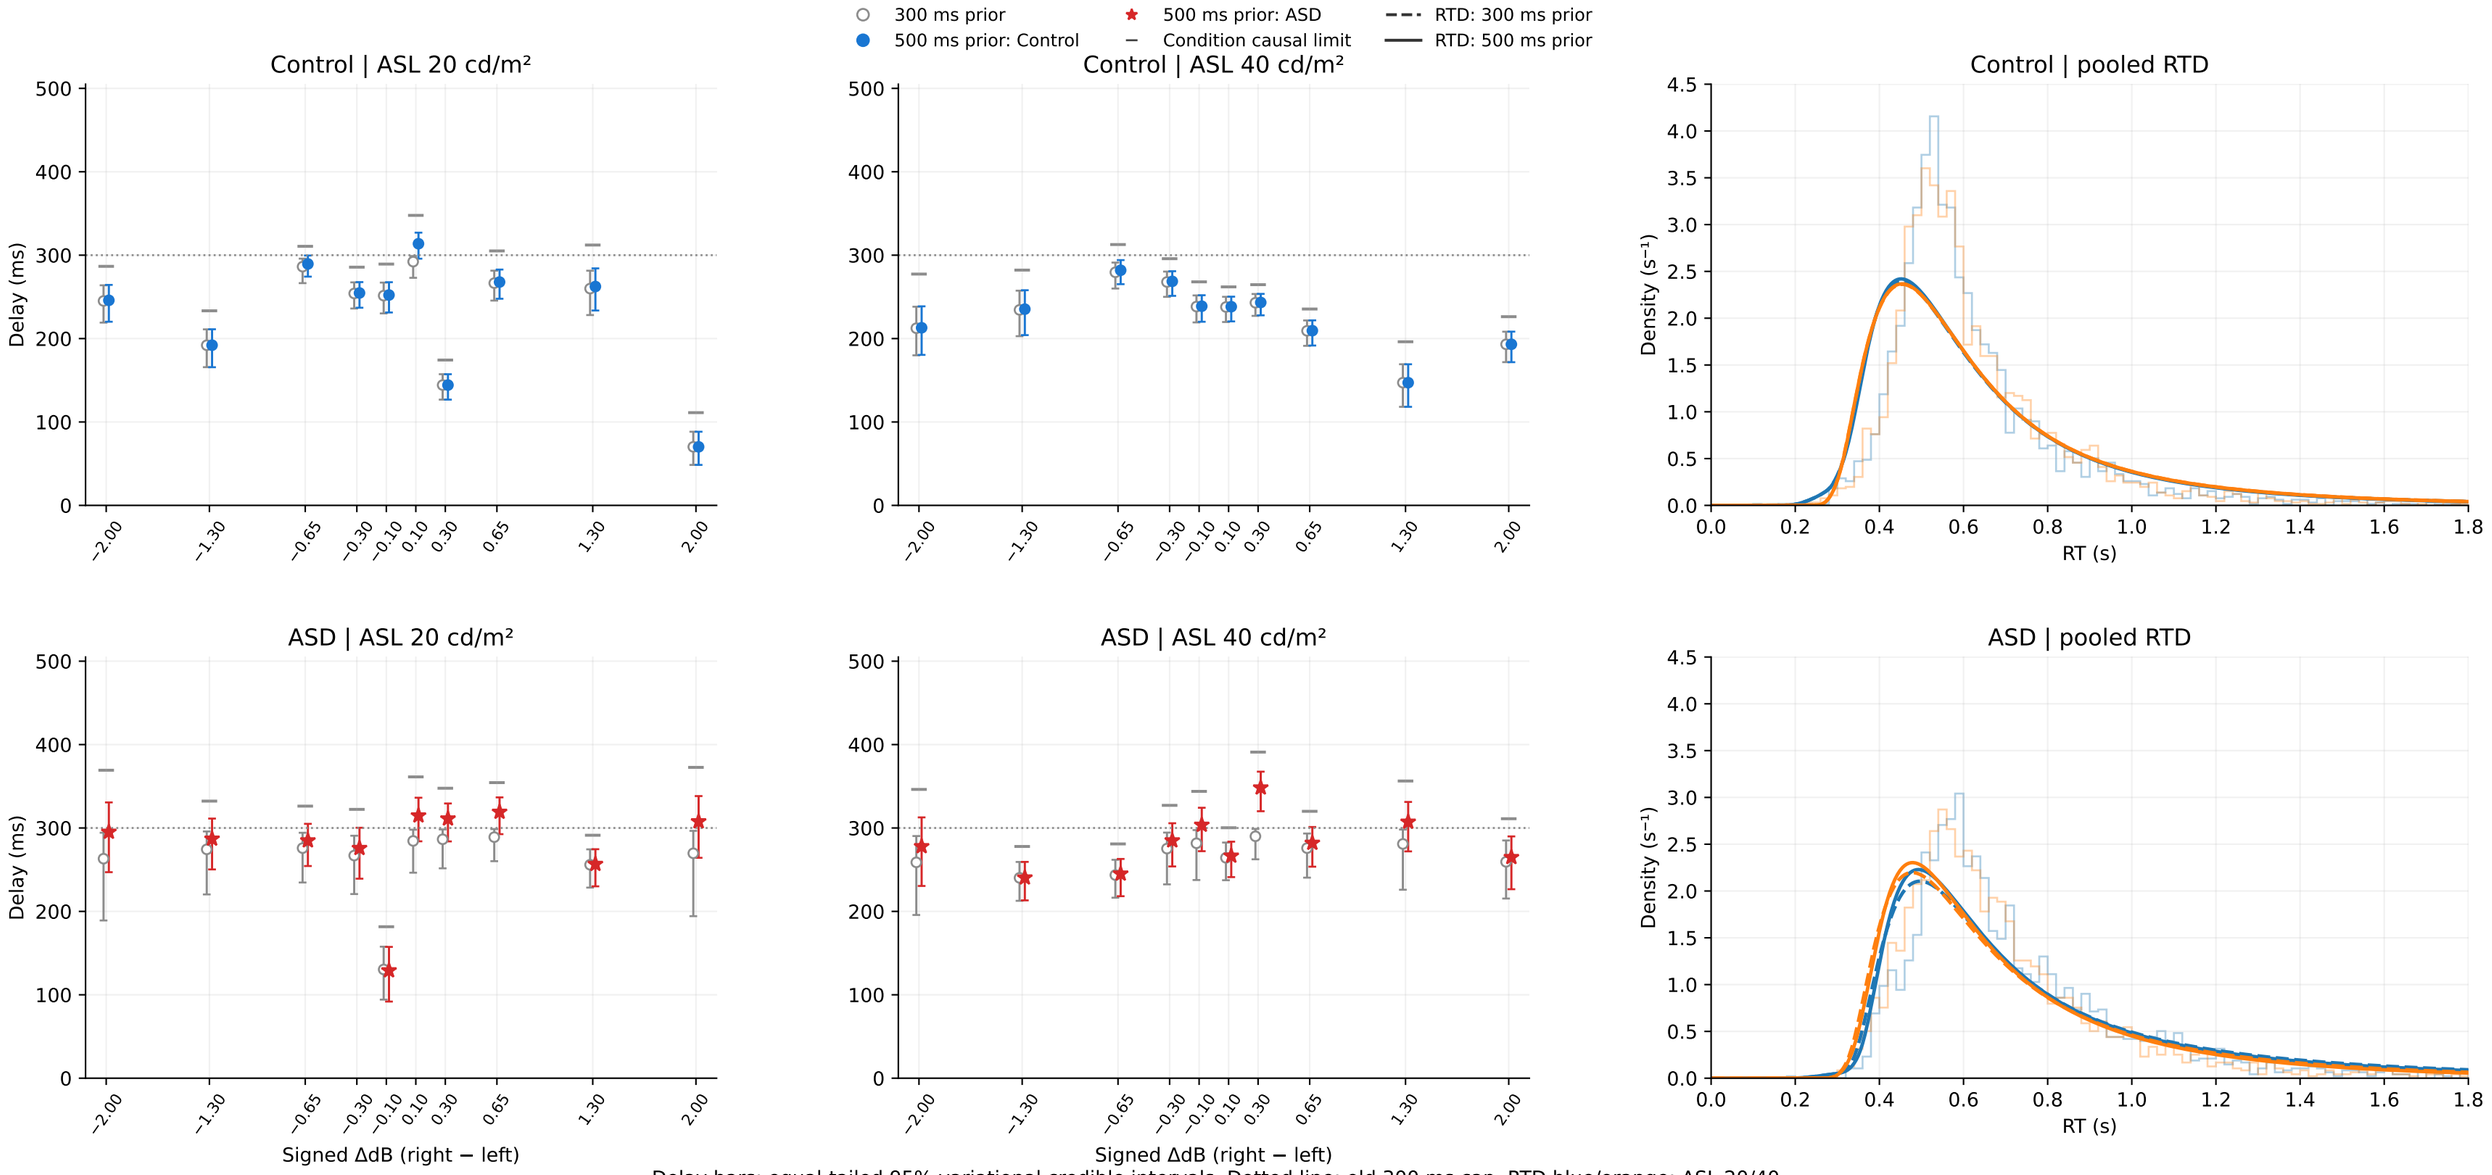

Delay bars: equal-tailed 95% variational credible intervals. Dotted line: old 300 ms cap. RTD blue/orange: ASL 20/40.

Condition = RT; raw-trial pooling; 0–1.8 s retained; both choices. Each signed-condition density is normalized before mixing.