SHANK3 cohort 1 | Gamma/Omega | Ω ≤ 25 s^{-1} | Gaussian delays by ABL

Control (WT) ASD (HOM)

68 parameters per genotype; 10,000 posterior draws; means and central 95% credible intervals.

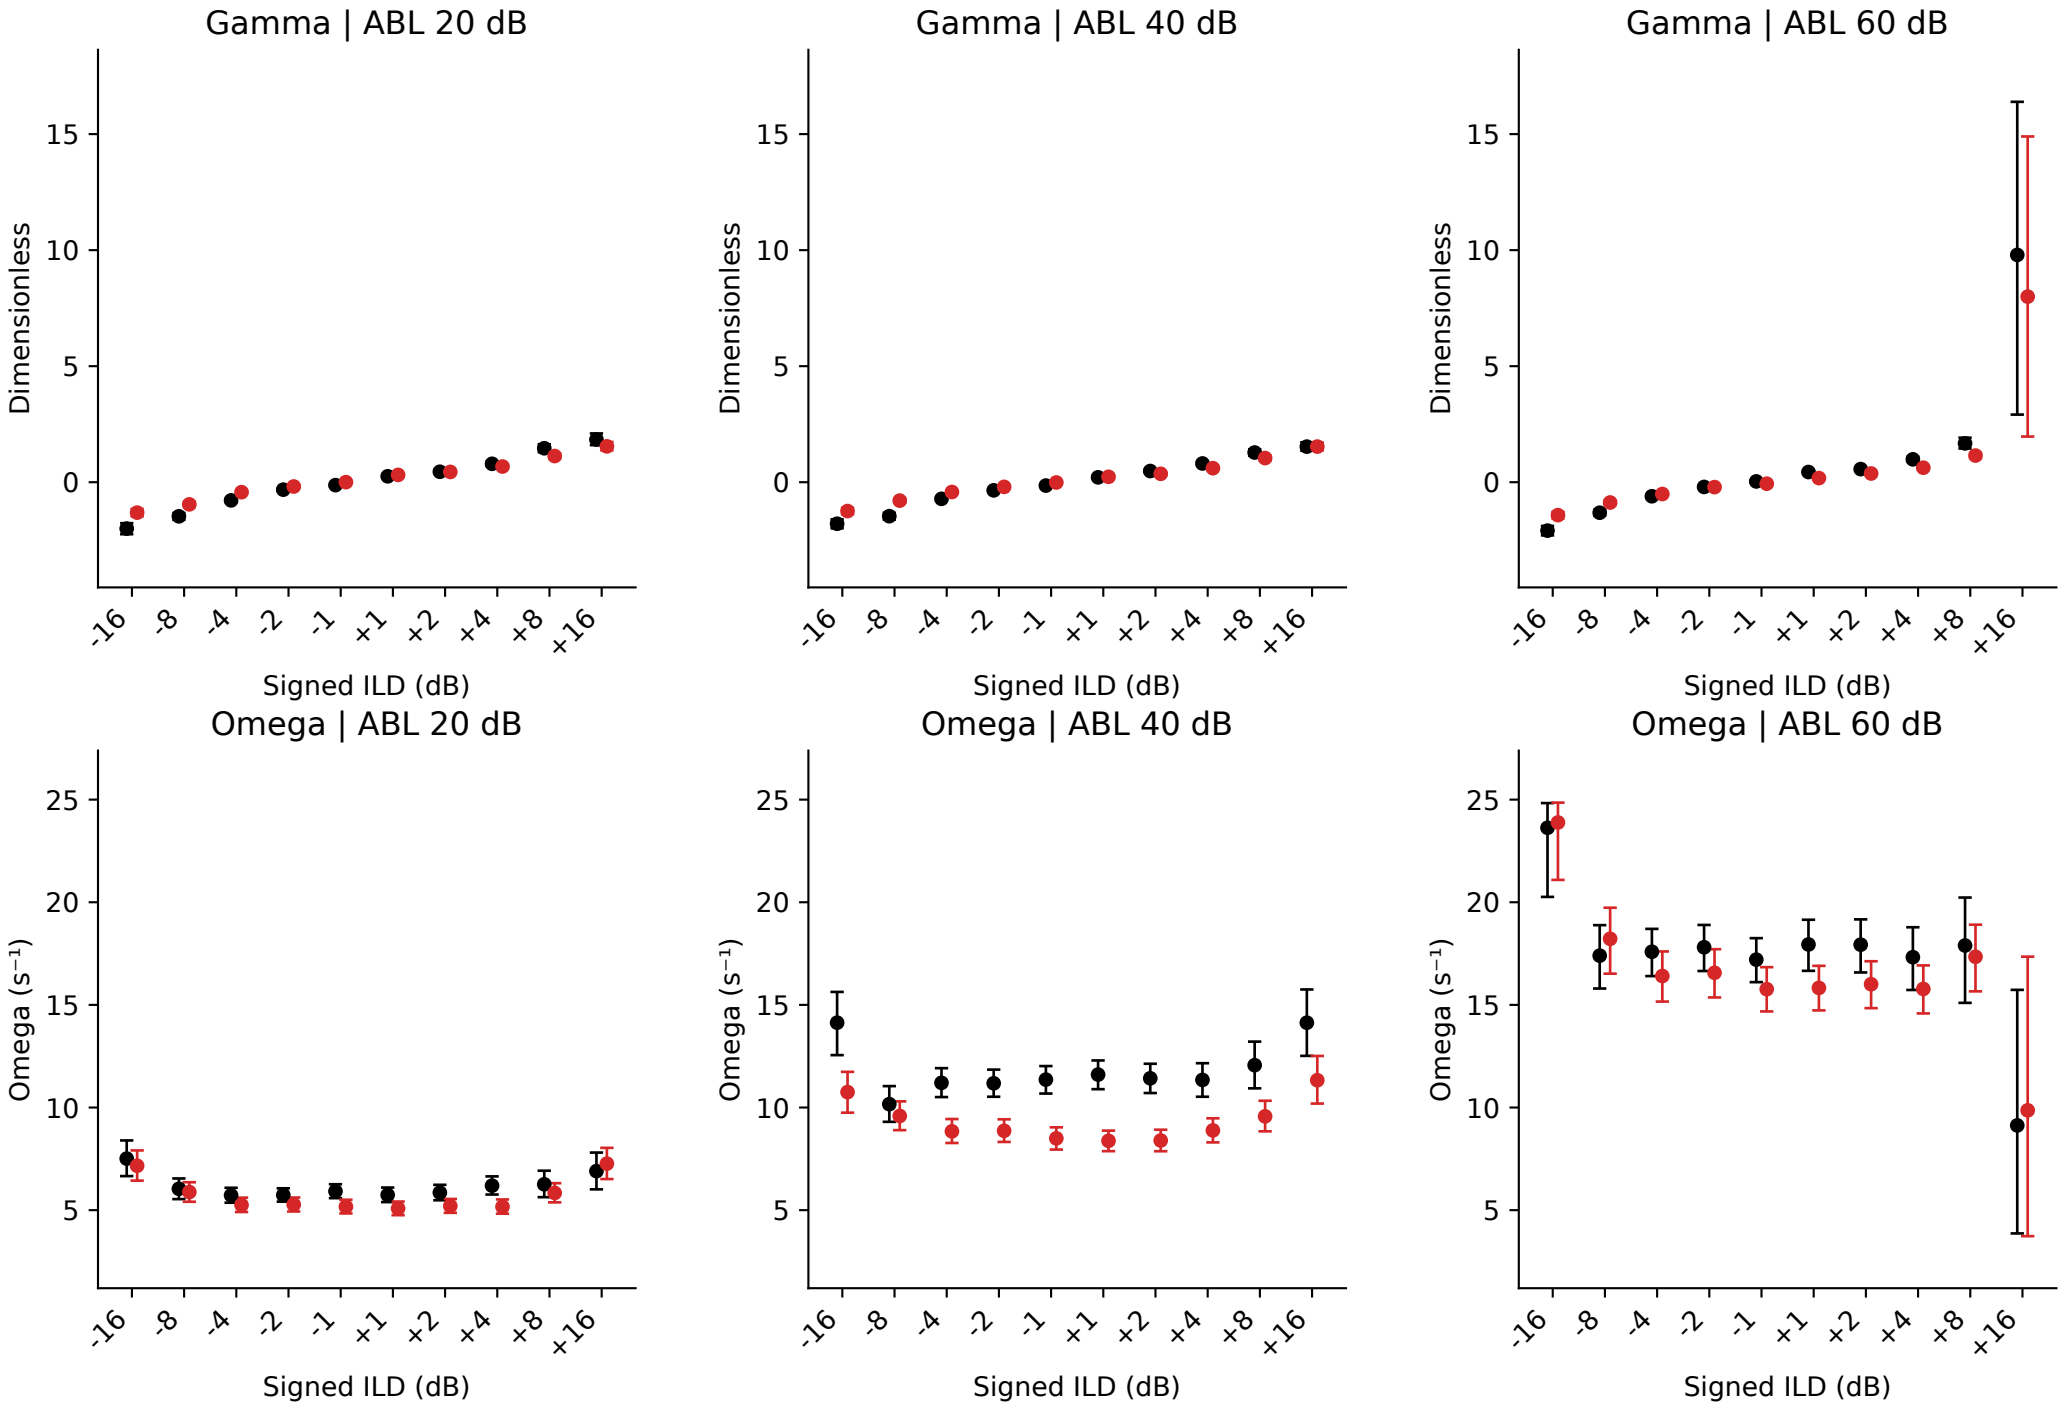

μ/σ describe the underlying Gaussian, truncated below zero, shared across signed ILDs within ABL.
Conditional variational uncertainty; proactive/exponential lapses fixed. Intervals are not animal SEMs.