# Session type 1 | Accuracy versus mean RT

53 animals | 159 animal–ABL dots | signed ILDs pooled

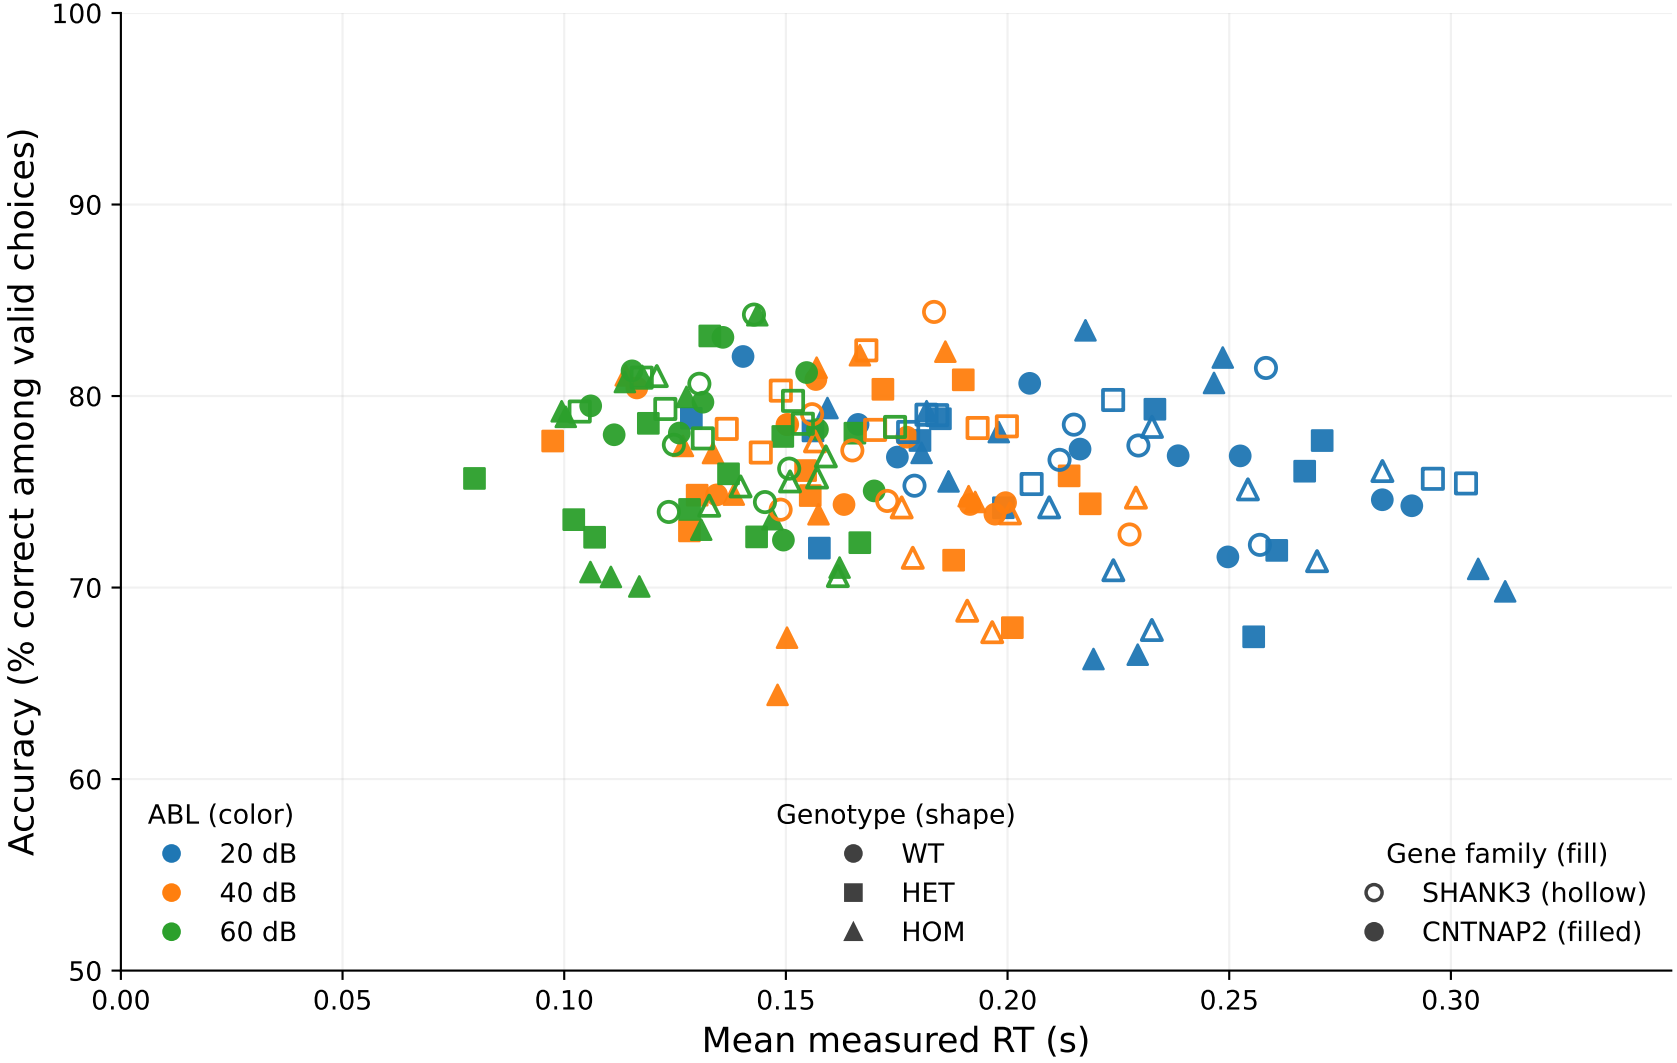


Valid trials: success in {1,-1}; accuracy = correct / (correct + error).
Mean RT uses all finite timed_rt values, including >1 s; no RT cutoff.

ABL 59 mapped to 60; signed ILDs ±1/2/4/8/16 dB and sessions pooled by observed trials.
Accuracy: 471,416 choices; mean RT: 469,228 finite RTs. Missing RTs stay in accuracy only.