


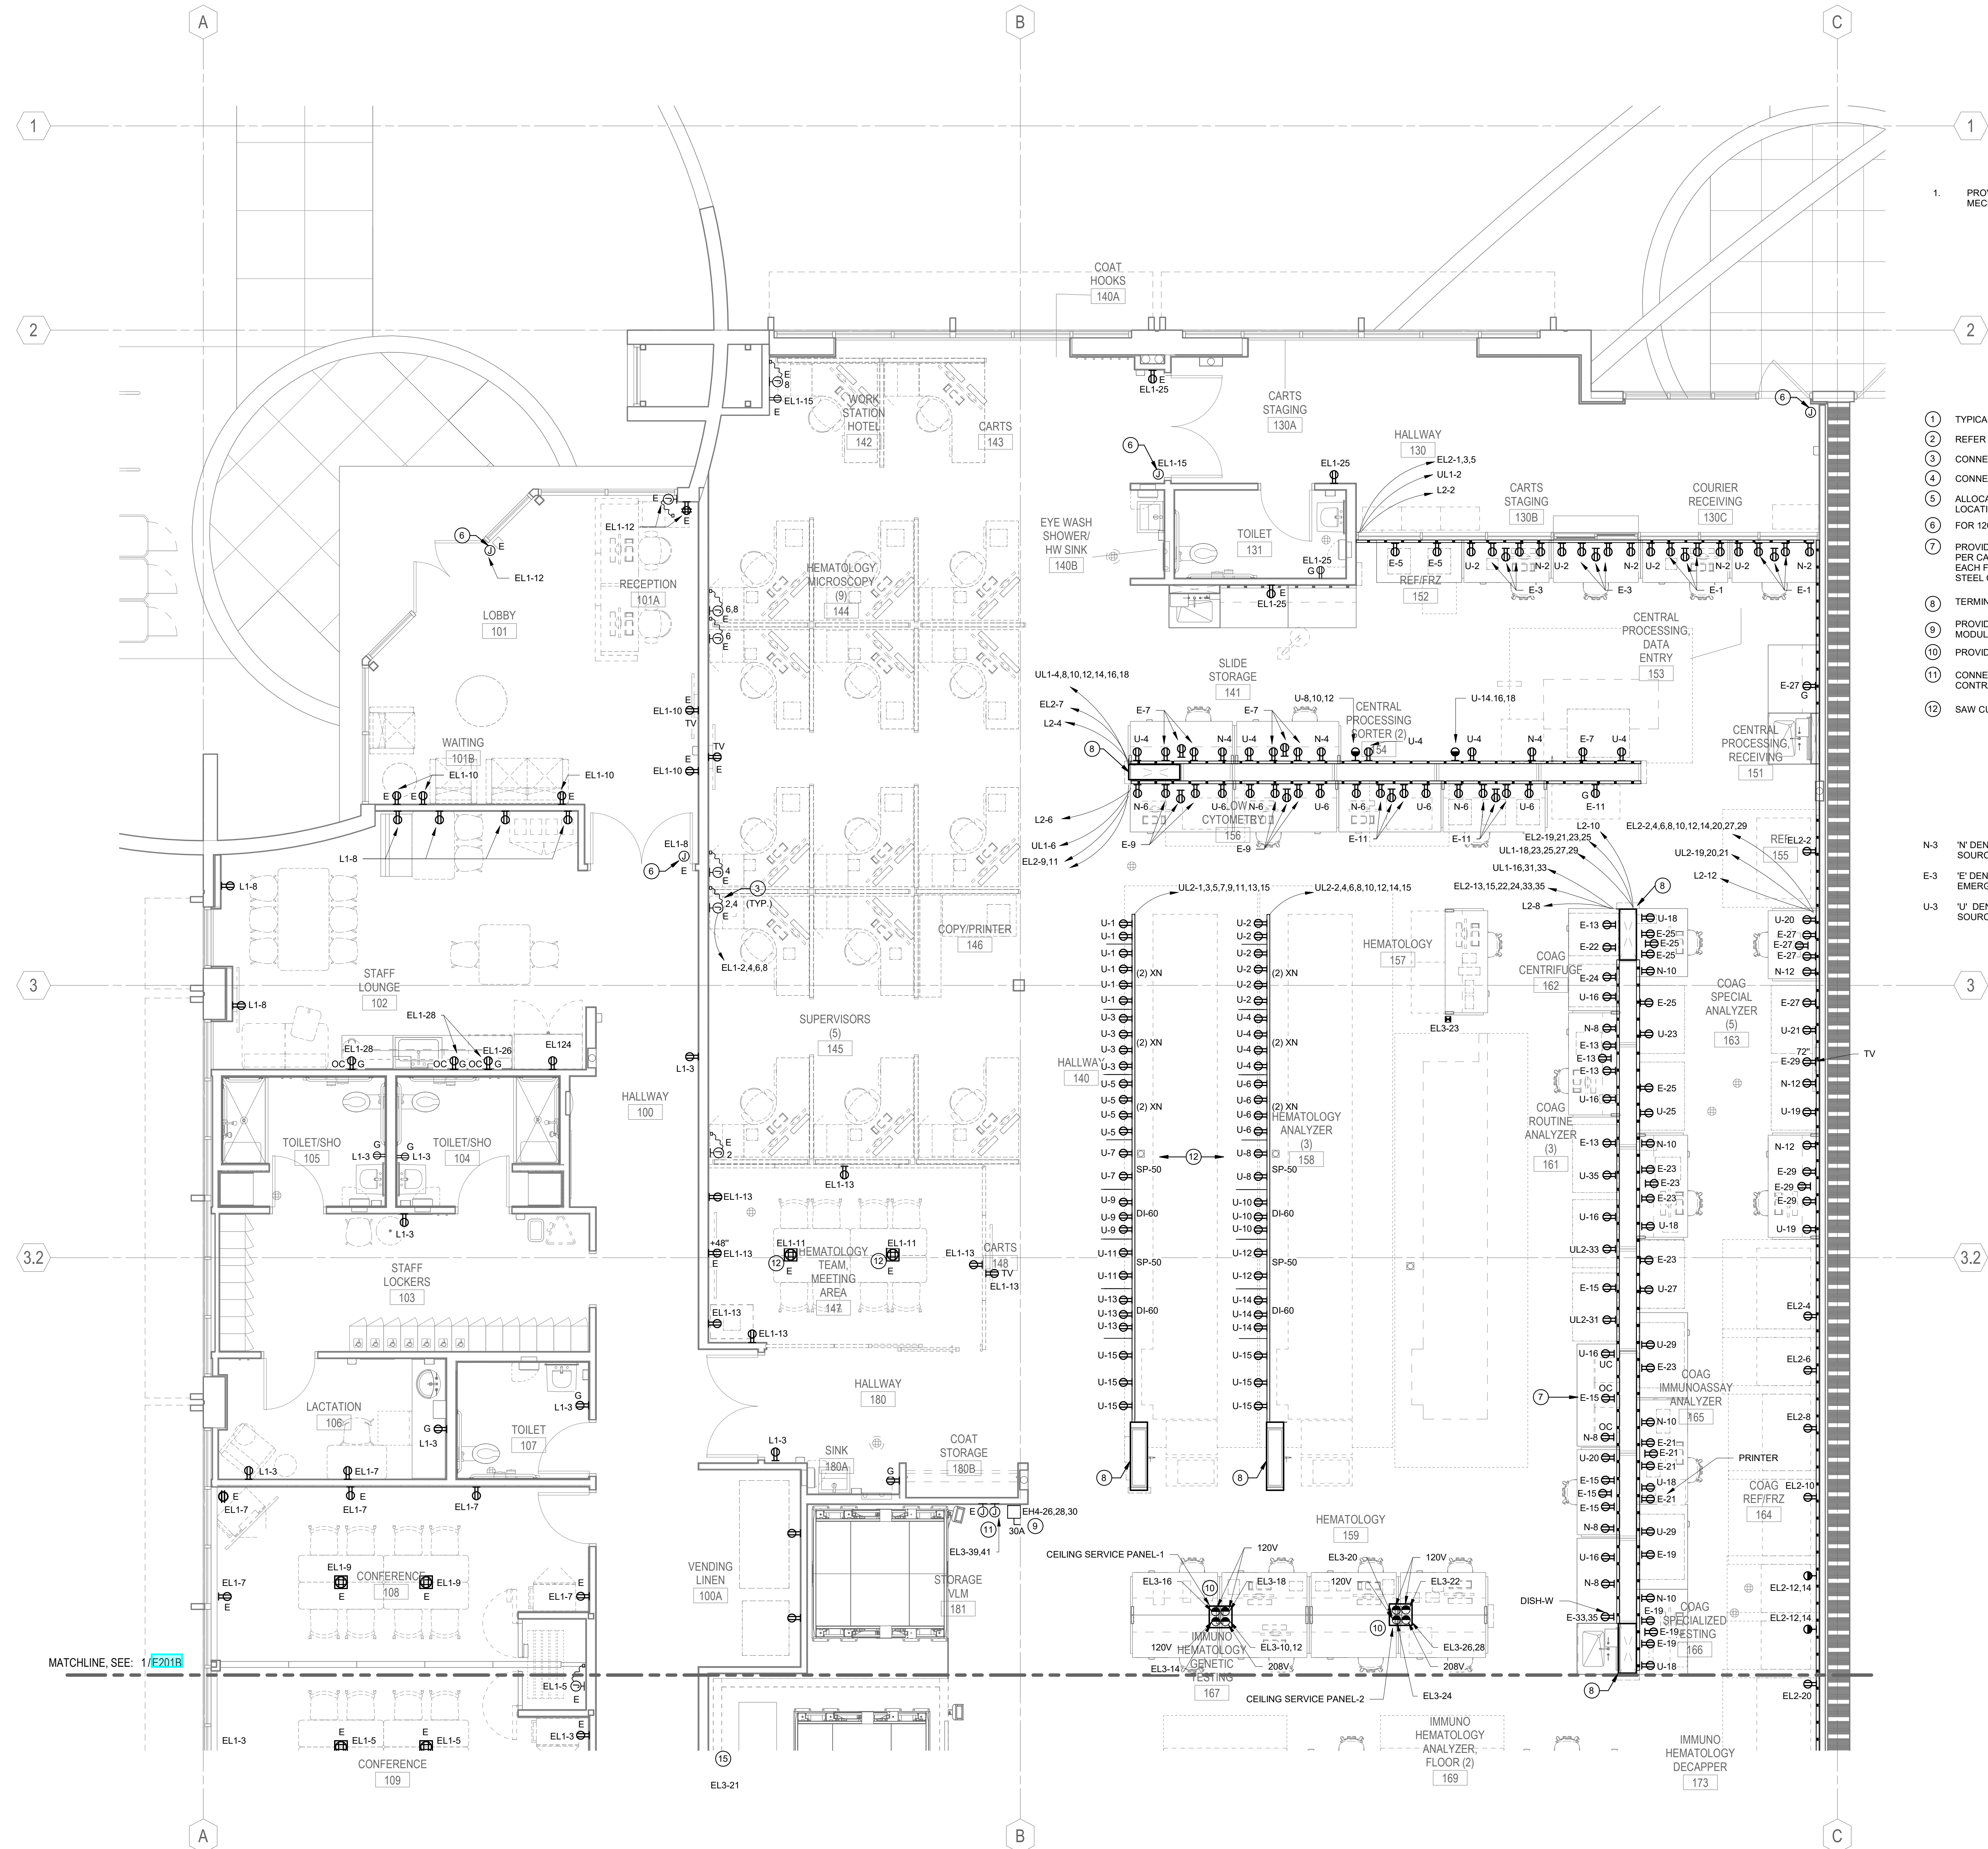

GENERAL NOTES:

1. PROVIDE POWER REQUIREMENTS PER THE EQUIPMENT SHOWN ON MECHANICAL/PLUMBING DRAWINGS.

SHEET NOTES:

1. TYPICAL LAYOUT OF DEVICES.
2. REFER TO SIMILAR ROOM FOR TYPICAL LAYOUT OF DEVICES.
3. CONNECT TO SYSTEM FURNITURE.
4. CONNECT TO MOTORIZED PARTITION.
5. ALLOCATE 120V FOR DRINKING FOUNTAIN/WATER BOTTLE FILLER. LOCATION TO BE DETERMINED.
6. FOR 120V AUTOMATIC DOOR OPERATOR.
7. PROVIDE #10 SOLID BARE COPPER GROUND CONDUCTOR (OR SIZE PER CABINET MANUFACTURER'S RECOMMENDATION), CONNECT TO EACH FLAMMABLE CABINET AND CLAMPED TO NEAREST BUILDING STEEL COLUMN.
8. TERMINATE POWER CONNECTION VIA VERTICAL UTILITY CHASE.
9. PROVIDE COMPLETE CONNECTION TO VLM (VERTICAL LIFT MODULES).
10. PROVIDE FOUR TWISTLOCK OUTLETS.
11. CONNECT TO VLM EVAPORATOR. COORDINATE WITH VLM CONTRACTOR FOR EXACT LOCATION PRIOR TO ROUGH-IN.
12. SAW CUT EXISTING CONCRETE FOR THE FLOORBOX INSTALLATION.

CIRCUITING LEGEND:


- N-3 'N' DENOTES CIRCUIT NUMBER CONNECTED TO A NORMAL BRANCH SOURCE.
- E-3 'E' DENOTES CIRCUIT NUMBER CONNECTED TO A EMERGENCY/STANDBY BRANCH SOURCE.
- U-3 'U' DENOTES CIRCUIT NUMBER CONNECTED TO A UPS BRANCH SOURCE.

**FLOOR PLAN -
LEVEL 01 - AREA
A - POWER &
SIGNAL**

DATE: APRIL 23, 2021

CONSTRUCTION
DOCUMENTS

E201A



©COPYRIGHT HAMMILL, GREEN AND ABRAHAMSON, INC.