


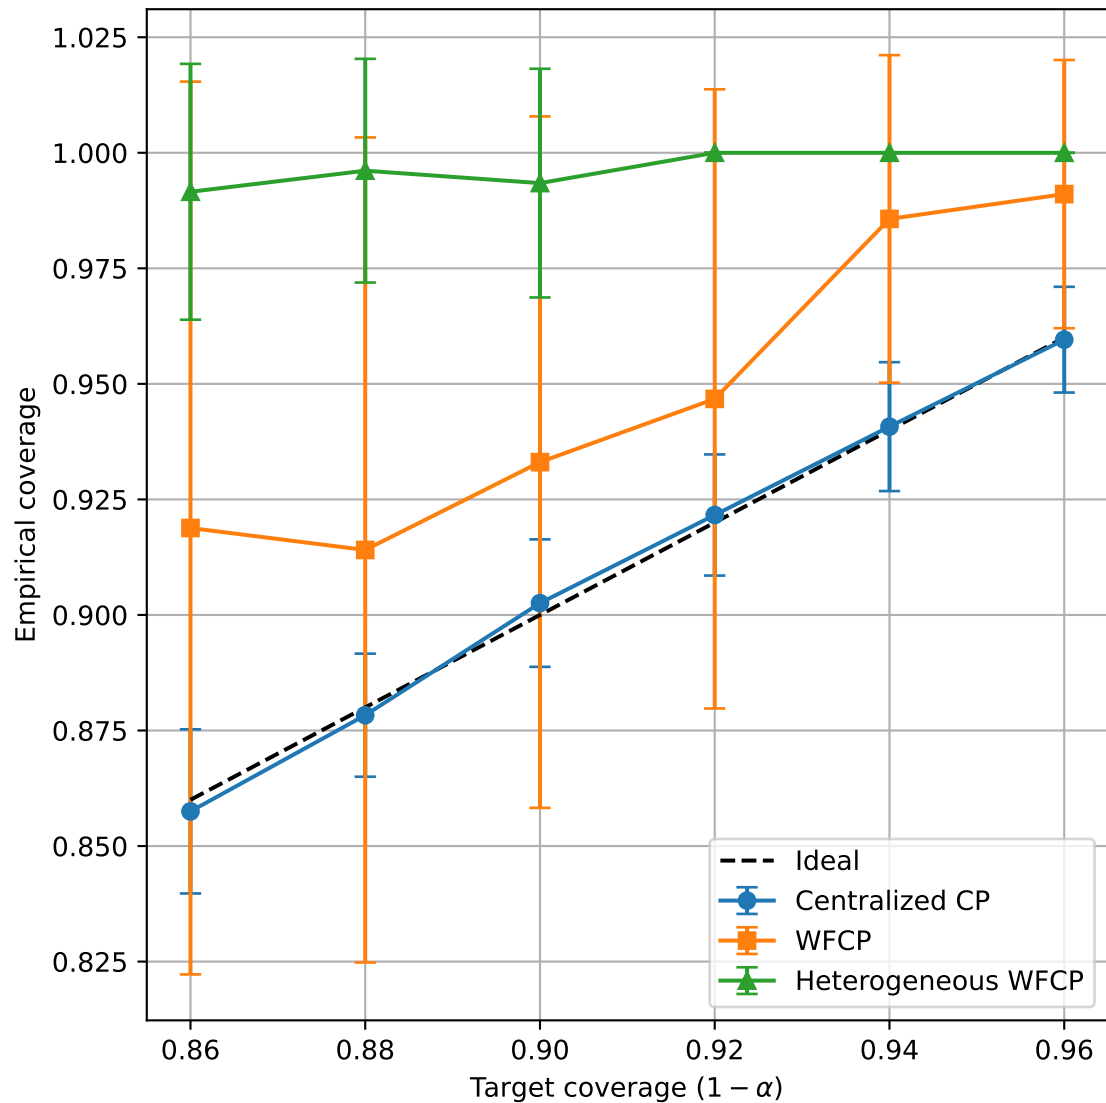

num\_trials = 40, num\_clients = 20, num\_bins = 20, num\_calib\_data = 4000, num\_valid\_data = 400, min\_gain = 1.0, noise\_ratio = 1.0, dirichlet\_alpha = 5.0