


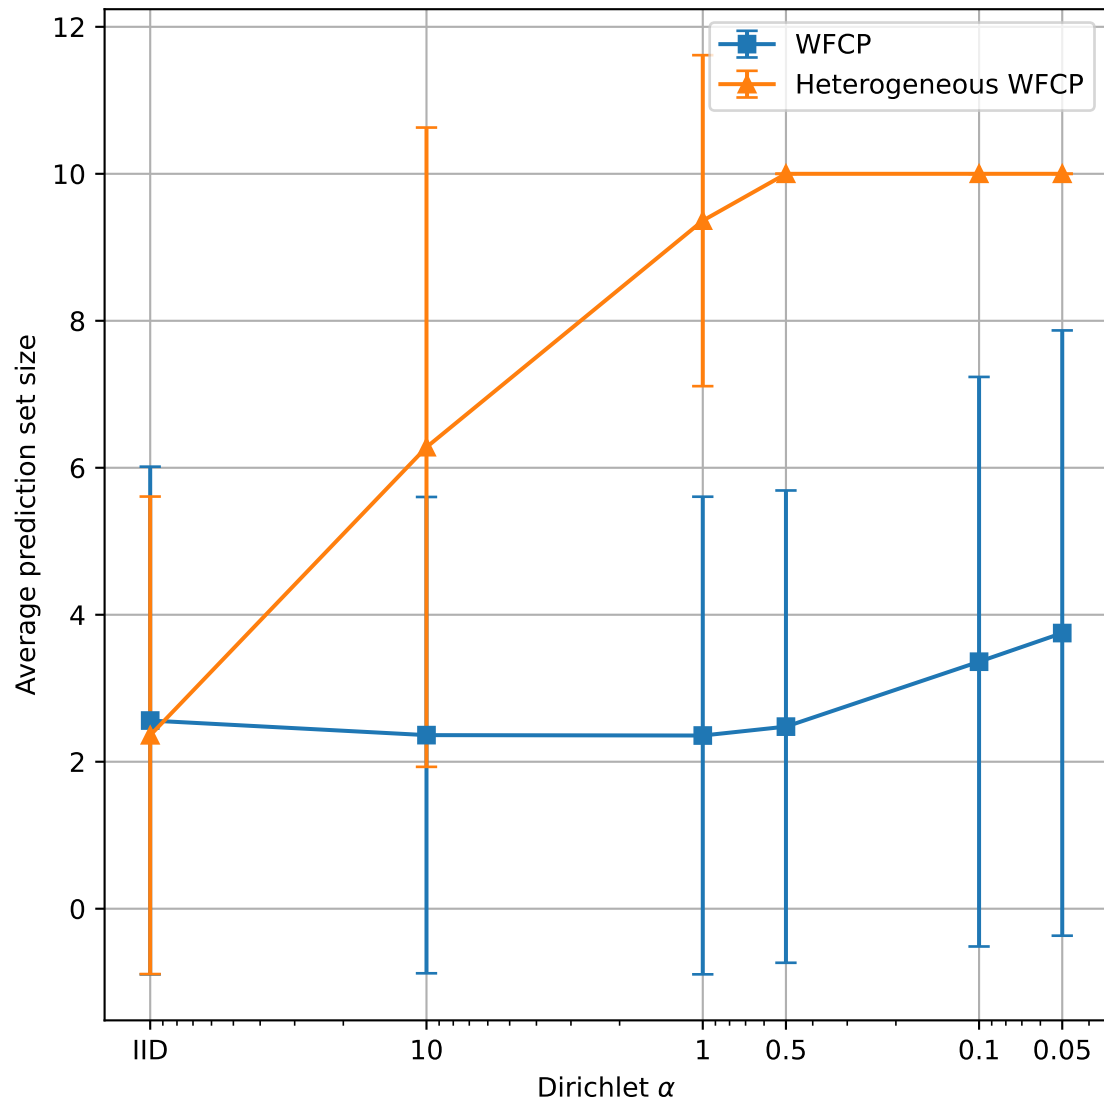

num_trials = 40, num_clients = 20, num_bins = 20, num_calib_data = 4000, num_valid_data = 400, min_gain = 1.0, noise_ratio = 1.0, alpha = 0.2