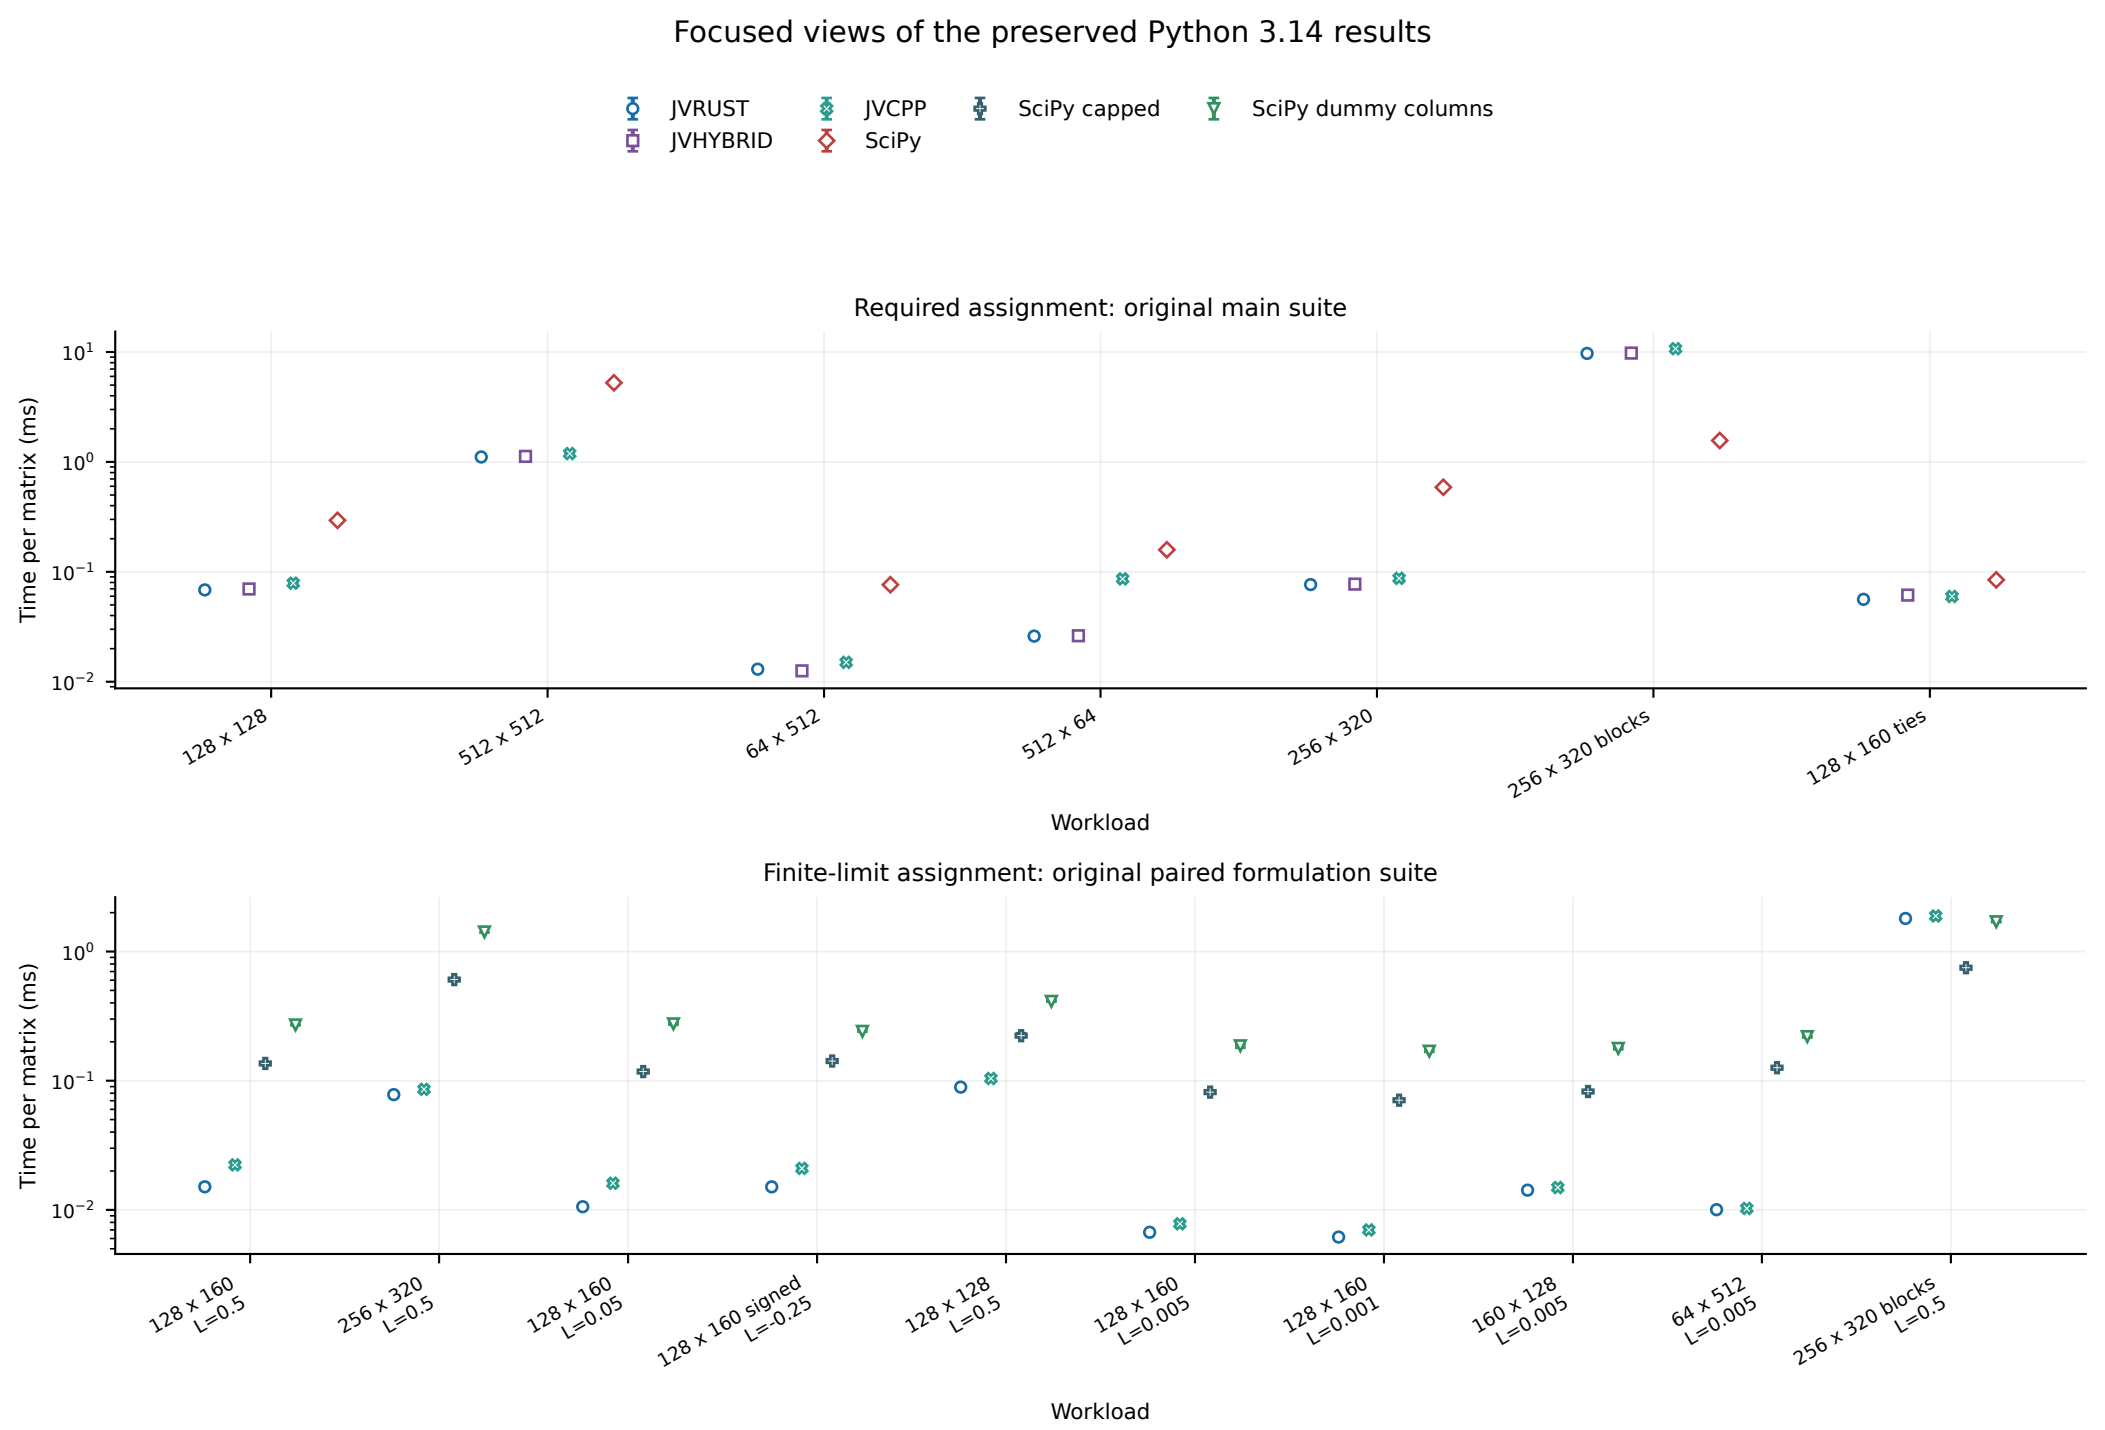

Original measurements retained unchanged; no timings combined across suites. Medians and timing-round IQRs.
The finite-limit panel uses capped and dummy-column SciPy from the paired formulation comparison. Congested cases are retained.