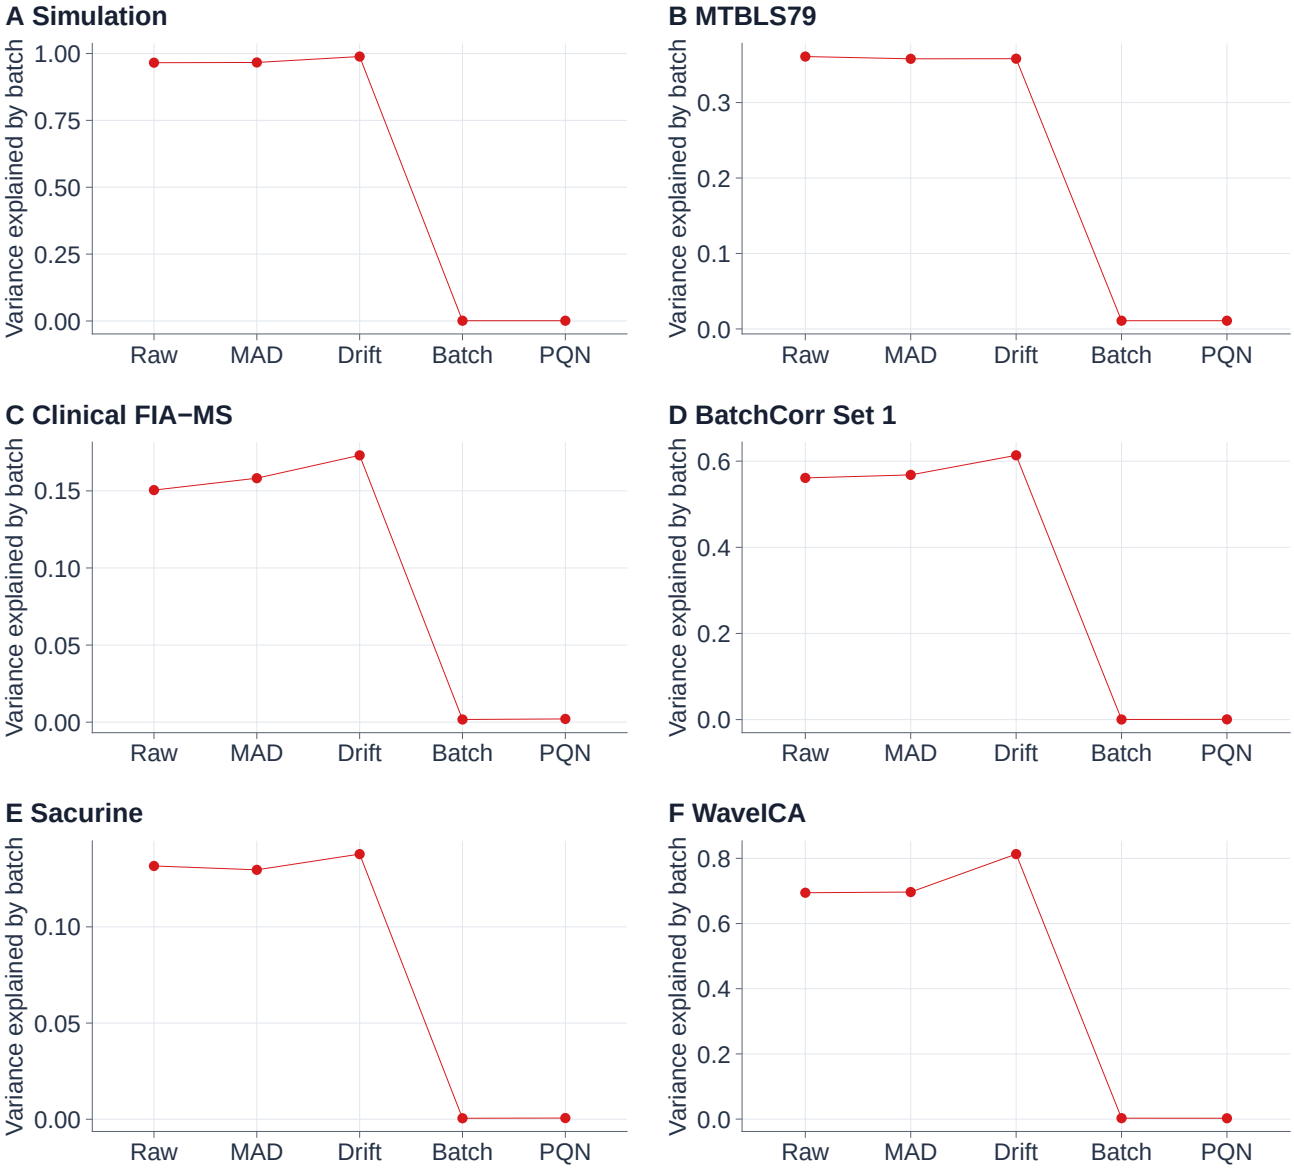
A Simulation
Variance explained by batch
1.00
0.75
0.50
0.25
0.00
Raw
MAD
Drift
Batch
PQN
B MTBLS79
Variance explained by batch
0.3
0.2
0.1
0.0
Raw
MAD
Drift
Batch
PQN
C Clinical FIA−MS
Variance explained by batch
0.15
0.10
0.05
0.00
Raw
MAD
Drift
Batch
PQN
D BatchCorr Set 1
Variance explained by batch
0.6
0.4
0.2
0.0
Raw
MAD
Drift
Batch
PQN
E Sacurine
Variance explained by batch
0.10
0.05
0.00
Raw
MAD
Drift
Batch
PQN
F WaveICA
Variance explained by batch
0.8
0.6
0.4
0.2
0.0
Raw
MAD
Drift
Batch
PQN