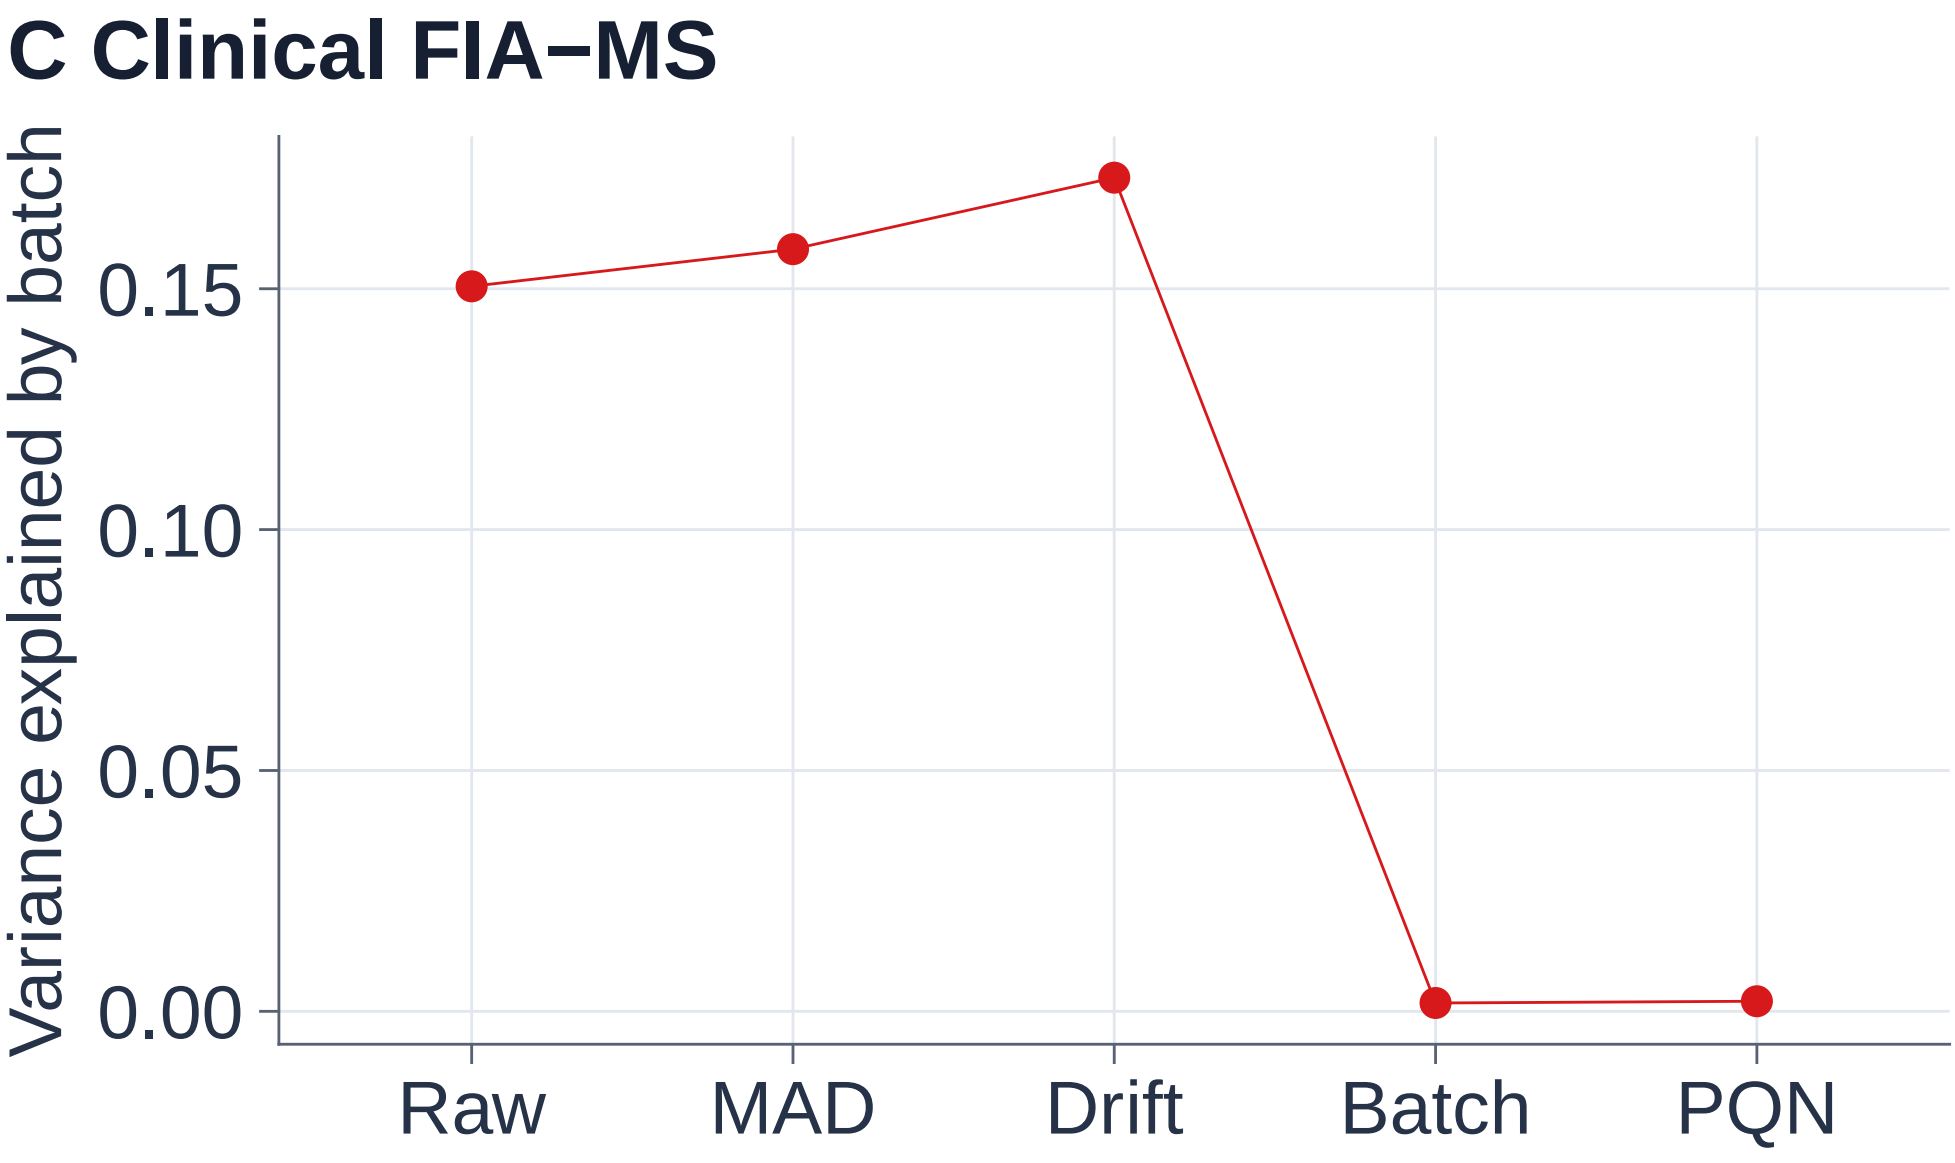
C Clinical FIA−MS
Variance explained by batch
0.15
0.10
0.05
0.00
Raw
MAD
Drift
Batch
PQN