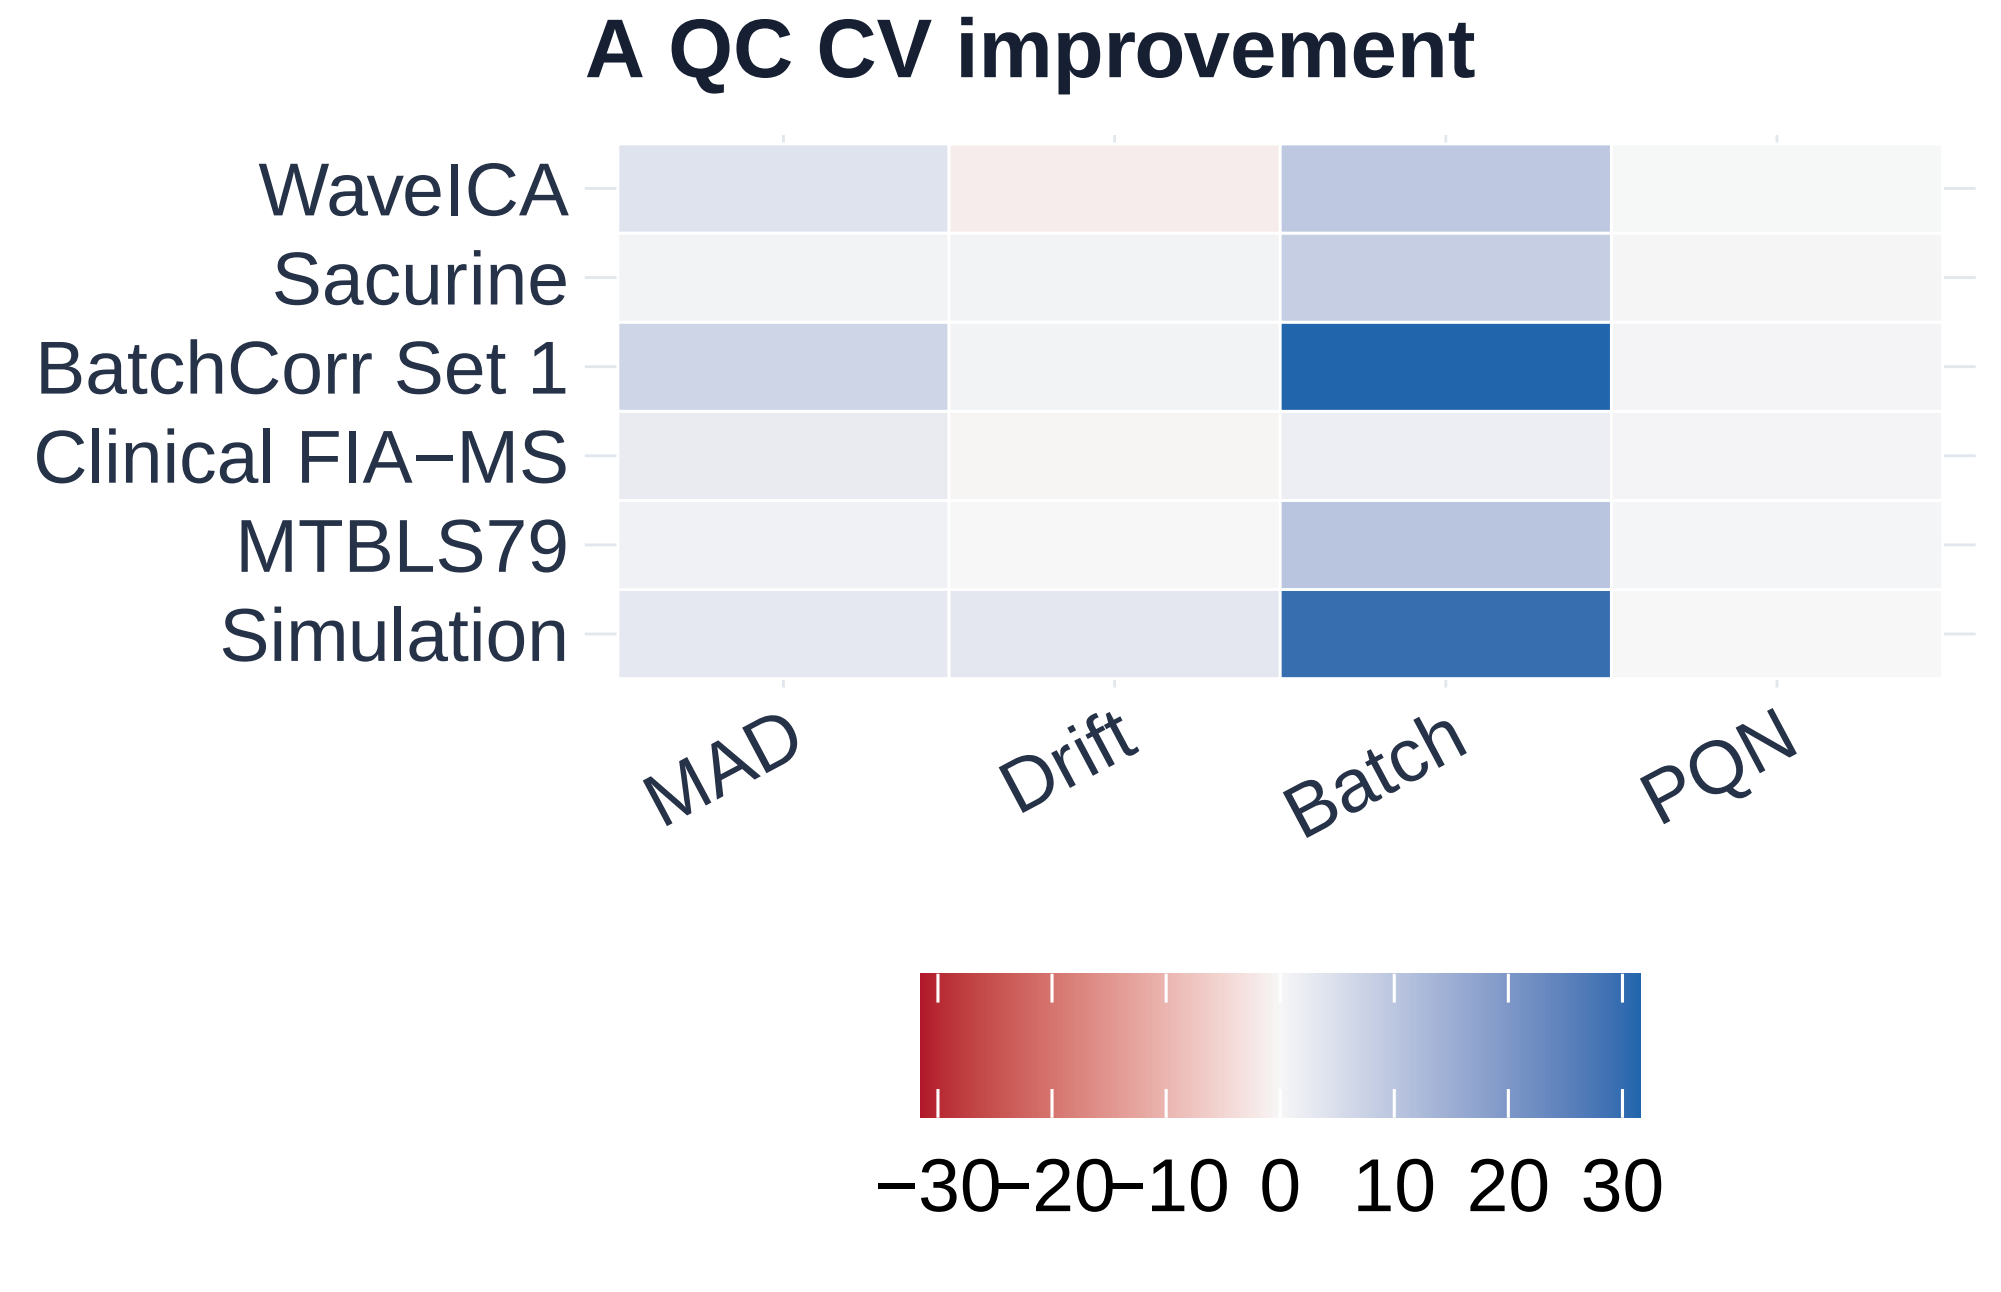
A QC CV improvement
WaveICA
Sacurine
BatchCorr Set 1
Clinical FIA−MS
MTBLS79
Simulation
MAD
Drift
Batch
PQN
−30
−20
−10
0
10
20
30