


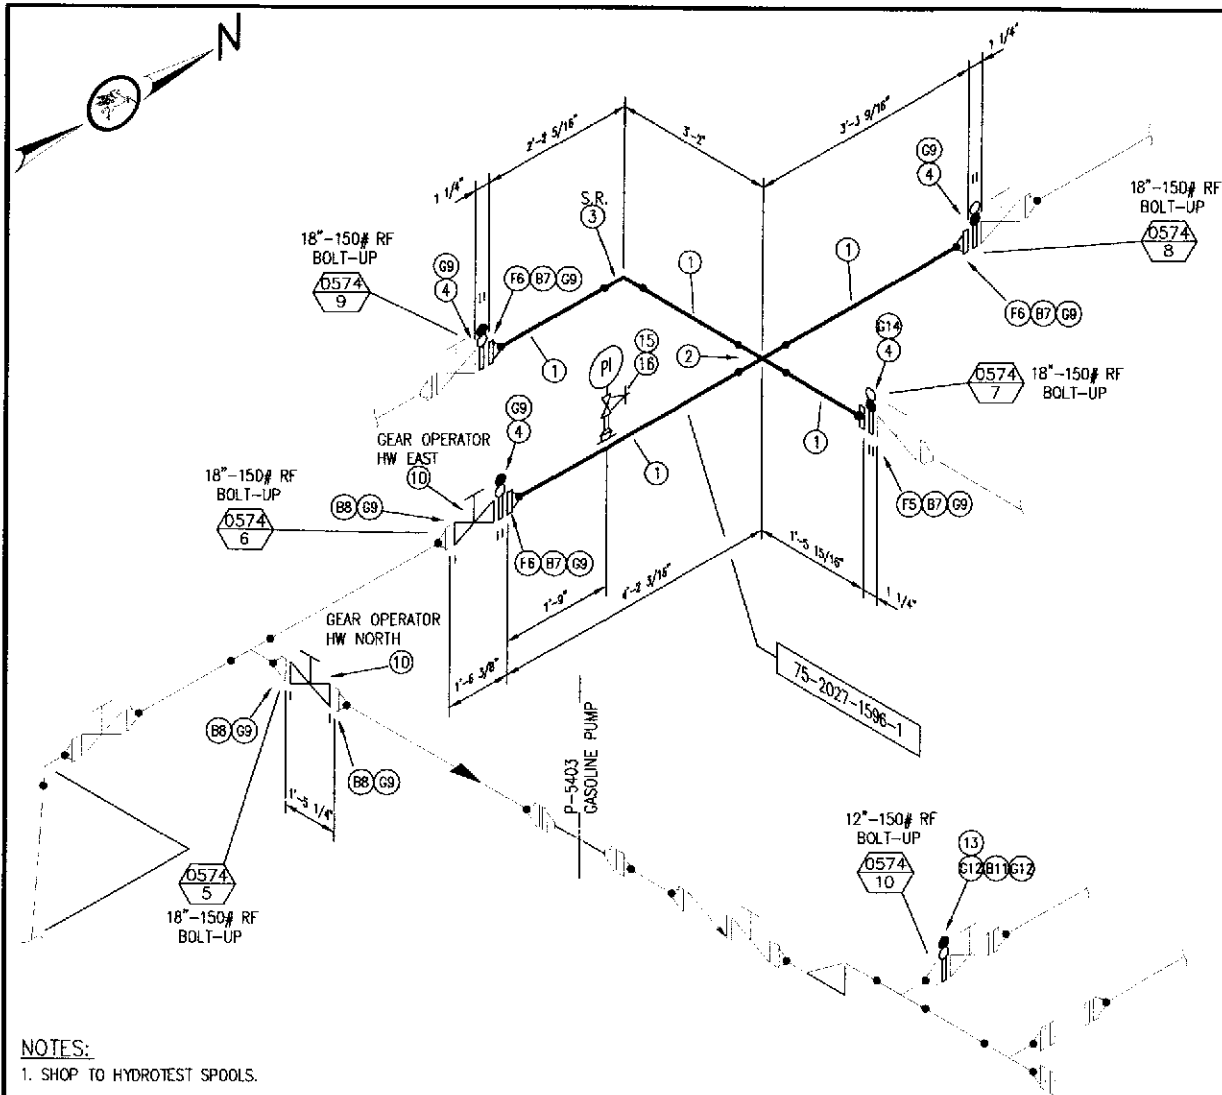

NOTES:

1. SHOP TO HYDROTEST SPOOLS.

NO.	REVISIONS	BY	CHK	APP	DATE	JOB#
						P031-23
						TEST PRESS. 428 PSIG
						OPER. PRESS.
						DES. PRESS. 285 PSIG
						DES. TEMP. 100° F
0	ISSUED FOR CONSTRUCTION	JCP	JAC	ES	7-20-23	
A	ISSUED FOR APPROVAL	JCP	JAC	ES	6-22-22	

OMCC/ETHYL PLANT
BEAUMONT REFINERY
REPLACE GATE VALVES AND
FIGURE 8 BLINDS AT GASOLINE PUMPS

PLAN
DWG. 3-2027-1000

FLOW
SHT. 3-2027-0574

BILL OF MATERIALS

ID	QTY	SHOP/FIELD	ND	DESCRIPTION
1	5'-10"	SHOP	18"	PIPE, CS, BE, ASTM A108 GRADE B, SMLS, SCH STD (PSA01)
2	1	SHOP	18"	CROSS, CS, BW, ASTM A234 GR. WPB, SMLS, SCH STD (PFA01)
3	1	SHOP	18"	ELL 90 SR, CS, ASTM A234 GR. WPB, SMLS, BW SCH STD (PFA01)
5	1	SHOP	18"	FLANGE, 150#, RF, SO, CS, ASTM A105 (FSA01)
6	3	SHOP	18"	FLANGE, 150#, RF, WN, CS, ASTM A105 SCH STD (FWA01)
15	1	FIELD	3/4"	WHTP PRESSURE GAUGE (RANGE= 0-300 PSIG)

ISSUED FOR


7-20-23

CONSTRUCTION

ExxonMobil

CHEMICAL, PETROLEUM & OTHER COMPANY
BEAUMONT, TEXAS

PROJ. ENG. EDGAR SOTO	DESIGNER. CASEY PRIDGEN	PMI N/A
NDE IN ACCORDANCE WITH GP 03-18-01 UNLESS NOTED	STRESS REL. N/A	HARDNESS TEST N/A
FLUID NORMAL	WELD PROCEDURE P-1	PAINT 1
MAIN SPEC. CLASS C1A-3	MAIN LINE SIZE 18"	INSUL. TYPE N/A
LINE NUMBER 77P-1670-18"-G1A-3-N	INSUL. TRACE N/A	INSUL. THK. N/A
	DWG NO. 3-2027-1595	REV. NO. 0

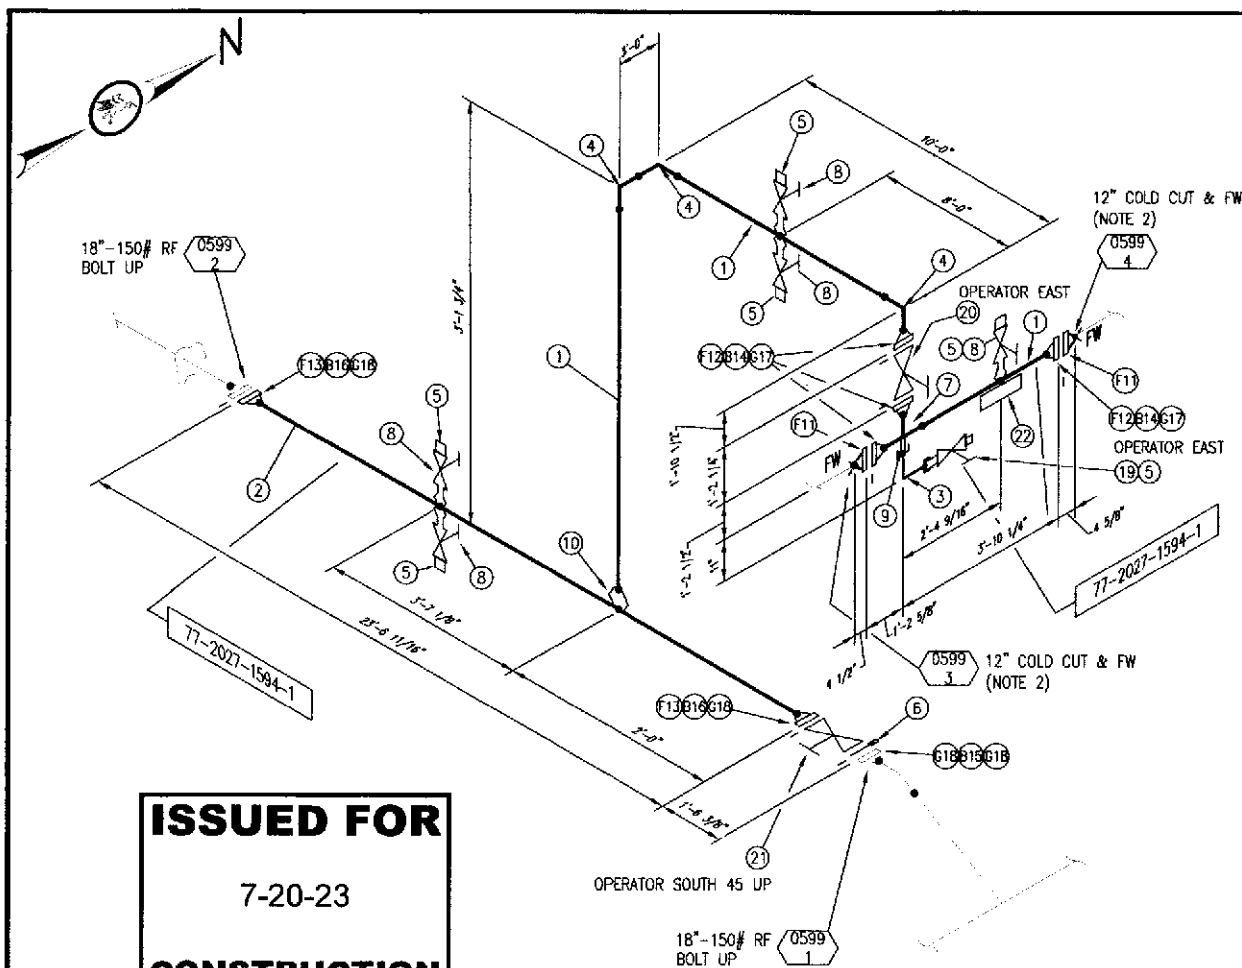

ISSUED FOR
7-20-23
CONSTRUCTION

NOTES:

1. SHOP TO HYDROTEST SPOOLS.
2. PT BASE, ROOT, FINAL WELD AND 100% X-RAY, UT/PA OR SHEARWAVE IN LIEU OF HYDRO.

NO.	REVISIONS	BY	CHK	APP	DATE
0	ISSUED FOR CONSTRUCTION	JCP	JAC	ES	7-20-23
A	ISSUED FOR APPROVAL	CB	JAC	ES	6-22-22

JOB# P031-23	OMCC/ETHYL PLANT BEAUMONT REFINERY JUMP OVER PIPING AT TK. 1212 ADD BLOCK VALVE AND BLINDS
TEST PRESS. 428 PSIG	PLAN DWG. 3-2027-1000
OPER. PRESS.	FLOW SHT. 3-2027-0599
OPER. TEMP.	
DES. PRESS. 285 PSIG	
DES. TEMP. 100F	

BILL OF MATERIALS				
ID	QTY	SHOP/FIELD	WD	DESCRIPTION
1	10'-3"	SHOP	12"	PIPE, CS, BE, ASTM A106 GRADE B, SMLS, SCH STD (PSA01)
2	22'-8"	SHOP	18"	PIPE, CS, BE, ASTM A106 GRADE B, SMLS, SCH STD (PSA01)
3	1	SHOP	1"	ELI 90, 6000#, SW, CS, ASTM A105, (PFA02)
4	3	SHOP	12"	ELI 90 LR, CS, ASTM A234 GR. WPB, SMLS, BW SCH STD (PFA01)
5	8	FIELD	1"	SOLID STEEL ROUND PLUG SCRD CS, ASTM A105 (PFA01)
6	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
7	1	SHOP	12"	TEE, CS, ASTM A234 WPB, SMLS, SCH STD (PFA01)
8	1	SHOP	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
9	1	SHOP	12"x1"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
10	1	SHOP	18"x12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
11	2	FIELD	12"	FLANGE, 150#, RF, WIG, CS, ASTM A105 SCH STD (PFA01)
12	4	SHOP	12"	FLANGE, 150#, RF, WIG, CS, ASTM A105 SCH STD (PFA01)
13	2	SHOP	18"	FLANGE, 150#, RF, WIG, CS, ASTM A105 SCH STD (PFA01)
14	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
15	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
16	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
17	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
18	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
19	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
20	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
21	1	FIELD	12"	WELD COUPLER, 150 LB, WIG, CS, SCH STD (PFA01)
22	1	SHOP	12"	PIPE SHOE PER BRS-1073-3 (2" HIGH)

ExxonMobil

CHEMICAL PROCESSING & SUPPLY COMPANY
BEAUMONT, TEXAS

PROJ. ENG. EDGAR SOTO	DESIGNER: CALLAN BURGESS	PMI N/A
NDE IN ACCORDANCE WITH CP 03-18-01 UNLESS NOTED	STRESS REL. N/A	HARDNESS TEST N/A
FLUID NORMAL	WELD PROCEDURE P1	PAINT 1
MAIN SPEC. CLASS G1A-3	MAIN LINE SIZE 12"	INSUL. TYPE N/A
LINE NUMBER 077P-1670-18"-G1A-3-N	INSUL. TRACE N/A	INSUL. THK. N/A
	DWG. NO. 3-2027-1594	REV. No. 0