

Frozen batch 2 model → batch 3 training; diagnostic only
Recorded versus saved passive ODE — not MuJoCo
Saved admission: rejected; no refit or model promotion


release-01: 0.5s forecasts; RMS 1.64°

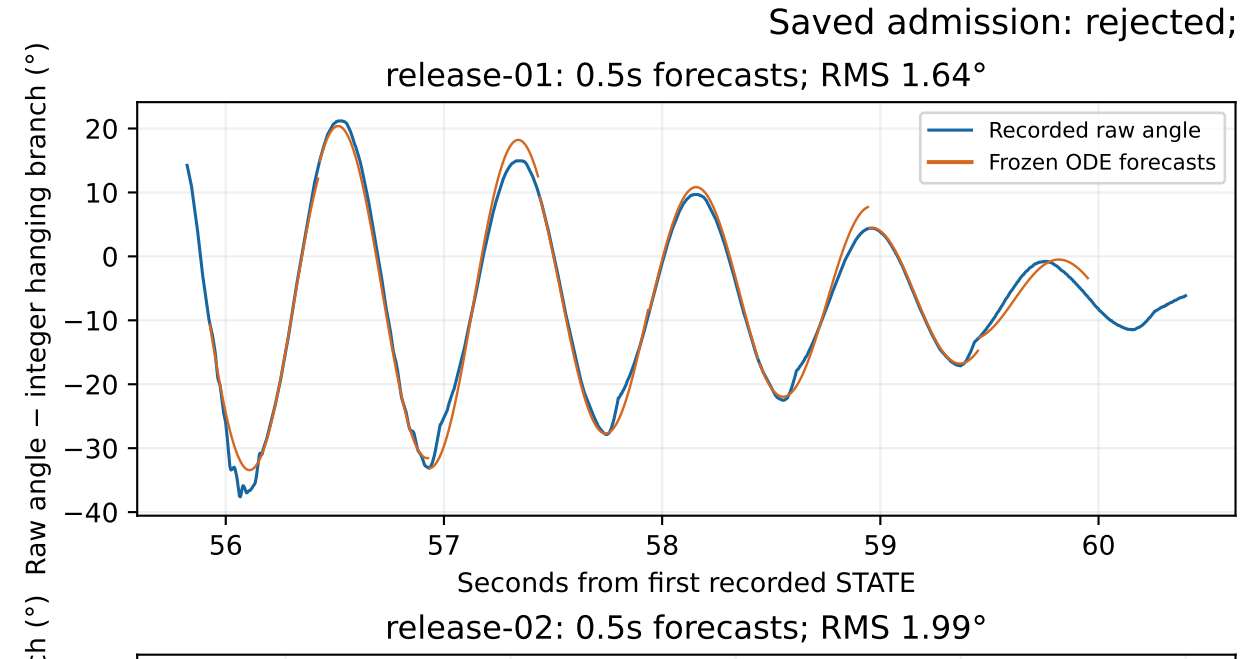


Continuous within each segment; RMS 3.43°

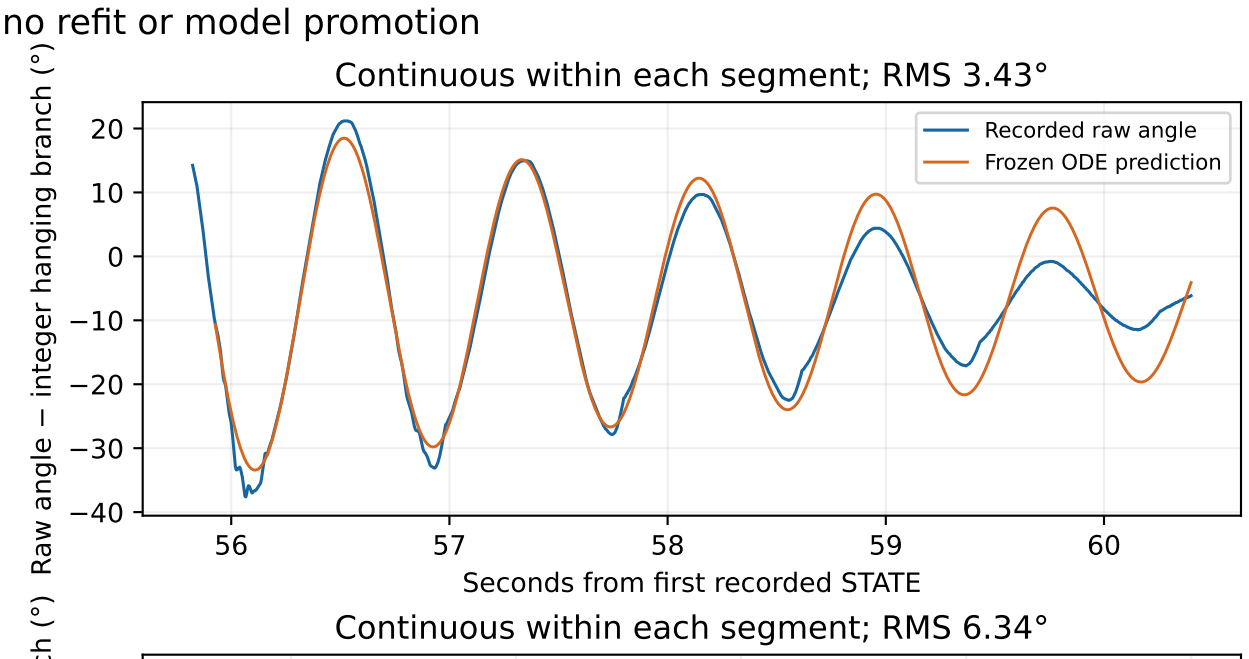


release-02: 0.5s forecasts; RMS 1.99°

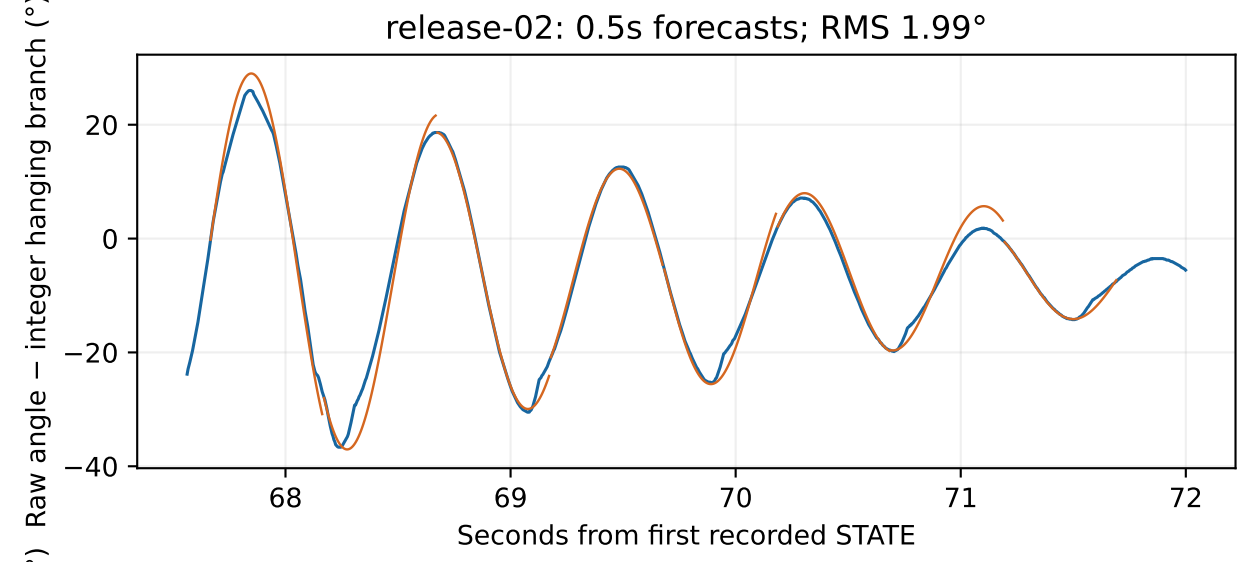


Continuous within each segment; RMS 6.34°

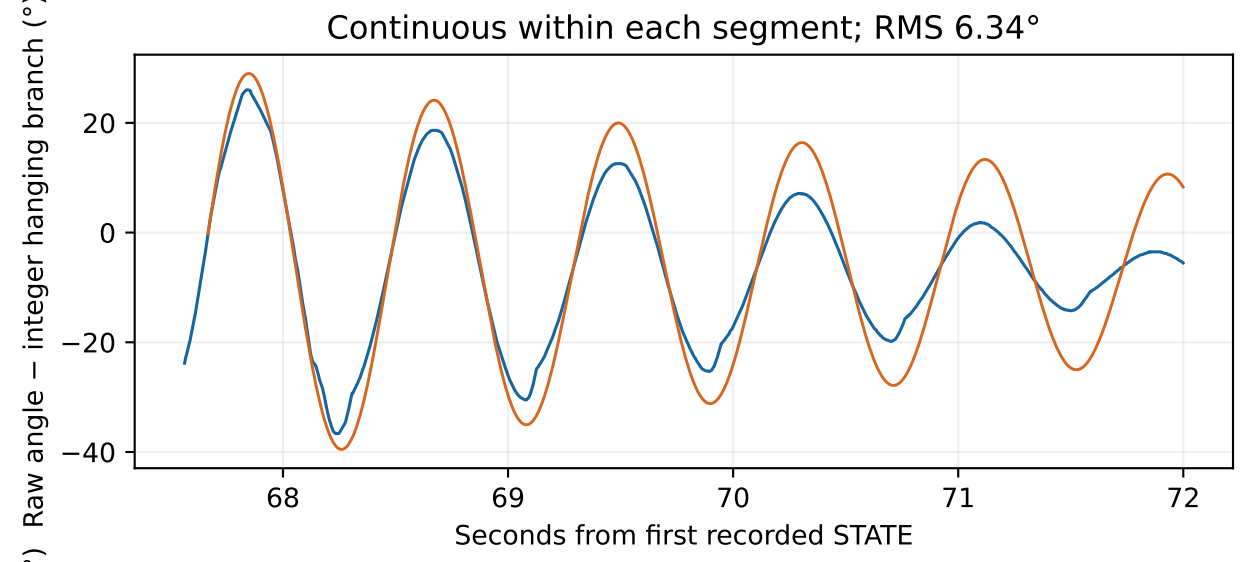


release-03: 0.5s forecasts; RMS 4.86°

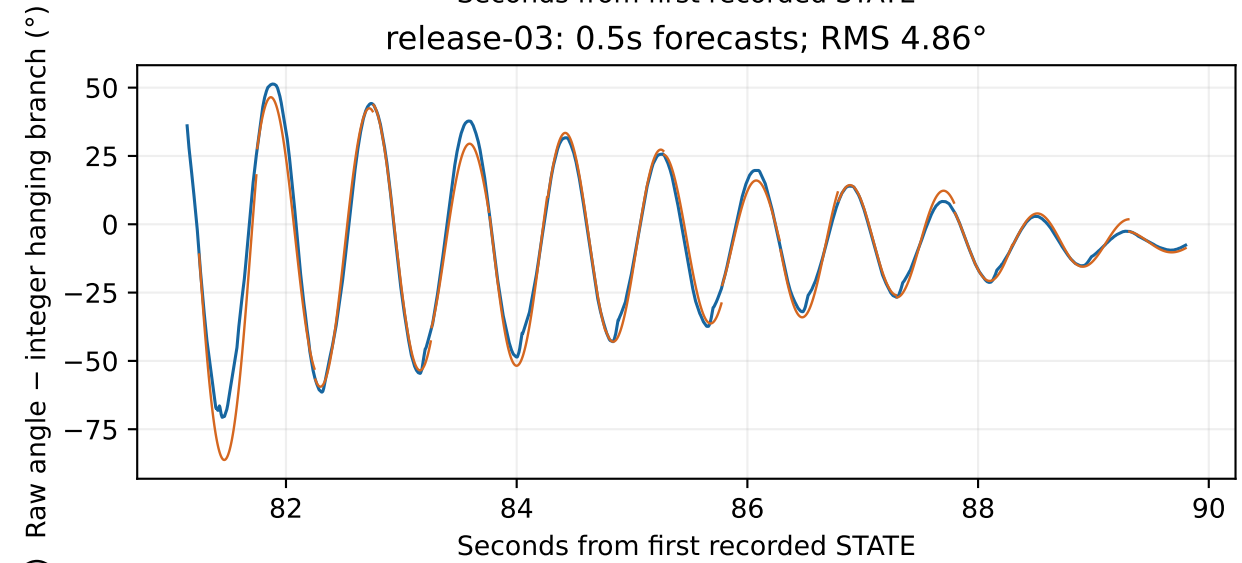


Continuous within each segment; RMS 16.78°

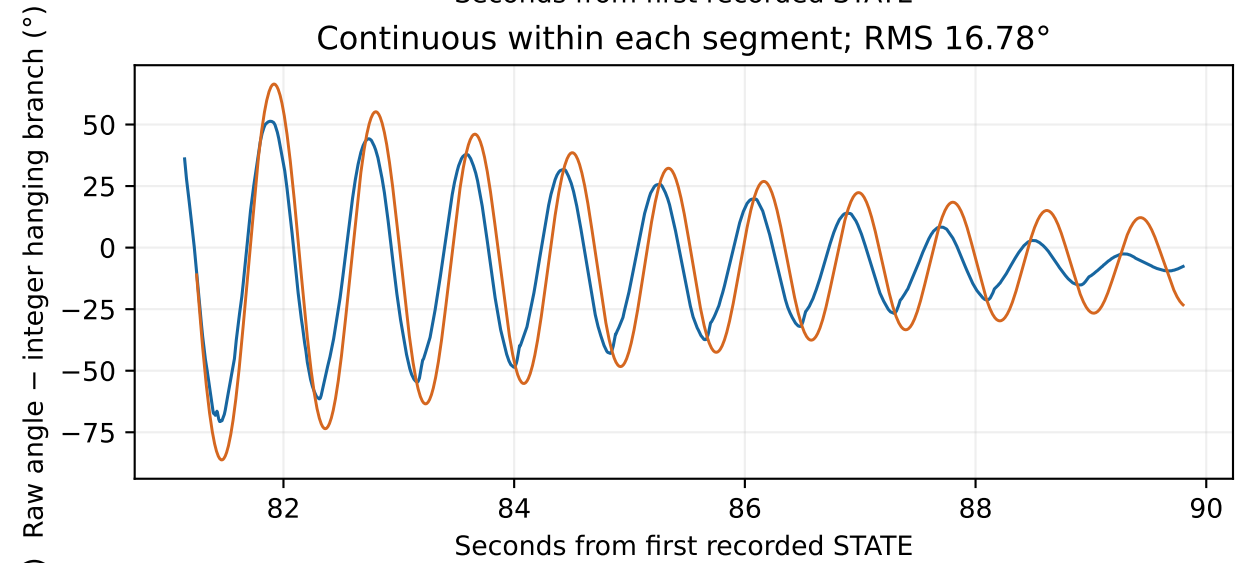


release-04: 0.5s forecasts; RMS 5.54°

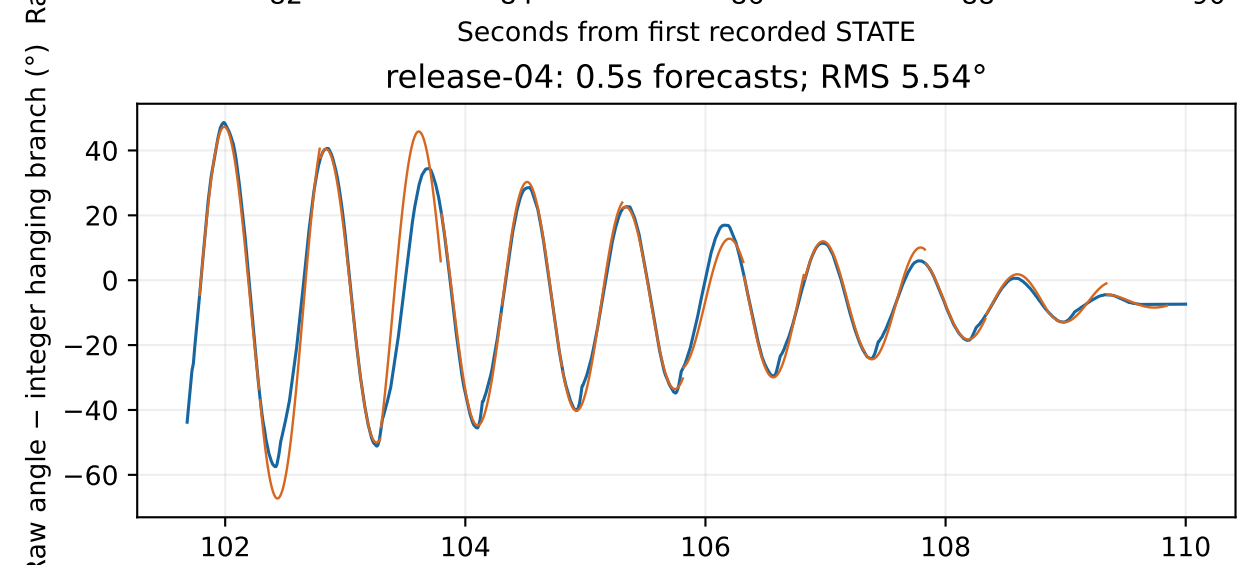


Continuous within each segment; RMS 4.34°

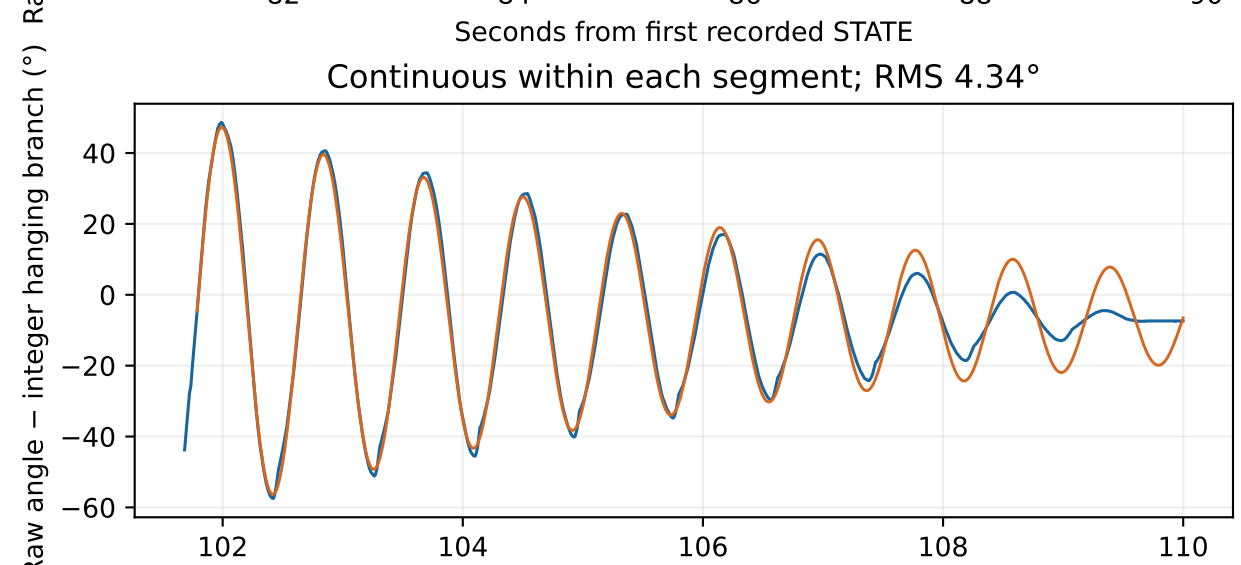


release-05: 0.5s forecasts; RMS 6.30°

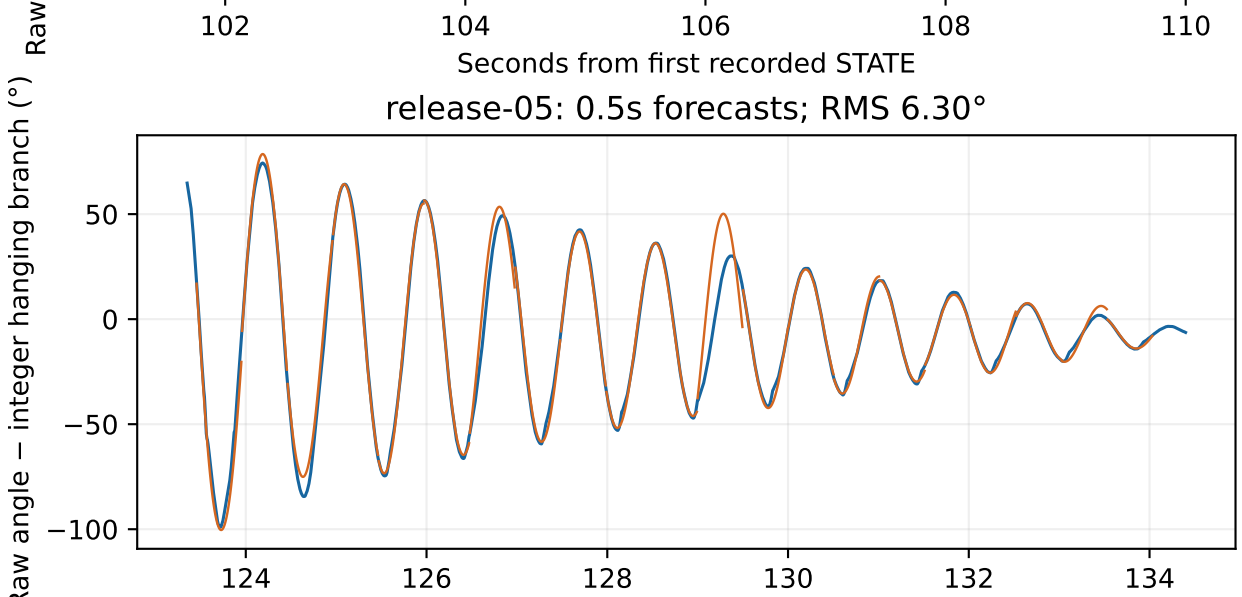

Continuous within each segment; RMS 5.39°

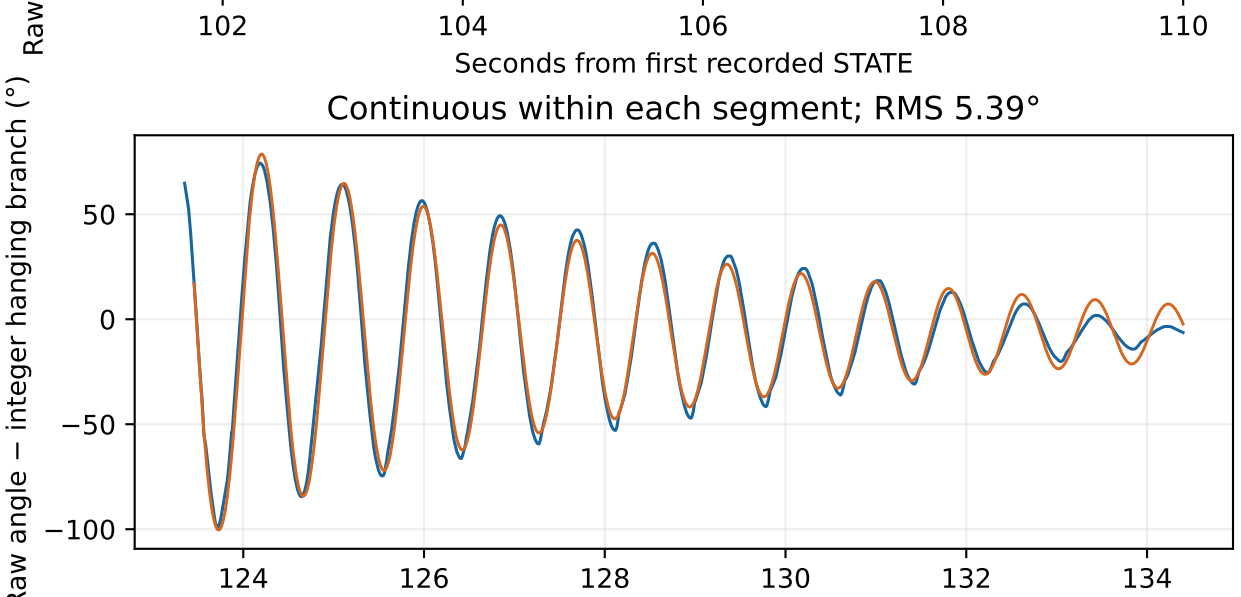

release-06: 0.5s forecasts; RMS 5.02°

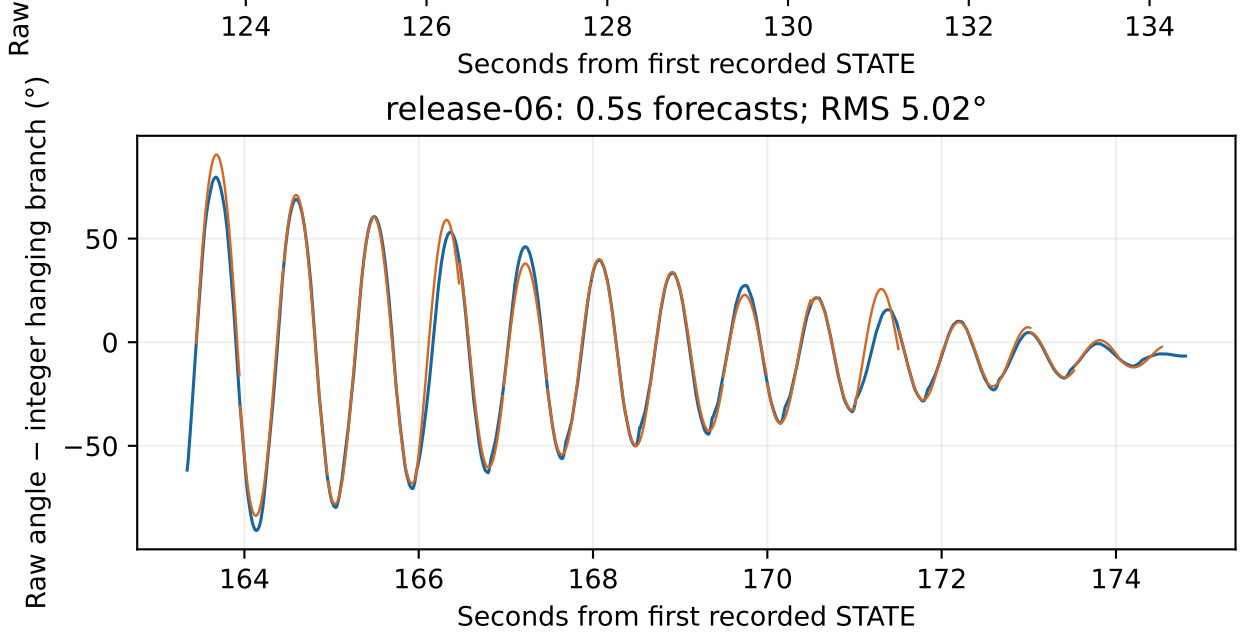

Continuous within each segment; RMS 7.47°

