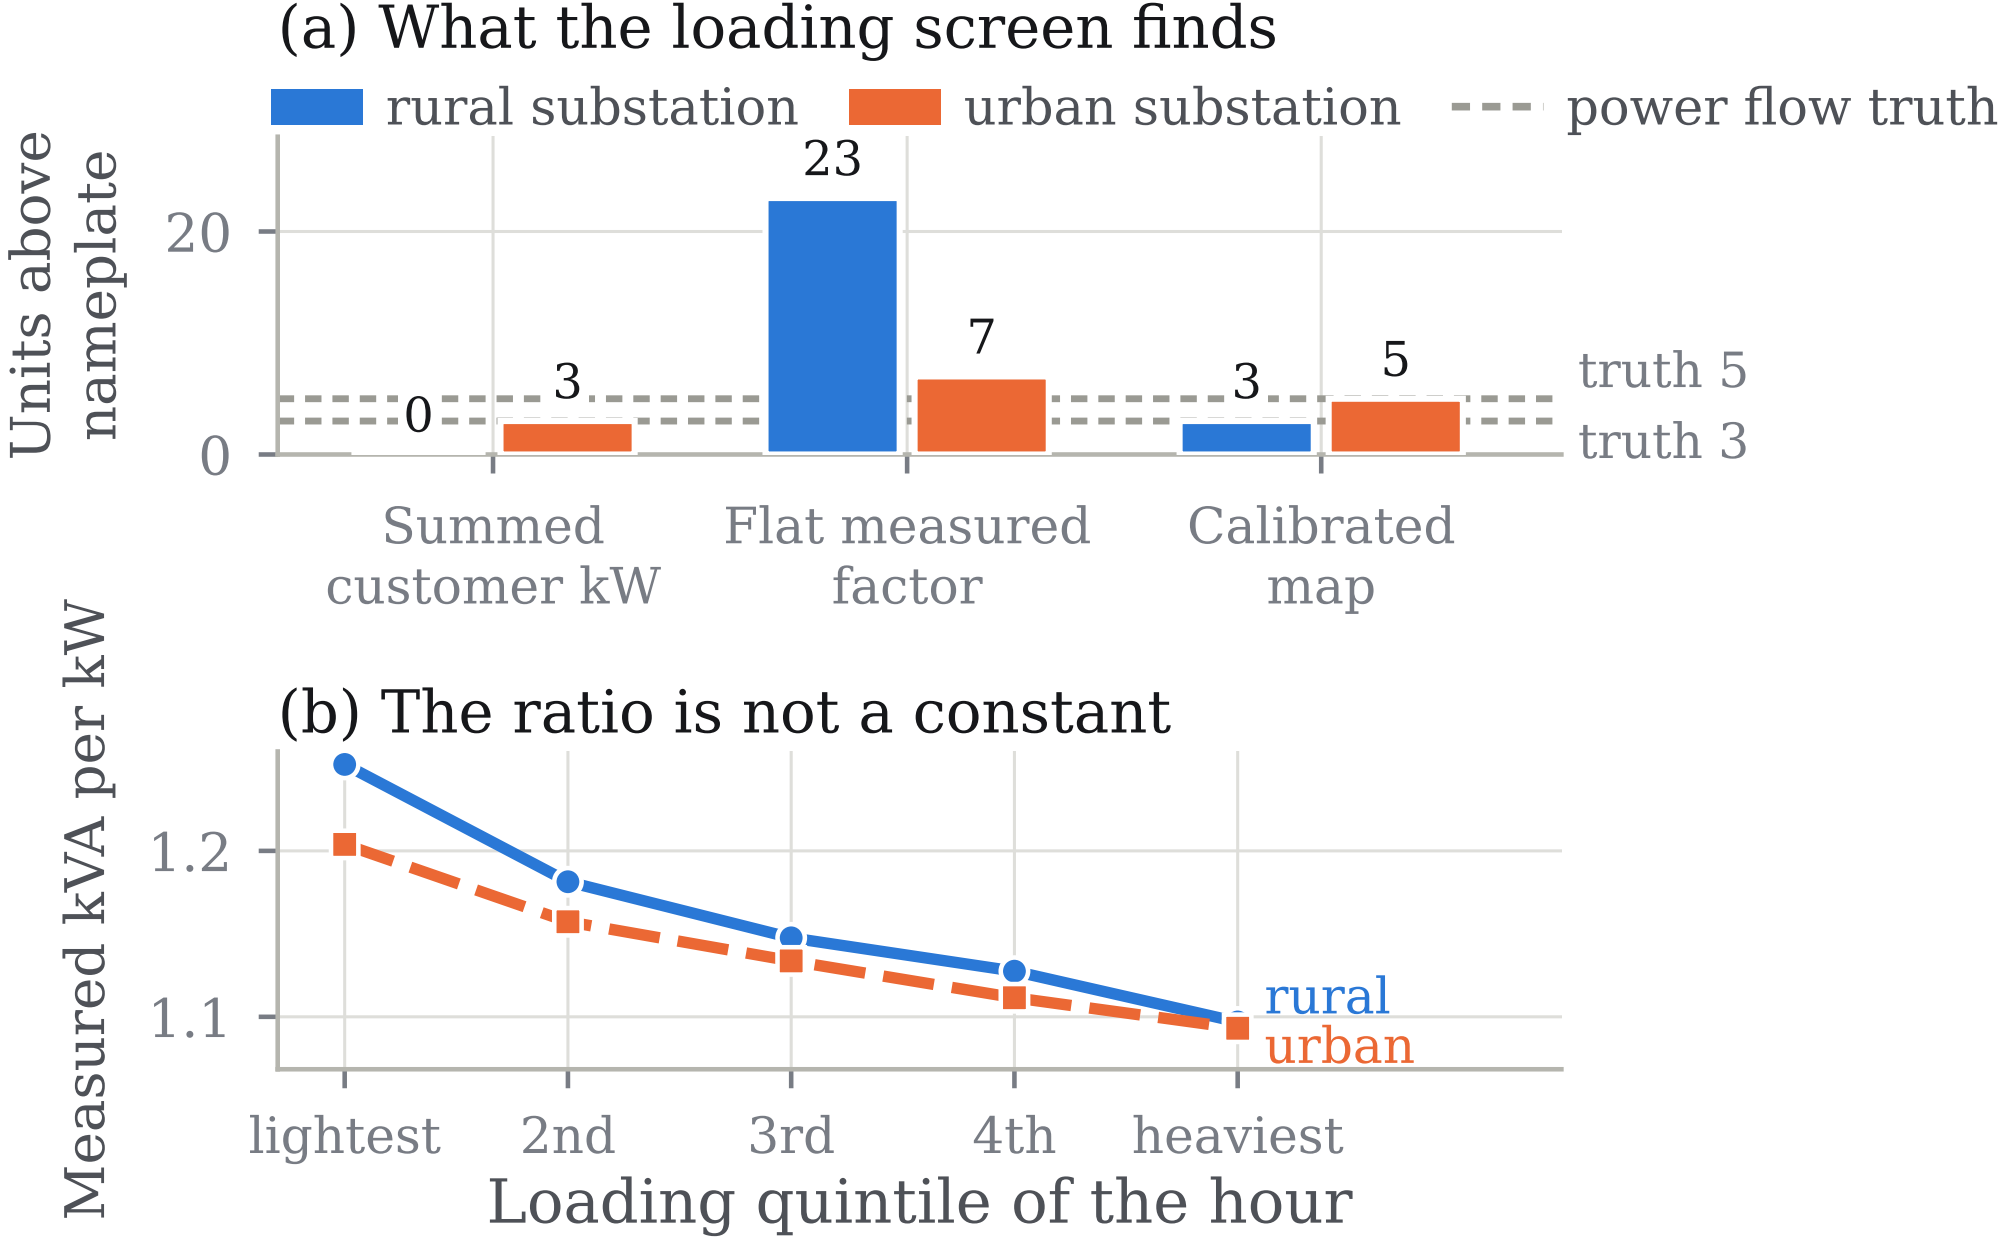
(a) What the loading screen finds
rural substation
urban substation
power flow truth
Units above nameplate
20
0
0
3
23
7
3
5
truth 5
truth 3
Summed customer kW
Flat measured factor
Calibrated map
(b) The ratio is not a constant
Measured kVA per kW
1.2
1.1
rural
urban
lightest
2nd
3rd
4th
heaviest
Loading quintile of the hour