RECEIVED
By William L. Pinnix, P.E. at 9:07 am, Aug 19, 2016

Calabash Lakes
Asbuilt from Randy Ward, PLS
August 19, 2016

Brunswick County Engineering Department

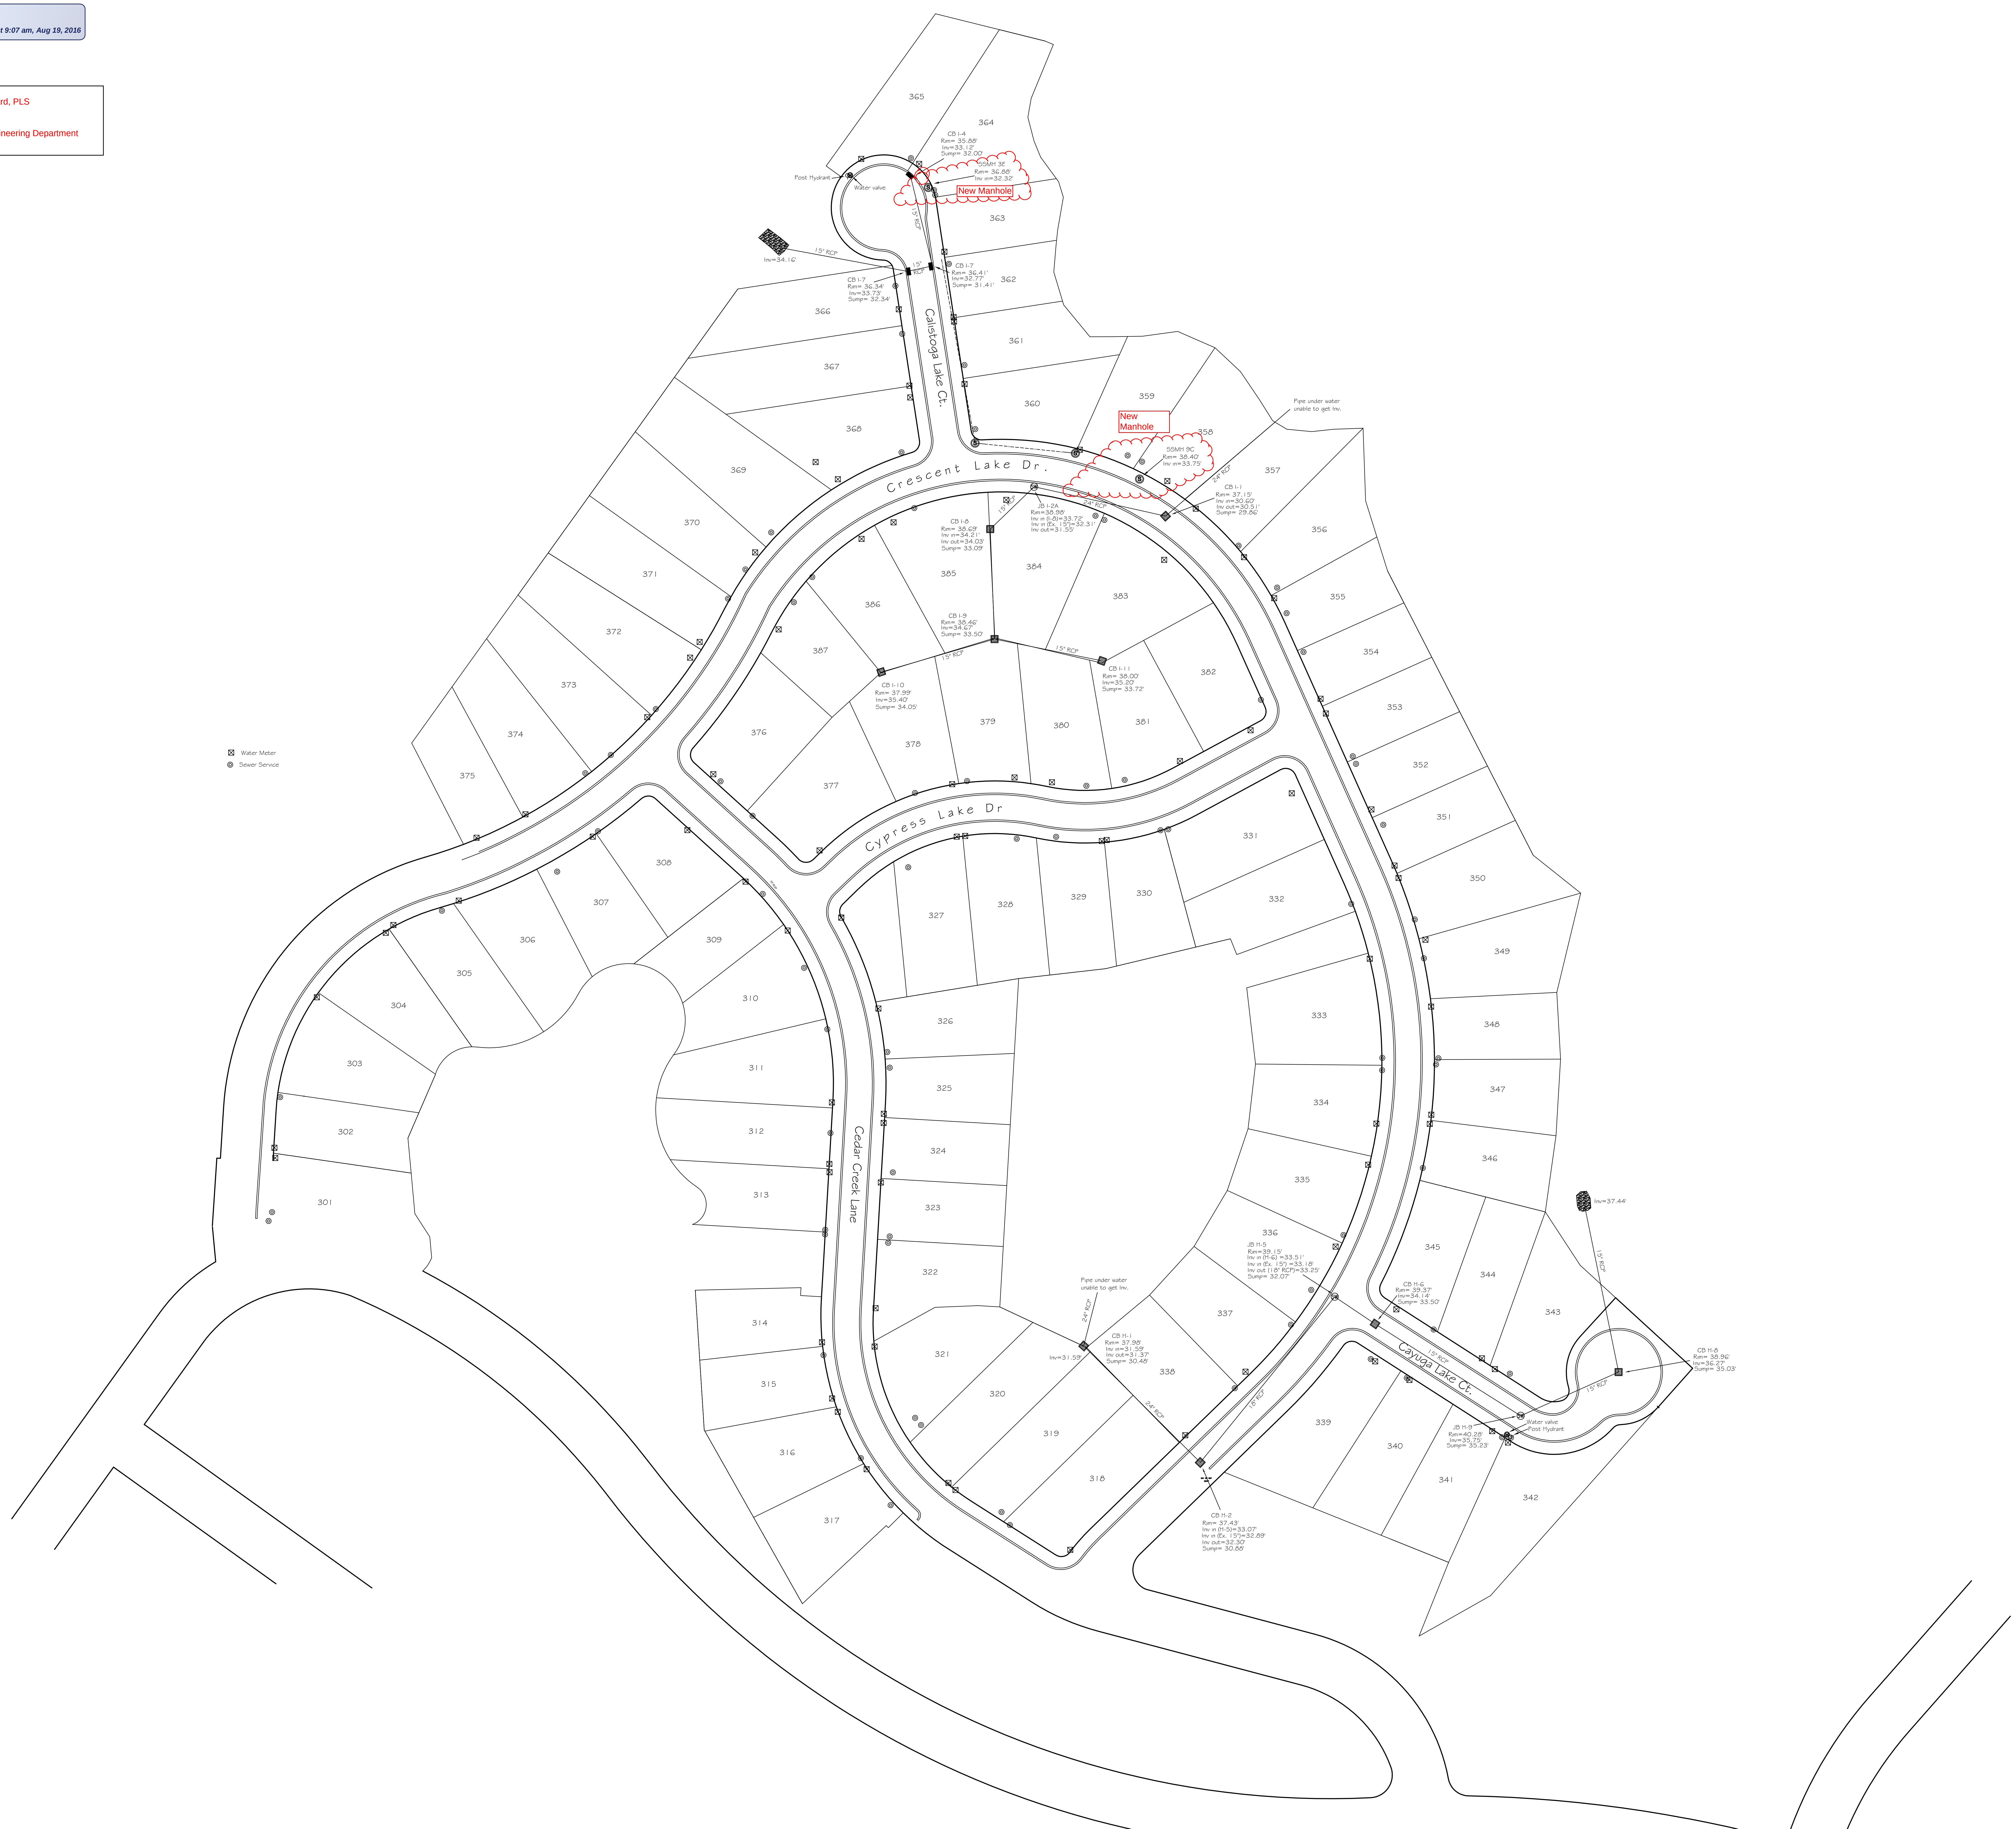

⊠ Water Meter
◎ Sewer Service
Crescent Lake Dr.
Calistoga Lake Ct.
Cypress Lake Dr
Cedar Creek Lane
Cayuga Lake Ct.
Post Hydrant
Water valve
CB I-4
Rim= 35.88'
Inv=33.12'
Sump= 32.00'
SSMH 3E
Rim= 36.88'
Inv in=32.32'
New Manhole
15" RCP
Inv=34.16'
CB I-7
Rim= 36.34'
Inv=33.73'
Sump= 32.34'
CB I-7
Rim= 36.41'
Inv=32.77'
Sump= 31.41'
New Manhole
SSMH 9C
Rim= 38.40'
Inv in=33.75'
Pipe under water unable to get Inv.
24" RCP
CB I-1
Rim= 37.15'
Inv in=30.60'
Inv out=30.51'
Sump= 29.86'
JB I-2A
Rim=38.98'
Inv in (I-8)=33.72'
Inv in (Ex. 15")=32.31'
Inv out=31.55'
CB I-8
Rim= 38.69'
Inv in=34.21'
Inv out=34.03'
Sump= 33.09'
CB I-9
Rim= 38.46'
Inv=34.67'
Sump= 33.50'
CB I-10
Rim= 37.99'
Inv=35.40'
Sump= 34.05'
CB I-11
Rim= 38.00'
Inv=35.20'
Sump= 33.72'
JB H-5
Rim=39.15'
Inv in (H-6) =33.51'
Inv in (Ex. 15") =33.18'
Inv out (18" RCP)=33.25'
Sump= 32.07'
Pipe under water unable to get Inv.
CB H-1
Rim= 37.98'
Inv in=31.59'
Inv out=31.37'
Sump= 30.48'
Inv=31.59'
18" RCP
CB H-2
Rim= 37.43'
Inv in (H-5)=33.07'
Inv in (Ex. 15")=32.89'
Inv out=32.30'
Sump= 30.88'
CB H-6
Rim= 39.37'
Inv=34.14'
Sump= 33.50'
Inv=37.44'
CB H-8
Rim= 38.96'
Inv=36.27'
Sump= 35.03'
JB H-9
Rim=40.28'
Inv=35.75'
Sump= 35.23'
Water valve
Post Hydrant
301 302 303 304 305 306 307 308 309 310 311 312 313 314 315 316 317 318 319 320 321 322 323 324 325 326 327 328 329 330 331 332 333 334 335 336 337 338 339 340 341 342 343 344 345 346 347 348 349 350 351 352 353 354 355 356 357 358 359 360 361 362 363 364 365 366 367 368 369 370 371 372 373 374 375 376 377 378 379 380 381 382 383 384 385 386 387