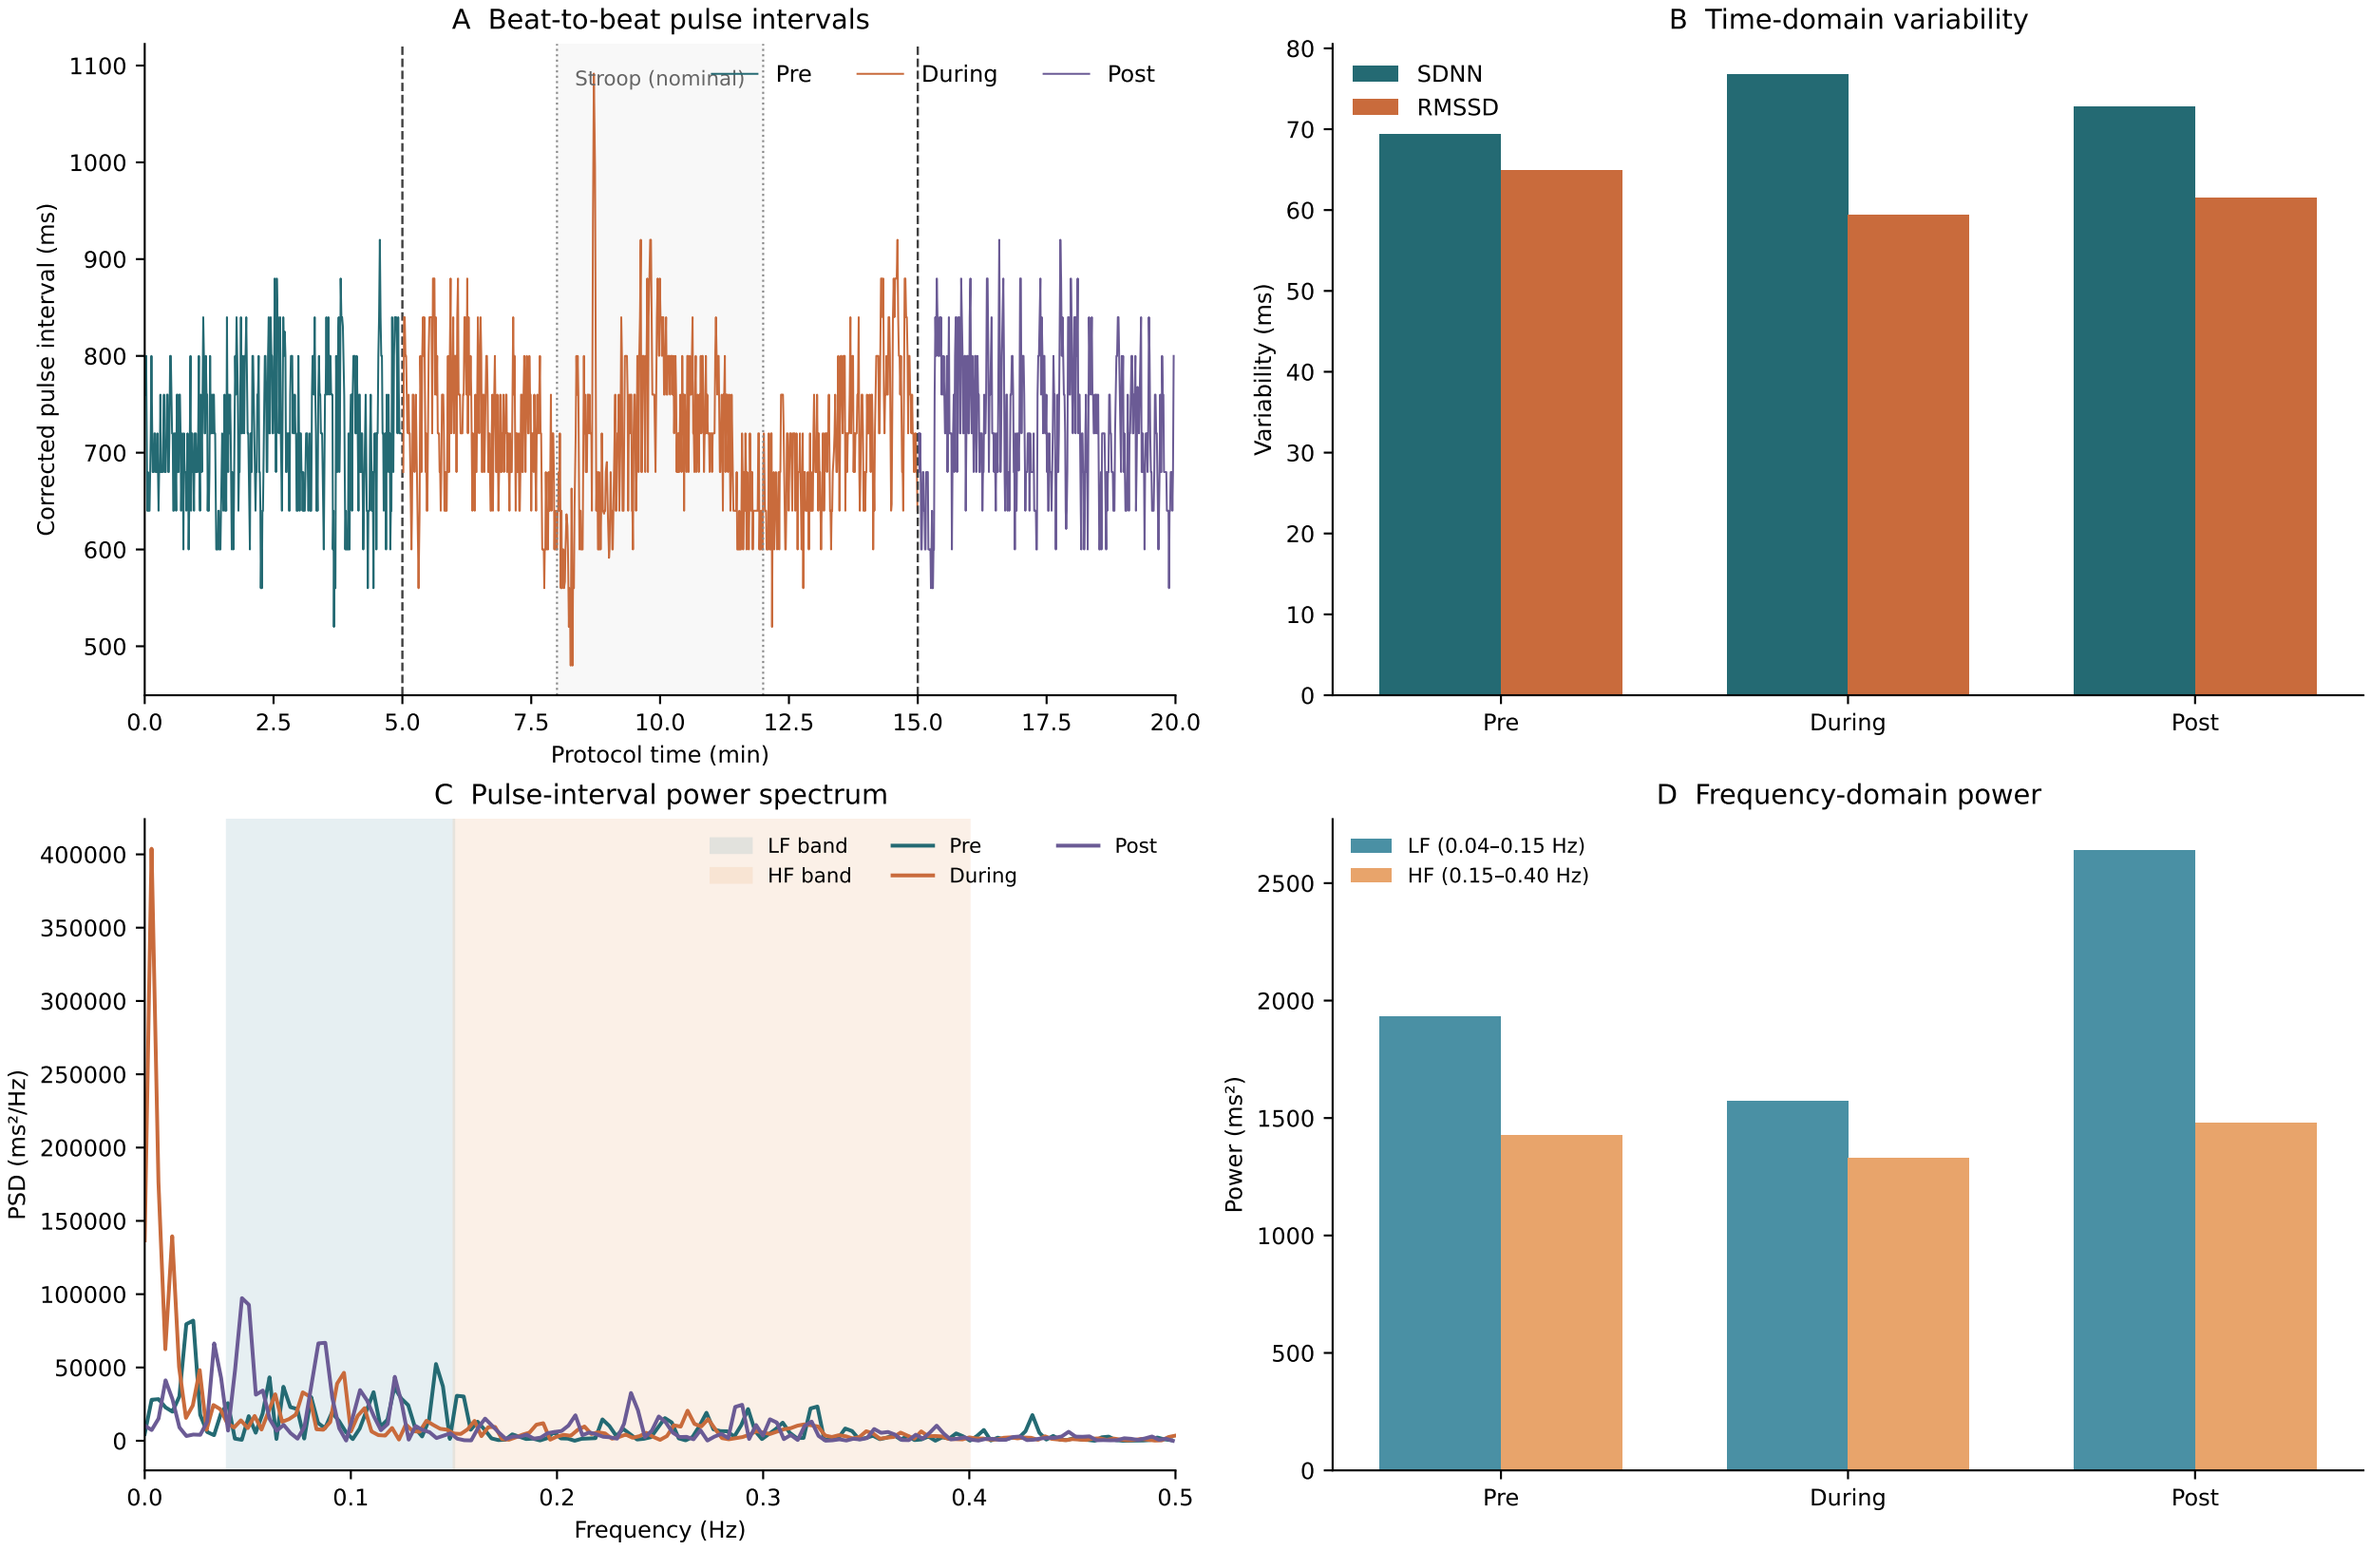
A Beat-to-beat pulse intervals
Stroop (nominal)
Pre
During
Post
Corrected pulse interval (ms)
Protocol time (min)
B Time-domain variability
SDNN
RMSSD
Variability (ms)
Pre
During
Post
C Pulse-interval power spectrum
LF band
HF band
Pre
During
Post
PSD (ms²/Hz)
Frequency (Hz)
D Frequency-domain power
LF (0.04–0.15 Hz)
HF (0.15–0.40 Hz)
Power (ms²)
Pre
During
Post