



A. Subgroup Consistency Audit

Hazard Ratio (Cluster 2 vs Cluster 1) is Robust

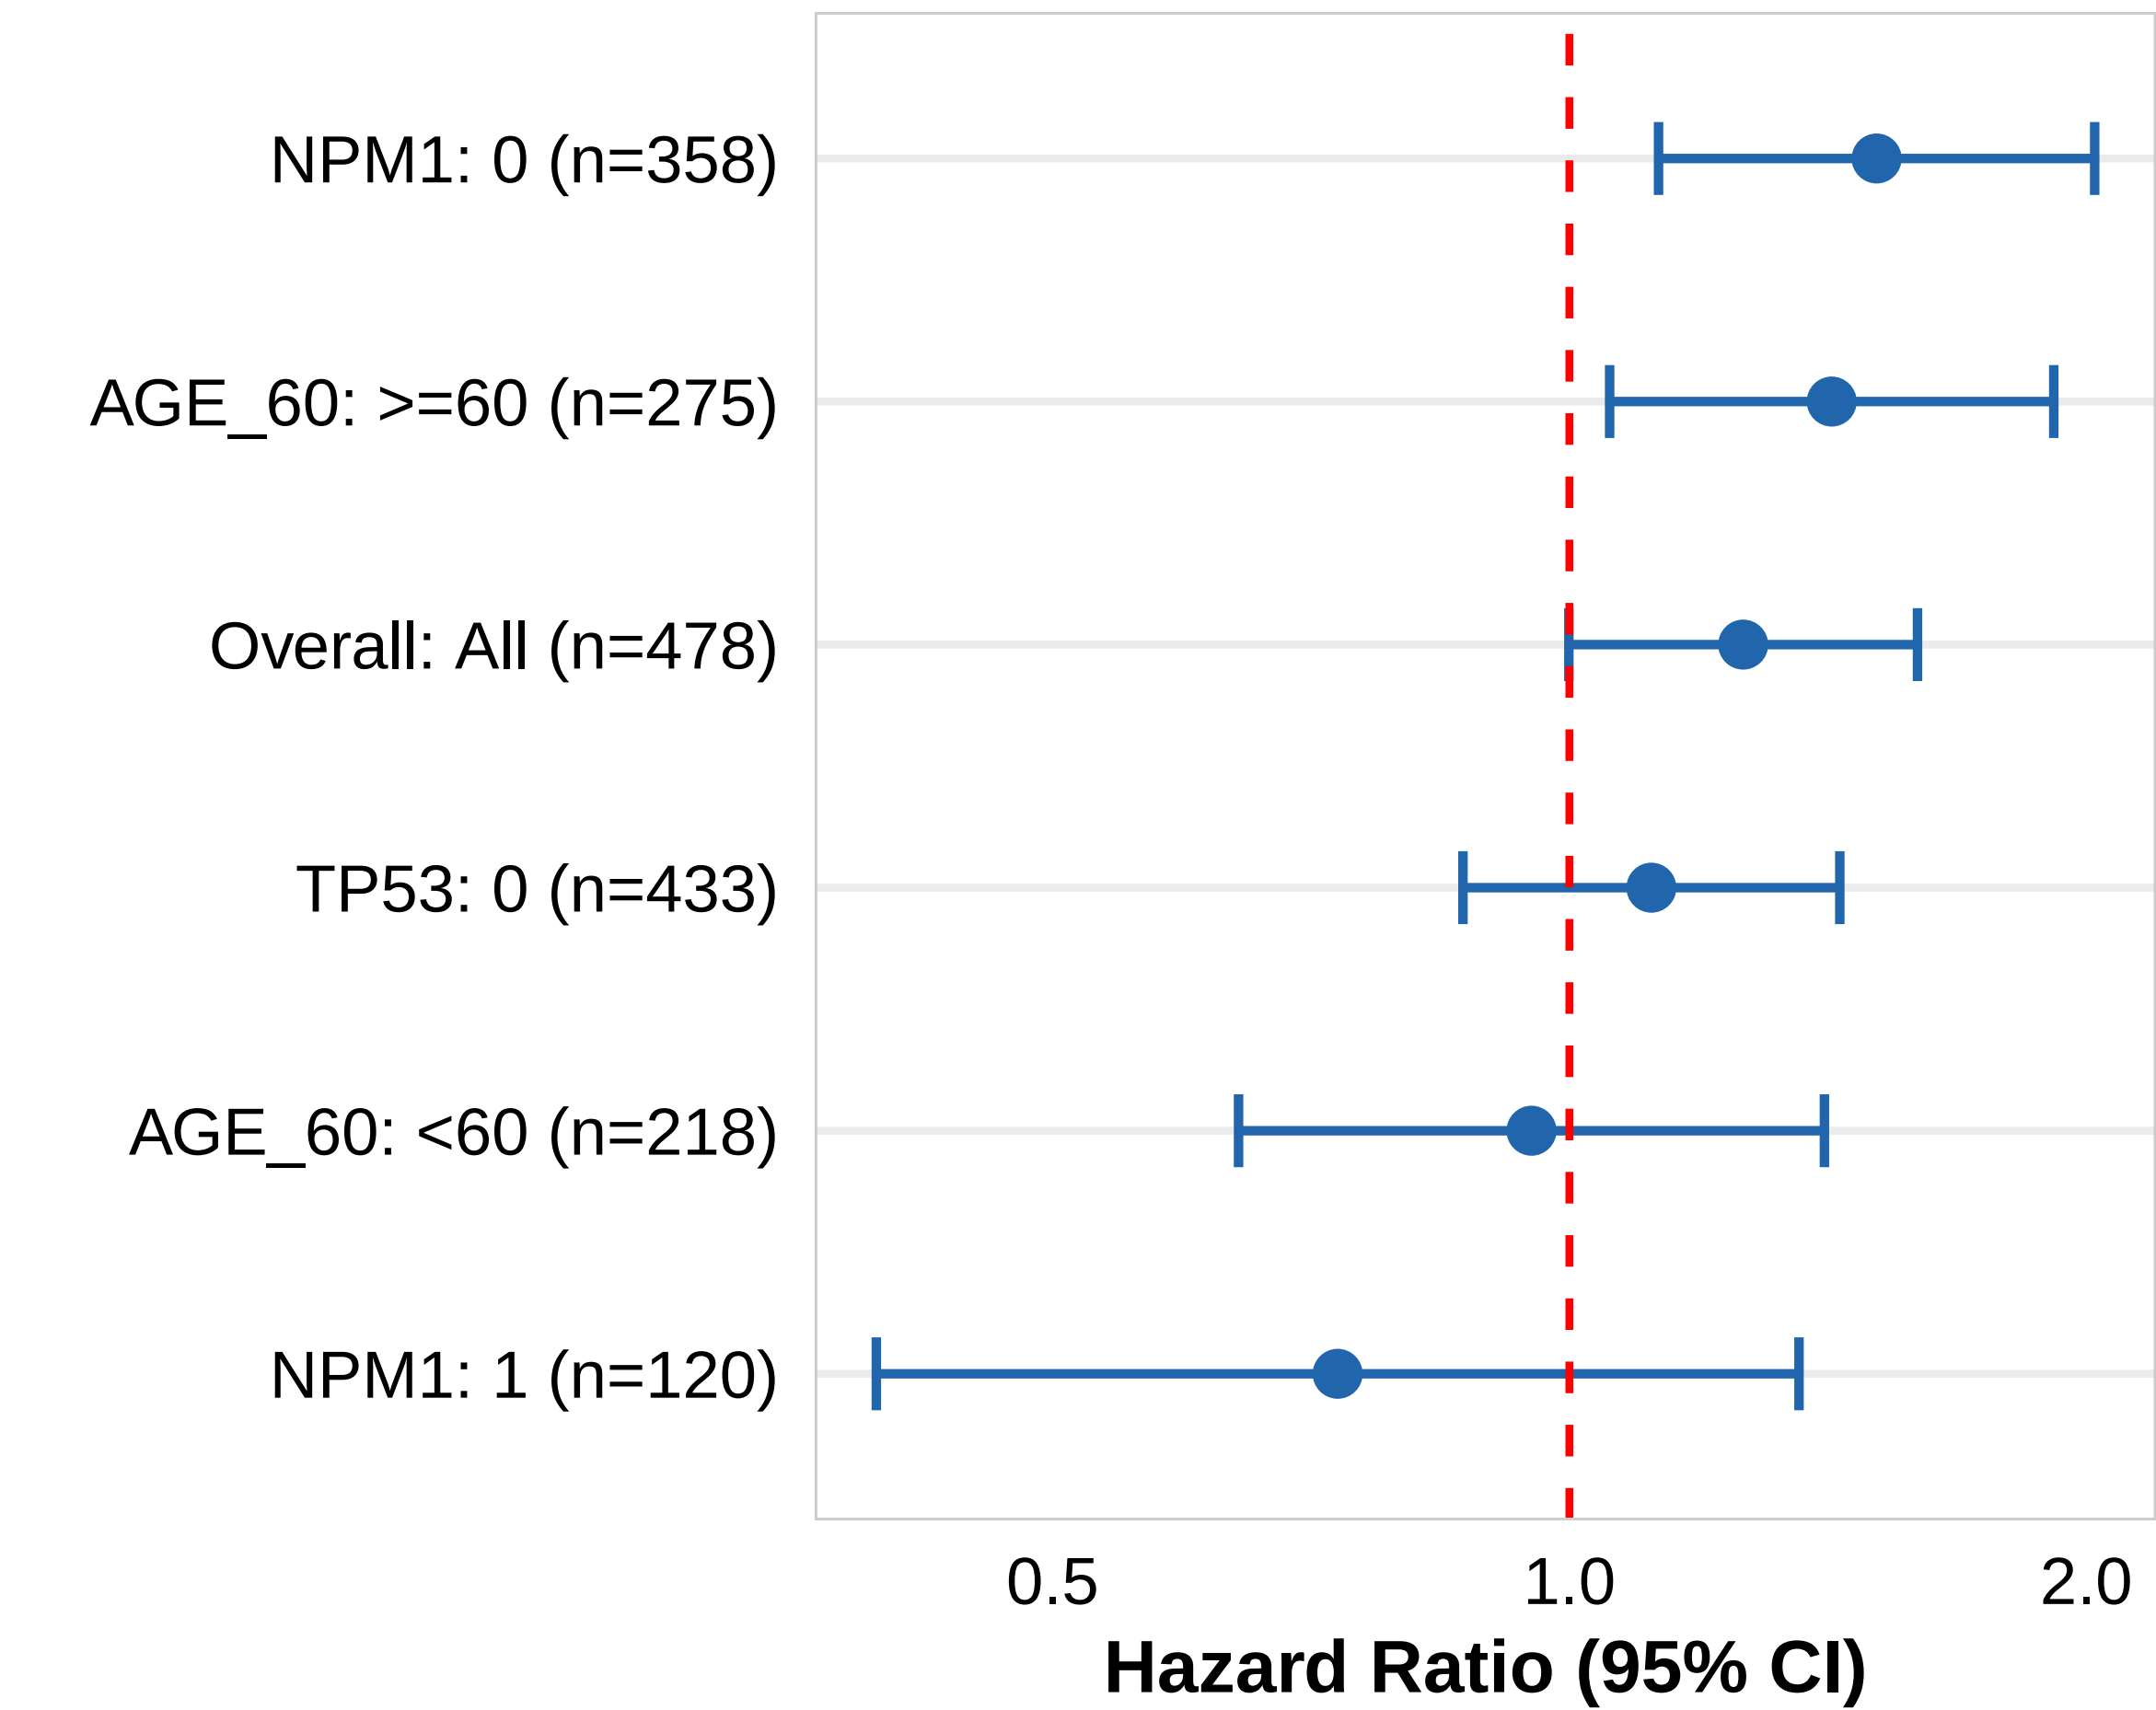


B. Schoenfeld Residuals Test

PH Assumption is satisfied ( $p > 0.05$ )

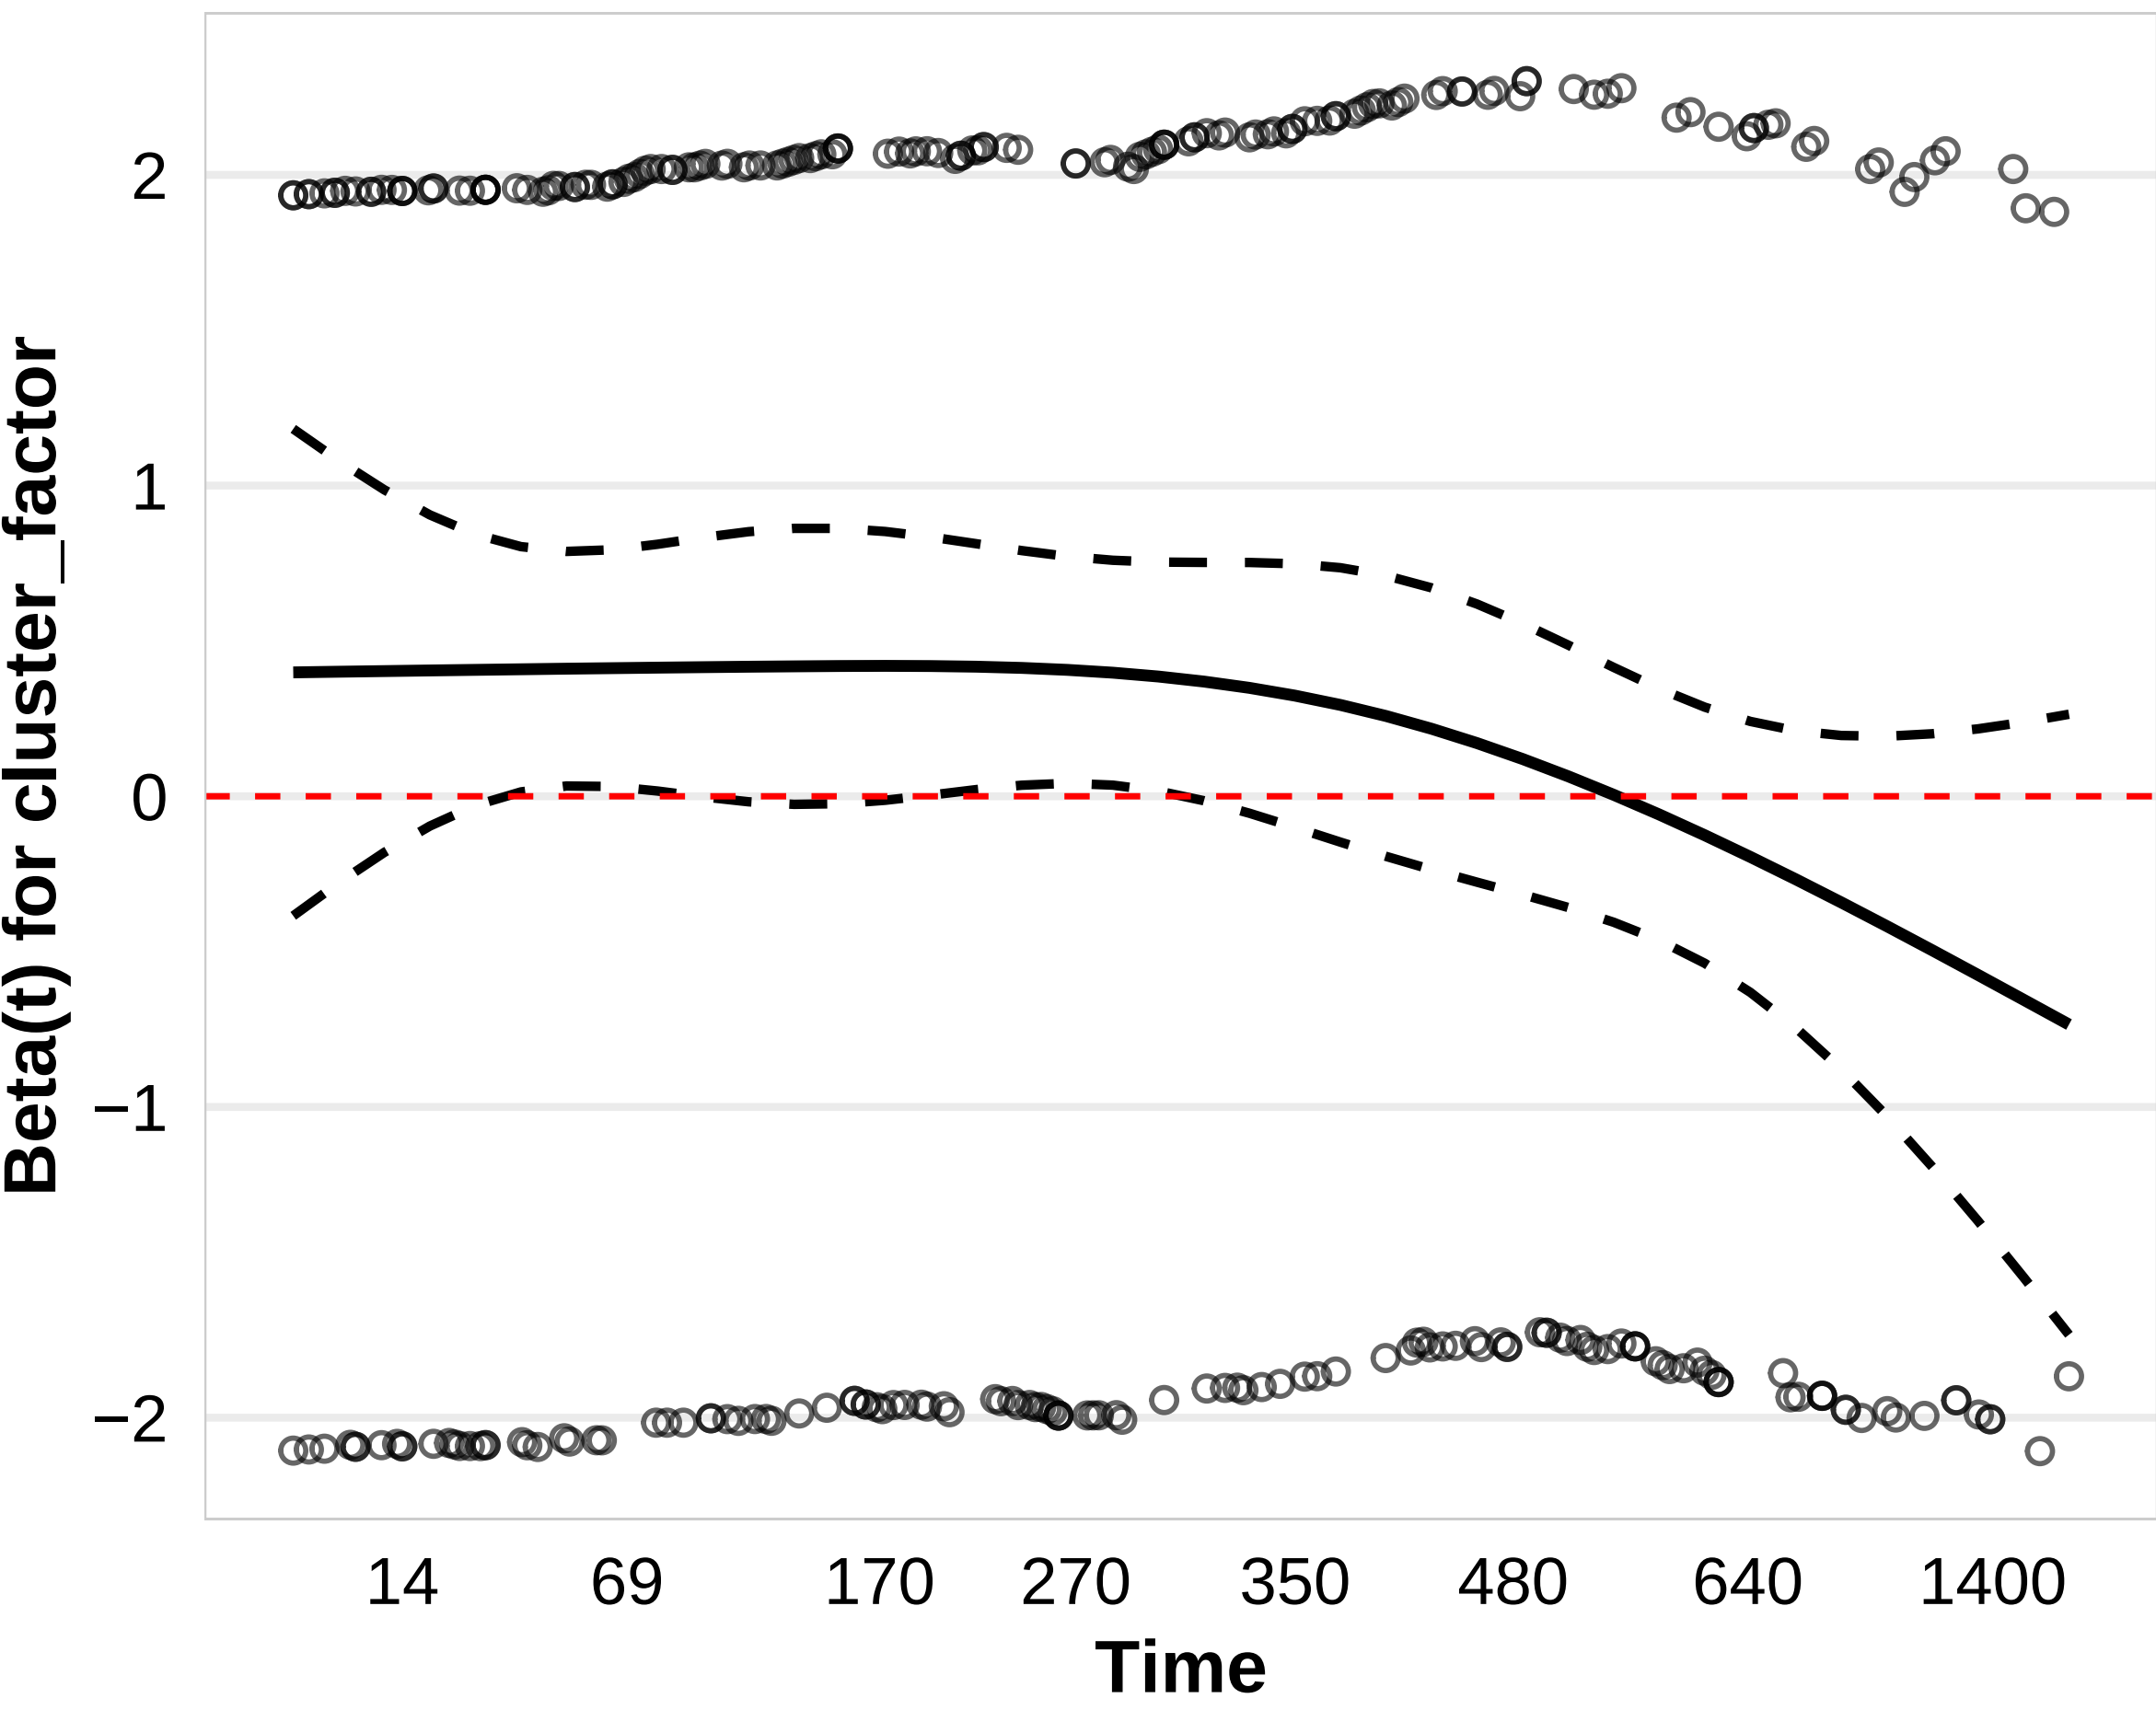

C. Model Calibration (3-year)

Observed Survival matches Model Predictions

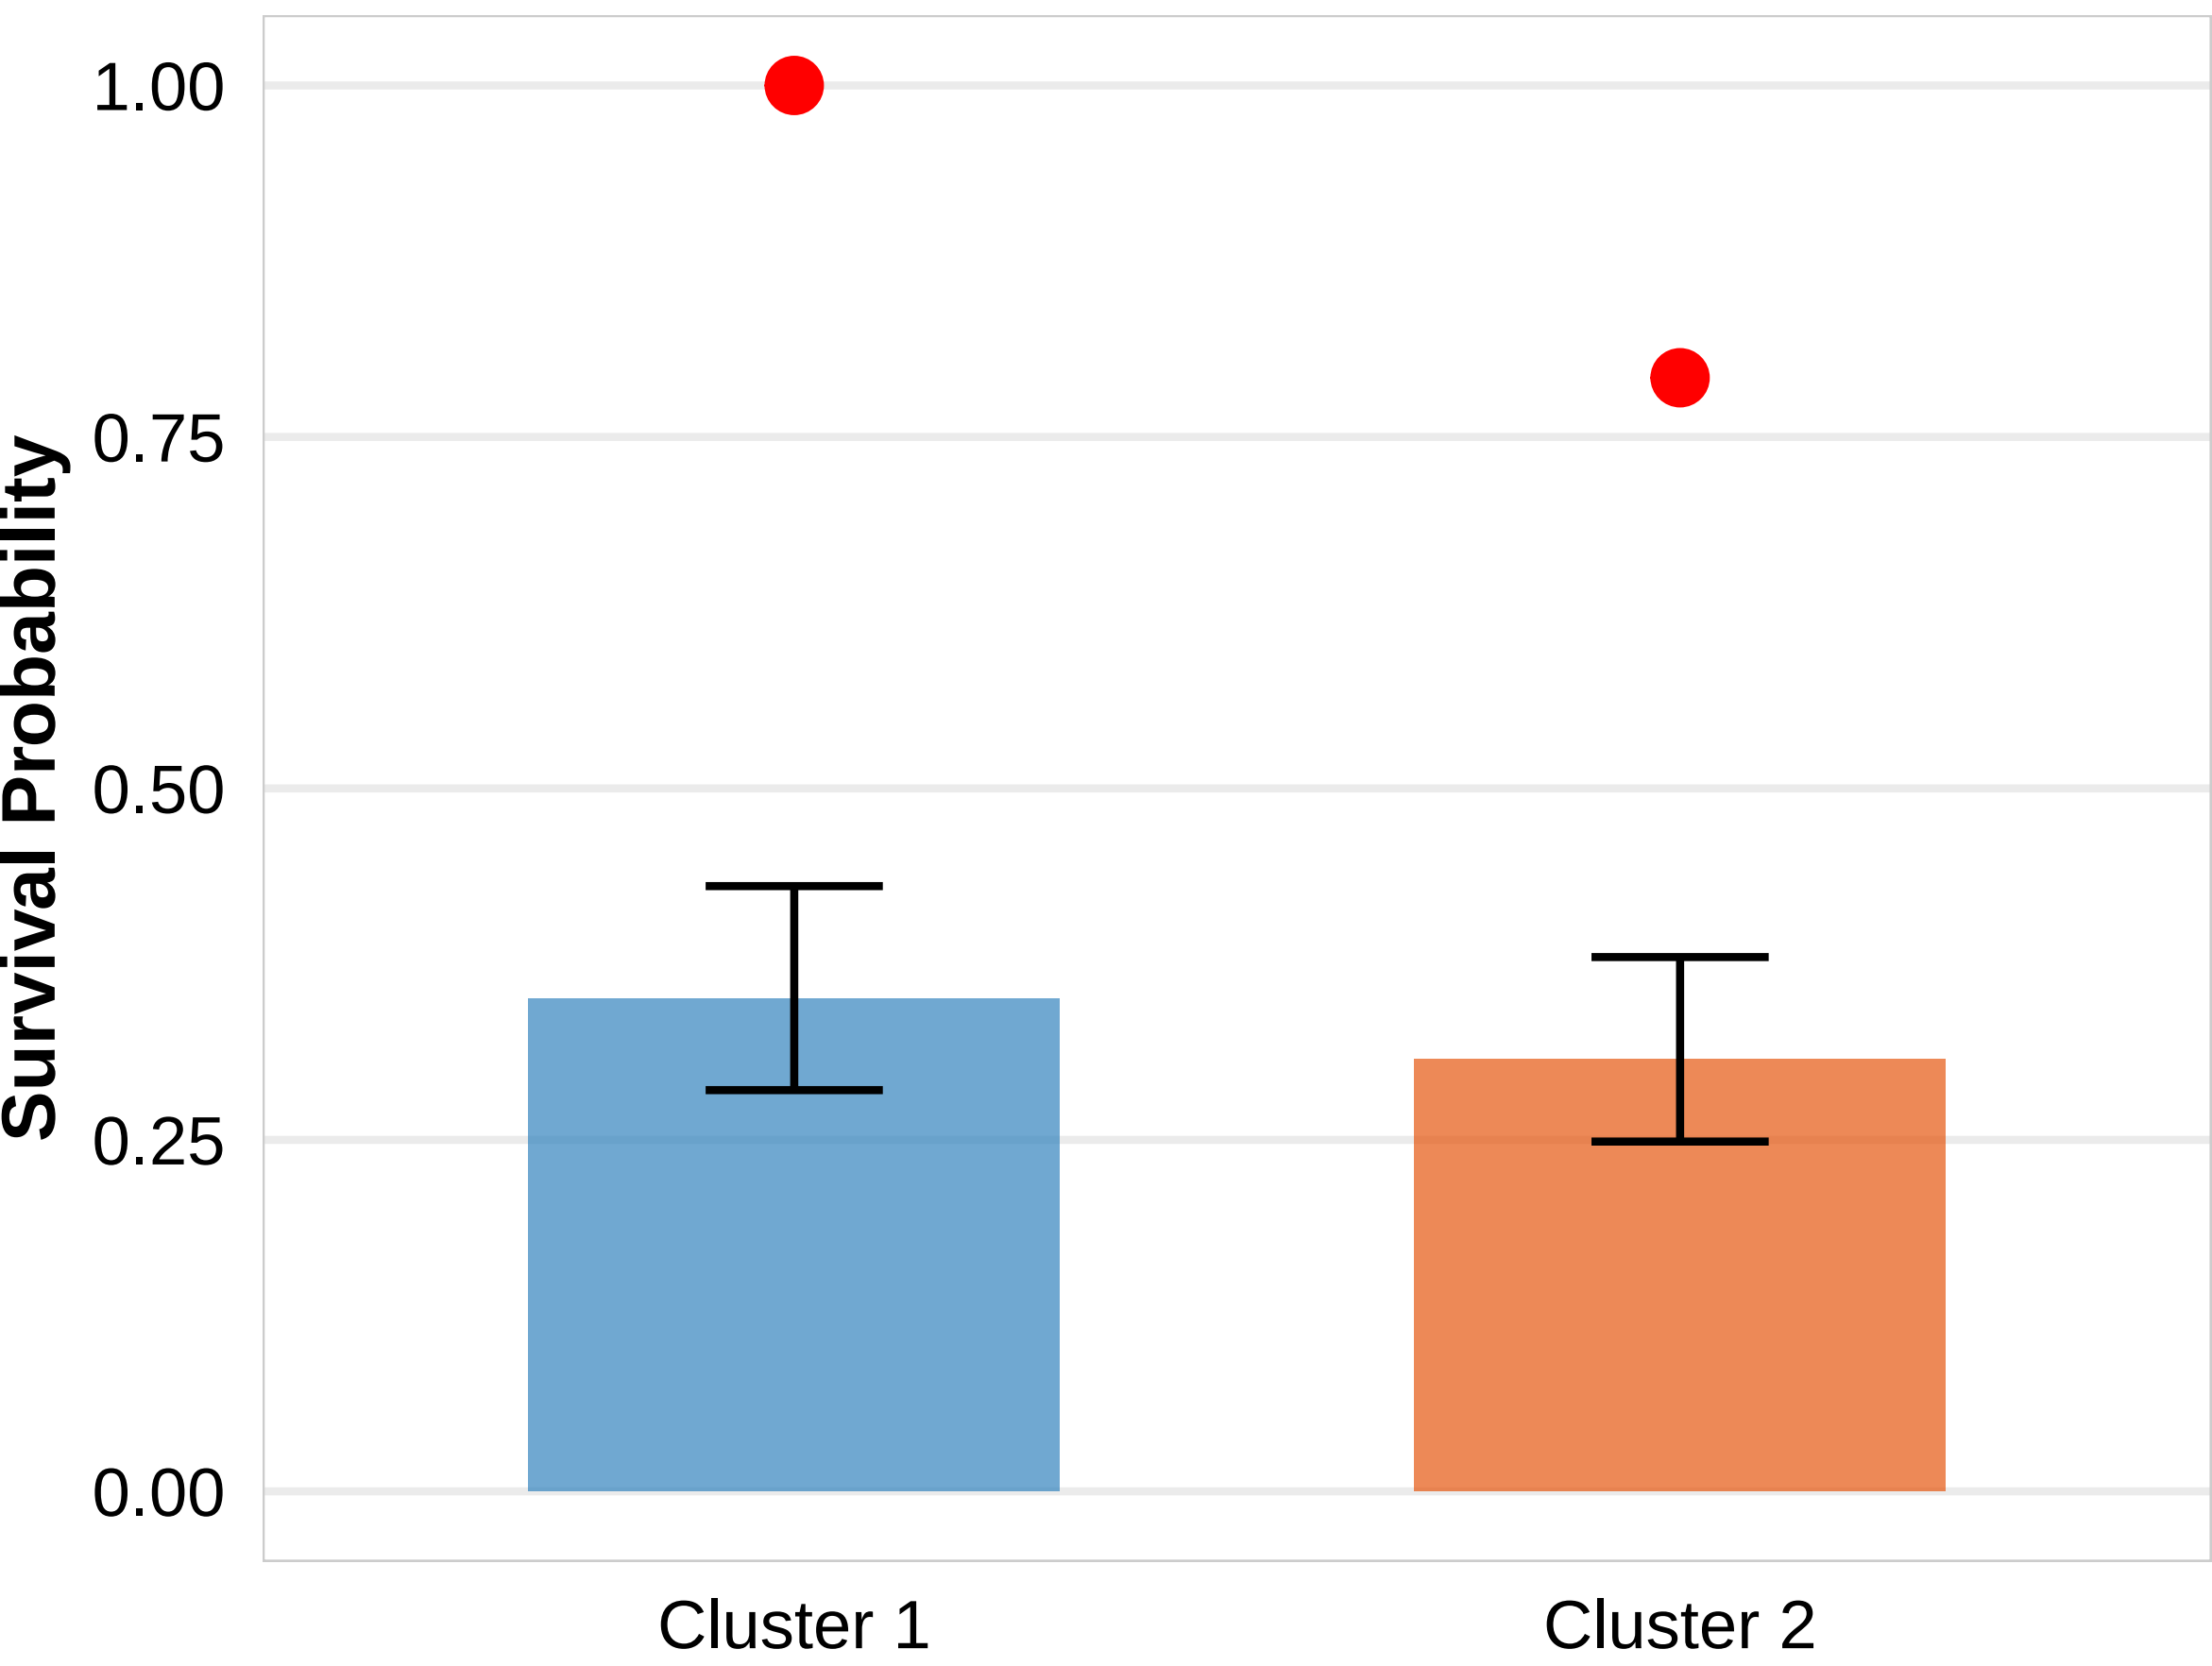

D. PH-Independent RMST Audit

Cluster 2 confers significantly fewer months of OS

