



Naphthalene — CENSO: censo:Compliant (both systems agree)

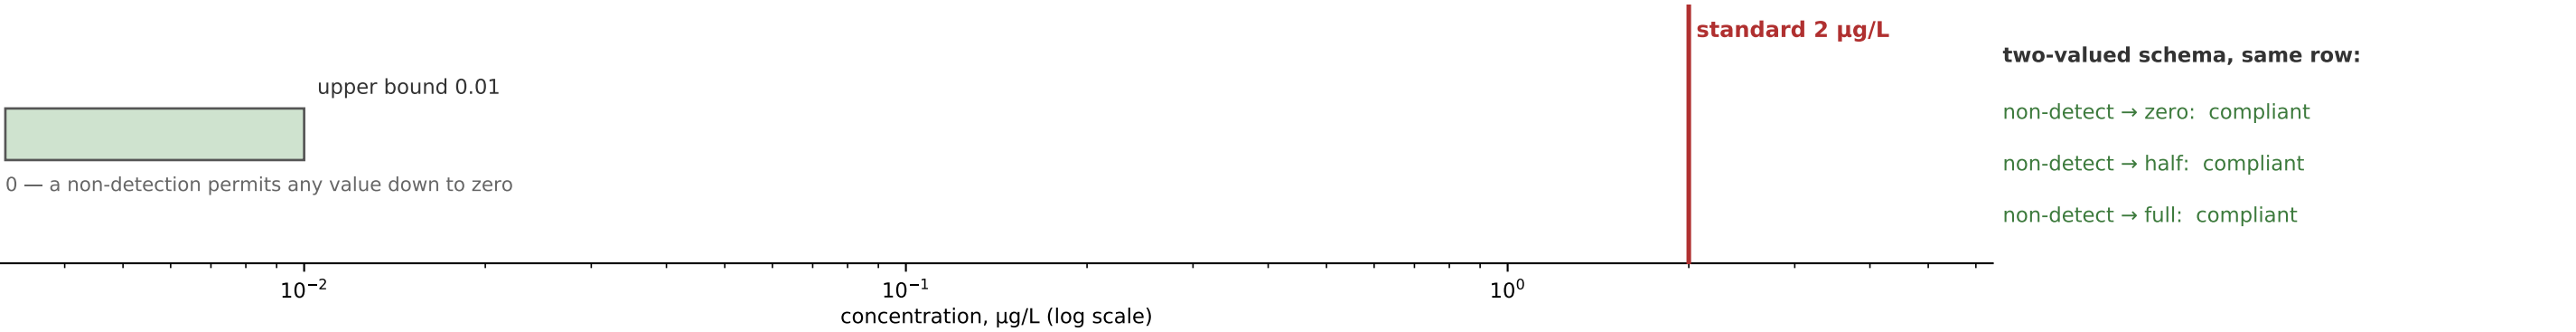


The bound clears the standard. Nothing is lost by the simpler model, and a vocabulary that could not say this would be useless.

Permethrin — CENSO: censo:MethodInsufficient (the verdict IS the convention)

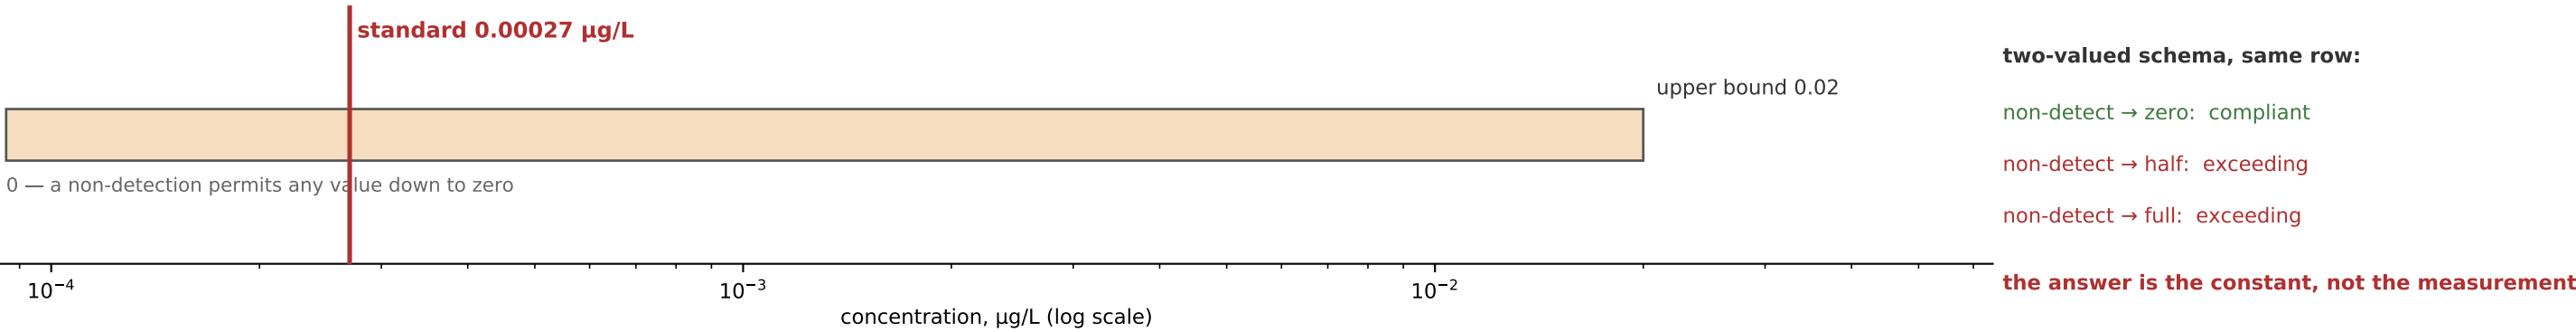


Art. 3(3b): a below-quantification result whose limit exceeds the standard shall not be considered. The two-valued answer flips with the substitution constant, and the record does not say which was used.

Clarithromycin — CENSO: censo:PossibleExceedance (inside the law's own uncertainty)

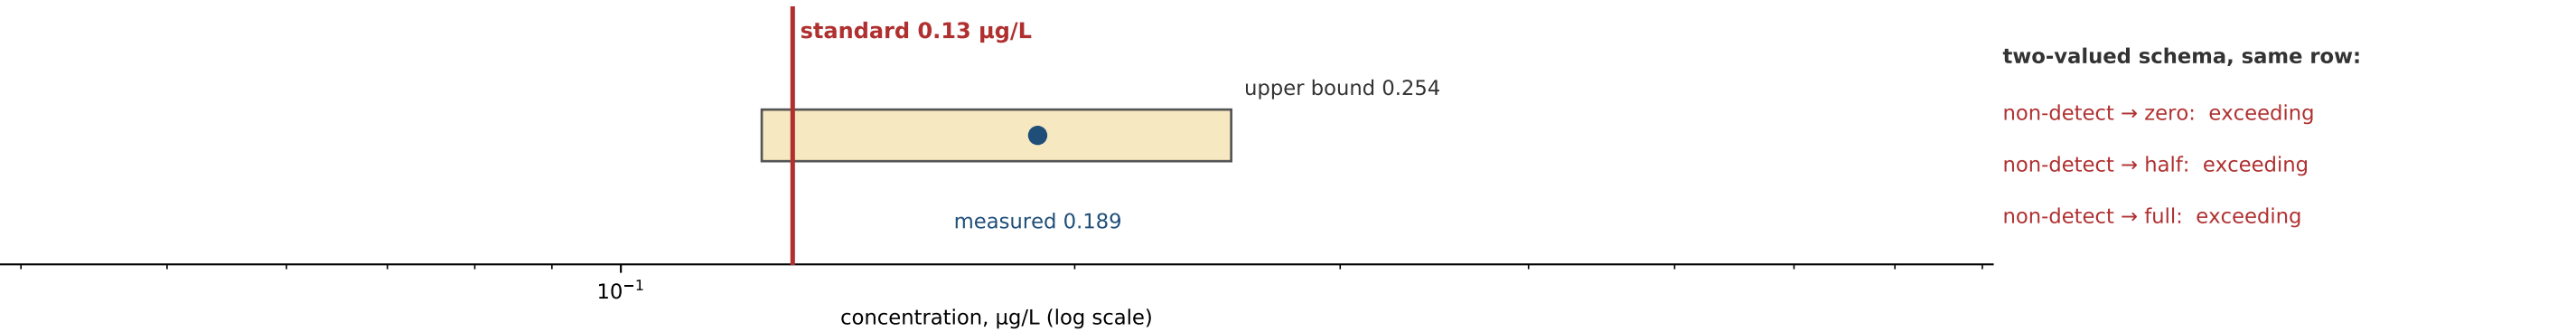

Art. 4(1) permits 50 % expanded uncertainty at the level of the standard, so this interval straddles it. A method meeting only the legal minimum cannot decide either way.

Cadmium and its compounds — CENSO: censo:PreconditionUnmet (the standard is not defined on what was measured)

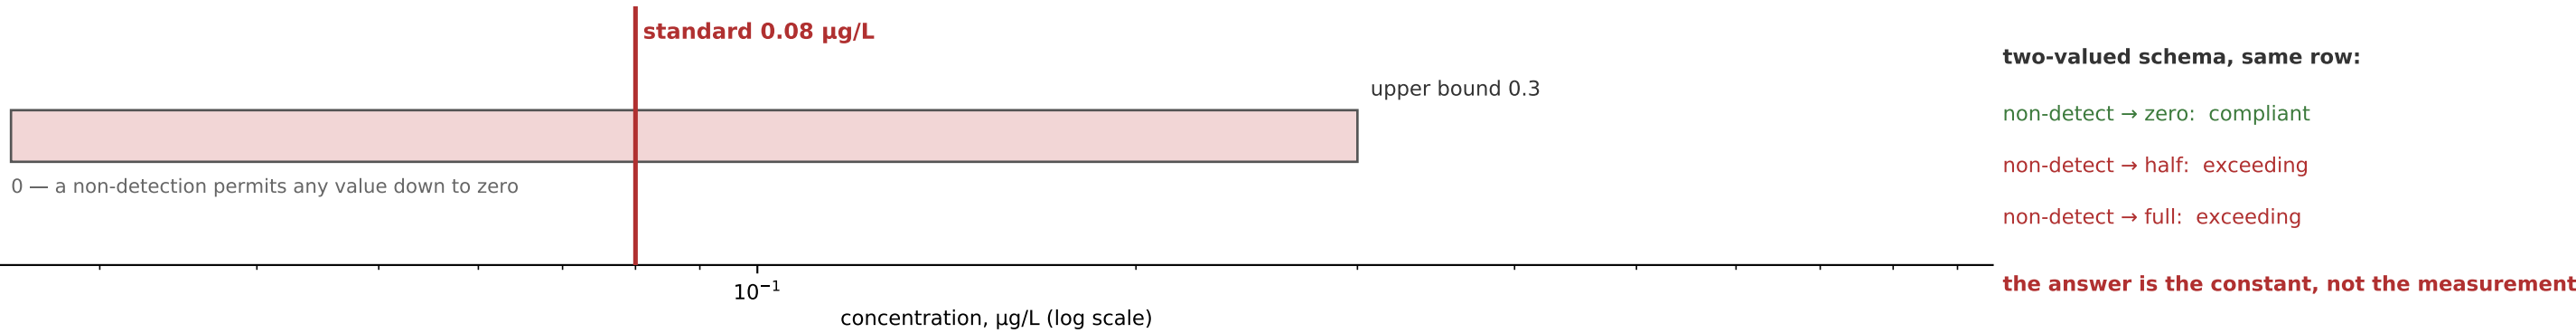

Annex I footnote 9 makes the cadmium standard vary with water hardness. WISE-6 reports no hardness on the row, so the number in the table and the number in the record are not measurements of the same quantity.