


What the laboratories reached since 2020, against what the law asked for  
26 of 54 carry a median limit above Article 4(1)'s ceiling

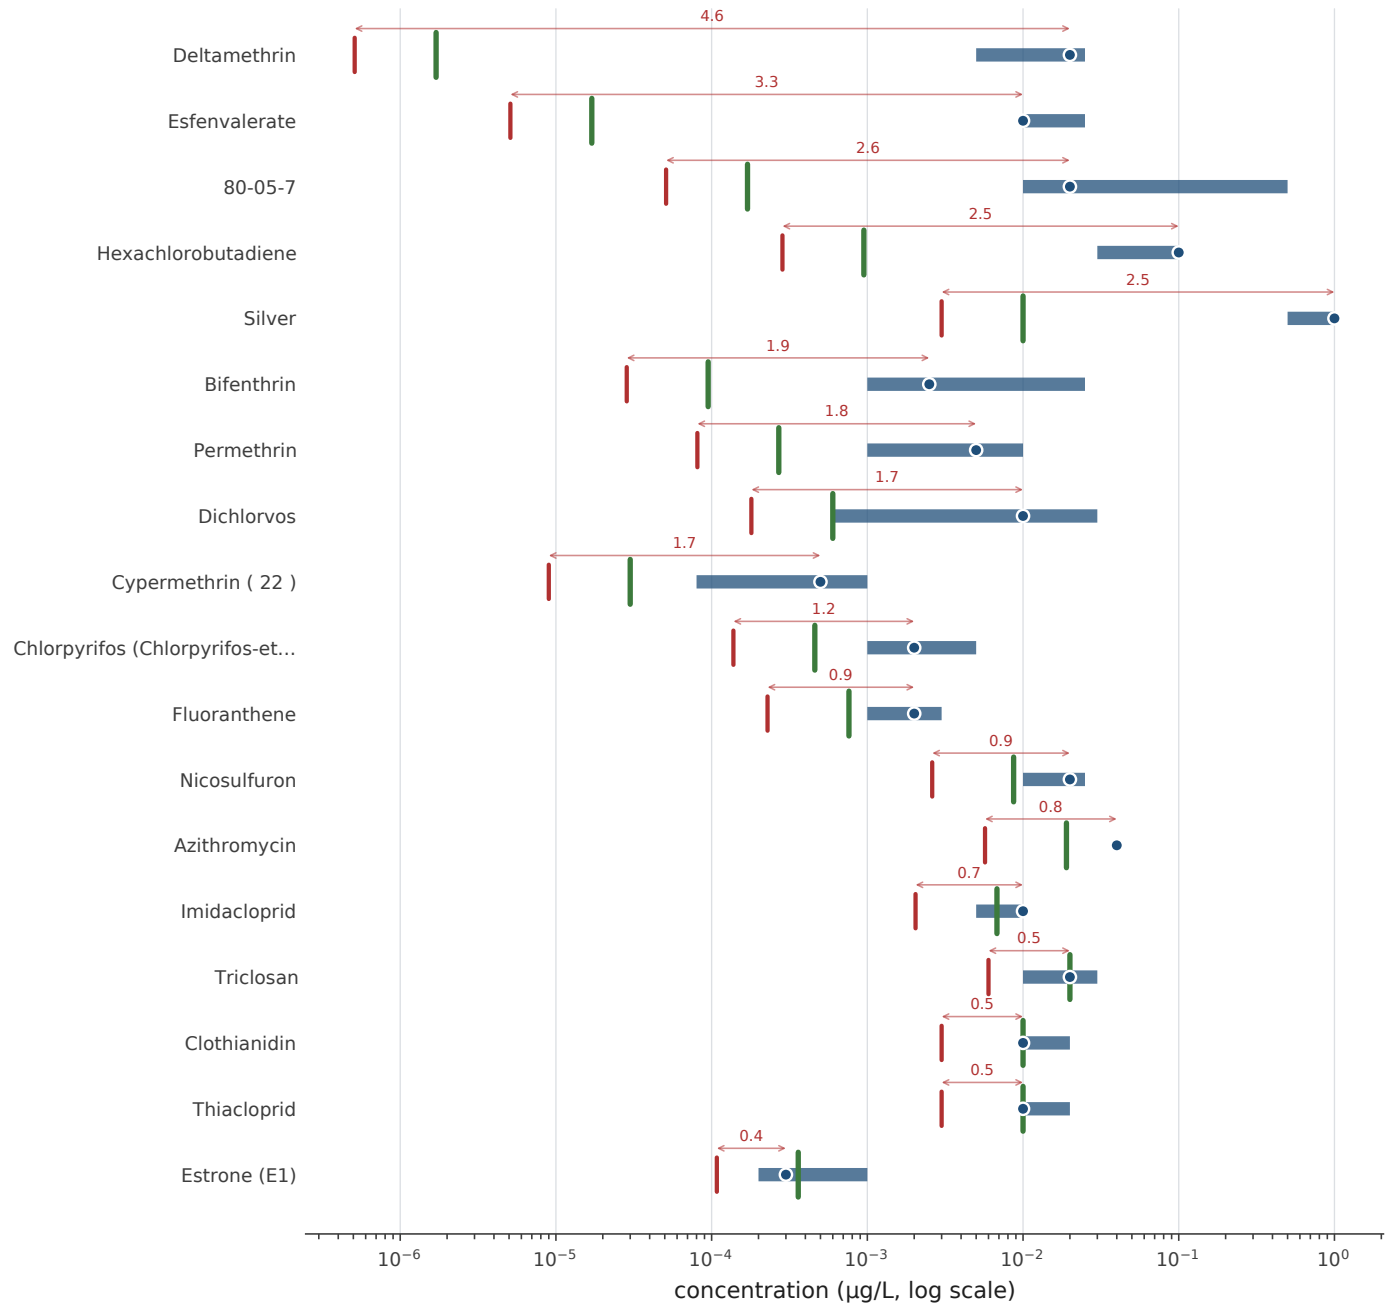

reported limits, middle half  
the standard  
median limit  
30 % of it — the ceiling