


What the laboratories reached since 2020, against what the law asked for
26 of 54 carry a median limit above Article 4(1)'s ceiling

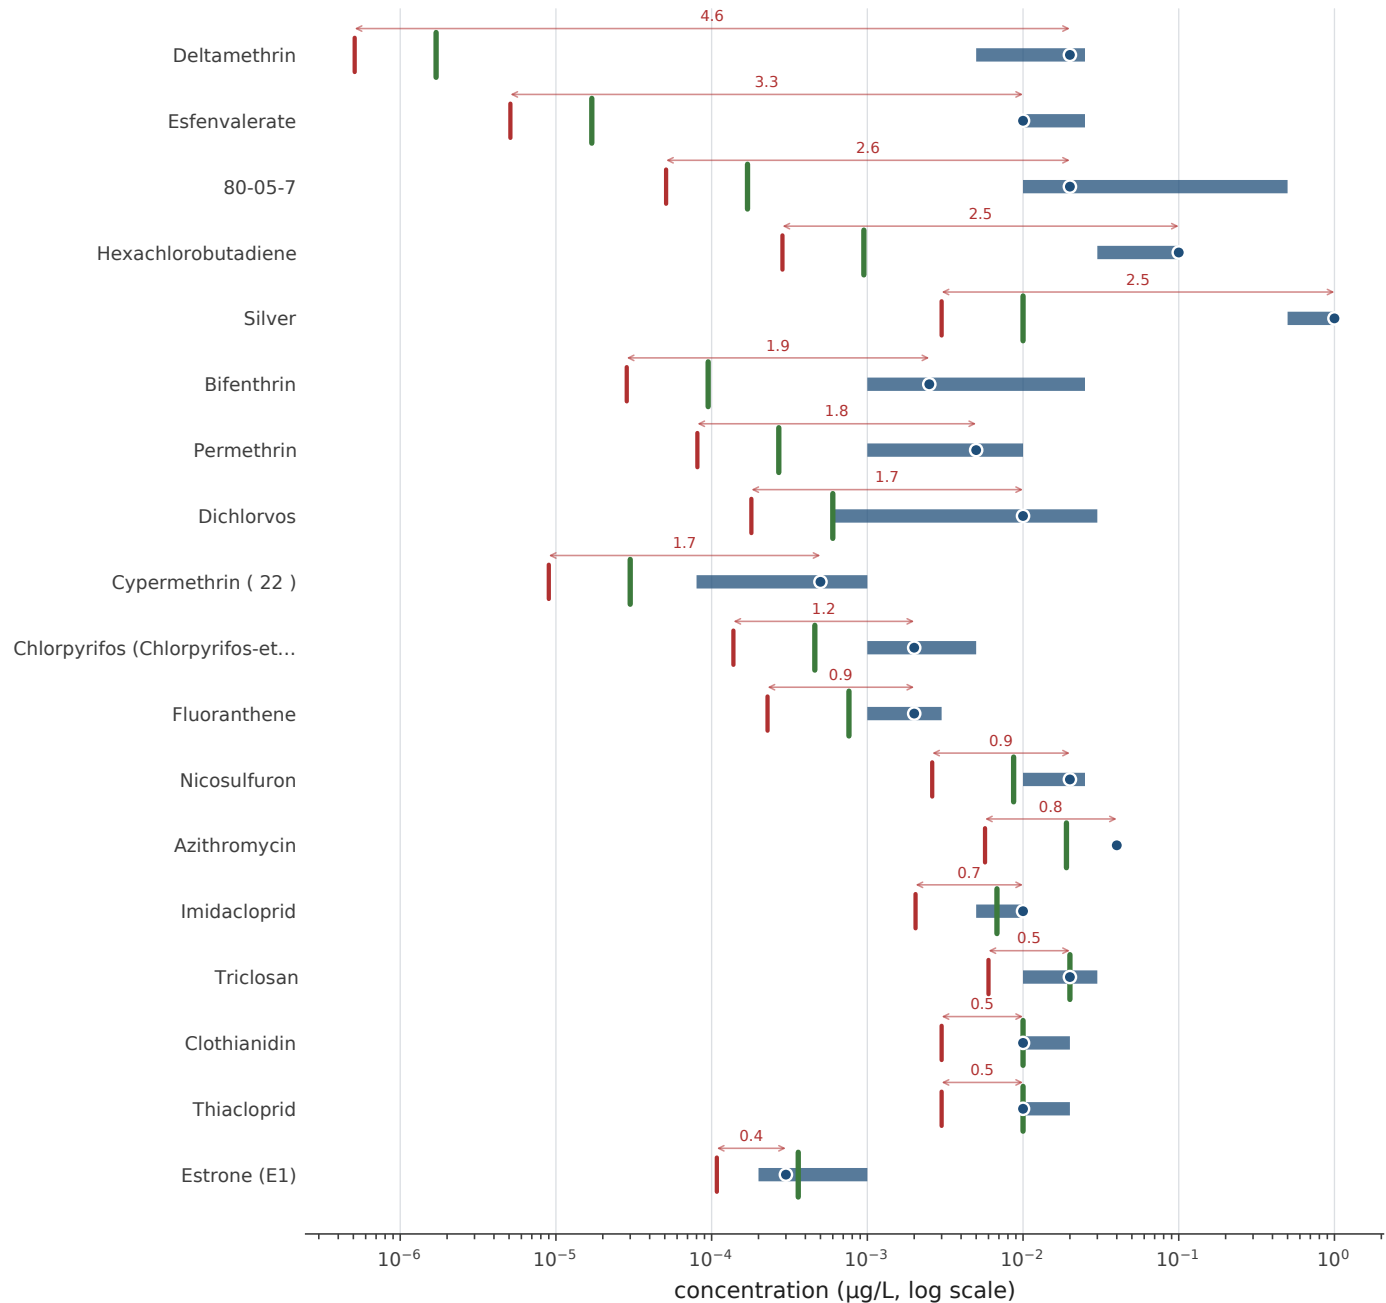

reported limits, middle half
the standard
median limit
30 % of it — the ceiling