


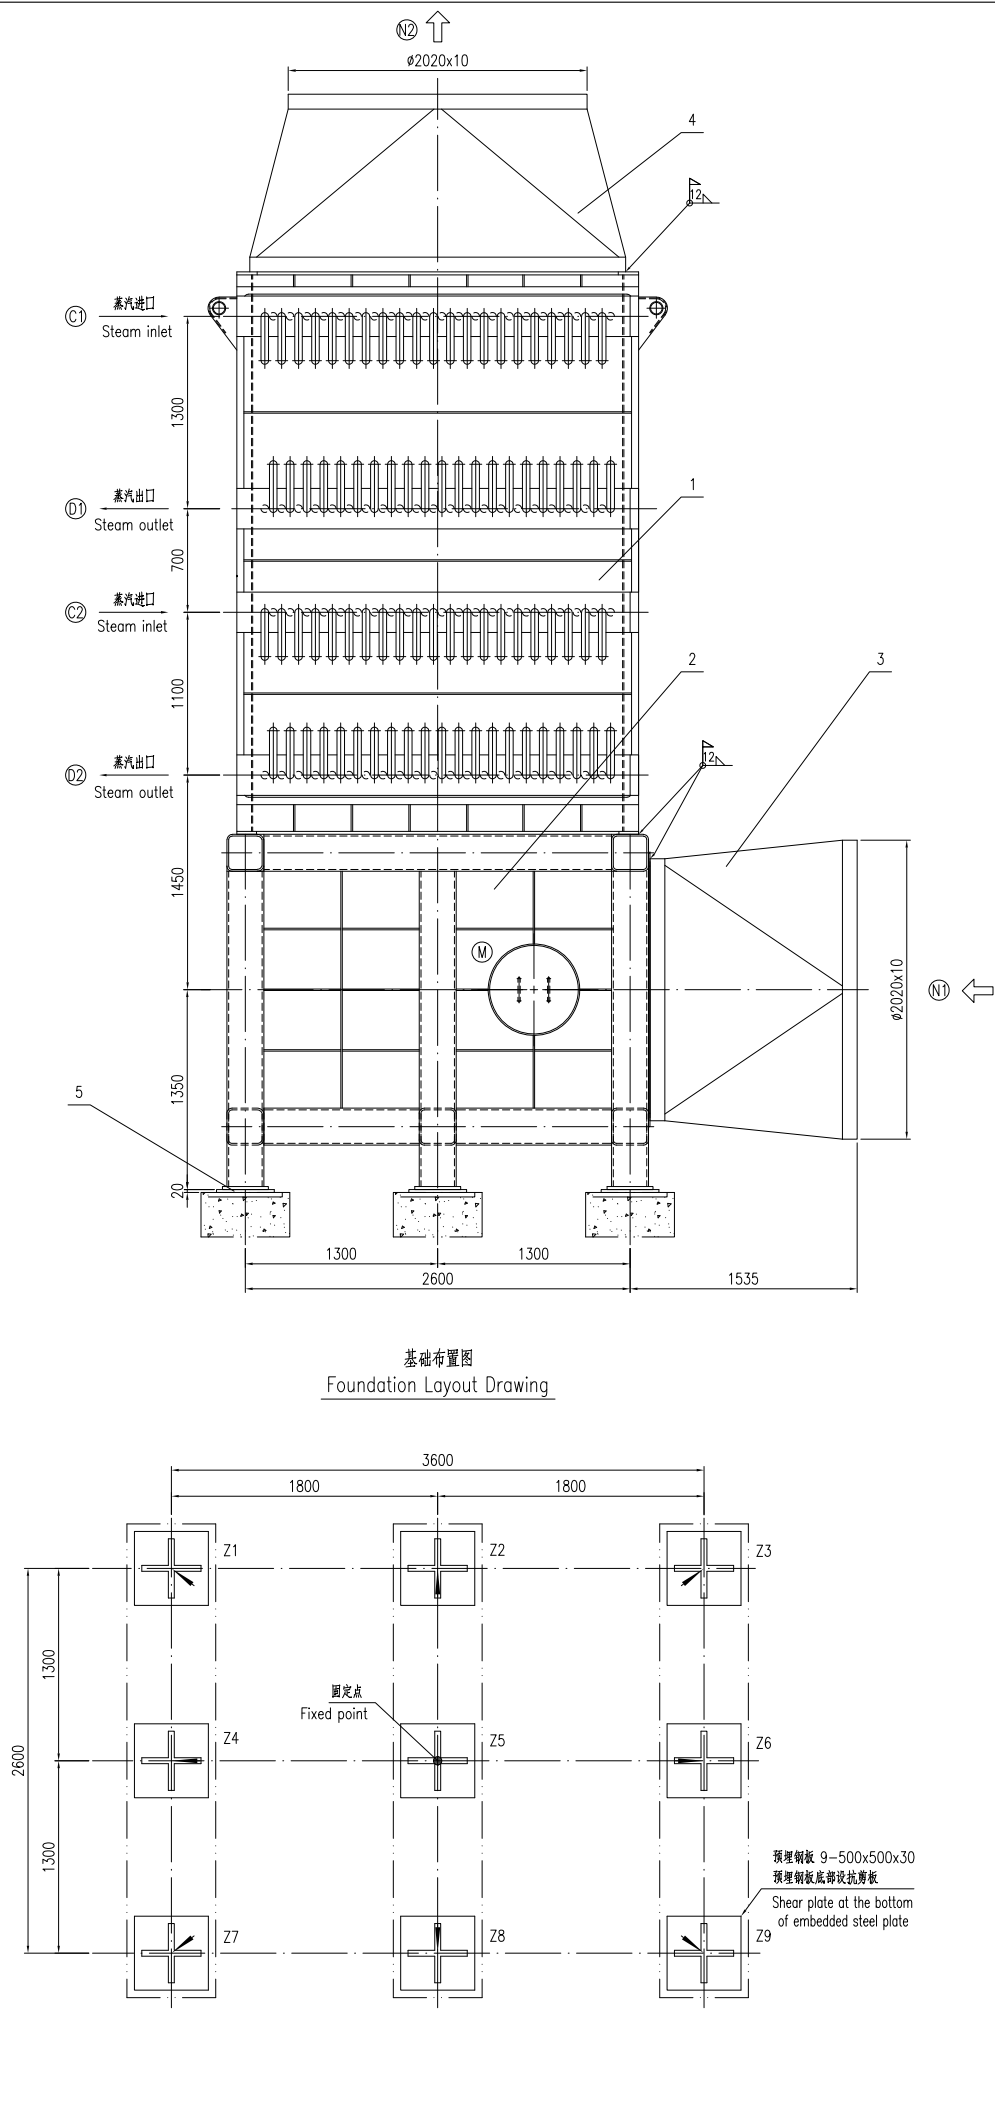

接口 C1、C2、D1、D2 详图

NOZZLE C1、C2-D1、D2 DETAIL

1:20

The drawing shows a cross-section of a nozzle assembly. The nozzle has a thickness of 16mm and a 30-degree bevel. The main pipe has an outer diameter of ø273 and a wall thickness of 18mm. The nozzle has an outer diameter of ø273 and a wall thickness of 14mm. The drawing is labeled with dimensions and a scale of 1:20.

技术要求：

- 1.过热器的设计、制造及验收按TSG 11—2020《锅炉安全技术规程》、GB/T16507—2022《水管锅炉》进行。
- 2.过热器的安装及验收应符合TSG 11—2020《锅炉安全技术规程》及DL 5190.2—2019《电力建设施工技术规范 第2部分：锅炉机组》的有关技术规定。
- 3.过热器的水质应当符合GB/T 12145—2016《火力发电机组及蒸汽动力设备水汽质量》的规定。
- 4.设备于施工现场安装完毕后应按照TSG 11—2020《锅炉安全技术规程》随锅炉系统整体进行水压试验，试验压力为汽包压力的1.25倍。

Technical Requirements:

- 1.The design, manufacture, and acceptance of the equipment shall comply with TSG 11—2020 Boiler Safety Technical Code and GB/T16507—2022 Water-tube Boilers.
- 2.The installation and acceptance of the boiler shall conform to the relevant technical provisions of TSG 11—2020 Boiler Safety Technical Code and DL 5190.2—2019 Technical Specification for Electric Power Construction - Part 2: Boiler Unit.
- 3.The water and steam quality of the equipment shall meet the requirements of GB/T12145—2016 Quality of water and steam for thermal power units and steam power equipment.
- 4.After the equipment is installed on site, a hydrostatic test shall be carried out in accordance with TSG 11—2020 Boiler Safety Technical Code as an integral part of the boiler system. The test pressure shall be 1.25 times the drum pressure.

6	42SCG-3-2-0	铝焊组件 NAMEPLATE ASSEMBLY	1	组合件 ASSEMBLY	4.0	MP200-SS
5	14SCG2504-2-5-0	过热器1B承载件 SUPERHEATER 1B SUPPORTING PARTS	1	组合件 ASSEMBLY	190	
4	14SCG2504-2-4-0	出口接管 OUTLET NOZZLE	1	组合件 ASSEMBLY	1016	
3	14SCG2504-2-3-0	减口接管 OUTLET NOZZLE	1	组合件 ASSEMBLY	1170	
2	14SCG2504-2-2-0	下箱体 FLUE GAS CHANNEL	1	组合件 ASSEMBLY	6076	
1	14SCG2504-2-1-0	过热器1B主体 SUPERHEATER 1B MAIN BODY	1	组合件 ASSEMBLY	31715	
件号 PART NO.	图号或标准号 DRAWING NO. OR	名 称 DESCRIPTION	数量 QTY.	材 料 MATERIAL	单 重 SINGLE WEIGHT	备 注 REMARK



江苏赛瑞科技工程有限公司
CERE China Technical Engineering Jiangsu Co., Ltd.

本CERE证书所许可,不得以在官方或权威场合用于非本项目无权的其它用途。
STRICTLY PROHIBITED REPRODUCE OR EMPLOY FOR OTHER PURPOSES
OTHER THAN THIS PROJECT WITHOUT WRITTEN PERMISSION FROM CERE.

江苏索普赛瑞装备制造有限公司
SOPO CERE Equipment Manufacturing Co., Ltd.

MARK 标记	TOTAL NO. 总 数	FILE NO. 更改文件号	SIGN 签名	DATE 日期	组 合 件 ASSEMBLY	过热器1B Superheater 1B
DESIGN 设计	李学亮	2025.12.24	李学亮	2025.12.24	WEIGHT(kg) 重量	SCALE 比例
CHECK 校核	张杰	2025.12.24	张杰	2025.12.24		
REVIEW 审核	许大奇	2025.12.24	许大奇	2025.12.24	40171	1:25
					TOTAL-PAGES 共 张	No.-PAGE 第 张

14SCG2504-2-0

本图纸及图件版权归江苏索普赛瑞装备制造有限公司所有,任何单位和个人未经江苏索普赛瑞装备制造有限公司许可,不得以任何方式复制或扩散至第三方,违者将承担法律责任。
THE DRAWING AND FIGURE RIGHTS BELONG TO JIANGSU SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. ANY INDIVIDUAL OR ENTITY WITHOUT THE WRITTEN PERMISSION OF JIANGSU SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. CANNOT REPRODUCE OR DISSEMINATE TO A THIRD PARTY, OTHERWISE, THE VIOLATOR WILL BE RESPONSIBLE FOR THE LEGAL CONSEQUENCES.