
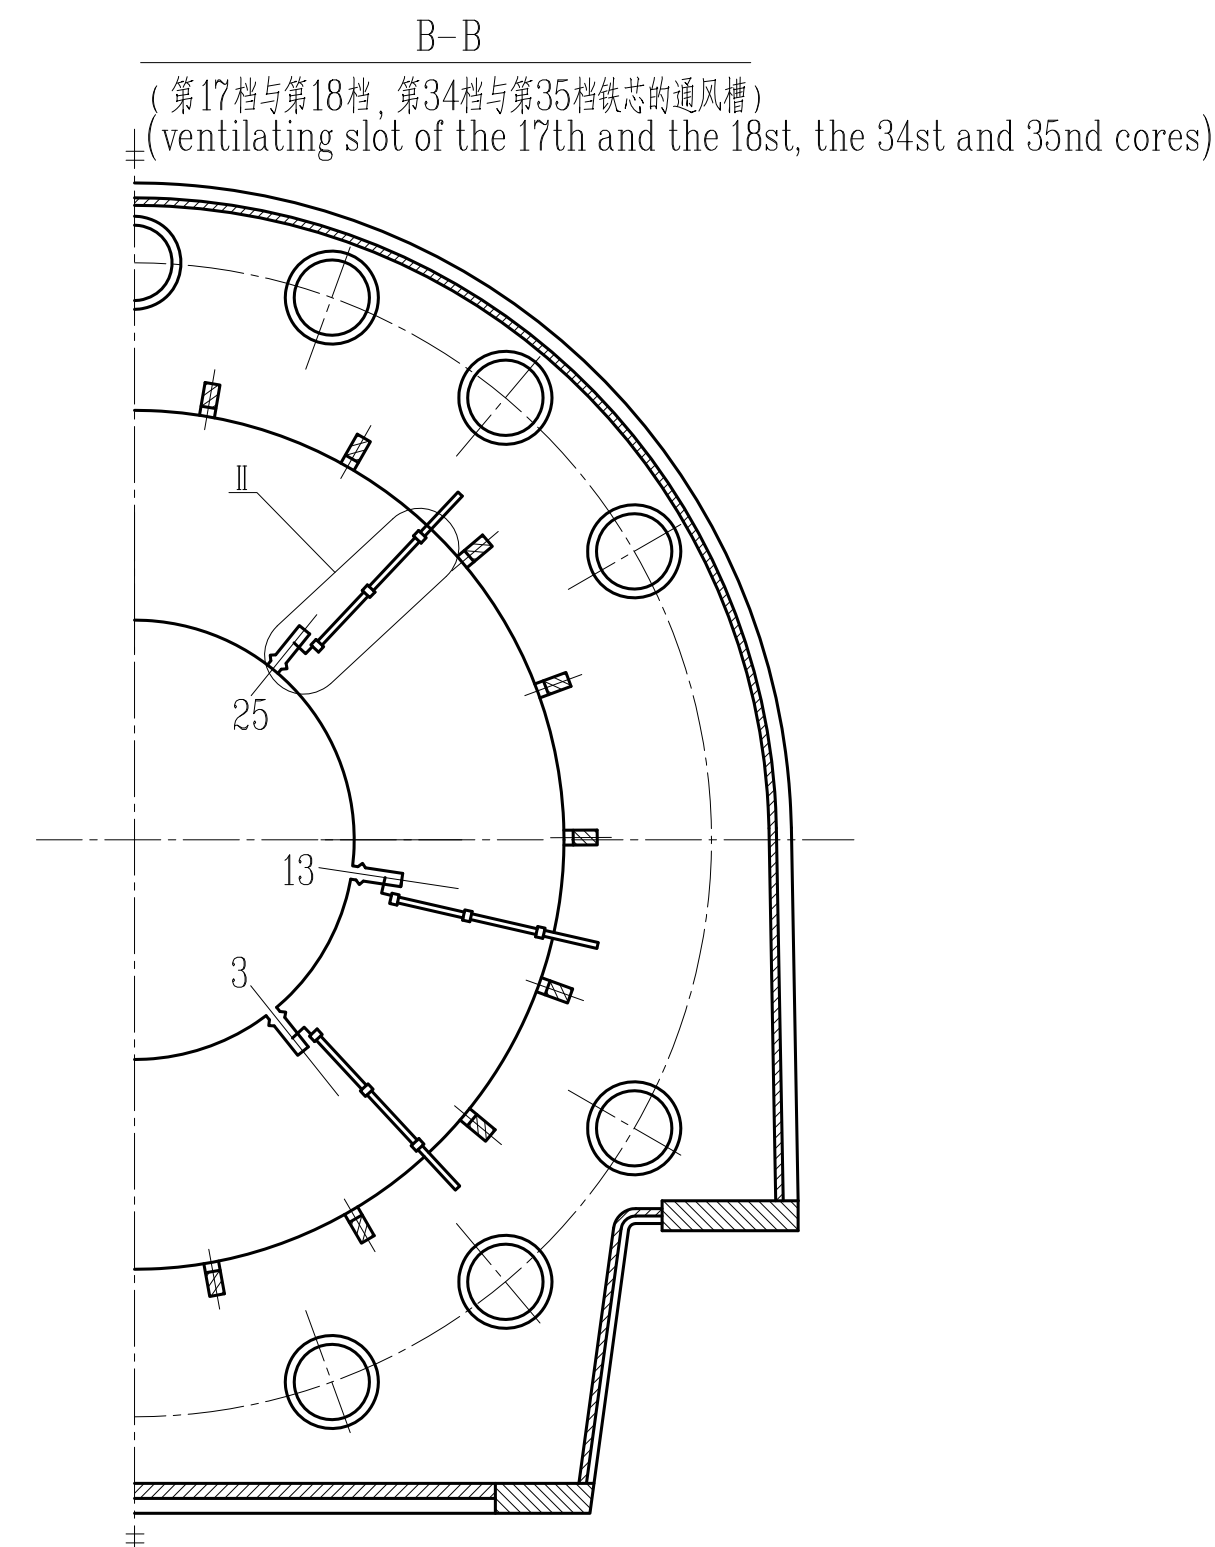
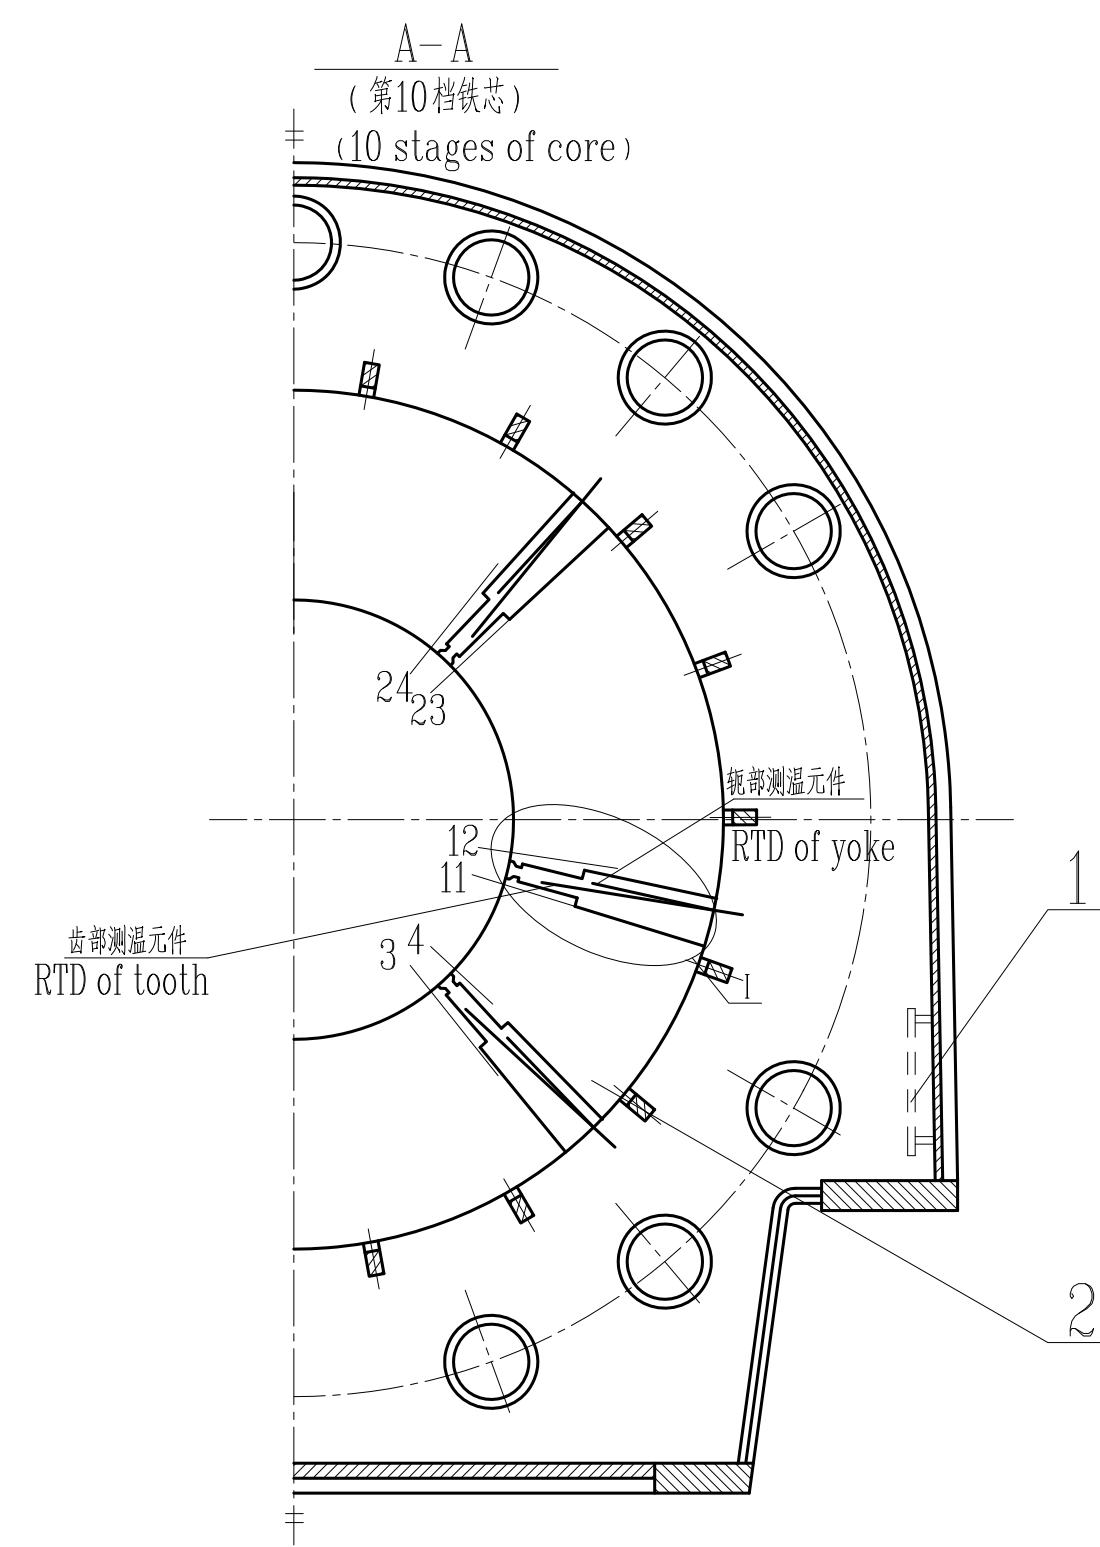
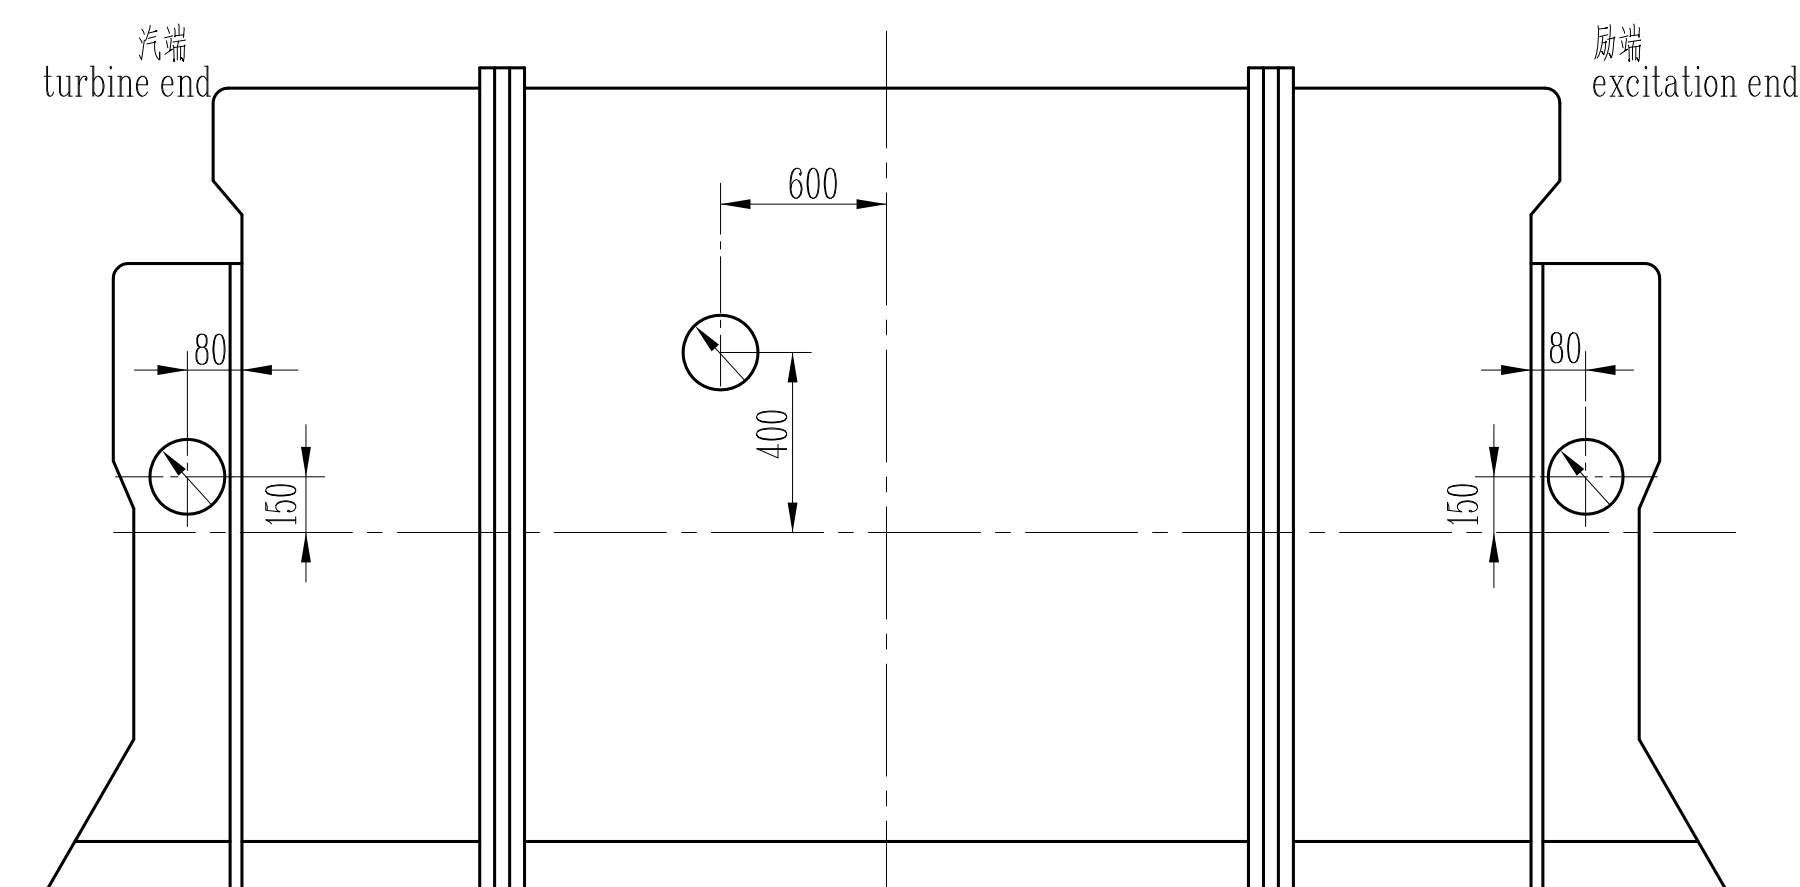
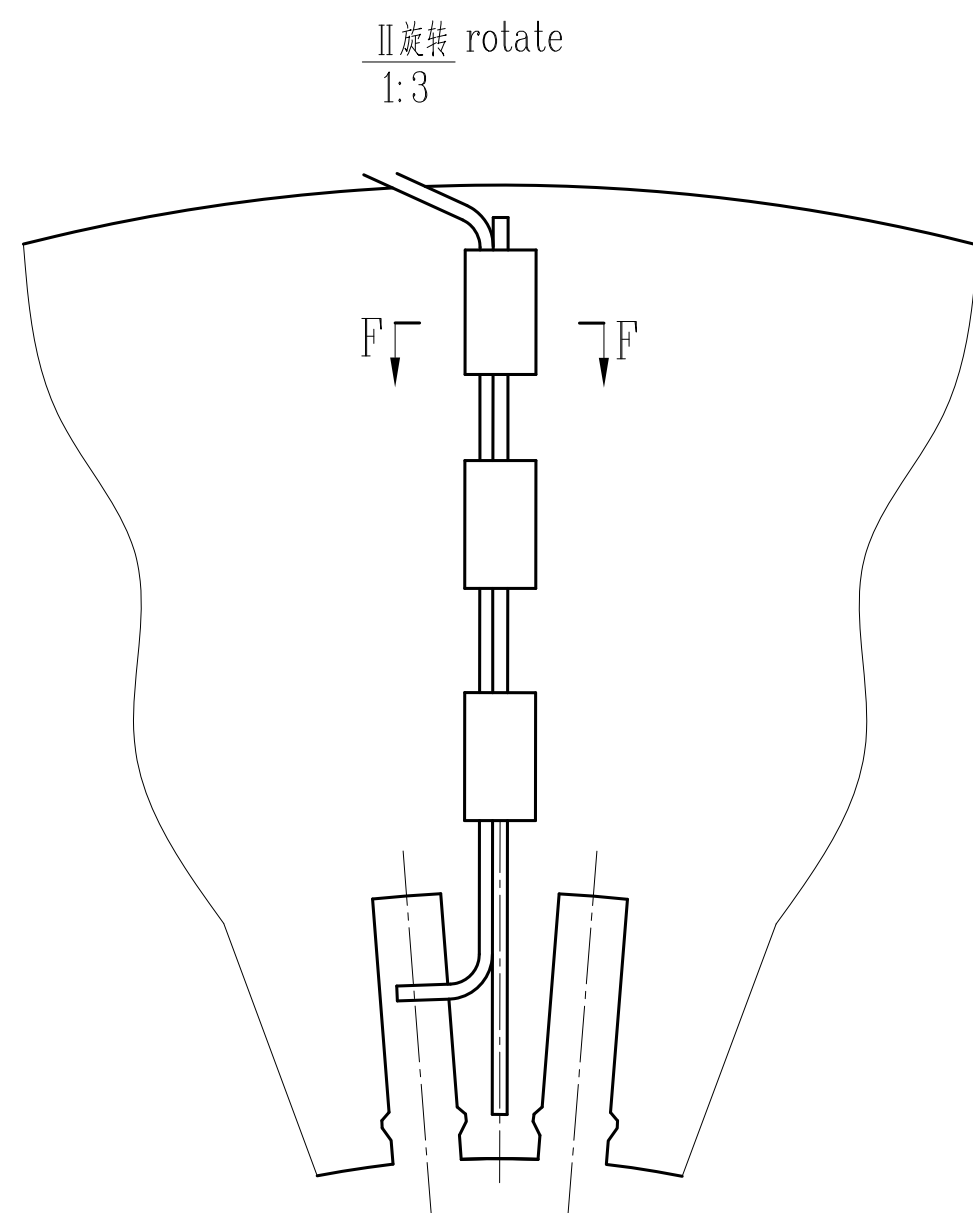
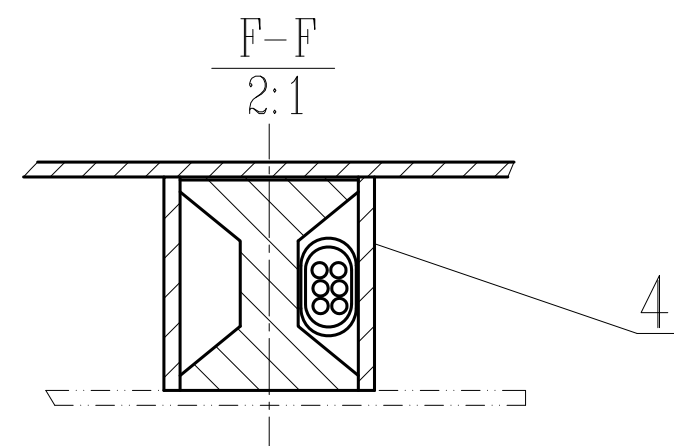
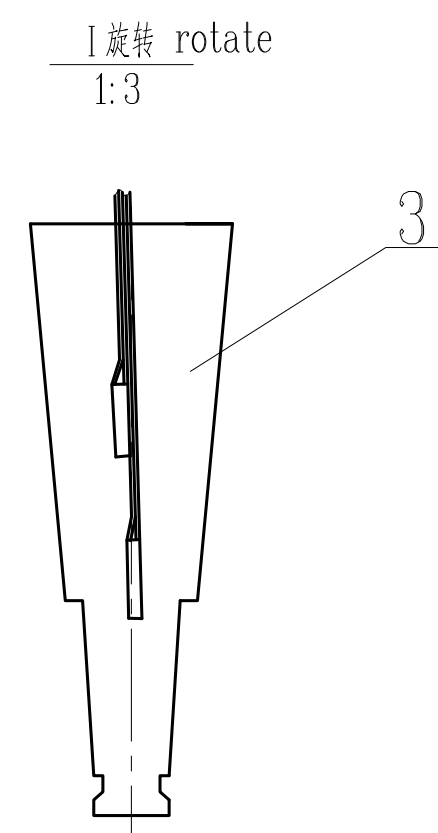


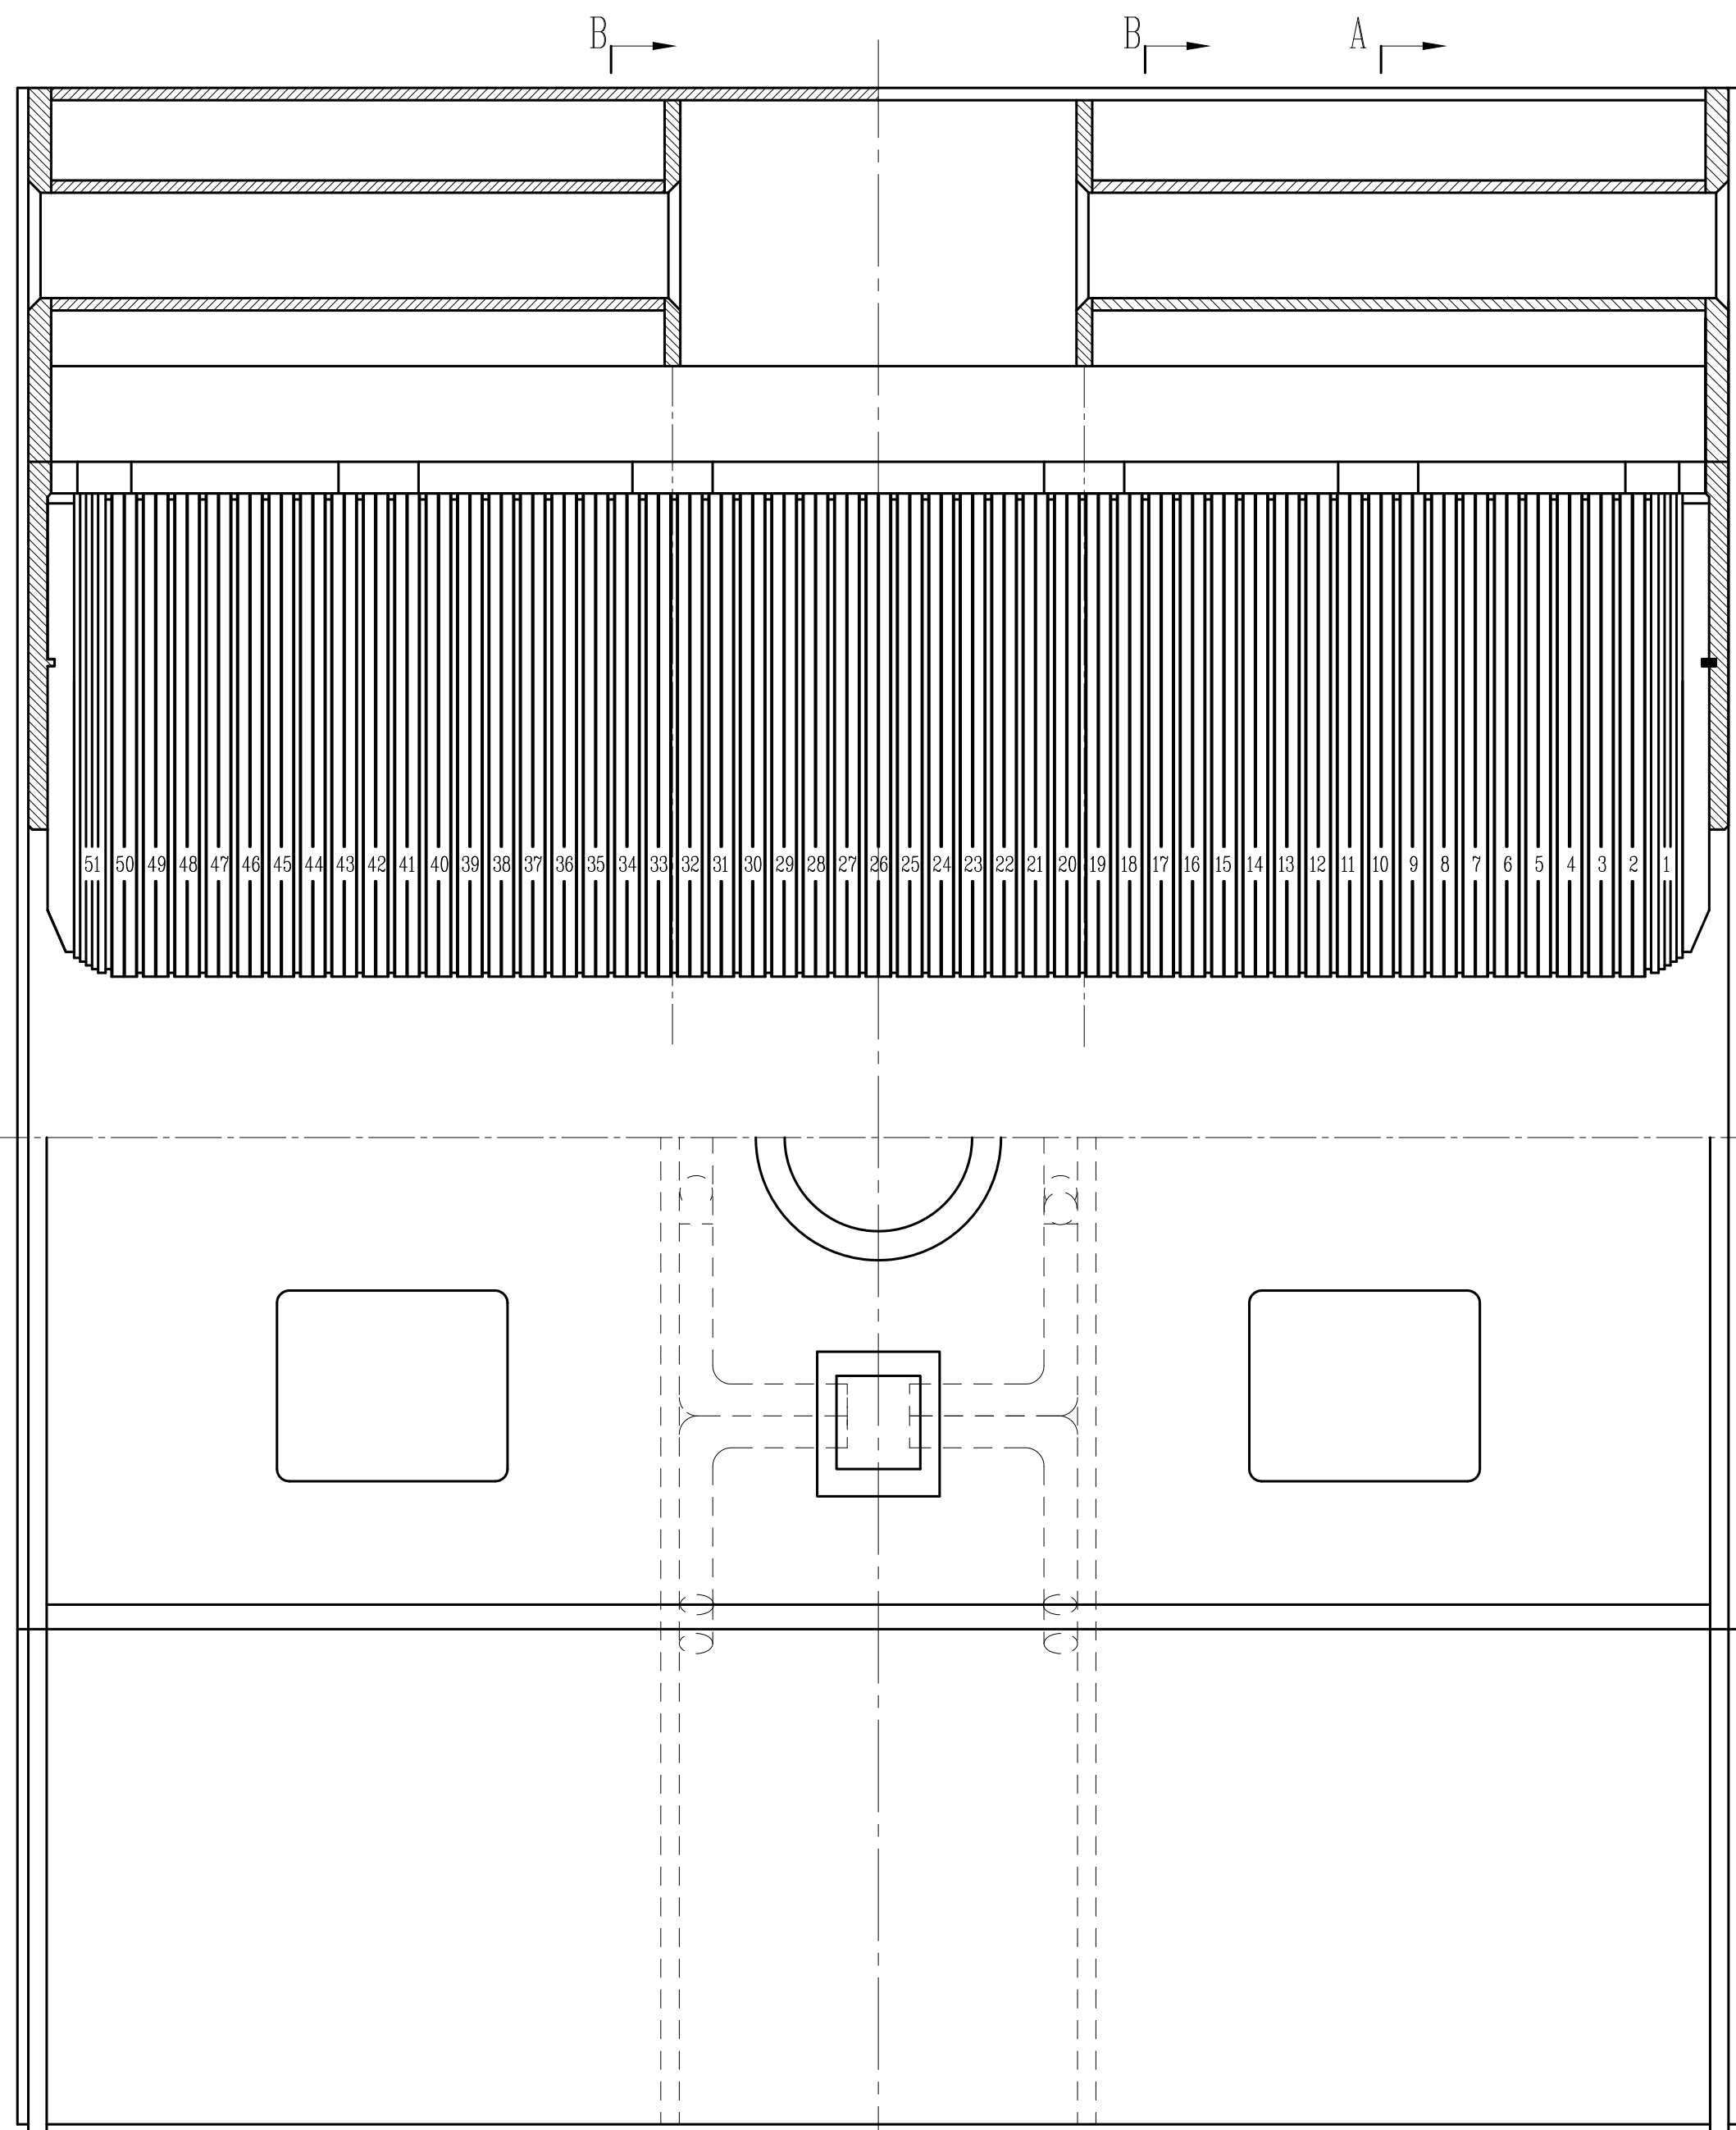

- ### 技术要求
1. 在电阻测温元件埋置及电阻测温软线穿管前，应该在每个电阻测温元件连接线首末端作好临时标志。
 2. 装序号4吋，线夹不得高出通风槽钢。
 3. 测温元件安放位置，见测温元件布置图。
- ### Technical Requirements
1. Before resistance thermometer embedding and connecting conductor inserting, the temporary symbols at the end of each connecting wire of resistance thermometer.
 2. When installing No.4, cable clamps shall not be higher than the channel steel.
 3. The location of RTD is in the RTD Layout Drawing

7		特号带帽 Special-shaped marker sleeve	24	2.5mm ² \	Special-shaped sleeve			
6		尼龙毛套 Nylon cable tie	24	3×80\				
5	T237-1-1-000	漆面 元件带罩图 Lacqued Layer of Thermal Elements	1					
4		钢板 Steel	18	0.5\Q235,20×20		0.001	0.018	
3	T237-1-1-10	垫片装配 Pad assembly	3			0.3	0.9	
2	T237-1-1-1-9	磨剪硅钢片装配 Silicon steel sheet assembly	1			12	12	
1	T1510-1-1-001	端子板 Terminal board	1					外购, 借用
序号 No	代号 Code	名称 Name	数量 Q'ty	材料 Material		单位 unit	总量 total	备注 Remark
					T237-1-1-1-5			
					测温装置 Thermal Device			
					图样标记 版本号 重量 比例			
					共 1 张 第 1 张 1:5			
					 东方电气 DONGFANG ELECTRIC 东风电机有限公司			
设计 吴越 罗文 穆建 校核 陈长利 标准化检查 马晨光 审查 徐大江 会签 范凌峻 日期 2013.9								