


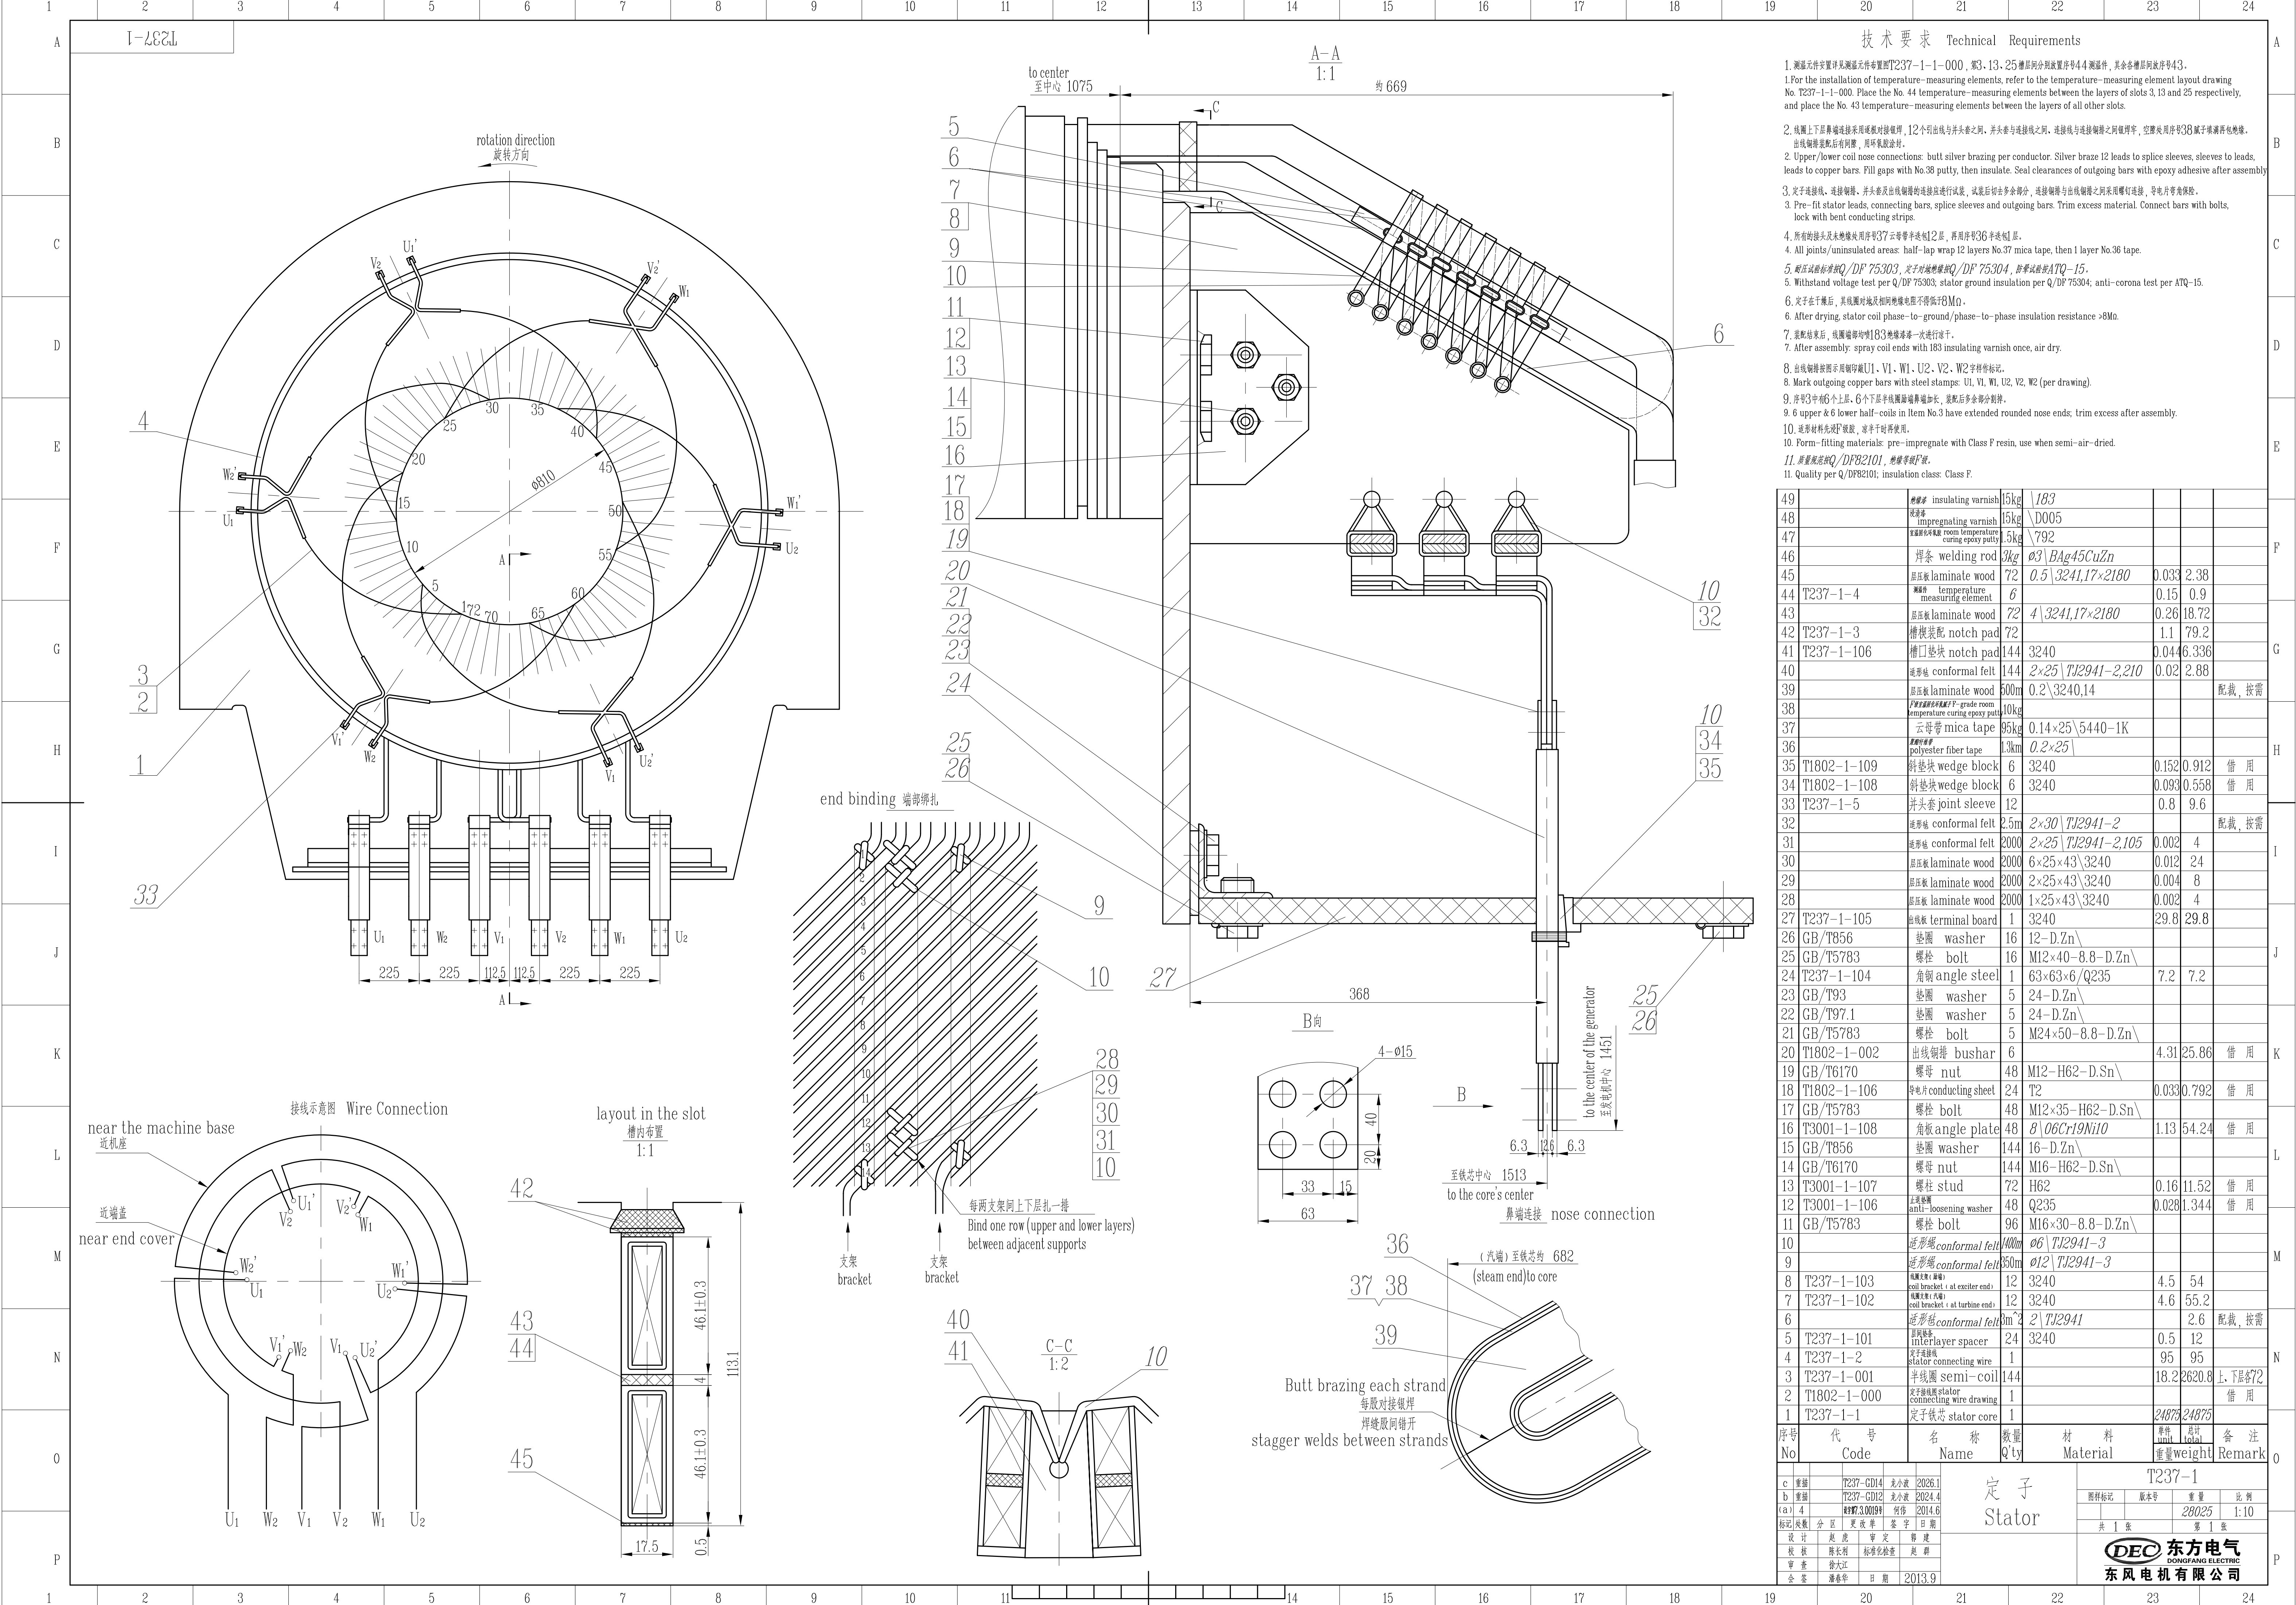

技术要求 Technical Requirements

- 测温元件安装详见测温元件布置图T237-1-1-000, 表3、13、25槽层间分别放置序号44测温件, 其余各槽层间放置序号43。
- For the installation of temperature-measuring elements, refer to the temperature-measuring element layout drawing No. T237-1-1-000. Place the No. 44 temperature-measuring elements between the layers of slots 3, 13 and 25 respectively, and place the No. 43 temperature-measuring elements between the layers of all other slots.
2. 线圈上下层鼻端连接采用预面对接焊接, 12个引出线与并头套之间、并头套与连接板之间、连接板与连接铜排之间留槽中, 空隙处用序号38腻子填满再包绝缘。
2. Upper/lower coil nose connections: butt silver brazing per conductor. Silver braze 12 leads to splice sleeves, sleeves to leads, leads to copper bars. Fill gaps with No.38 putty, then insulate. Seal clearances of outgoing bars with epoxy adhesive after assembly.
3. 定子连接板、连接铜排、并头套及引出铜排的连接应进行试装, 试装后切去多余部分, 连接铜排与引出铜排之间采用螺钉连接, 导电片弯角磨圆。
3. Pre-fit stator leads, connecting bars, splice sleeves and outgoing bars. Trim excess material. Connect bars with bolts, lock with bent conducting strips.
4. 所有的接头及未绝缘处用序号37云母带半迭包2层, 再用序号36半迭包1层。
4. All joints/uninsulated areas: half-lap wrap 12 layers No.37 mica tape, then 1 layer No.36 tape.
5. 耐压试验标准按Q/DF 75303, 定子对地绝缘按Q/DF 75304, 防晕试验按ATQ-15。
5. Withstand voltage test per Q/DF 75303; stator ground insulation per Q/DF 75304; anti-corona test per ATQ-15.
6. 定子干燥后, 其线圈对地及相同绝缘电阻不得低于0.8MΩ。
6. After drying, stator coil phase-to-ground/phase-to-phase insulation resistance >0.8MΩ.
7. 装配结束后, 线圈端部均喷183绝缘漆漆一次进行防护。
7. After assembly, spray coil ends with 183 insulating varnish once, air dry.
8. 出线铜排按图用铜印做U1、W1、U2、V2、W2字样作标记。
8. Mark outgoing copper bars with steel stamps: U1, W1, U2, V2, W2 (per drawing).
9. 序号3中槽6个上层、6个下层半线圈端部端加长, 装配后多余部分割掉。
9. 6 upper & 6 lower half-coils in item No.3 have extended rounded nose ends; trim excess after assembly.
10. 透形毡材料先浸F级漆, 晾干干后再使用。
10. Form-fitting materials: pre-impregnate with Class F resin, use when semi-air-dried.
11. 质量检验按Q/DF82101, 绝缘等级F级。
11. Quality per Q/DF82101; insulation class: Class F.

49		绝缘漆 insulating varnish	15kg	183				
48		浸渍漆 impregnating varnish	15kg	D005				
47		室温固化环氧树脂 room temperature curing epoxy putty	5kg	792				
46		焊条 welding rod	3kg	03\BAg45CuZn				
45		层压板 laminate wood	72	0.5\3241,17×2180	0.033	2.38		
44	T237-1-4	测温件 temperature measuring element	6		0.15	0.9		
43		层压板 laminate wood	72	4\3241,17×2180	0.26	18.72		
42	T237-1-3	槽楔装配 notch pad	72		1.1	79.2		
41	T237-1-106	槽口垫块 notch pad	144	3240	0.046	6.336		
40		透形毡 conformal felt	144	2×25\TJ2941-2,210	0.02	2.88		
39		层压板 laminate wood	500m	0.2\3240,14				配裁, 按需
38		透形毡 conformal felt	10kg	0.2×25				
37		云母带 mica tape	95kg	0.14×25\5440-1K				
36		透形毡 conformal felt	13km	0.2×25				
35	T1802-1-109	斜垫块 wedge block	6	3240	0.152	0.912	借用	
34	T1802-1-108	斜垫块 wedge block	6	3240	0.093	0.558	借用	
33	T237-1-5	并头套 joint sleeve	12		0.8	9.6		
32		透形毡 conformal felt	2.5m	2×30\TJ2941-2				配裁, 按需
31		透形毡 conformal felt	2000	2×25\TJ2941-2,105	0.002	4		
30		层压板 laminate wood	2000	6×25×43\3240	0.012	24		
29		层压板 laminate wood	2000	2×25×43\3240	0.004	8		
28		层压板 laminate wood	2000	1×25×43\3240	0.002	4		
27	T237-1-105	出线板 terminal board	1	3240	29.8	29.8		
26	GB/T856	垫圈 washer	16	12-D.Zn\				
25	GB/T5783	螺栓 bolt	16	M12×40-8.8-D.Zn\				
24	T237-1-104	角钢 angle steel	1	63×63×6/Q235	7.2	7.2		
23	GB/T93	垫圈 washer	5	24-D.Zn\				
22	GB/T97.1	垫圈 washer	5	24-D.Zn\				
21	GB/T5783	螺栓 bolt	5	M24×50-8.8-D.Zn\				
20	T1802-1-002	出线铜排 bushar	6		4.31	25.86	借用	
19	GB/T6170	螺母 nut	48	M12-H62-D.Sn\				
18	T1802-1-106	导电片 conducting sheet	24	T2	0.033	0.792	借用	
17	GB/T5783	螺栓 bolt	48	M12×35-H62-D.Sn\				
16	T3001-1-108	角板 angle plate	48	8\06Cr19Ni10	1.13	54.24	借用	
15	GB/T856	垫圈 washer	144	16-D.Zn\				
14	GB/T6170	螺母 nut	144	M16-H62-D.Sn\				
13	T3001-1-107	螺栓 stud	72	H62	0.16	11.52	借用	
12	T3001-1-106	垫圈 washer	48	Q235	0.028	1.344	借用	
11	GB/T5783	螺栓 bolt	96	M16×30-8.8-D.Zn\				
10		透形毡 conformal felt	400m	06\TJ2941-3				
9		透形毡 conformal felt	350m	012\TJ2941-3				
8	T237-1-103	线圈支架(汽端) coil bracket (at exciter end)	12	3240	4.5	54		
7	T237-1-102	线圈支架(水端) coil bracket (at turbine end)	12	3240	4.6	55.2		
6		透形毡 conformal felt	3m	2\TJ2941		2.6		配裁, 按需
5	T237-1-101	层间垫块 interlayer spacer	24	3240	0.5	12		
4	T237-1-2	定子连接线 stator connecting wire	1		95	95		
3	T237-1-001	半线圈 semi-coil	144		18.2	2620.8	上、下层各72	
2	T1802-1-000	定子接线图 stator connecting wire drawing	1				借用	
1	T237-1-1	定子铁芯 stator core	1					

序号	代号	名称	数量	材料	单件重量	总计重量	备注
No	Code	Name	Qty	Material	Weight	Total Weight	Remark
c	定稿	T237-CD14	无小波	2026.1			
b	审核	T237-CD12	无小波	2024.4			
a	4	审核	2024.4				
标记/页数	分区	更改/签字	日期				
设计	赵虎	审定	薛建				
校核	陈长利	标准/检查	赵群				
审查	徐大江						
会签	潘春华	日期	2013.9				

定子
Stator

