
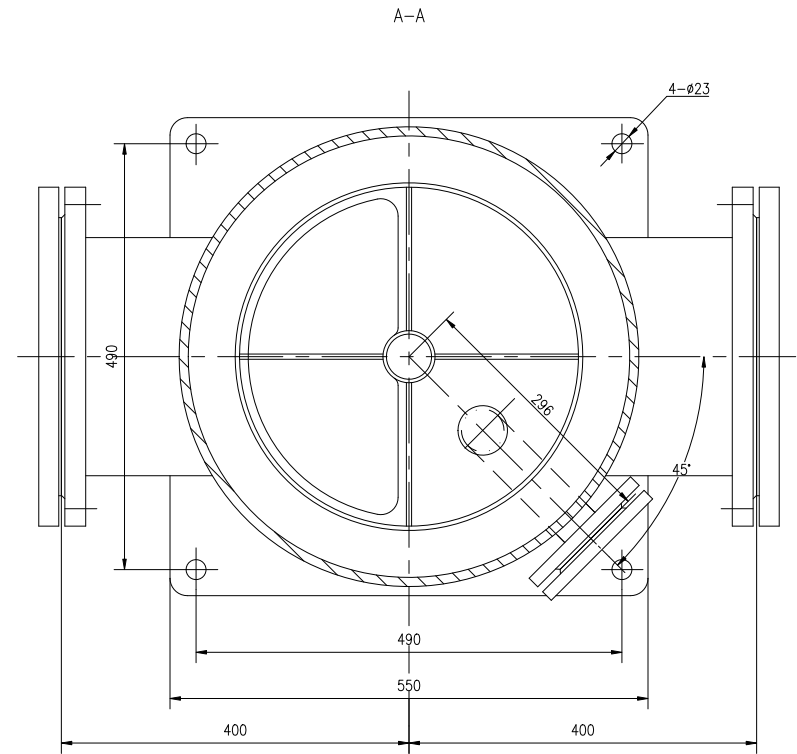


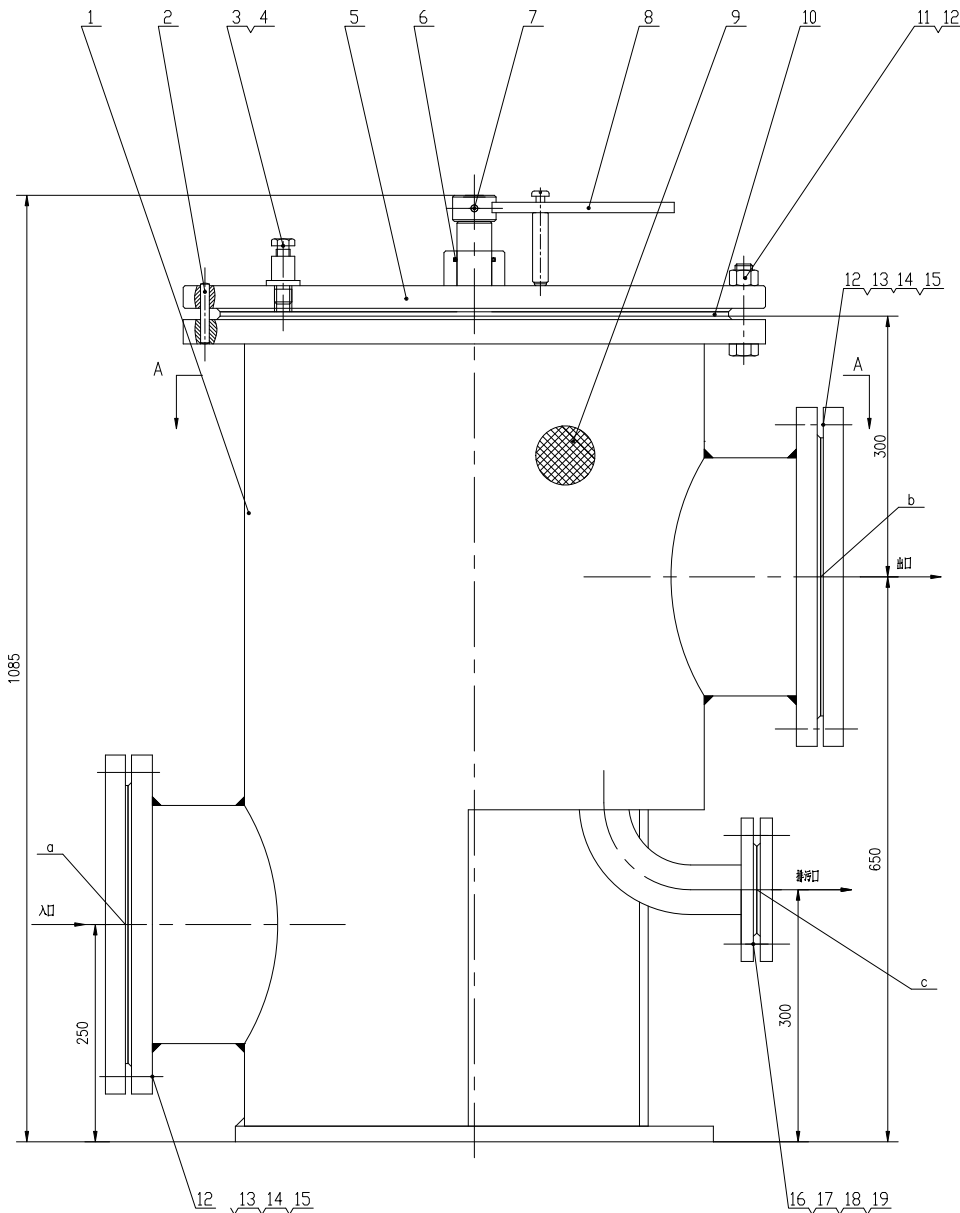

技术要求

- 装配后进行水压试验, 试验压力1.5MPa, 稳压10min.
- 转动手柄, 应灵活无卡涩.

Notes:

- After assembly, a hydrostatic test at pressure 1.5MPa will be performed, during which the pressure will hold for 10 minutes.
- Handle can be rotated freely without seizure up.

管口表 PIPE ORIFICES

序号 Symbol	用途 Usage	接口形式 Joint shape	公称尺寸 Nominal size	连接尺寸标准规格 Joint standards	密封面型式 Sealing face	备注 Remarks
a	进水口 Water inlet	法兰 Flange	DN250	JB/T81-2015 法兰DN250-PN10 PL RF 2	RF	
b	出水口 Water outlet	法兰 Flange	DN250	JB/T81-2015 法兰DN250-PN10 PL RF 2	RF	
c	排污口 Blow	法兰 Flange	DN50	JB/T81-2015 法兰DN50-PN10 PL RF 2	RF	

设计
王丽芬
校对
刘恩朝
日期
2023.11

				滤水器 Water Filter	
标记	处数	更改文件号	签字日期	0-0631-1125-0000-00	重量(Kg) 403
设计	2	王丽芬	审定	20231114	青岛捷能汽轮机集团股份有限公司
校对	刘恩朝	日期	20231114	共 1 页 第 1 页	QINGDAO JIENENG STEAM TURBINE GROUP CO.,LTD
审核					