

NOTE:

1.The Condenser will be manufactured in compliance with QQ/Z51015-99 Manufacture and Assembly Specifications for Steam Turbine.

2. During the installation in a power plant, after welding the steam admission chamber partially, remove the holding angle block, and then weld the steam admission chamber completely.

3. Before tube expansion, clean the tube holes thoroughly, and the tube will be expanded by 27mm.

4. The flange of the shell is welded 10mm above the surface of the shell.

5. The inside wall of the tube end will be even and smooth, free of damage caused by protrusion, scratch and non-smoothness. A smooth transition will be achieved from the expanded part to the non-expanded part, without recess nor grooves.

6. In placing tubes, put tubes through air cooling zone first, followed by welding 18 pieces of cross partition board of air cooling zone and then through other zones.

7. In placing tubes, put tubes through air cooling zone first, followed by welding 4 pieces of steel plate of 471x905x4mm between A-I boards and 14 pieces of steel plate of 471x787x4mm between B, C, D, E, F, G, H board.

8.After assembly,a hydrostatic test at the pressure 0.455MPa will be given on the water chamber,the pressure will hold for 10 minutes,and a water filling test given on the steam chamber,during which no leakage happens in 2 hours since the steam chamber has been filled up with water, in compliance with JB/T9629-2016 Hydrostatic Test Specifications for Steam Turbines,Pressure Parts.


9.Spring support will be mounted at the site,during which the springs are to bear the condenser without water.In mounting,seat the condenser on the springs while adjusting the set screws of the support so that the condenser is connected with and welded to the exhaust adapter in free state, and according to the adjusted height,put the adjusting blocks under the bottom of the support and then loosen the set screws.

10. The condenser complies with JB/T4058-2017 Standard of Cleanliness for Steam Turbines, with the internal wall with Cleanliness Level 2 and the remains with Cleanliness Level 4 therein in welding cleanliness.

11. The condenser complies with QQ9426-2023 Painting Specifications for Steam Turbines in painting condition.

12.The condenser complies with QQ9628-2023 Rust-Prevention Specifications for Steam Turbines in rust prevention condition.

13. After installing the water chamber cover plate, first loosen the pull rod nut inside the water chamber cover plate completely to the bottom, then tighten the external nut to tighten the water chamber, and then tighten the internal nut. To ensure thread sealing, the threads need to be wrapped with hemp rope or tape and coated with pipe thread sealant.

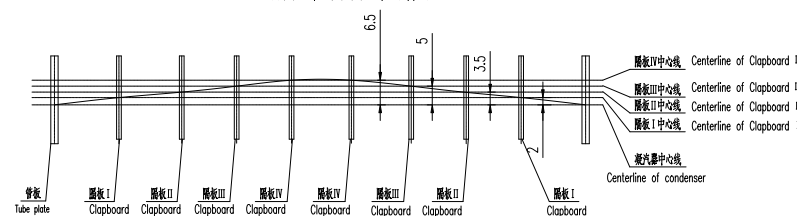

					蒸汽器	
					Condenser	
标记	处数	更改文件号	签字	日期	0-0801-2220-8400-81	
设计	刘俊卿	审定			重量(Kg) 29520	
校对	王书	日期	20251212	青岛捷能汽轮机集团股份有限公司		
审核	共 2 页	第 2 页	QINGDAO JIENENG STEAM TURBINE GROUP CO.,LTD			