
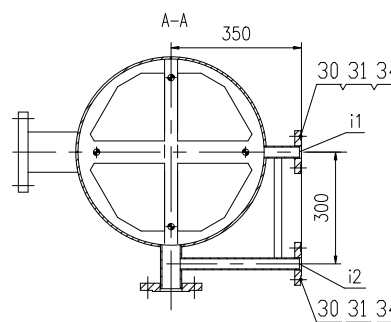


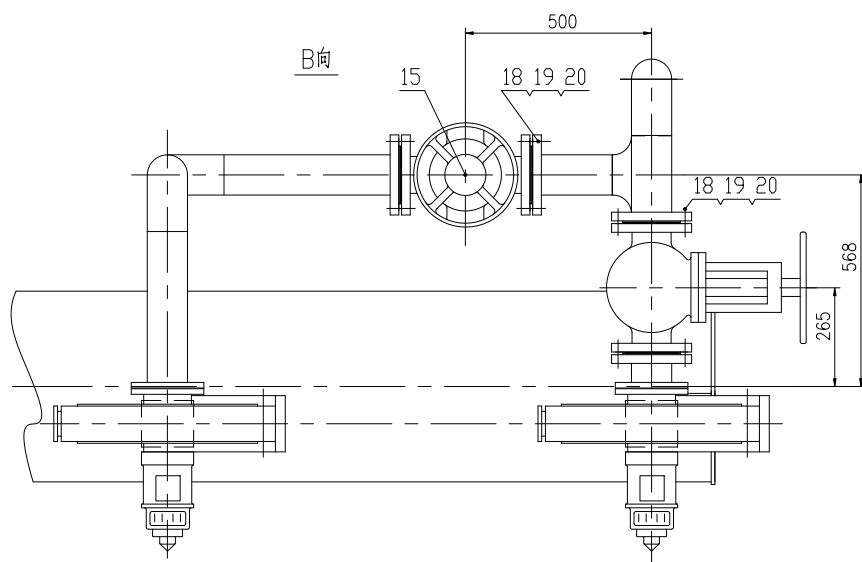

NOTES:

- 1.Model:LQ-40.
- 2.Cooling water flow rate 55~75t/h.
- 3.Cooling surface area 40m².
- 4.Condensate working pressure 1.5Mpa.
- 5.Pressure for hydrostatic test:
 - 2.25MPa in water chamber.and 0.2MPa in steam chamber The test will be held for 10 minutes,during which no leakage is allowed.
- 6.Cleanliness condition conforms to JB/T4058-2017 Standard of Cleanliness for steam Turbines.
- 7.Each interface of this device is provided with counter flange.

技术要求

1. 型号: LQ-40.
2. 冷却水量 $55 \sim 75 \text{ t/h}$.
3. 冷却面积 40 m^2 .
4. 凝汽器工作压力 1.5 MPa .
5. 水压试验: 水室部分 2.25 MPa ; 汽室部分 0.2 MPa ; 稳压 10 min , 不得有渗漏现象.
6. 清洁度应符合 JB/T4058—2017《汽轮机清洁度》“清-4”的规定.
7. 抽汽机底部设置放水孔并配有放水阀, 风机启动和停机时, 打开放水阀放尽积水.
8. 风机正常运行时放水阀应关闭.

				轴封冷却器	
				Shaft Gland Cooler	
				0-0829-5040-586C-01	
				重量(Kg) 1150	
标记	处数	更改文件号	签字	日期	
设计	24		审定	2026.309	
校	对	刘佩朝	日期	2026.309	
审核			共 1 页	第 1 页	
				青岛捷能汽轮机集团股份有限公司 QINGDAO JIENENG STEAM TURBINE GROUP CO.,LTD	