




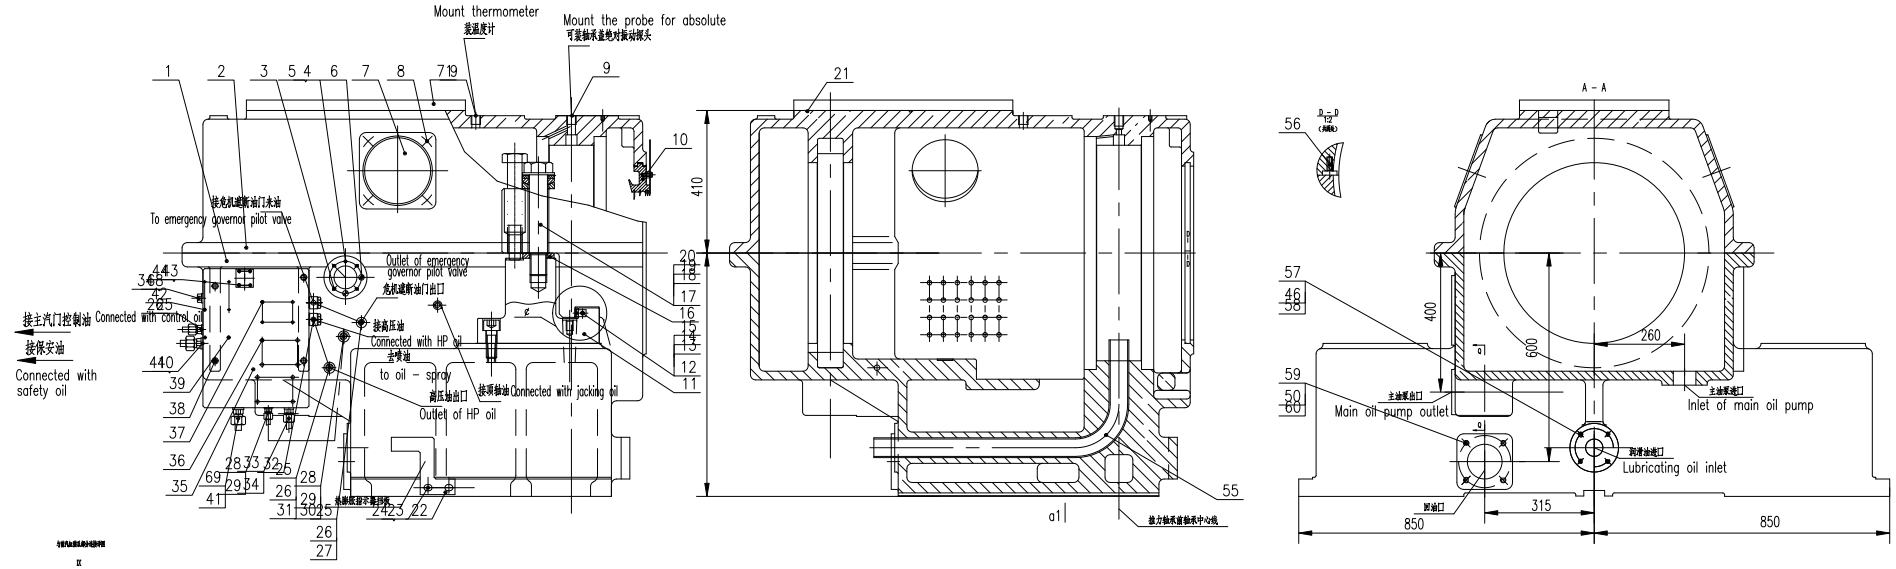





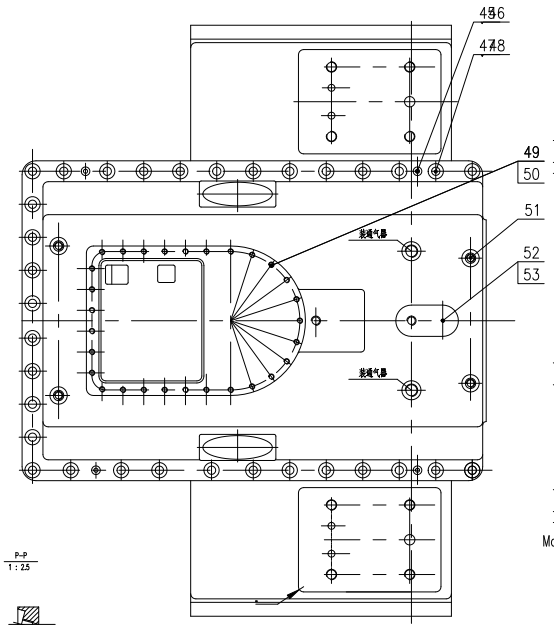


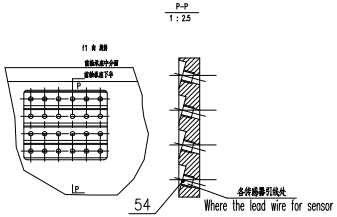




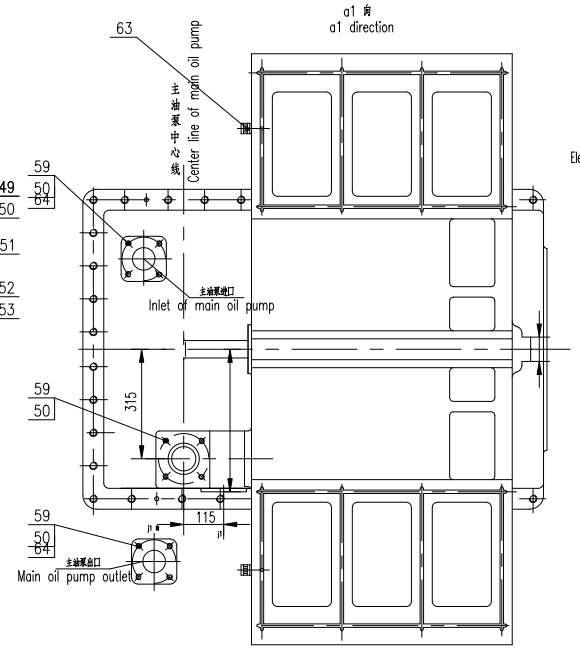

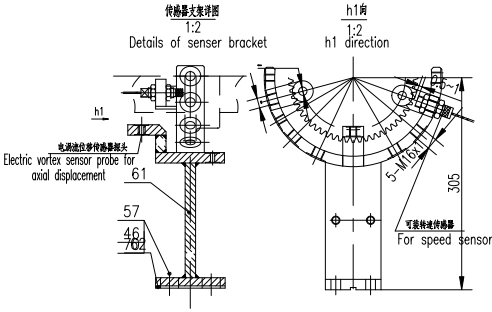

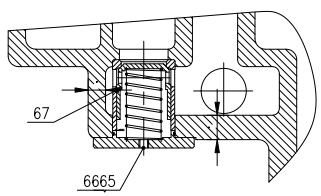



Note:

1.Put the upper half on the lower half and then,tighten up one of every three bolts to the extent that a feeler gauge of 0.03mm thick can not be inserted inbetween.
2.The width of the sliding key for longitudinal thermal expansion will be 0.04-0.06mm less than that of the keyway in the front bearing housing.
3.In assembly,the centerline of front bearing will be made to 0.05-0.06mm higher than that of the annular recess for inlet casing gland.
4.The misalignment,leftwards or rightwards,against the centerline of the casing will be 0.03mm or less.
5.In assembling thrust-journal bearing,connect the joints of all thermistors with sockets.

技术要求

1.两半中分面合上后，每隔两只拧紧一只螺栓时，用0.03mm塞尺不能塞入。
2.纵向热膨胀滑键的宽度较前轴承座键槽小0.04~0.06mm。
3.装配时前轴承中心线应比前汽缸前汽封挡中心线高0.05~0.06mm。
4.与汽缸中心线的左右偏心度≤0.03mm。
5.组装推力轴承前轴承时，将各热电阻接头与插座相连。

设计	
校对	
日期	

标记	处数	更改文件号	签字	日期
设计		马文青	审定	
校对		孟雨	日期	20251127
审核		冲山	共 2 页	第 1 页

前轴承座
Front Bearing Housing
0-0071-0158-0000-04
重量(Kg) 3814
青岛捷能汽轮机集团股份有限公司
QINGDAO JIENENG STEAM TURBINE GROUP CO.,LTD