





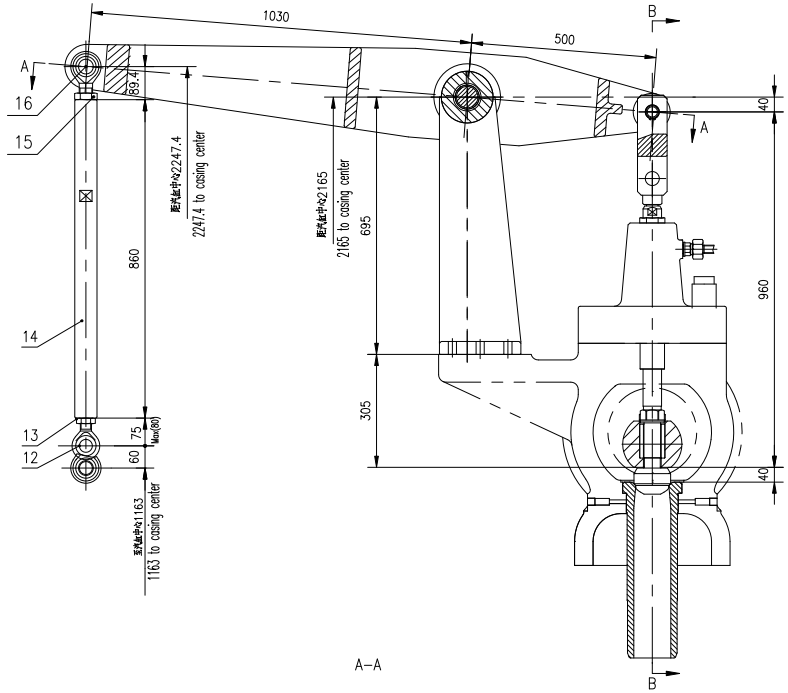


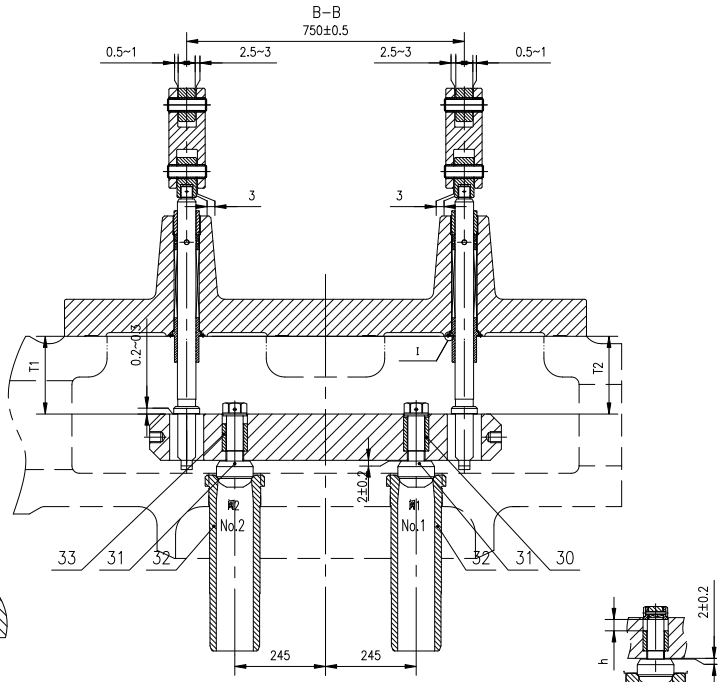

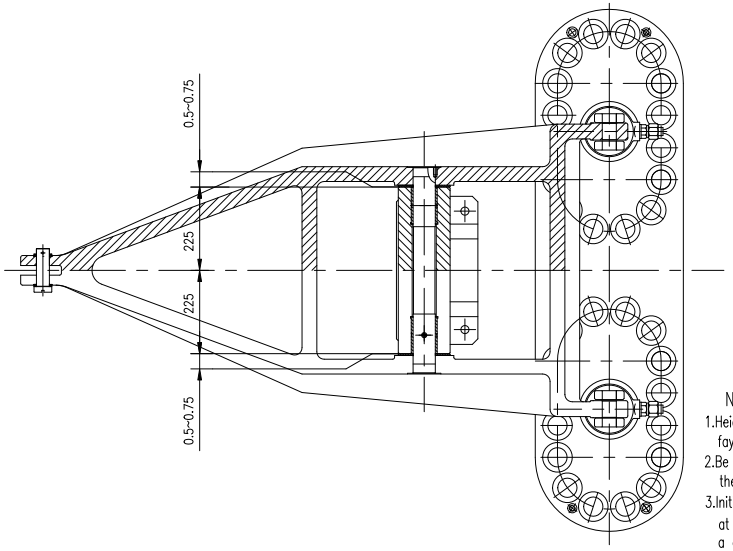



杠杆位置(杠杆比 2.06:1)
lever position (Ratio2.06:1)

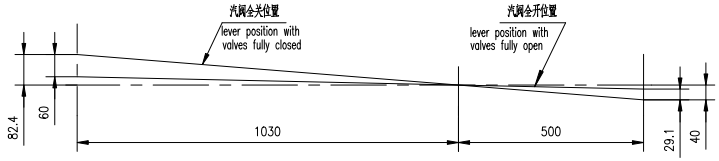

油动机行程m
Travel of servopiston
60

技术要求

1.横梁至蒸汽室结合面T1、T2值相差不大于0.10mm。
2.填料环装入时须小心，不可磨损密封表面，填料室和阀杆表面须清洗干净。
3.填料初始压紧量不可太大，阀杆处允许有微量泄漏，待运行一段时间后，再调整压紧量，完全密封。

Notes:

1.Height difference between T1 and T2, the distances from the cross bar and the faying face of steam chamber, will be not larger than 0.10 mm.
2.Be careful with mounting filler ring so as not to damage the sealing surface.Both the filler chamber and the surface of valve spindle will be washed clean.
3.Initial packing density of the filler will be not too large,with slight leakage allowable at the valve spindle.After running for a certain time,readjust the packing density for a complete sealing.

阀门升程调整
ADJUSTMENT OF VALVE LIFT

阀序 Sequence	阀 径 d Valve dia	h±0.1
1	ø90(梨) pear	3.5
2	ø90(梨) pear	21.34

绝密

设 计	
盛蕾	
校 对	
袁涛	
日 期	
2025.12	

标记	处数	更改文件号	签字	日期	调节汽阀及连杆 Steam Governing valve with link lever	
设计			审定		0-0341-586C-0000-00	重量(Kg) 1185
校对			日期	20260109	青岛捷能汽轮机集团股份有限公司 QINGDAO JIENENG STEAM TURBINE GROUP CO., LTD.	
审核			共1页	第1页		