


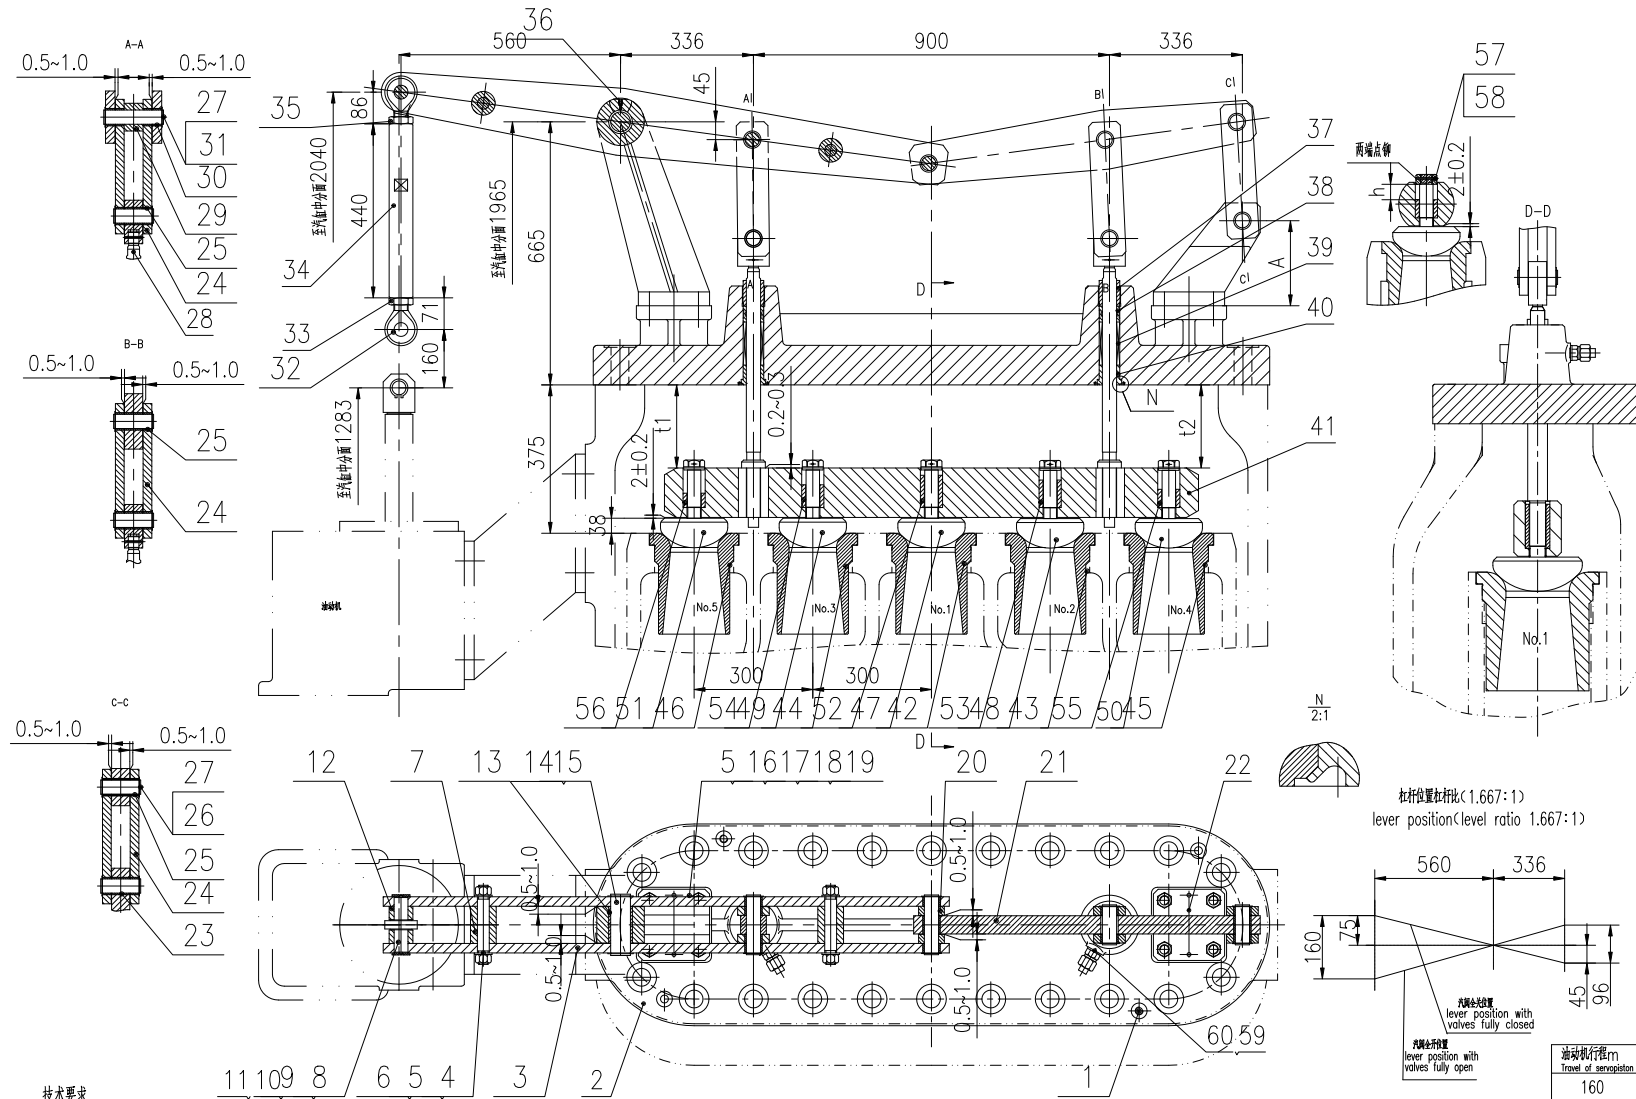

- 技术要求
1. 横梁至蒸汽室结合面T1、T2处偏差不得大于0.10mm。
 2. 填料环装入时须小心，不可磨伤密封表面，填料室和阀杆表面应保持干净。
 3. 填料和轴套量不可太大，阀杆处允许有微量泄漏。待运行一段时间后，再调整压紧量，完全密封。

Notes:

1. Difference between T1 and T2, the distances from the cross bar to the facing face of steam chamber, will not larger than 0.10 mm.
2. Be careful with mounting packing ring so as not to wear out the sealing surface, both the packing chamber and the surface of valve spindle will be washed clean.
3. Initial packing density of the filler will be not too large, with slight leakage allowable at the valve spindle. After running for a certain time, readjust the packing density for a complete sealing.

序号 Item No.	尺寸 Dimension	公差 Tolerance
1	Ø120C (ø120)	3.5
2	Ø120C (ø120)	20.93
3	Ø120C (ø120)	38.36
4	Ø120C (ø120)	55.78
5	Ø120C (ø120)	74.77

蒸汽阀及连杆			
设计/Design	更改文件号/Revision	签字/Signature	日期/Date
设计/Design	审核/Check	日期/Date	数量/Quantity
校对/Check	日期/Date	青島捷能汽輪機集團股份有限公司	
审核/Check	共1页/Total 1 page	QINGDAO JIENENG STEAM TURBINE GROUP CO.,LTD	