
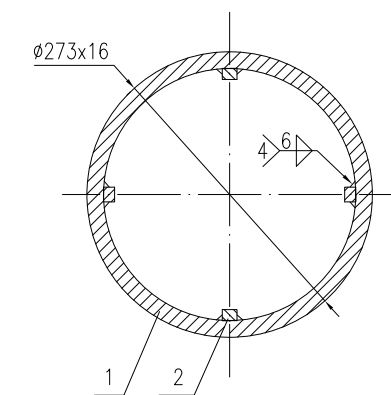
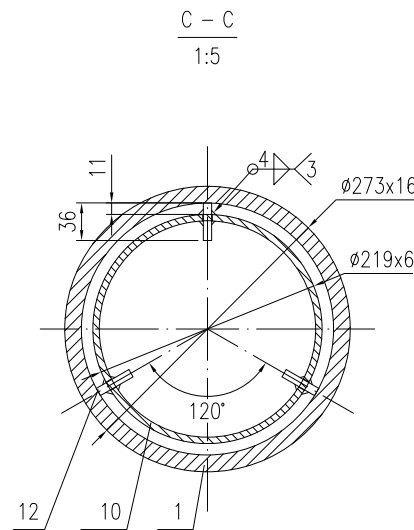


本图纸及相关文件版权属于江苏索普赛瑞装备制造有限公司所有,任何单位和个人未经江苏索普赛瑞装备制造有限公司书面许可,不得以任何方式复制或扩散至第三方,违者应相应地法律责任。
THIS DRAWING AND RELEVANT DOCUMENT'S COPYRIGHT BELONGS TO SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THEY MAY NOT BE REPRODUCED OR DISCLOSED TO ANY THIRD PARTY IN ANY FORM WITHOUT THE PRIOR WRITTEN PERMISSION OF SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THE OFFENDERS SHALL BEAR THE CORRESPONDING LEGAL RESPONSIBILITY.

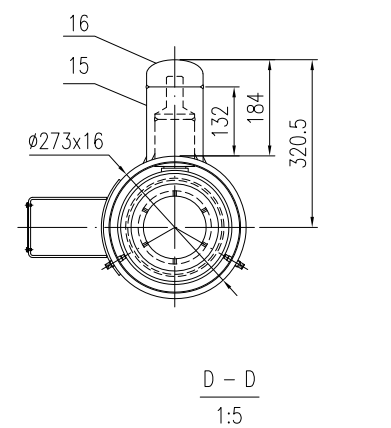

1. The manufacturing, inspection, and acceptance of headers shall be carried out in accordance with GB/T16507.5 "Water-tube Boilers Part 5: Manufacturing" and GB/T16507.6 "Water-Tube Boilers Part 6: Inspection, Testing, and Acceptance."
2. The butt welds of pressure-bearing components must be 100% radiographic inspection and comply with NB/T47013.2 "Non-Destructive Testing of Pressure-Bearing Equipment Part 2: Radiographic Testing" RT-II (AB) standard. Magnetic particle testing of fillet welds must comply with NB/T47013.4 "Non-Destructive Testing of Pressure-Bearing Equipment Part 4: Magnetic Particle Testing" MT-I standard, and all welds must be primed with argon arc welding.
3. The header hydrostatic test is conducted according to GB/T16507.6 "Water-tube Boilers Part 6: Inspection, Testing, and Acceptance." After passing the test, remove the hydrostatic test seal and smooth the inner wall. The hydrostatic test pressure is 9.9MPa.
4. When assembling equipment, ensure the neutrality between the hose and the gradually expanding pipe and sleeve.
5. During assembly, component 8 and part 2 should first be securely welded and integrated, then assembly between part 2 and piece 1.
6. The nameplate pre-welded plate of part 13 and the nameplate assembly of part 14 are installed in the mid-position along the axis direction of the cylinder.
7. Parts 1 and 5 should be trimmed and ground after passing the hydrostatic test; Part 1 has a 30° groove at both ends and a 2mm blunt edge; One end of part 5 has a 30° groove and a 1mm blunt edge.

技术特性表 Technical Performance									
规范: TSG 11-2020 锅炉安全技术规程 Code: TSG 11-2020 Regulation on Safety Technical for Boiler									
序号 NO.	项 目 ITEM	单 位 UNIT	2# 喷水减温器 Spray-type Attemperator						
1	介质 Medium	--	过热蒸汽+减温水 Superheated steam+desuperheating water						
2	工作压力 Working pressure	MPa	6.6						
3	蒸汽进/出口温度 Steam inlet/outlet temperature	℃	379/379						
4	额定出口流量 Rated outlet flow	t/h	~82						
5	喷水量 Injection flow	t/h	0~5						
接管表 Nozzle Schedule									
符 号 MARK	接管名称 NAME	公称尺寸 N. SIZE	公称压力 N. PN	数 量 QUANTITY	连接标准或接管规格 CON. STD	法兰型式 TYPE	连接面型式 FACING	材 料 MATERIAL	备 注 NOTE
N1	蒸汽进口 Steam inlet	250	--	1	ø273x16	--	BW	12Cr1MoVG	
N2	蒸汽出口 Steam outlet	250	--	1	ø273x16	--	BW	12Cr1MoVG	
N3	减温水进口 Desuperheating water inlet	25	--	1	ø32x4	--	BW	12Cr1MoⅢ	
N4	检查口 Inspection port	100	--	1	ø108x10	--	BW	12Cr1MoVG	盲端封头 Blind head

17	按本图 SEE THIS DWG	水压试验封板 $\phi 240$ $t=24$ Hydraulic Test Blind Plate	2	12Cr1MoVR	11.3	22.6	
16	32SCG2504-2-16	封头 $\phi 108 \times 10$ End cap	1	12Cr1MoVR/GB/T713		3	
15	按本图 SEE THIS DWG	接管 $\phi 108 \times 10$ $L=156$ Connection pipe	1	12Cr1MoVG/GB/T5310		2.6	
14	42SCG-1-1-0	铭牌组件 Nameplate Component	1	组合件 ASSEMBLY		2.6	MP150-CS
13	32SCG2504-2-13	铭牌预焊板 Nameplate Pre-welded Plate	1	12Cr1MoVR		1.2	
12	32SCG2504-2-12	钢板 $50 \times 36 \times 8$ Steel plate	3	12Cr1MoVR	0.1	0.3	
11	32SCG2504-2-11	支承圆钢 Support round steel	3	12Cr1MoV	0.04	0.12	
10	32SCG2504-2-10	套管 $\phi 219 \times 6$ $L=1060$ Casing	1	12Cr1MoVG/GB/T5310		33.4	
9	32SCG2504-2-9	渐扩管 $t=6$ Tapered tube	1	12Cr1MoVR		8.8	
8	32SCG2504-2-8	喉管 Throat tube	1	12Cr1MoVⅧ/NB/T47008		10.8	
7	32SCG2504-2-7	螺母 $M42 \times 2$ Nut	1	12Cr1MoVG/GB/T5310		0.2	
6	32SCG2504-2-6	螺纹接管 $\phi 42 \times 5$ Threaded pipe	1	12Cr1MoVG/GB/T5310		0.5	
5	32SCG2504-2-5	套管接头 Casing joint	1	12Cr1MoVⅧ/NB/T47008		0.4	
4	按本图 SEE THIS DWG	接管 $\phi 76 \times 7$ $L=95$ Connection pipe	1	12Cr1MoVG/GB/T5310		1.1	
3	32SCG2504-2-3	圆环 $t=3.5$ Ring	1	12Cr1MoVR		1.4	
2	32SCG2504-2-2	固定块 Fixed block	4	12Cr1MoVR	0.1	0.4	
1	32SCG2504-2-1	钢管 $\phi 273 \times 16$ $L=2000+100$ Steel pipe	1	12Cr1MoVG/GB/T5310		202.8	两端各留50余量 Leave about 50 units at each end
件号 PART NO.	图号或标准号 DRAWING NO. OR STD NO.	名 称 DESCRIPTION	数量 QTY.	材 料 MATERIAL	单 SINGLE 重量(kg)	总 TOTAL 重量(kg)	备 注 REMARK

					江苏索普赛瑞装备制造有限公司 SOPO CERE Equipment Manufacturing Co., Ltd.			
					组合件 ASSEMBLY			2#喷水减温器 Spray-type Attenuator
MARK 标 记	TOTAL NO. 处 数	FILE NO. 更改文件号	SIGN 签 名	DATE 日 期	Text WEIGHT(kg) 重 量	SCALE 比 例	REV. 版 次	32SCG2504-2-0
DESIGN 设计	李学亮	2025.12.24	TECH REVIEW 工 艺 陈逸	2025.12.24	297	1:10	0	
CHECK 校对	黄杰	2025.12.24	APPROVE 批 准 王健明	2025.12.24	TOTAL-PAGES 共 张		No.-PAGE 第 张	
REVIEW 审核	许大宇	2025.12.24						
本图纸及相关文件版权归属于江苏索普赛瑞装备制造有限公司所有,任何单位和个人未经江苏索普赛瑞装备制造有限公司书面许可,不得以任何方式复制或扩散至第三方,违者追究相关法律责任。 THIS DRAWING AND RELEVANT DOCUMENTS COPYRIGHT BELONGS TO SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THEY MAY NOT BE REPRODUCED OR DISCLOSED TO ANY THIRD PARTY IN ANY FORM WITHOUT THE PRIOR WRITTEN PERMISSION OF SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THE OFFENDERS SHALL BEAR THE CORRESPONDING LEGAL RESPONSIBILITY.								