



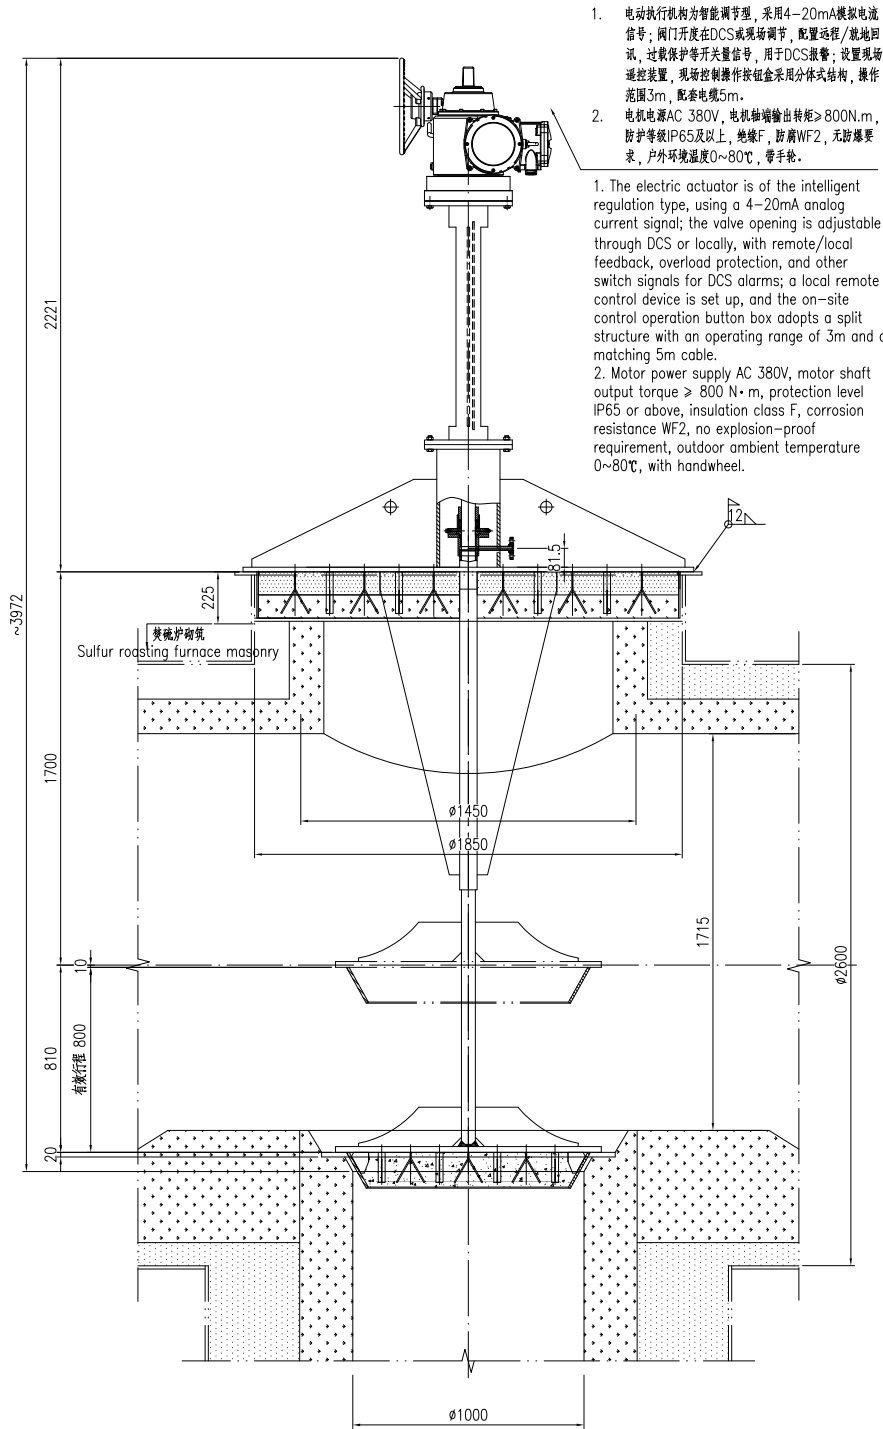

1. 电动执行机构为智能调节型,采用4-20mA模拟电流信号;阀门开度在DCS或现场调节,配置远程/就地回讯,过载保护等开关量信号,用于DCS报警;设置现场遥控装置,现场控制操作按钮盒采用分体式结构,操作范围3m,配套电缆5m。
2. 电机电源AC 380V,电机轴输出转矩≥800N.m,防护等级IP65及以上,绝缘F,防腐WF2,无防爆要求,户外环境温度0~80℃,带手轮。

1. The electric actuator is of the intelligent regulation type, using a 4-20mA analog current signal; the valve opening is adjustable through DCS or locally, with remote/local feedback, overload protection, and other switch signals for DCS alarms; a local remote control device is set up, and the on-site control operation button box adopts a split structure with an operating range of 3m and a matching 5m cable.
2. Motor power supply AC 380V, motor shaft output torque ≥ 800 N·m, protection level IP65 or above, insulation class F, corrosion resistance WF2, no explosion-proof requirement, outdoor ambient temperature 0~80℃, with handwheel.

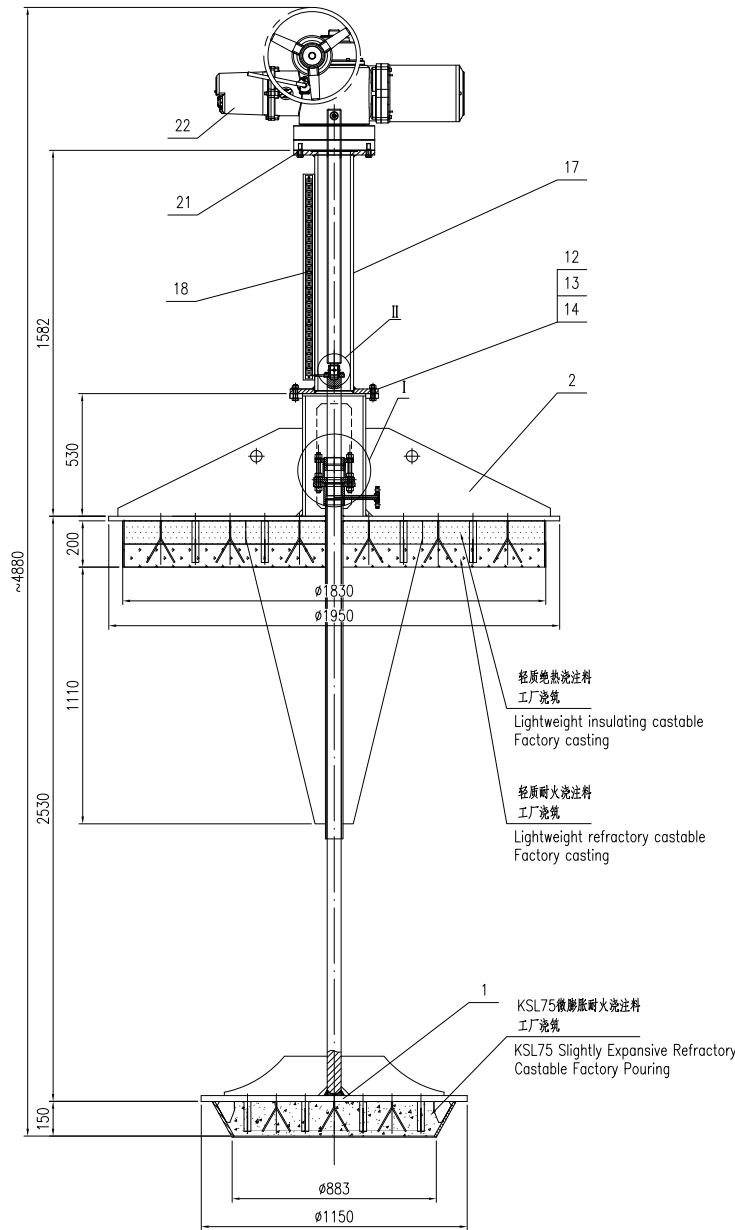

轻质绝热浇注料
工厂浇筑
Lightweight insulating castable
Factory casting

轻质耐火浇注料
工厂浇筑
Lightweight refractory castable
Factory casting


1 KSL75微膨胀耐火浇注料
工厂浇筑
KSL75 Slightly Expansive Refractory
Castable Factory Pouring

技术要求及安装说明:


1. 本阀门用以调节焚烧炉旁通出口烟气温度。
2. 厂内按本图实线图纸尺寸装配合格后,再安装刻度指示器,此时标记指针位置为0刻度处,将刻度标示器焊于支撑管架上,其面向与电动执行装置手轮方向一致。
3. 设备不锈钢部分进行酸洗钝化。
4. 浇注料施工在工厂进行,在工厂烘干保养后发货。
5. 厂内将电动执行装置安装好后,随设备整体出厂。
6. 冷却用仪表风用量为~5Nm³/h。

Technical Requirements and Installation Instructions:

1. This valve is used to regulate the flue gas temperature at the bypass outlet of the incinerator.
2. After the assembly in the factory is completed according to the solid-line dimensions in this drawing, install the scale indicator. At this time, the marked pointer position is at the 0 scale. The scale indicator should be welded onto the support pipe frame, facing the same direction as the handwheel of the electric actuator.
3. The stainless steel parts of the equipment should undergo pickling and passivation.
4. The castable material construction is carried out in the factory and shipped after drying and curing in the factory.
5. After the electric actuator is installed in the factory, it is delivered as part of the overall equipment.
6. The flow of instrument cooling air is ~5 Nm³/h.

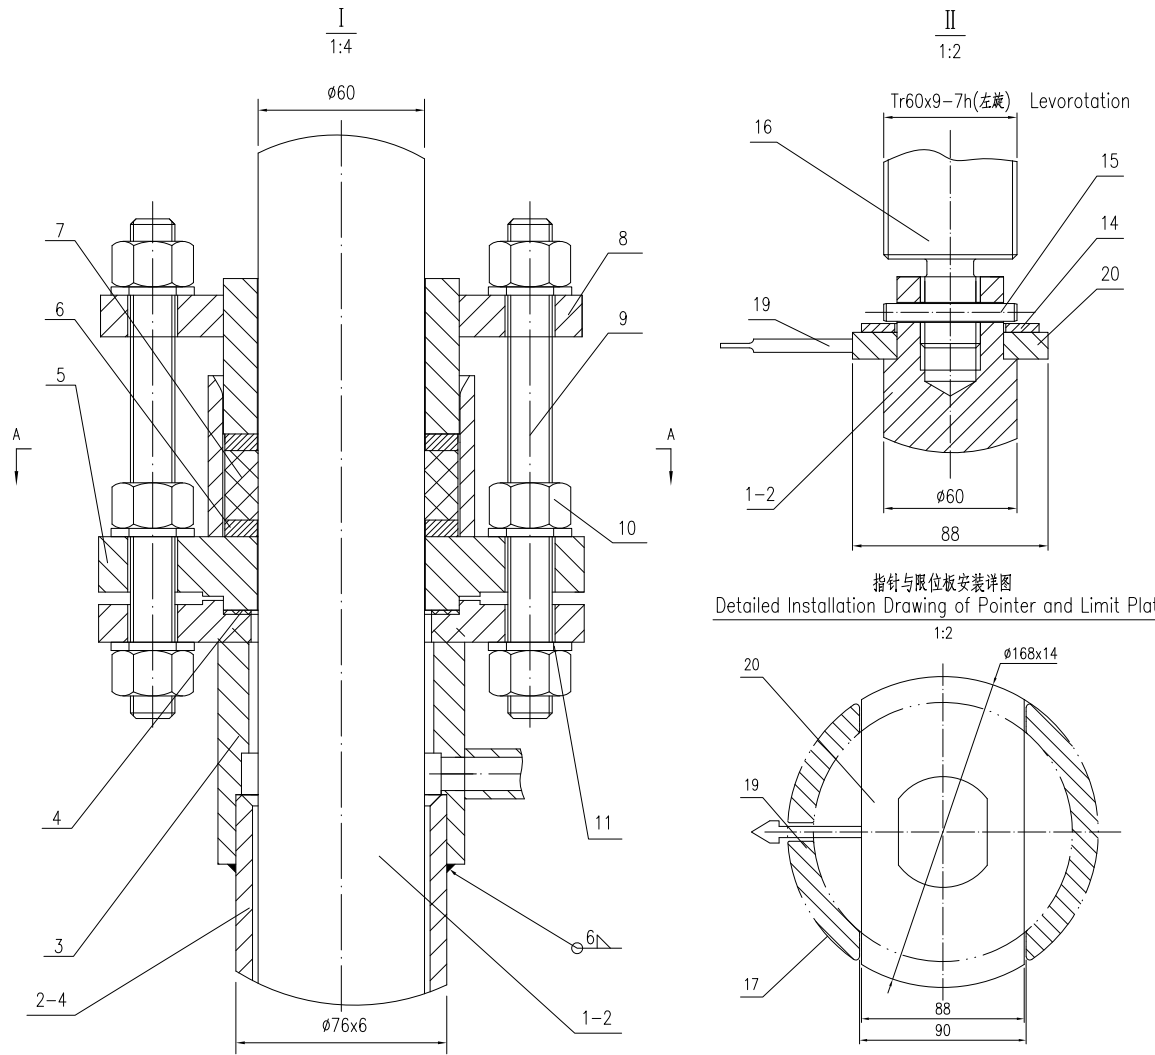

指针与限位板安装详图
Detailed Installation Drawing of Pointer and Limit Plate

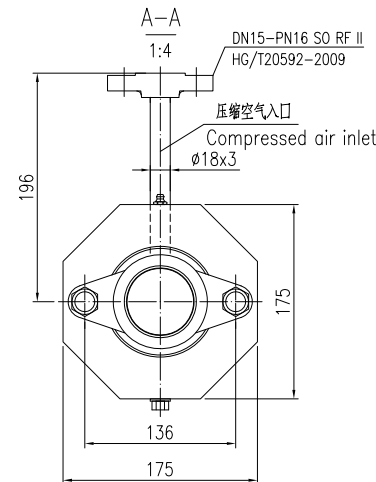

22	按本图 SEE THIS DWG	电动执行装置 Electric actuator	1	组合件 ASSEMBLY			外购 见技术协议 Purchased externally see technical agreement
21	GB/T 5783	六角螺栓 M16x40 Hexagon bolt	8	8.8级 Level 8.8	0.2	1.6	
20	40SCG2504-5	限位板 t=20 Limit plate	1	Q345R		1.9	
19	40SCG2504-5	指针 Pointer	1	304		--	
18	40SCG2504-5	刻度标示器 Scale indicator	1	组合件 ASSEMBLY		2.3	
17	40SCG2504-4	支撑管架 Support frame	1	组合件 ASSEMBLY		70.1	
16	40SCG2504-3	梯型螺栓 Ø60 Trapezoidal screw	1	20Cr13		26	
15	GB/T 877	开尾锥销 Ø10x70 Open-end taper pin	1	35CrMoA		--	
14	40SCG2504-3	垫圈 t=8 gasket	1	Q345R		--	
13	GB/T 6170	螺母 M16 nut	8	8级 Level 8	0.03	0.24	
12	GB/T 5782	六角螺栓 M16x60 Hexagon bolt	8	8.8级 Level 8.8	0.1	0.8	
11	GB 97.2	垫圈 16 gasket	14	100HV	--	--	
10	GB/T 6175	螺母 M16 nut	6	30CrMo	0.03	0.18	
9	HG/T20613	全螺纹螺栓 M16x180 Full-thread stud	2	35CrMo	0.3	0.6	
8	40SCG2504-4	填料压盖 Packing gland	1	组合件 ASSEMBLY		1.6	
7	按本图 SEE THIS DWG	填料 Packing	2	石墨 Graphite	--	--	1套作为备件 1 set as spare parts
6	40SCG2504-3	填料垫圈 Packing gasket	2	S31008	0.2	0.4	
5	40SCG2504-3	填料盒 Packing box	1	组合件 ASSEMBLY		7.1	
4	40SCG2504-3	陶瓷纤维垫 t=3 Ceramic fiber	1	陶瓷纤维 Ceramic fiber	--	--	
3	40SCG2504-1	密封法兰 Sealed flange	1	组合件 ASSEMBLY		5.2	
2	40SCG2504-2	阀座 Valve seat	1	组合件 ASSEMBLY		1273.7	
1	40SCG2504-1	阀盖 Valve cover	1	组合件 ASSEMBLY		489.2	

件号 PART NO.	图号或标准号 DRAWING OR STD. NO.	名称 DESCRIPTION	数量 QTY.	材料 MATERIAL	单重 SINGLE WEIGHT(kg)	总重 TOTAL WEIGHT(kg)	备注 REMARK

江苏赛瑞科技工程有限公司 CERE China Technical Engineering Jiangsu Co., Ltd.				江苏赛瑞装备制造有限公司 SOPO CERE Equipment Manufacturing Co., Ltd.			
组合件 ASSEMBLY				钟罩阀 Bell valve			
1881				40SCG2504-0			
共 张				第 张			

本图纸及相关资料版权归江苏赛瑞装备制造有限公司所有,任何单位和个人未经江苏赛瑞装备制造有限公司许可,不得以任何方式复制或传播。违者将依法追究法律责任。
THIS DRAWING AND RELEVANT DOCUMENTS BELONG TO SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THEY MAY NOT BE REPRODUCED OR DISCLOSED TO ANY THIRD PARTY IN ANY FORM WITHOUT THE PRIOR WRITTEN PERMISSION OF SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THE OFFENDERS SHALL BEAR THE CORRESPONDING LEGAL RESPONSIBILITY.