


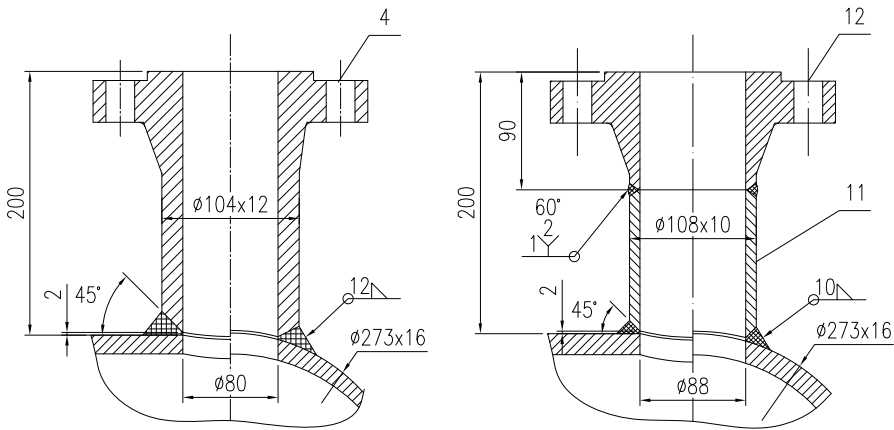
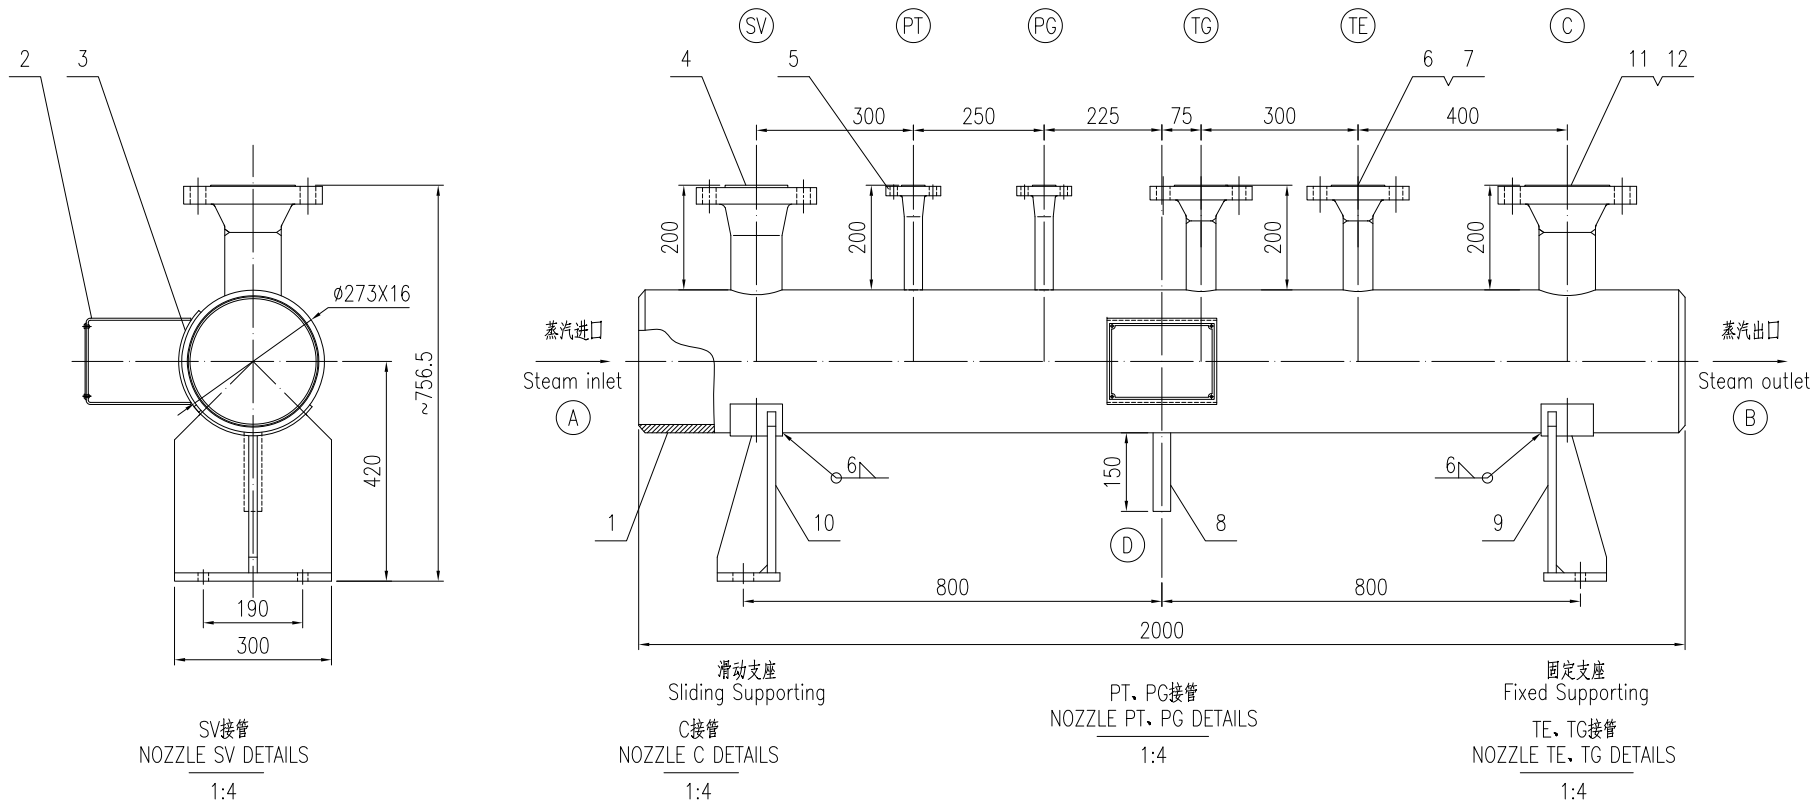


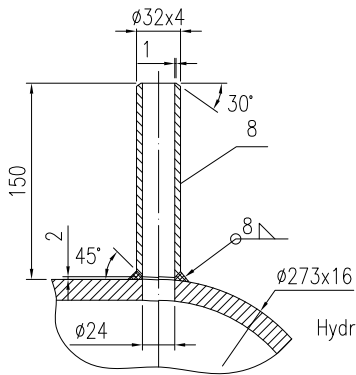

D接管(旋转)
NOZZLE D DETAILSD (ROTATION)
1:2

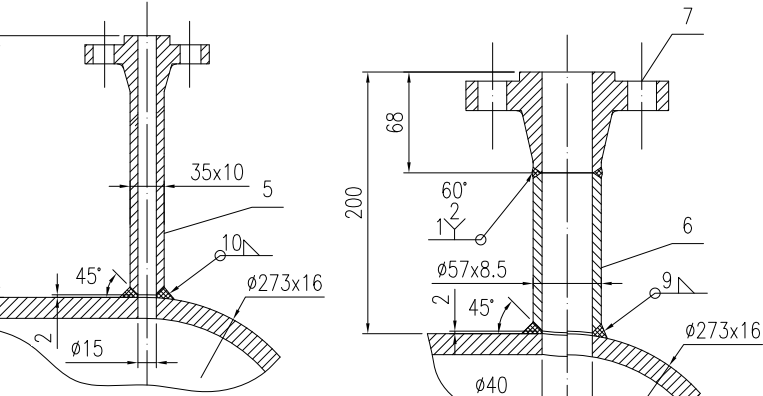

集箱进出口详图
Detailed Drawing of Inlet/Outlet for Steam Header
1:4

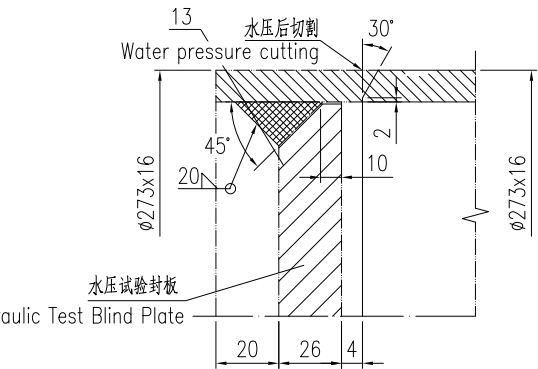

技术要求:
1. 集箱的制造、检验及验收按GB/T16507.5《水管锅炉 第5部分: 制造》和GB/T16507.6《水管锅炉 第6部分: 检验、试验和验收》进行。
2. 承压元件的对接焊缝必须100%射线检测, 并符合NB/T47013.2《承压设备无损检测 第2部分: 射线检测》RT-II (AB) 级标准。接管角焊缝进行磁粉检测, 应符合NB/T47013.4《承压设备无损检测 第4部分: 磁粉检测》MT-I 级标准, 所有焊缝必须氩弧焊打底。
3. 集箱焊后必须整体热处理。
4. 所有开孔内侧倒圆R=2mm。
5. 接管D预留20mm余量用于做水压试验, 水压试验封板为φ50,t=6mm, 材质为12Cr1MoVR, 角焊缝高度为4mm, 水压试验后, 切除余量并且削边成本图坡口。

Technical Requirements:
1. The fabrication, inspection, and acceptance of the header shall be carried out in accordance with GB/T16507.5 "Water-tube Boilers Part 5: Fabrication" and GB/T16507.6 "Water-tube Boilers Part 6: Inspection, Testing, and Acceptance".
2. Butt welds of pressure-bearing components must undergo 100% radiographic testing and meet NB/T47013.2 "Non-destructive Testing of Pressure Equipment Part 2: Radiographic Testing" RT-II (AB) grade standards. Fillet welds of nozzles shall be subjected to magnetic particle testing and meet NB/T47013.4 "Non-destructive Testing of Pressure Equipment Part 4: Magnetic Particle Testing" MT-I grade standards. All welds must have argon backing.
3. The header must undergo overall heat treatment after welding.
4. All hole inner edges shall be rounded with R=2mm.
5. An allowance of 20mm shall be reserved on nozzle D for hydraulic testing. The hydraulic test sealing plate shall be φ50, t=6mm, made of 12Cr1MoVR. The fillet weld height is 4mm. After the hydraulic test, the allowance shall be removed and the edge trimmed according to the drawing bevel.

技术特性表 Technical Performance

规范: TSG 11-2020 锅炉安全技术规程 Code: TSG 11 Regulation on Safety Technology for Boiler 2020ED			
序号 NO.	项目 ITEM	单位 UNIT	集汽集箱 Steam Box
1	介质 Medium	/	过热蒸汽 Superheated Steam
2	介质流量 Medium flow	t/h	~82
3	工作温度 Working temperature	°C	450
4	工作压力 Working pressure	MPa	6.4
5	水压试验压力 Hydrostatic test pressure	MPa	9.6

接管表 Nozzle Schedule

符号 MARK	接管名称 NAME	公称尺寸 N. SIZE	公称压力 N. PN	数量 QUANTITY	连接标准或接管规格 CON. STD	法兰型式 TYPE	连接型式 FACING	材料 MATERIAL	备注 NOTE
A	蒸汽进口 Steam inlet	250	/	1	φ273x16	/	BW	12Cr1MoVG	
B	蒸汽出口 Steam outlet	250	/	1	φ273x16	/	BW	12Cr1MoVG	
C	放空口 Vent	100(B)	PN100	1	HG/T20592-2009	WN	RF	12Cr1MoVⅢ	
SV	安全阀接口 Safety valve	80(B)	PN100	1	HG/T20592-2009	IF	RF	12Cr1MoVⅢ	
PT	压力远传接口 Pressure transmitter	15(B)	PN100	1	HG/T20592-2009	IF	RF	12Cr1MoVⅢ	
PG	压力表接口 Pressure gauge	15(B)	PN100	1	HG/T20592-2009	IF	RF	12Cr1MoVⅢ	
TE	温度远传接口 Temperature transmitter	50(B)	PN100	1	HG/T20592-2009	WN	RF	12Cr1MoVⅢ	
TG	温度计接口 Temperature gauge	50(B)	PN100	1	HG/T20592-2009	WN	RF	12Cr1MoVⅢ	
D	疏水口 Drain	25	/	1	φ32x4	/	BW	12Cr1MoVG	

13	按本图 SEE THIS DWG	水压试验封板 φ240 t=26 Hydraulic Test Blind Plate	2	12Cr1MoVR	11.3	22.6			
12	HG/T 20592-2009	法兰 WN 100(B)-100 RF (S=10) Flange	1	12Cr1MoVⅢ/NB/T47008		13.0		C	
11	按本图 SEE THIS DWG	接管 φ108x10 L=121 Connecting pipe	1	12Cr1MoVG/GB/T5310		2.9		C	
10	31SCG2504-10-0	滑动支座 Sliding Supporting	1	组合件 ASSEMBLY		18.3			
9	31SCG2504-9-0	固定支座 Fixed Supporting	1	组合件 ASSEMBLY		18.3			
8	按本图 SEE THIS DWG	接管 φ32x4 L=151+20 Connecting pipe	1	12Cr1MoVG/GB/T5310		0.5		D(含余量) Including allowance	
7	HG/T 20592-2009	法兰 WN 50(B)-100 RF (S=8.5) Flange	2	12Cr1MoVⅢ/NB/T47008	6.0	12.0		TE TG	
6	按本图 SEE THIS DWG	接管 φ57x8.5 L=135 Connecting pipe	2	12Cr1MoVG/GB/T5310	1.4	2.8		TE TG	
5	31SCG2504-5	法兰 IF 15-100 RF Flange	2	12Cr1MoVⅢ/NB/T47008	0.4	0.8		PT PG	
4	31SCG2504-4	法兰 IF 80-100 RF Flange	1	12Cr1MoVⅢ/NB/T47008		4		SV	
3	31SCG2504-3	铭牌预焊板 Nameplate Pre-welded Board	1	12Cr1MoVR		2.5			
2	42SCG-2-1-0	铭牌组件 Nameplate Component	1	组合件 ASSEMBLY		4.3		MP200-CS	
1	按本图 SEE THIS DWG	筒体 φ273x16 L=2000+100 Shell	1	12Cr1MoVG/GB/T5310		202.8		两端各留50余量 Leave about 50 units of each end	
件号 PART NO.	图号或标准号 DRAWING NO. OR	名称 DESCRIPTION	数量 QTY.	材料 MATERIAL	单重 SINGLE WEIGHT	总重 TOTAL WEIGHT	kg	重量(kg) WEIGHT	备注 REMARK

江苏索普赛瑞装备制造有限公司 SOPO CERE Equipment Manufacturing Co., Ltd.					集汽集箱 Steam Box		
MARK 标记	TOTAL NO. 总数	FILE NO. 更改文件号	SIGN 签名	DATE 日期	组合件 ASSEMBLY		
DESIGN 设计	李学亮	2025.12.24	工艺	2025.12.24	WEIGHT(kg) 重量	SCALE 比例	REV. 版次
CHECK 校对	黄杰	2025.12.24	批准	2025.12.24	304.8	1:10	0
REVIEW 审核	许大为	2025.12.24			TOTAL-PAGES 共 张	No.-PAGE 第 页	31SCG2504-0

本图纸及相关文件版权属于江苏索普赛瑞装备制造有限公司所有, 任何单位和个人未经江苏索普赛瑞装备制造有限公司书面许可, 不得以任何方式复制或扩散至第三方, 违者应负相应法律责任。
THIS DRAWING AND RELEVANT DOCUMENT'S COPYRIGHT BELONGS TO SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THEY MAY NOT BE REPRODUCED OR DISCLOSED TO ANY THIRD PARTY IN ANY FORM WITHOUT THE PRIOR WRITTEN PERMISSION OF SOPO CERE EQUIPMENT MANUFACTURING CO., LTD. THE OFFENDERS SHALL BEAR THE CORRESPONDING LEGAL RESPONSIBILITY.