FRONT ELEVATION - PART "A"

SCALE: 1/4"=1'-0"

NOTE:
VERIFY DESIGN OF FRONT PORCH W/ OWNER

ELEVATION GENERAL NOTES:

- ALL FIRST FLOOR CEILING HEIGHTS TO BE 12'-1 1/8" HIGH, UNLESS OTHERWISE NOTED.
- ALL SECOND FLOOR CEILING HEIGHTS TO BE 8'-1 1/8" HIGH, UNLESS OTHERWISE NOTED.
- ALL EXTERIOR MATERIALS TO BE STONE, UNLESS OTHERWISE NOTED.
- ALL WINDOWS AT STONE TO HAVE 4" STUCCO TRIM AS SHOWN ON ELEVATIONS, UNLESS OTHERWISE NOTED.
- ALL HORIZONTAL STONE OPENINGS TO BE SUPPORTED BY 4" X 5" X 3/8" STEEL ANGLE, UNLESS OTHERWISE NOTED. VERIFY WITH ENGINEER.
- STONE SHELF TO FOLLOW FINISH GRADE, MIN. 5 1/2" WIDE.
- ALL DOOR AND WINDOW TRIM AT STUCCO TO BE 4" STUCCO, UNLESS OTHERWISE NOTED.
- ALL FLASHING, CRICKETS AND GABLE ROOF VENTS TO BE COPPER, UNLESS OTHERWISE NOTED (VERIFY W/ OWNER).
- ROUTE ALL STACKS AND VENTS TO BACKSIDE OF ROOF. ALL PLUMBING STACKS TO BE "RE-VENTED" WHERE POSSIBLE FOR MIN. # OF ROOF PENETRATIONS.

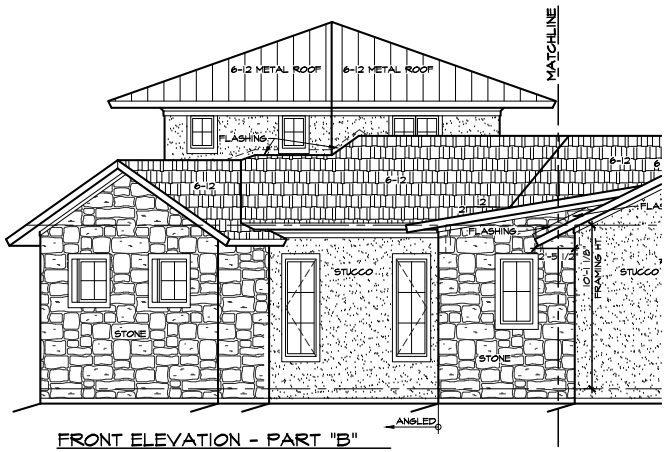

FRONT ELEVATION - PART "B"

SCALE: 1/4"=1'-0"

ROOF NOTES:

-TYPICAL 2 X 8 RAFTERS AT MAXIMUM 24" ON CENTER BRACED AT MAXIMUM 12' ON CENTER.
-ANY ALTERATION TO RIDGE/ VALLEY OR RAFTER LAYOUT MUST BE APPROVED BY LICENSED STRUCTURAL ENGINEER.
-TYPICAL 2 X 8 RIDGES & VALLEYS UNLESS OTHERWISE NOTED.

FRAMING NOTES:

- PROVIDE SOLID BLOCKING AT MAXIMUM 8'-0" ON CENTER.
- ANY ALTERATION TO JOIST OR SPAN AND BEAM SIZING MUST BE APPROVED BY LICENSED STRUCTURAL ENGINEER.
- JOIST LAYOUT FOR SCHEMATIC & ESTIMATING PURPOSES ONLY - VERIFY SPACING & DIRECTION OF SPAN W/ MECHANICAL CONTRACTOR PRIOR TO CONSTRUCTION.
- BEAM SIZES ARE PROVIDED FOR PRICE ESTIMATING PURPOSES ONLY - ALL SIZES TO BE VERIFIED BY STRUCTURAL ENGINEER.
- PROVIDE GALV. JOIST HANGERS @ ALL FLUSH BEAMS.

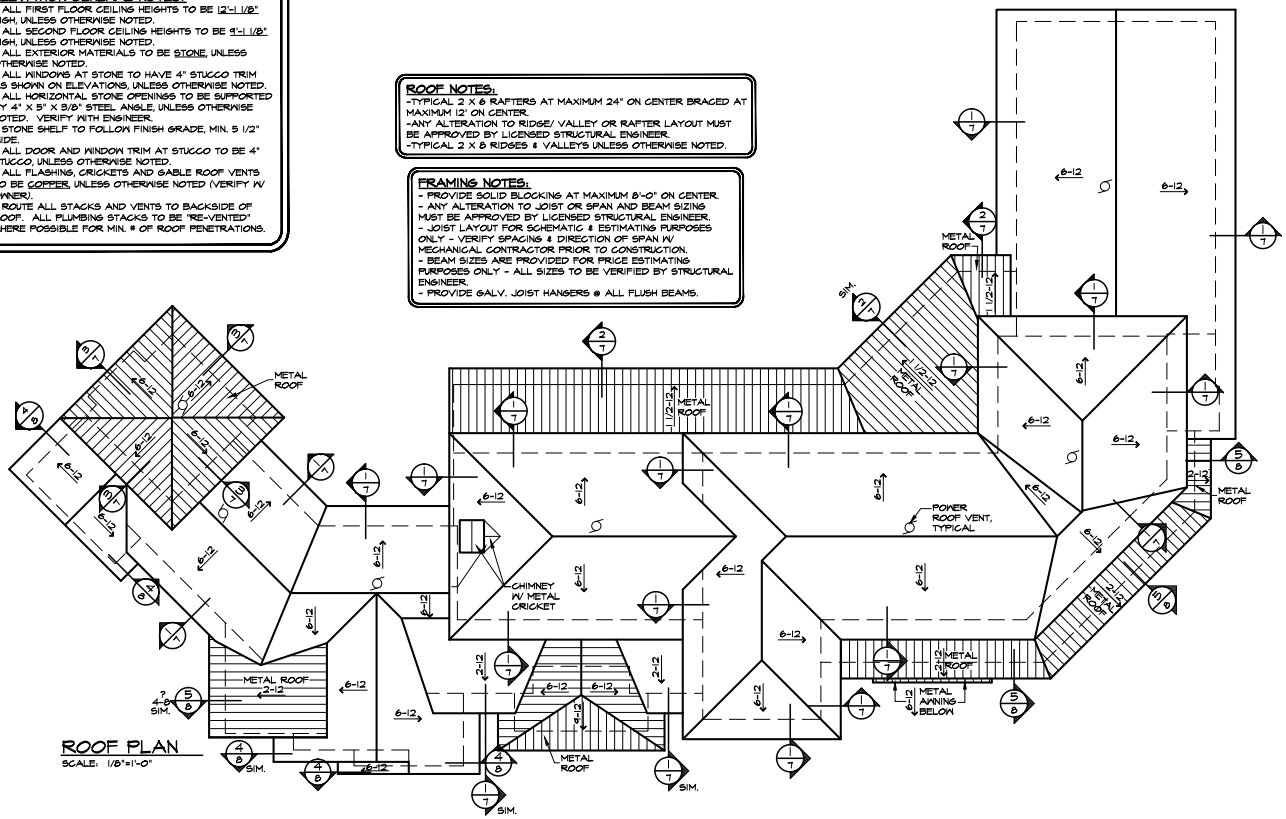

ROOF PLAN

SCALE: 1/8"=1'-0"