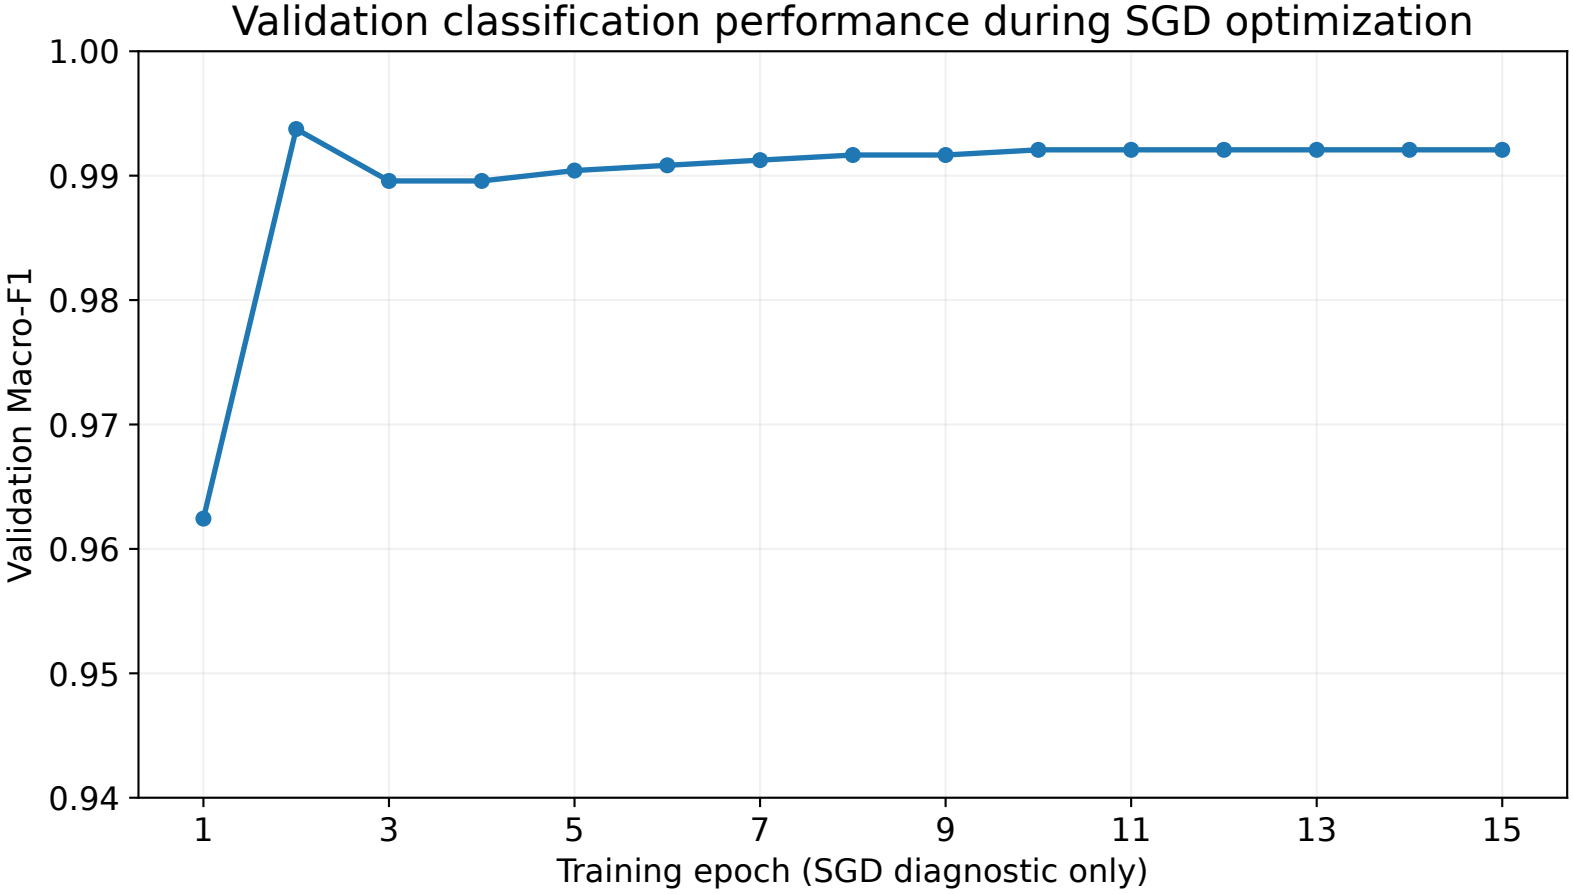
Validation classification performance during SGD optimization
Validation Macro-F1
1.00
0.99
0.98
0.97
0.96
0.95
0.94
1
3
5
7
9
11
13
15
Training epoch (SGD diagnostic only)