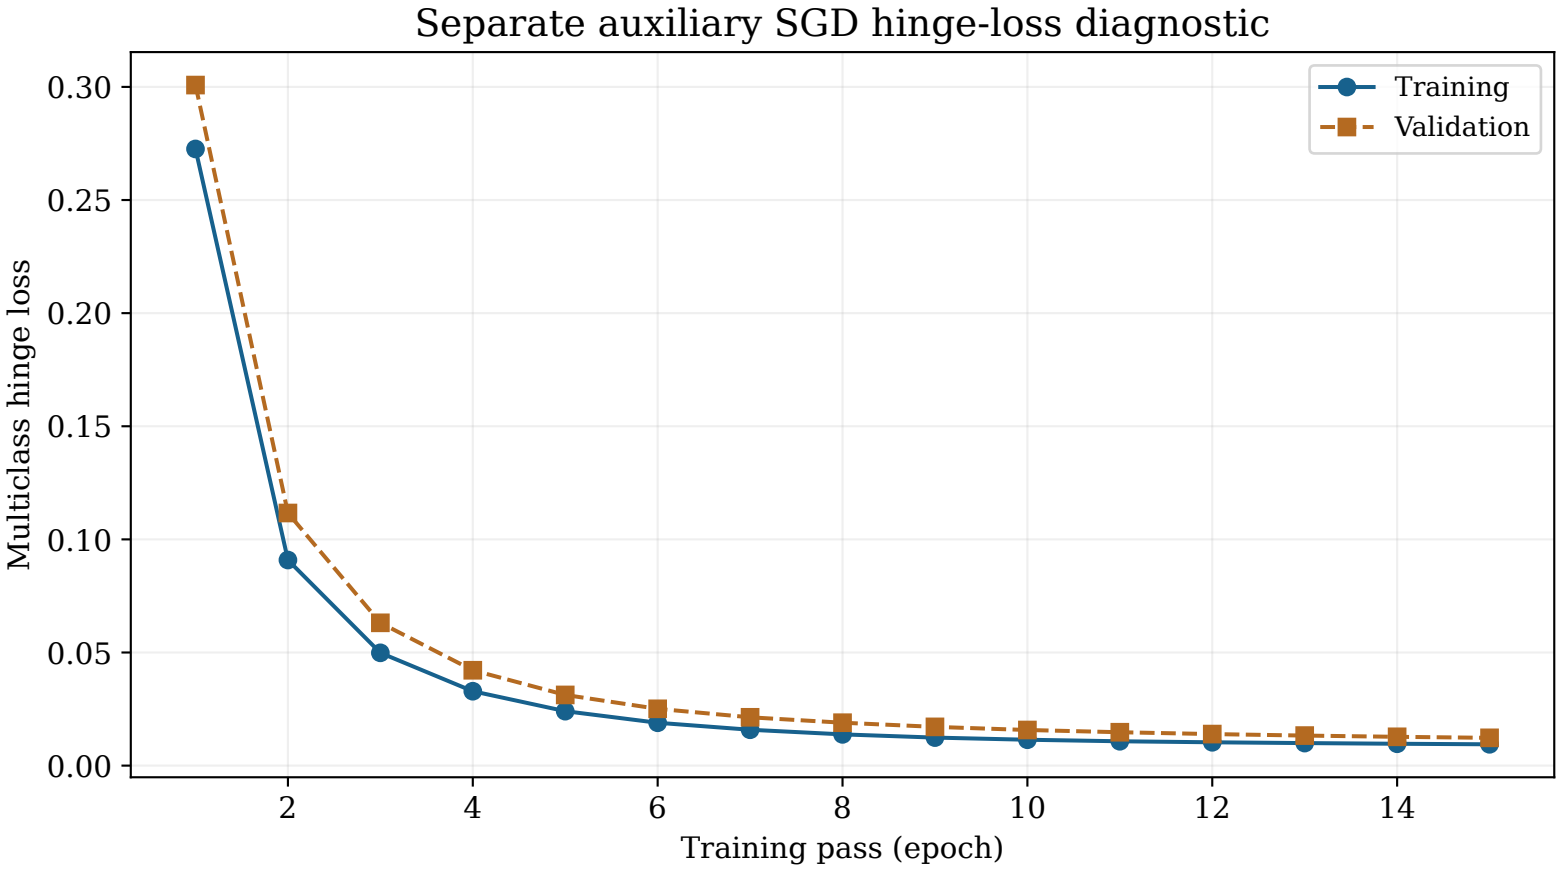
Separate auxiliary SGD hinge-loss diagnostic
Training
Validation
Multiclass hinge loss
0.30
0.25
0.20
0.15
0.10
0.05
0.00
2
4
6
8
10
12
14
Training pass (epoch)