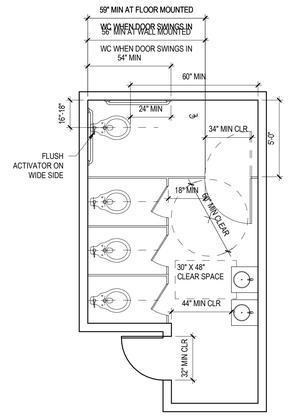

SCALE: 1/4" = 1'-0"

MULTIPLE ACCOM. TOILET1 16

GENERAL ADA NOTES

THE DETAILS AND NOTES ON THIS SHEET ARE "TYPICAL", AND ARE TO BE USED BY THE CONTRACTOR WHERE AND WHEN THESE VARIOUS GENERAL CONDITIONS EXIST. THESE DETAILS ARE NOT NECESSARILY REFERENCED ANYWHERE ELSE IN THIS SET OF CONSTRUCTION DOCUMENTS. PRIOR TO STARTING WORK, THE CONTRACTOR IS TO CONFIRM WITH THE ARCHITECT THAT THESE DETAILS ARE PROPERLY INTERPRETED AND APPLLIED TO THE APPROPRIATE CONDITIONS.

NOTE:

THESE DIAGRAMS ILLUSTRATE THE SPECIFIC REQUIREMENTS OF ACCESSIBILITY STANDARDS, TITLE 24 & ADA REQUIREMENTS AND IS INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION.



NOTES:
OPERATING PARTS OF DISPENSING AND DISPOSAL FIXTURES (IF PROVIDED) SHALL BE WITHIN 40" OF THE FLOOR. FAUCETS ARE OPERABLE WITH ONE HAND (LEVER TYPE) AND DO NOT REQUIRE TIGHT GRASPING,PINCHING OR TWISTING OF THE WRIST, 5 lb. MAXIMUM FORCE REQUIRED TO ACTIVATE CONTROLS.



SCALE: 3/8" = 1'-0"

LAVATORY CLEARANCE DETAIL1 14

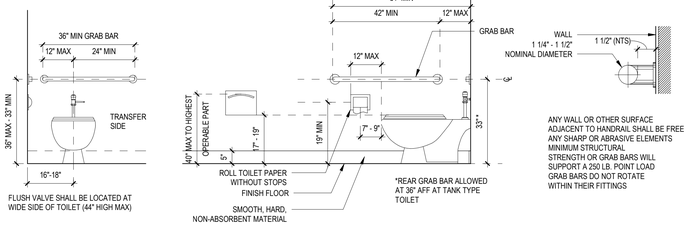

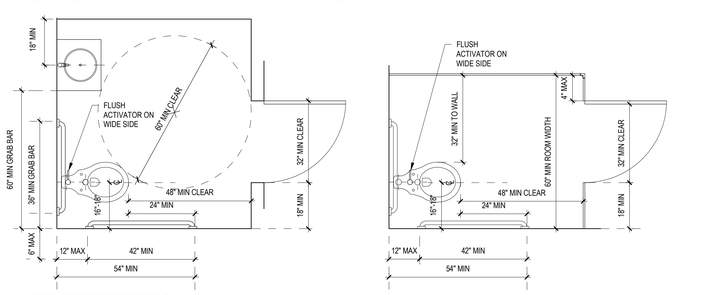

SCALE: 1/2" = 1'-0"

TOILET DIMENSIONS AND GRAB BAR DETAIL1 13

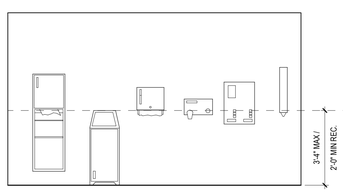

NOTE:
THIS DIAGRAM ILLUSTRATES THE SPECIFIC REQUIREMENTS OF ACCESSIBILITY STANDARDS, TITLE 24 & ADA REQUIREMENTS AND IS INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION

SCALE: 3/8" = 1'-0"

ACCESSORIES1 15

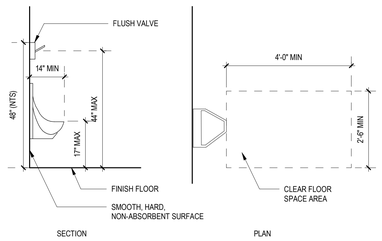

NOTE:
THIS DIAGRAM ILLUSTRATES THE SPECIFIC REQUIREMENTS OF ACCESSIBILITY STANDARDS, TITLE 24 & ADA REQUIREMENTS AND IS INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION

SCALE: 1/2" = 1'-0"

URINAL DIMENSIONS1 12

WHERE THE EXTENSION OF THE HANDRAIL IN THE DIRECTION OF THE RAMP RUN WOULD CREATE A HAZARD, THE TERMINATION OF THE EXTENSION MAY BE MADE ROUNDED OR RETURNED SMOOTHLY TO A FLOOR, WALL OR POST. HANDRAILS MAY PROJECT INTO THE REQUIRED WIDTH A DISTANCE OF 3 1/2" FROM EACH SIDE OF A RAMP. OTHER PROJECTIONS, SUCH AS TRIM AND SIMILAR DECORATIVE FEATURES, MAY PROJECT INTO THE REQUIRED WIDTH 1 1/2" ON EACH SIDE

NOTE:
HANDRAILS MUST EXTEND A MIN OF 12" OF LEVEL DISTANCE (PARALLEL TO LANDING SURFACE) BEYOND TOP & BOTTOM OF THE RAMP ENDS BEFORE THEY ARE RETURNED.
HANDRAILS SHALL BE CONT. FOR FULL LENGTH OF RAMP W/ 1/8" MIN RADIUS AT CORNERS AND SHALL PROVIDE 1 1/2" MIN CLEAR WALL.

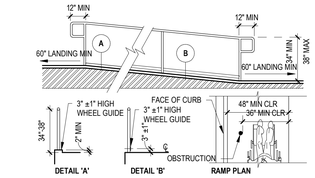

SCALE: 3/8" = 1'-0"

TYPICAL RAMP AND RAILING1 11

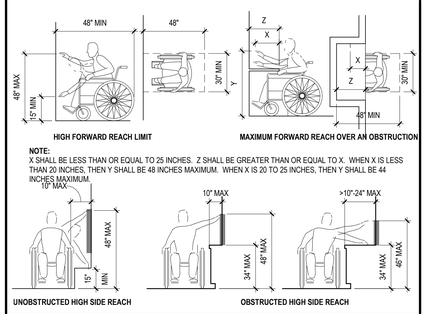

NOTE:
X SHALL BE LESS THAN OR EQUAL TO 25 INCHES. Z SHALL BE GREATER THAN OR EQUAL TO X. WHEN X IS LESS THAN 20 INCHES, THEN Y SHALL BE 48 INCHES MAXIMUM. WHEN X IS 20 TO 25 INCHES, THEN Y SHALL BE 44 INCHES MAXIMUM.

SCALE: 1/4" = 1'-0"

SIDE REACH1 07

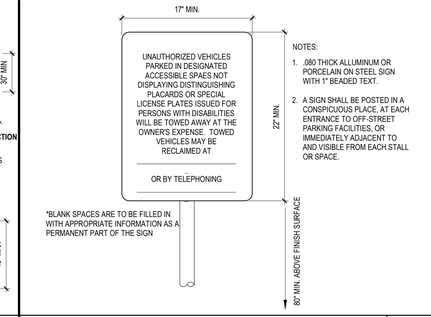

NOTES:
1. .080 THICK ALLUMINUM OR PORCELAIN ON STEEL SIGN WITH 1" BEADED TEXT.
2. A SIGN SHALL BE POSTED IN A CONSPICUOUS PLACE, AT EACH ENTRANCE TO OFF-STREET PARKING FACILITIES, OR IMMEDIATELY ADJACENT TO AND VISIBLE FROM EACH STALL OR SPACE.

SCALE: 1 1/2" = 1'-0"

SIGN @ OFF STREET PARKING1 03

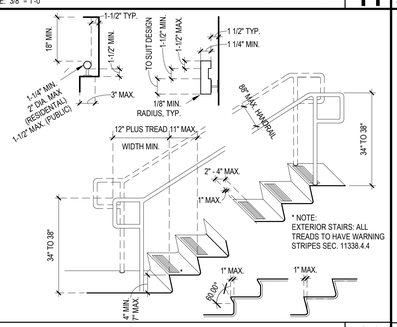

* NOTE:
EXTERIOR STAIRS: ALL TREADS TO HAVE WARNING STRIPES SEC. 11338.4.4

SCALE: 1/2" = 1'-0"

STAIR HANDRAILS AND WARNING STRIP1 10

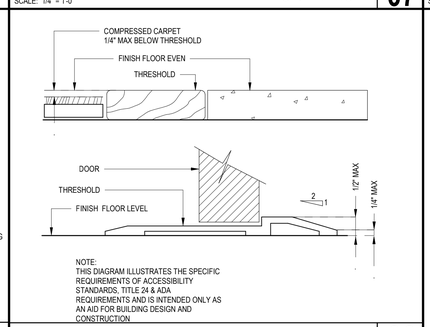

NOTE:
THIS DIAGRAM ILLUSTRATES THE SPECIFIC REQUIREMENTS OF ACCESSIBILITY STANDARDS, TITLE 24 & ADA REQUIREMENTS AND IS INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION

SCALE: 1/2" = 1'-0"

THRESHOLD1 06

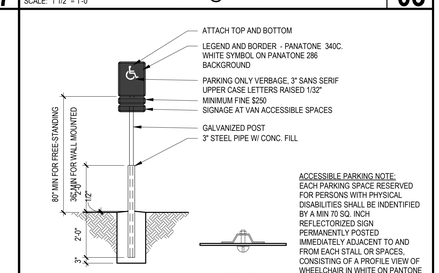

NOTES:
VAN ACCESSIBLE SPACES SHALL HAVE AN ADDITIONAL SIGN STATING "VAN ACCESSIBLE" MOUNTED BELOW THE SYMBOL OF ACCESSIBILITY.

SIGNS MAY ALSO BE CENTERED ON THE WALL AT THE INTERIOR END OF THE PARKING SPACE AT A MINIMUM HEIGHT OF 36" FROM THE PARKING SPACE FINISHED GRADE, GROUND, OR WALK.

ACCESSIBLE PARKING NOTE:
EACH PARKING SPACE RESERVED FOR PERSONS WITH PHYSICAL DISABILITIES SHALL BE INDENTIFIED BY A MIN 70 SQ. INCH REFLECTORIZED SIGN PERMANENTLY POSTED IMMEDIATELY ADJACENT TO AND FROM EACH STALL OR SPACES, CONSISTING OF A PROFILE VIEW OF WHEELCHAIR IN WHITE ON PANTONE 286 BACKGROUND. THE SIGN SHALL NOT BE SMALLER THAN 70 SQ. IN AREA. WHEN IN PATH OF TRAVEL IT SHALL BE POSTED AT A MIN. HT. OF 80" FROM THE PARKING SPACE FIN. GRADE. GROUND. OR SIDEWALK.

INTERNATIONAL SYMBOL OF ACCESSIBILITY (WHITE ON DARK BACKGROUND)

INTERNATIONAL SYMBOL OF ACCESSIBILITY (DARK COLOR ON WHITE OR TRANSPARENT BACKGROUND)

A. ACCESSIBLE PARKING SIGN
INTERNATIONAL SYMBOL OF ACCESSIBILITY. PAINTED WHITE WITH 3" MIN. WIDE TRAFFIC PAINT STRIPE ON BLUE BACKGROUND FIELD TRAFFIC PAINT 3'-0" SQUARE WITH 3" RADIUSED CORNERS

B. ACCESSIBLE ENTRANCE SIGN (ON GLASS)
INTERNATIONAL SYMBOL OF ACCESSIBILITY, 4" X 4" REVERSE STICK-ON, WHITE FIGURE ON BLUE BACKGROUND FIELD.

C. ACCESSIBLE PATH OF TRAVEL
INTERNATIONAL SYMBOL OF ACCESSIBILITY, 2" X 4" PAINTED BLUE ON PAVED BACKGROUND SURFACE.

SCALE: 3/8" = 1'-0"

PARKING SIGN1 02

GENERAL NOTES:
MOUNT CENTER OF SIGN +60" ABOVE FINISH FLOOR. W/ 1/32" HIGH RAISED LETTERS 5/8" TO 2" HIGH, SANS SERIF, UPPERCASE, NON-GLARE BACKGROUND (ADA AG 4.30.4). CONTRAST LIGHT ON DARK OR DARK ON LIGHT

WOMEN'S:
WHITE FIGURE & LETTERING ON DARK BACKGROUND W/ 12" DIA CIRCLE, 1/4" THICK

MEN'S:
WHITE FIGURE & LETTERING ON DARK BACKGROUND W/ 12" EQUILATERAL TRIANGLE (VERTEX UPWARD), 1/4" THICK

UNISEX:
WHITE FIGURE & LETTERING ON DARK BACKGROUND W/ EQUILATERAL TRIANGLE (VERTEX UPWARD) SUPERIMPOSED OVER 12" DIA CIRCLE, 1/4" THICK

SCALE: 1" = 1'-0"

DOOR MOUNTED TOILET ROOM SIGNS1 09

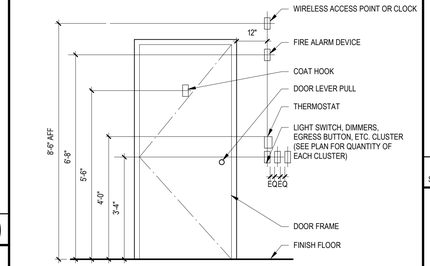

SCALE: 1/2" = 1'-0"

MOUNTING HEIGHTS AT DOORS1 05

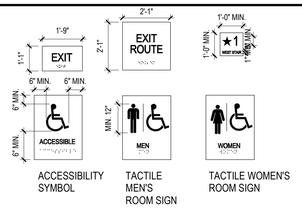

GENERAL CONTRACTOR TO VERIFY EXISTING SINAGE IN FIELD AND PROVIDE NEW AS REQUIRED TO COMPLY WITH APPLICABLE BUILDING CODES

ALL SIGNAGE SHALL CONFORM WITH ADA ACCESSIBILITY GUIDELINES, INCLUDING BUT NOT LIMITED TO PROPORTION, COLOR, CONTRAST AND RELIEF AND 2 BRAILLE REQUIREMENTS

SIGNAGE: AFFIX AN INTERNATION ACCESSIBILITY SYMBOL ON ALL ACCESSIBLE ENTRANCES PER APPLICABLE BUILDING CODE.

STRIKE EDGE CLEARANCE AT DOORWAY:
PROVIDE AN 18" STRIKE EDGE CLEARANCE ON PULL SIDE OF INTERIOR DOORS
PROVIDE A 24" STRIKE EDGE ON THE PULL SIDE OF EXTERIOR DOORS
PROVIDE A 12" STRIKE EDGE CLEARANCE ON THE PUSH SIDE OF ALL DOORS WHICH HAVE BOTH A LATCH AND A CLOSER.

TACTILE EXIT SIGNAGE:
A TACTILE EXIT SIGN WITH THE WORD "EXIT" SHALL IDENTIFY EACH GRADE LEVEL EXTERIOR EXIT DOOR

A TACTILE EXIT SIGN WITH THE WORDS "EXIT ROUTE" SHALL IDENTIFY EACH EXIT ACCESS DOOR FROM AN INTERIOR ROOM OR AREA TO A CORRIDOR OR HALLWAY THAT IS REQUIRED TO HAVE A VISUAL EXIT SIGN.

GENERAL CONTRACTOR TO VERIFY EXISTING SIGNAGE INSTALLATIONS AND PROVIDE NEW AS REQUIRED

CHARACTERS, SYMBOLS, AND BACKGROUND SHALL HAVE A NON-GLARE FINISH. CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THE BACKGROUND, EITHER LIGHT ON DARK BACKGROUND OR DARK ON LIGHT BACKGROUND.

SIGNS TO INCLUDE BRAILLE AND CHARACTERS AS DEFINED BY CODE. CONTRACTED GRADE 2 BRAILLE SHALL BE USED WHEREVER BRAILLE IS REQUIRED IN OTHER PORTIONS OF THESE STANDARDS

MOUNT SIGNAGE AT 60" A.F.F. TO THE CENTER OF THE SIGN. MOUNTING LOCATION SHALL BE SO THAT A PERSON APPROACHING WITHIN 3" OF SIGN DOES NOT ENCOUNTER PROTRUDING OBJECTS OR WITHIN THE SWING OF A DOOR.

SCALE: 3/8" = 1'-0"

SIGNAGE1 08

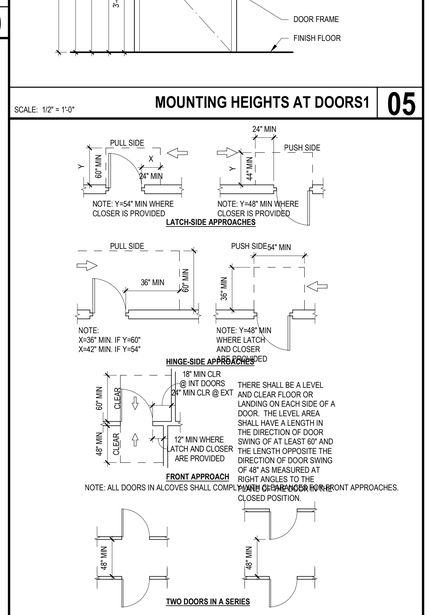

THERE SHALL BE A LEVEL AND CLEAR FLOOR OR LANDING ON EACH SIDE OF A DOOR. THE LEVEL AREA SHALL HAVE A LENGTH IN THE DIRECTION OF DOOR SWING OF AT LEAST 60" AND THE LENGTH OPPOSITE THE DIRECTION OF DOOR SWING OF 48" AS MEASURED AT RIGHT ANGLES TO THE CENTERLINE OF THE DOOR IN THE CLOSED POSITION.

SCALE: 3/16" = 1'-0"

SWINGING DOORS1 04

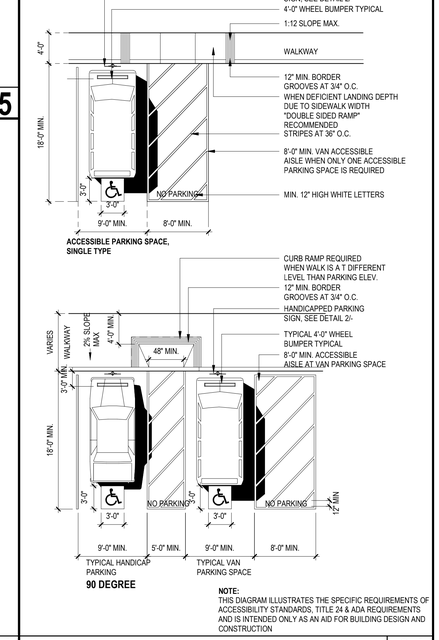

NOTE:
THIS DIAGRAM ILLUSTRATES THE SPECIFIC REQUIREMENTS OF ACCESSIBILITY STANDARDS, TITLE 24 & ADA REQUIREMENTS AND IS INTENDED ONLY AS AN AID FOR BUILDING DESIGN AND CONSTRUCTION

SCALE: 1/8" = 1'-0"

ACC. PARKING AND CURB RAMPS1 01

ACCESSIBILITY NOTES1

1. DURING ALL HOURS THE BUILDING IS OPEN TO THE PUBLIC, ALL PRIMARY ENTRANCES TO THE BUILDING AND TO PORTIONS THEREOF SHALL BE MADE ACCESSIBLE TO THE HANDICAPPED. SIGNAGE INDICATING ACCESSIBILITY SHALL BE DISPLAYED.

2. HAND-ACTIVATED DOOR OPENING HARDWARE SHALL BE CENTERED BETWEEN 30 INCHES AND 44 INCHES ABOVE THE FINISHED FLOOR. LATCHING AND LOCKING DOORS THAT ARE IN THE PATH OF TRAVEL SHALL BE OPERABLE WITH A SINGLE EFFORT BY LEVER TYPE HARDWARE, BY PANIC BARS, PUSH-PULL ACTIVATING BARS, OR OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE WITHOUT THE ABILITY TO GRASP THE OPENING DEVICE. LOCKED EXIT DOORS SHALL OPERATE AS ABOVE IN THE EGRESS DIRECTION.

3. MANUALLY OPERATED EDGE OR SURFACE MOUNTED FLUSH BOLTS ARE NOT ALLOWED. WHEN EXIT DOORS ARE USED IN PAIRS AND APPROVED FLUSH BOLTS ARE USED, THE DOOR LEAF HAVING THE AUTOMATIC FLUSH BOLTS SHALL HAVE NO DOOR KNOB OR SURFACE-MOUNTED HARDWARE. THE UNLATCHING OF ANY LEAF SHALL NOT REQUIRE MORE THAN ONE OPERATION.

4. REGARDLESS OF THE OCCUPANCY LOAD, THERE SHALL BE A FLOOR OR LANDING ON EACH SIDE OF A DOOR, AND SHALL NOT BE MORE THAN 1/2" LOWER THAN THE THRESHOLD OF THE DOORWAY. CHANGES IN LEVEL BETWEEN 1/4" AND 1/2" SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1:2. CHANGES IN LEVEL GREATER THAN 1/2" SHALL BE ACCOMPLISHED BY MEANS OF A RAMP.

5. THE FLOOR OR LANDING ON EACH SIDE OF AN EXIT DOOR SHALL BE LEVEL AND CLEAR. THE LEVEL AREA SHALL HAVE A LENGTH IN THE DIRECTION OF DOOR SWING OF A LEAST 60 INCHES AND THE LENGTH OPPOSITE THE DIRECTION OF THE DOOR SWING OF 44 INCHES AS MEASURED AT RIGHT ANGLES TO THE PLANE OF THE DOOR IN ITS CLOSED POSITION. THE WIDTH OF THE LEVEL AREA ON THE SIDE TO WHICH THE DOOR SWINGS SHALL EXTEND 24 INCHES PAST THE STRIKE EDGE OF THE DOOR FOR EXTERIOR DOORS AND 18 INCHES PAST THE STRIKE EDGE FOR INTERIOR DOORS. THE WIDTH OF THE AREA ON THE SIDE OPPOSITE THE SWING SHALL EXTEND 12 INCHES PAST THE STRIKE EDGE OF THE DOOR WHEN THE DOOR IS EQUIPPED WITH BOTH A CLOSER AND A LATCH SET.

6. ABRUPT CHANGES IN LEVEL ALONG ANY ACCESSIBLE ROUTE SHALL NOT EXCEED 1/2 INCH. WHEN CHANGES IN LEVEL DO OCCUR, THEY SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1:2 EXCEPT THAT LEVEL CHANGES EXCEEDING 1/4 INCH MAY BE VERTICAL. WHEN CHANGES IN LEVELS GREATER THAN 1/2 INCH ARE NECESSARY THEY SHALL COMPLY WITH THE REQUIREMENTS FOR RAMPS. MINIMUM WIDTH SHALL BE 48".

7. SIDE REACH MOUNTING HEIGHTS: IF THE CLEAR FLOOR SPACE ALLOWS PARALLEL APPROACH BY A PERSON IN A WHEELCHAIR, THE MAXIMUM HEIGHT FOR HIGH SIDE REACH SHALL BE 54 INCHES AND THE LOW SIDE REACH SHALL BE 9 INCHES ABOVE THE FINISHED FLOOR.

8. FORWARD REACH MOUNTING HEIGHTS: IF THE CLEAR SPACE ONLY ALLOWS FORWARD APPROACH BY A PERSON IN A WHEELCHAIR, THE MAXIMUM HEIGHT FOR HIGH SIDE REACH SHALL BE 48 INCHES AND THE LOW SIDE REACH SHALL BE 15 INCHES ABOVE THE FINISHED FLOOR.

9. MAXIMUM EFFORT TO OPERATE DOORS SHALL NOT EXCEED 5 POUNDS FOR INTERIOR DOORS, 8.5 POUNDS FOR EXTERIOR DOORS AND 15 POUNDS FOR FIRE RATED DOORS. SUCH PUSH OR PULL EFFORT BEING APPLIED AT RIGHT ANGLES TO HINGED DOORS AND TO THE CENTER OF PLANE FOR SLIDING DOORS.

10. SELF-CLOSING DEVICES WHERE SPECIFIED SHALL OPERATE WITH-IN 5 POUNDS FOR INTERIOR DOORS, 8.5 POUNDS FOR EXTERIOR DOORS AND 15 POUNDS FOR FIRE RATED DOORS.

11. THE BOTTOM 10 INCHES OF ALL DOORS EXCEPT AUTOMATIC AND SLIDING SHALL HAVE A SMOOTH, UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION. WHERE NARROW FRAMED DOORS ARE USED, A 10 INCH HIGH SMOOTH PANEL SHALL BE INSTALLED ON THE PUSH SIDE OF THE DOOR, WHICH WILL ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION.

12. DOORS LEADING TO MEN'S SANITARY FACILITIES SHALL BE IDENTIFIED BY AN EQUILATERAL TRIANGLE 1/4" THICK, WITH EDGES 12" LONG AND A VERTEX POINTING UPWARD. WOMEN'S SANITARY FACILITIES SHALL BE IDENTIFIED BY A CIRCLE 1/4" THICK AND 12" IN DIAMETER. UNISEX SANITARY FACILITIES SHALL BE IDENTIFIED BY A CIRCLE 1/4" THICK, 12" DIAMETER, WITH A 1/4" THICK TRIANGLE SUPERIMPOSED ON THE CIRCLE AND WITHIN THE 12" DIAMETER. GEOMETRIC (CIRCLE AND TRIANGLE) SYMBOLS SHALL BE CENTERED ON THE DOOR AT A HEIGHT OF 60" ABOVE FINISHED FLOOR AND THEIR COLOR AND CONTRAST SHALL BE DISTINCTLY DIFFERENT FROM THE COLOR AND CONTRAST OF THE DOOR. ADDITIONAL SIGNAGE REQUIREMENTS: RAISED LETTERS SHALL BE PROVIDED AND SHALL BE ACCOMPANIED BY BRAILLE IN CONFORMANCE WITH C.B.C. SECTION 1117B.5.6. THEY SHALL BE INSTALLED ON THE WALL ADJACENT TO THE LATCH OUTSIDE OF THE DOOR. WHERE THERE IS NO WALL SPACE ON THE LATCH SIDE, INCLUDING DOUBLE LEAF DOORS, SIGNS SHALL BE PLACED ON THE NEAREST ADJACENT WALL. PREFERABLY ON THE RIGHT. MOUNTING HEIGHT SHALL BE 60" ABOVE FINISHED FLOOR TO THE CENTERLINE OF THE SIGN. MOUNTING LOCATION SHALL BE DETERMINED SO A PERSON MAY APPROACH WITHIN 3 INCHES OF SIGNAGE WITHOUT ENCOUNTERING PROTRUDING OBJECTS OR STANDING WITHIN THE SWING OF A DOOR.

BLUEBEAM®
A NEMETSCHEK COMPANY

CAPTURE ENGINEERS
Mechanical
Electrical
Plumbing

1234 Miller St.
Manchester, NH 06930

REVU ARCHITECTS

5555 N. Broad St
Pasadena CA 91101

OFFICE BUILDING

Project No: 323232

Project Address:
123 Schonsett St
Chicago, IL 60601

THIS DRAWING IS INTENDED FOR DEMONSTRATION PURPOSES ONLY. DO NOT USE THIS DRAWING FOR ANY OTHER PURPOSE WITHOUT THE EXPRESS WRITTEN PERMISSION OF BLUEBEAM, INC.

DATE	03/04/2018
ISSUED FOR:	INTERNAL REVIEW
PROJECT	3232
DRAWN BY:	Author
CHECKED BY:	Checker
APPROVED BY:	Approver

#	DATE	DESCRIPTION

NOT FOR CONSTRUCTION

STAMP:

STAMP:

SHEET TITLE & NUMBER
ACCESSIBILITY DETAILS

G0.01

© 2018 Bluebeam, Inc.