PLACEHOLDER — synthetic test output, not results

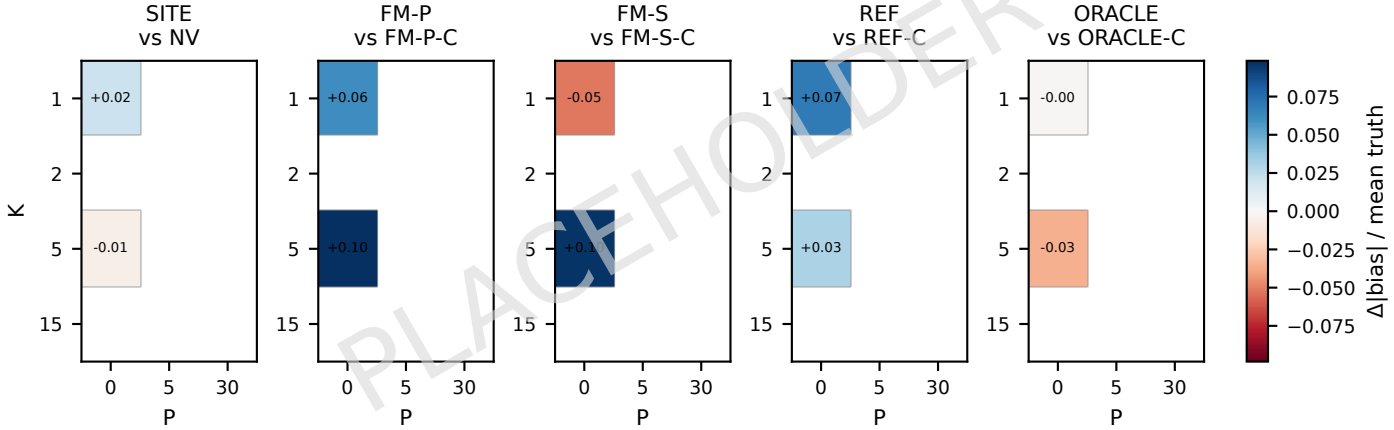

PLACEHOLDER

slice: W = 30, α = 0.5, γ = 1, φ_A = 0; blank = not run